



**City of Ketchum
Planning & Building**

Design Review Application

OFFICIAL USE ONLY	
File Number:	P23-020
Date Received:	3/28/23
By:	HLN
Pre-Application Fee Paid:	
Design Review Fee Paid:	\$1400
Approved Date:	
Denied Date:	
By:	
ADRE: Yes	<input type="checkbox"/> No <input type="checkbox"/>

APPLICANT INFORMATION				
Project Name: Warm springs Lot 35		Phone: 208.1875		
Owner: WSR Development LLC		Mailing Address: PO Box 284 sun Valley, Idaho 83353		
Email: robert@vpcompanies.com				
Architect/Representative: Think Architecture, John Shirley		Phone: 801.269.0055		
Email: jmshirley@thinkaec.com		Mailing Address: 7927 S. High Point Pkwy, Ste 300 Salt Lake City, UT 84094		
Architect License Number: #6247466-0301				
Engineer of Record: Benchmark Associates		Phone: 208-726-9512		
Email: rob@bma5b.com		Mailing Address: 100 Bell Dr, Ketchum, ID 83340		
Engineer License Number:				
<i>All design review plans and drawings for public commercial projects, residential buildings containing more than four (4) dwelling units and development projects containing more than four (4) dwelling units shall be prepared by an Idaho licensed architect or an Idaho licensed engineer.</i>				
PROJECT INFORMATION				
Legal Land Description: Warm springs Residences Block 4, Lot 35 - RPK05790040350				
Street Address: 190 Bald Mountain Road				
Lot Area (Square Feet): 9,907 sq. ft.				
Zoning District: GR-L				
Overlay District: <input type="checkbox"/> Floodplain <input type="checkbox"/> Avalanche <input type="checkbox"/> Mountain				
Type of Construction: <input checked="" type="checkbox"/> New <input type="checkbox"/> Addition <input type="checkbox"/> Remodel <input type="checkbox"/> Other				
Anticipated Use: Single Family Residence		Number of Residential Units: 1		
TOTAL FLOOR AREA				
	Proposed		Existing	
Basements	1,831	Sq. Ft.	0	Sq. Ft.
1 st Floor	1,960	Sq. Ft.		Sq. Ft.
2 nd Floor		Sq. Ft.		Sq. Ft.
3 rd Floor		Sq. Ft.		Sq. Ft.
Mezzanine		Sq. Ft.		Sq. Ft.
Total	3,971	Sq. Ft.		Sq. Ft.
FLOOR AREA RATIO				
Community Core:		Tourist:	General Residential-High:	
BUILDING COVERAGE/OPEN SPACE				
Percent of Building Coverage: 35% or 3,467 sq. ft. allowed, 1,934 proposed or 21% proposed				
DIMENSIONAL STANDARDS/PROPOSED SETBACKS				
Front: 15'-0"	Side: 10'-0"	Side: 10'-0"	Rear: 30'-0"	
Building Height: 35'-0" allowed: 34'-8" Proposed				
OFF STREET PARKING				
Parking Spaces Provided: (2) garage spaces. (2) driveway stalls				
Curb Cut: 20'-0"	Sq. Ft.	923 sq. ft.	%	
WATER SYSTEM				
<input checked="" type="checkbox"/> Municipal Service		<input type="checkbox"/> Ketchum Spring Water		

The Applicant agrees in the event of a dispute concerning the interpretation or enforcement of the Design Review Application in which the city of Ketchum is the prevailing party, to pay the reasonable attorney fees, including attorney fees on appeal and expenses of the city of Ketchum. I, the undersigned, certify that all information submitted with and upon this application form is true and accurate to the best of my knowledge and belief.



2023.03.01

Signature of Owner/Representative

Date

Once your application has been received, we will review it and contact you with next steps.
No further action is required at this time.

DESIGN REVIEW EVALUATION STANDARDS

(May not apply to Administrative Design Review):

17.96.060: IMPROVEMENTS AND STANDARDS FOR ALL PROJECTS

A. Streets:

1. The applicant shall be responsible for all costs associated with providing a connection from an existing city streets to their development.
2. All streets designs shall be in conformance with the right-of-way standards and approved by the Public Works Director.

B. Sidewalks:

1. All projects under 17.96.010(A) that qualify as a "Substantial Improvement" shall install sidewalks in conformance with the right-of-way standards. Sidewalk improvements may be waived for projects that qualify as a "Substantial Improvement" which comprise additions of less than 250 square feet of conditioned space.
2. The length of sidewalk improvements constructed shall be equal to the length of the subject property line(s) adjacent to any public street or private street.
3. New sidewalks shall be planned to provide pedestrian connections to any existing or future sidewalks adjacent to the site. In addition, sidewalks shall be constructed to provide safe pedestrian access to and around a building.
4. The city may approve and accept voluntary cash contributions in-lieu of the above described improvements, which contributions must be segregated by the city and not used for any purpose other than the provision of these improvements. The contribution amount shall be one hundred ten percent (110%) of the estimated costs of concrete sidewalk and drainage improvements provided by a qualified contractor, plus associated engineering costs, as approved by the Public Works Director. Any approved in-lieu contribution shall be paid before the city issues a certificate of occupancy.

C. Drainage:

1. All storm water shall be retained on site.
2. Drainage improvements constructed shall be equal to the length of the subject property lines adjacent to any public street or private street.
3. The Public Works Director may require additional drainage improvements as necessary, depending on the unique characteristics of a site.



WARM SPRINGS #35

PROJECT ADDRESS
190 BALD MOUNTAIN ROAD KETCHUM, ID 83340
PROPERTY I.D. NUMBER:

DRAWING INDEX

GENERAL				STRUCTURAL			
SHEET #	SHEET NAME	#	DATE	SHEET #	SHEET NAME	#	DATE
COVER	COVER SHEET	1	04-27-2023	S101	STRUCTURAL		
G002	GENERAL NOTES			MECHANICAL SHEET # SHEET NAME # DATE M101 MECHANICAL GENERAL NOTES M102 MECHANICAL PLAN			
G003	BUILDING AREA ANALYSIS						
G005	SPECIFICATIONS						
G006	SPECIFICATIONS						
G007	SPECIFICATIONS	1	04-27-2023				
G008	SPECIFICATIONS						
G009	SPECIFICATIONS						
G010	SPECIFICATIONS			ELECTRICAL SHEET # SHEET NAME # DATE E101 ELECTRICAL GENERAL NOTES E102 ELECTRICAL PLAN			
CIVIL SHEET # SHEET NAME # DATE C101 CIVIL				LANDSCAPE SHEET # SHEET NAME # DATE L101 Landscape			
ARCHITECTURAL SHEET # SHEET NAME # DATE A101 SITE PLAN A103 LEVEL 1 SLAB PLAN A104 LEVEL 1 FLOOR PLAN A105 LEVEL 2 FLOOR PLAN A107 ROOF PLAN A109 LEVEL 1 CEILING PLAN A110 LEVEL 2 CEILING PLAN A201 EXTERIOR ELEVATIONS A202 EXTERIOR ELEVATIONS A203 EXTERIOR ELEVATIONS A301 BUILDING SECTIONS A302 BUILDING SECTIONS A401 FIREPLACE ELEVATIONS A501 ARCHITECTURAL DETAILS A502 ARCHITECTURAL DETAILS A503 STAIR RAIL DETAILS A601 DOOR SCHEDULE & ELEVATIONS A602 WINDOW SCHEDULE & ELEVATIONS							




Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Sandvy, Utah 84094
ph. 801.269.0055
fax 801.269.1425
www.thinkaoc.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced in whole or in part without the sole and express written permission from THINK Architecture, Inc.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

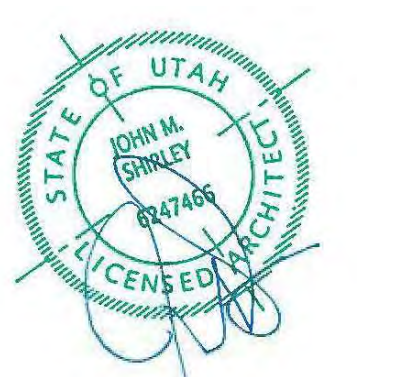

PROJECT TEAM	SEAL	GOVERNING BUILDING CODES & INFORMATION	ABBREVIATIONS	GRAPHIC SYMBOLS/ MATERIAL LEGENDS	VICINITY MAP			
ARCHITECT: THINK ARCHITECTURE: 7927 SOUTH HIGH POINT WAY, SUITE 300 SANDVY, UT 84094 801.269.0055 STRUCTURAL ENGINEER: VECTOR ENGINEERS 1500 S. CLOVERDALE ROAD, SUITE 315 KETCHUM, ID 83340 208.996.0003 MECHANICAL ENGINEER: DESIGN BUILD ELECTRICAL ENGINEER: DESIGN BUILD CIVIL ENGINEER: BENCHMARK ASSOCIATES PA 1102 BELL DRIVE KETCHUM, ID 83340 208.726.9512 LANDSCAPE ARCHITECT: EGGERS ASSOCIATES, PA 340 NORTH 2ND AVE KETCHUM, ID 83340 208.726.0988 GENERAL CONTRACTOR: MAGLEBY CONSTRUCTION SUN VALLEY 511 EAST AVENUE NORTH SUITE 201 KETCHUM, IDAHO 83340 208.726.3923 OWNER: VP PROPERTIES 240 LEADVILLE KETCHUM, IDAHO 83340 208.726.1875		BUILDING CODE: 2018 INTERNATIONAL RESIDENTIAL CODE (I.R.C.) WITH IDAHO STATE AMENDMENTS PLUMBING CODE: 2017 IDAHO STATE PLUMBING CODE (I.S.P.C.) ELECTRICAL CODE: 2017 IDAHO ELECTRICAL CODE (INFA 70) ACCESSIBILITY: 2009 ANSI 117.1 & 2018 I.B.C. Mechanical Code: 2018 INTERNATIONAL MECHANICAL CODE (I.M.C.) AMENDED Fire Code: 2018 INTERNATIONAL FIRE CODE (I.F.C.) AMENDED. Energy Conservation: 2018 INTERNATIONAL ENERGY CONSERVATION CODE (I.E.C.C.) OCCUPANCY GROUP: R2 FIRE SPRINKLER: YES MONITORED SYSTEM: YES BUILDING TYPE: TYPE V-8 FIRE SPRINKLER TYPE: NFPA 72 FIRE DETECTION SYSTEM PER KETCHUM ORDINANCE #1217: BUILDING TYPE: TYPE V-8 ADDRESSABLE FIRE ALARMS: YES RISK CATEGORY (I.C. 104.5): II SITE EXPOSURE: B BASIC WIND SPEED: 90 MPH ULTIMATE WIND SPEED: 115 MPH MATERIALS: CONCRETE FOUNDATIONS, WOOD FRAME W/ BRICK MASONRY & FIBER CEMENT PANELS, SINGLE PLY ROOFING MEMBRANE, & METAL ROOFING.	DEFERRED SUBMITTAL REQUIREMENTS DEFERRED SUBMITTALS ARE THOSE PORTIONS OF DESIGN THAT ARE NOT SUBMITTED AT THE TIME OF THE PERMIT APPLICATION AND HAVE RECEIVED PRIOR APPROVAL FROM THE BUILDING OFFICIAL TO BE DEFERRED. THE DEFERRED SUBMITTALS SHALL BE SUBMITTED TO THE ARCHITECT AND GENERAL CONTRACTOR WITHIN SIX WEEKS TO COMMENCEMENT OF CONSTRUCTION TO THIS PORTION OF WORK. DEFERRED SUBMITTAL PROCES: 1. THE DEFERRED SUBMITTAL SHALL FIRST BE REVIEWED BY THE GENERAL CONTRACTOR FOR COMPLIANCE WITH THE CONSTRUCTION DOCUMENTS. THE SUBMITTAL MUST BE REVIEWED, APPROVED, STAMPED AND SIGNED BY THE GENERAL CONTRACTOR BEFORE BEING SUBMITTED TO THE ARCHITECT. 2. THE GENERAL CONTRACTOR SHALL DIGITALLY SUBMIT DEFERRED SUBMITTALS TO THE ARCHITECT. 3. THE DEFERRED SUBMITTAL ITEMS WILL BE REVIEWED BY THE ENGINEER OR ARCHITECT IN RESPONSIBLE CHARGE. THE ENGINEER OR ARCHITECT WILL ATTACH A LETTER TO THE SUBMITTAL STATING THAT THE DEFERRED ITEM IS IN CONFORMANCE WITH THE DESIGN OF THE STRUCTURE. 4. THE APPROVED SUBMITTALS WILL BE RETURNED TO THE GENERAL CONTRACTOR. TWO SETS OF THE DEFERRED SUBMITTAL ARE THEN SUBMITTED TO THE CITY FOR REVIEW. 5. THE GENERAL CONTRACTOR SHALL MAINTAIN ONE SET OF THE APPROVED SUBMITTAL ON SITE FOR REFERENCE BY THE CITY INSPECTOR. 6. THE DEFERRED SUBMITTAL ITEMS SHALL NOT BE INSTALLED UNTIL THE SUBMITTAL DOCUMENTS HAVE BEEN APPROVED BY THE BUILDING OFFICIAL. 7. SEE STRUCTURAL NOTES FOR ADDITIONAL REQUIREMENTS FOR STRUCTURAL DEFERRED SUBMITTALS.	DEFERRED SUBMITTAL ITEMS 1. EXTERIOR FRAMING, DESIGN, AND INSTALLATION DETAILS PER STRUCTURAL. 2. FIRE SPRINKLING DRAWINGS, INCLUDING DESIGN DRAWINGS AND CALCULATIONS. 3. FIRE ALARM DRAWINGS AND SPECIFICATIONS. 4. JACOZZI DRAWINGS AND SPECIFICATIONS. 5. CCTV SECURITY CAMERAS AND SECURITY SYSTEM. 6. PROJECT TRIPLE PLAY - (PHONE, DATA, TV) SHALL BE PROVIDED BY DEFERRED SUBMITTAL. 7. CAST IN PLACE STORM WATER DETENTION SYSTEM.	SPECIAL INSPECTIONS REQUIREMENTS SPECIAL INSPECTIONS ARE REQUIRED IN ACCORDANCE WITH IBC 2015 CHAPTER 17, SECTION 1704. SPECIAL INSPECTIONS SHALL KEEP RECORDS OF INSPECTIONS. THE SPECIAL INSPECTOR SHALL FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL, AND TO THE REGISTERED DESIGN PROFESSIONALS IN RESPONSIBLE CHARGE. (2015 IBC SECTION 1704.2.4). SEE PROJECT MANUAL, SPECIFICATIONS, STRUCTURAL, MECHANICAL, PLUMBING, AND ELECTRICAL GENERAL NOTES FOR ADDITIONAL SPECIAL INSPECTION REQUIREMENTS.	ABBREVIATIONS # NUMBER A.B. ANCHOR BOLT ABV. ABOVE ADJ. ADJUSTABLE A.F.F. ABOVE FINISHED FLOOR ALUM. ALUMINUM BO BOARD BLDG. BUILDING B.M. BENCHMARK B.O. BOTTOM OF BOT. BOTTOM B.P. BASE PLATE BRG. BEARING BTWN. BETWEEN C.J. CONSTRUCTION JOINT C.L.G. CEILING CLR. CLEAR CMU CONCRETE MASONRY UNIT COL. COLUMN CONC. CONCRETE CONT. CONTINUOUS CONSTR. CONSTRUCTION C.T.J. CONTRACTION JOINT DBL. DOUBLE DFT./DTL. DETAIL DIA. DIAMETER DTL. DETAIL DWCS. DRAWINGS E.F. EACH FACE E.J. EXPANSION JOINT ELEV. ELEVATION EQ. EQUAL E.S. EACH SIDE E.W. EACH WAY EXIST. EXISTING EXPAN. EXPANSION EXT. EXTERIOR F.D. FLOOR DRAIN FDN./FDN. FOUNDATION F.E. FIRE EXTINGUISHER F.E.C. FIRE EXTINGUISHER CABINET F.F. FINISH FLOOR FIN. FINISH FIR. FEET FT. FEET FIG. FOOTING GA. GAGE/GAUGE GALV. GALVANIZED GPM. GALLONS PER MINUTE GND. GROUND GOVT. GOVERNMENT GYP. RD. GYPSUM WALL BOARD HC. HANDICAPPED HDW. HARDWARE H.M. HOLLOW METAL HOBRZ. HORIZONTAL HT. HEIGHT HVAC HEATING/VENTILATION/AIR CONDITIONING HYD. HYDRANT ID. INSIDE DIAMETER INFO. INFORMATION INSL. INSULATION LAV. LAVATORY LT. LIGHT LT WF. LIGHT WEIGHT MAINT. MAINTENANCE MANUF. MANUFACTURER MAX. MAXIMUM MAT. MATERIAL M.C.J. MASONRY CONTROL JOINT MECH. MECHANICAL MIN. MINIMUM MISC. MISCELLANEOUS M.O. MASONRY OPENING MTL. METAL N.O.I. NOT IN CONTRACT N.T.S. NOT TO SCALE O.C. ON CENTER O.D. OUTSIDE DIAMETER O.F. OUTSIDE FACE PERP. PERPENDICULAR PL. PLATE PTD. PAINTED QTY. QUANTITY R.D. ROOF DRAIN RAD. RADIUS REIN. REINFORCED REQ.D. REQUIRED RM. ROOM R.O. ROUGH OPENING SCHED. SCHEDULE SH. SHEET SIM. SIMILAR SPEC. SPECIFICATION STC. SOUND TRANSMISSION COEFFICIENT STRUCT. STRUCTURAL SUSP. SUSPENDED T.O.S. TOP OF T.O.C. TOP OF CURB T.O.F. TOP OF FOOTING T.O.S.S. TOP OF SLAB OR SIDEWALK T.O.P. TOP OF WALL TYP. TYPICAL U.N.O. UNLESS NOTED OTHERWISE VERT. VERTICAL W. WITH WD. WOOD W.W.F. WELDED WIRE FABRIC.	GRAPHIC SYMBOLS/ MATERIAL LEGENDS FLOOR OR POINT ELEVATION KEY NOTE SPECIFICATION KEY NOTE WALL TYPE DOOR NUMBER WINDOW NUMBER FIXTURE TAG REVISION TAG DETAIL INTERIOR ELEVATION BUILDING ELEVATION ROOM NAME & NUMBER BUILDING SECTION WALL SECTION CENTER LINE MASTER GRID LINES PARKING GRID LINES BUILDING GRID LINES E.I.F.S. CONCRETE MASONRY UNIT BRICK VENEER STONE VENEER CONCRETE GYPSUM BOARD OR GROUT MORTAR BATT INSULATION RIGID INSULATION PLYWOOD ROUGH WOOD-CONTINUOUS ROUGH WOOD-BLOCKING WOOD TRIM STEEL GRAVEL EARTH	VICINITY MAP CITY APPROVAL STAMP PROJECT NO. 22023 DATE: 2023.06.30 REVISIONS: 1 04-27-2023 PER CITY COMMENTS

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30

REVISIONS:
1 04-27-2023 PER CITY COMMENTS

SHEET TITLE:
COVER SHEET


SHEET NUMBER:
COVER

© 2021 THINK ARCHITECTURE, INC.


PROJECT GENERAL NOTES

- 1. DEFINITIONS
a. PROVIDE: MEANS TO PROVIDE, FURNISH AND INSTALL...
b. FURNISH: MEANS TO SUPPLY, PURCHASE, PROCURE AND DELIVER COMPLETE WITH RELATED ACCESSORIES...
c. INSTALL: MEANS TO CONSTRUCT, ASSEMBLE, ERECT, MOUNT, ANCHOR, PLACE, CONNECT, APPLY AND SIMILAR OPERATIONS...
d. EQUIVALENT: MEANS EQUIVALENT AS ACCEPTED BY THE ARCHITECT...
GENERAL NOTES
G1. INTENT OF THE DOCUMENTS: DRAWINGS AND SPECIFICATIONS ARE INTENDED TO PROVIDE THE BASIS FOR THE PROPER COMPLETION...
G2. DRAWINGS AND SPECIFICATIONS: SPECIFICATIONS ARE INTENDED TO BE COMPLEMENTARY AND SUPPLEMENTAL TO THE DRAWINGS...
G3. WORK NOT INCLUDED: ANY ITEM INDICATED ON THE DRAWINGS AS "N.I.C." (NOT IN CONTRACT)...
G4. CONTRACT DOCUMENTS AT SITE: THE CONTRACTOR SHALL MAINTAIN CURRENT PERMITS, SHOP DRAWINGS, REVISED DRAWINGS...
G5. RECORD DRAWINGS: THE CONTRACTOR SHALL ACCURATELY DIMENSIONED RECORDS OF ALL UNDERGROUND LINES, SERVICES, AND UTILITIES...
G6. WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED SIZES: DO NOT SCALE DRAWINGS TO DETERMINE ANY LOCATIONS...
G7. FIELD CONFIRMATION OF DISCREPANCIES SHALL BE RECORDED ON RESPONSIBLE DOCUMENT AND IMMEDIATELY TRANSMITTED TO ARCHITECT FOR PROJECT RECORD...
G8. FIELD MEASUREMENTS: VERIFY FIELD MEASUREMENTS BEFORE ORDERING MATERIALS AND PREFABRICATED ITEMS...
G9. ALL WORK SHALL CONFORM TO THE LATEST ADOPTED EDITIONS OF ALL APPLICABLE BUILDING CODES...
G10. REFERENCE STANDARDS: COMPLY WITH ASSOCIATION, TRADE, FEDERAL, COMMERCIAL, ASTM, AND OTHER SIMILAR STANDARDS...
CONTRACTOR
C1. THE CONTRACTOR SHALL BE RESPONSIBLE TO FIELD VERIFY ALL EXISTING SITE CONDITIONS, UTILITIES, CONNECTIONS, LOCATIONS, ETC...
C2. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO LOCATE ALL EXISTING UTILITIES...
C3. CONTRACTOR SHALL, PRIOR TO COMMENCEMENT OF WORK, FIELD VERIFY ALL EXISTING PROJECT CONDITIONS...
C4. THE CONTRACTOR SHALL BE REQUIRED TO MEET ALL NATIONAL, STATE AND LOCAL, AND RELATED CODES FOR STANDARD CONSTRUCTION PRACTICES...
C5. INSTALLATION STANDARDS: ALL MANUFACTURED MATERIALS AND PRODUCTS SHALL BE APPLIED, INSTALLED, CONNECTED, CLEANED AND CONDITIONED...
C6. HOURS OF WORK: ALL DEMOLITION, GRADING, AND CONSTRUCTION WORK SHALL BE LIMITED TO THE FOLLOWING HOURS...
C7. TESTING AGENCIES: THE CONTRACTOR SHALL PROVIDE AND PAY FOR INSPECTIONS, TESTS, AND OTHER SERVICES SPECIFIED...
C8. PROJECT LOG: MAINTAIN DAILY LOG CONTAINING ALL INFORMATION REGARDING CONSTRUCTION OPERATIONS AND OTHER OCCURRENCES...
C9. WORK PROGRESS SCHEDULE: MAINTAIN AN UPDATED WORK PROGRESS SCHEDULE POSTED IN A VISIBLE PLACE...
C10. THE GENERAL BUILDING PERMITS SHALL BE PAID FOR BY THE OWNER AND SECURED BY THE GENERAL CONTRACTOR...
C11. CONTRACTOR SHALL ASSIST OWNER IN OBTAINING FINAL APPROVAL OF LOCAL HEALTH DEPARTMENT AND THE TEMPORARY AND FINAL CERTIFICATES OF OCCUPANCY...
C12. ADDITIONAL REQUIRED CITY AND COUNTY LICENSES SHALL BE ACQUIRED AND PAID FOR BY THE INDIVIDUAL TRADES...
C13. ALL CONTRACTORS SHALL HAVE VALID CERTIFICATES OF WORKMAN'S COMPENSATION OF FILE WITH THE APPROPRIATE AGENCIES...
C14. CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO ENSURE THE SAFETY OF THE OCCUPANTS AND WORKERS AT ALL TIMES...
C15. CONTRACTOR'S FIELD OFFICE: PROVIDE AND MAINTAIN A FIELD OFFICE ON THE PREMISES WHERE DIRECTED...
o. STORAGE STRUCTURE: PROVIDE AND MAINTAIN, WHERE DIRECTED, A WATERIGHT STORAGE STRUCTURE FOR ALL MATERIALS...
b. COSTS: PAY COSTS FOR A LOCAL BUSINESS TELEPHONE FOR WORK BY CONTRACTOR, OWNER AND ARCHITECT THROUGHOUT PROJECT PERIOD...
c. COMMUNICATION EQUIPMENT: PROVIDE A TELEPHONE ON SITE, ASSIGN A RESPONSIBLE PERSON TO ANSWER ALL TELEPHONE CALLS...
C16. TEMPORARY FACILITIES: PROVIDE TEMPORARY FACILITIES AND CONNECTIONS AS REQUIRED FOR THE PROPER COMPLETION OF THE PROJECT...
C17. STORAGE AND PROTECTION: STORE AND PROTECT PRODUCTS IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS WITH LABELS INTACT AND LEGIBLE...

- C18. FIELD QUALITY CONTROL: EMPLOY ONLY EXPERIENCED INSTALLERS AND FURNISH EVIDENCE OF EXPERIENCE IF REQUESTED...
C19. PRODUCT HANDLING: TRANSPORT AND HANDLE PRODUCTS IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS...
C20. COMPLIANCE WITH MANUFACTURER'S INSTRUCTIONS: HANDLE, INSTALL, ERECT, CONNECT, CONDITION, USE, ADJUST, AND CLEAN PRODUCTS IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTION...
C21. MANUFACTURER'S FIELD SERVICES: WHEN SPECIFIED IN INDIVIDUAL SECTIONS, REQUIRE MATERIAL OR PRODUCT SUPPLIERS OR MANUFACTURERS TO PROVIDE QUALIFIED STAFF PERSONNEL...
C22. CONTRACTOR SHALL VERIFY, AND BE RESPONSIBLE FOR, ALL WORK AND MATERIALS - INCLUDING THOSE FURNISHED BY SUBCONTRACTORS...
SUBMITTALS/SUBSTITUTIONS
S1. CONTRACTOR SHALL PROVIDE COMPLETE LIST OF SUBMITTALS TO ARCHITECT/OWNER WITHIN 1 WEEK OF OBTAINING BUILDING PERMIT...
S2. ALL SUBMITTALS SHALL BE COMPLETE AND SUBMITTED WITHIN 90 DAYS OF WORK...
S3. ALL ITEMS NOTED AS DESIGNED "BY MANUFACTURER" IS A DEFERRED DESIGN AND SHALL BE RESPONSIBILITY OF THE CONTRACTOR...
S4. SOURCE QUALITY CONTROL: PROVIDE PRODUCTS OF APPLICABLE MANUFACTURERS, WHICH HAVE BEEN IN SATISFACTORY USE IN SIMILAR SERVICE FOR THREE YEARS...
S5. SUBSTITUTIONS: PROPOSALS FOR SUBSTITUTION OF MATERIALS, EQUIPMENT, AND METHODS WILL ONLY BE CONSIDERED WHEN ACCOMPANIED BY FULL AND COMPLETE TECHNICAL DATA...
S6. AVAILABILITY OF PRODUCTS: VERIFY PRIOR TO CONSTRUCTION THAT ALL SPECIFIED ITEMS WILL BE AVAILABLE IN TIME FOR INSTALLATION...
S7. PRODUCTS AND MATERIALS: PROVIDE PRODUCTS AND MATERIALS SPECIFIED; REQUEST ARCHITECT'S SELECTION OF COLORS AND ACCESSORIES...
TOLERANCES
T1. TOLERANCES: INSTALL WORK TRUE TO LINE, PLUMB, AND LEVEL, EXCEPT WHERE SPECIFIED OTHERWISE...
o. TRUE TO LINE: ALLOWED DEVIATION FROM AN ABSOLUTELY STRAIGHT LINE OF SIGHT WITHIN PLUS OR MINUS 1/8 INCH IN 10 FT...
b. PLUMB: ALLOWED DEVIATIONS FROM AN ABSOLUTELY VERTICAL PLANE OF PLUS OR MINUS 1/8 INCH IN 10 FT...
c. LEVEL: ALLOWED DEVIATIONS FROM AN ABSOLUTELY HORIZONTAL PLANE OF PLUS OR MINUS 1/8 INCH IN 10 FT...
d. ALLOWED DEVIATIONS FROM AN ABSOLUTELY FLAT IF WITHIN PLUS OR MINUS 1/16 INCH IN ONE SQUARE FOOT...
T2. REFER TO SPECIFICATIONS FOR ADDITIONAL TOLERANCE REQUIREMENTS...
PROJECT CONTRACT COORDINATOR:
a. SUBSTANTIAL COMPLETION: AT SUBSTANTIAL COMPLETION OF THE PROJECT, SCHEDULE AND ATTEND A PUNCH LIST WALK THROUGH OF REMAINING WORK FOR REVIEW WITH THE ARCHITECT AND OWNER...
b. CERTIFICATE OF OCCUPANCY: PROVIDE THE FINAL CERTIFICATE OF OCCUPANCY FROM THE BUILDING DEPARTMENT...
c. PERMITS/INSPECTION CARDS: FURNISH COPIES OF PERMITS AND SIGNED INSPECTION CARDS FOR EACH OF THE FOLLOWING AGENCIES...
d. FURNISH COPIES OF PERMITS AND SIGNED INSPECTION CARDS FOR EACH OF THE FOLLOWING AGENCIES...
e. MAINTENANCE MANUALS AND WARRANTIES: FURNISH (2) COPIES FOR EACH UNIT OF ALL MANUALS, MAINTENANCE INSTRUCTIONS, CONTRACTORS AND MANUFACTURER'S PRINTED WARRANTIES...
f. TOUCH UP MATERIAL: FURNISH OWNER WITH ONE GALLON OF EACH PAINT AND STAIN USED PER UNIT...
g. SUBCONTRACTORS: PROVIDE THE OWNER THE NAMES, ADDRESSES, AND PHONE NUMBERS OF ALL SUBCONTRACTORS...
h. FINAL CLEANING AND REPAIRS: REMOVE TEMPORARY FACILITIES AND PROVIDE FINAL CLEANING AND TOUCH-UP...
i. CLOSEOUT DOCUMENTS: PROVIDE THE OWNER WITH A COMPACT DISK OF ALL RECORD DRAWINGS IN PDF FORMAT...
C33. EXAMINATION OF CONDITIONS: EXAMINE SUBSTRATE AND CONDITIONS UNDER WHICH WORK IS TO BE PERFORMED...
C34. CONTRACTOR SHALL PROVIDE BACKING SUPPORT OF ALL WALL, CEILING, AND PARTITION MOUNTED ITEMS...
C35. EXTERIOR OPENINGS SHALL COMPLY WITH ALL SECURITY REQUIREMENTS AS OUTLINED IN ALL LOCAL BUILDING CODES AND ORDINANCES...
C36. GLASS AND GLAZING FOR ALL WINDOWS SHALL COMPLY WITH ALL APPLICABLE BUILDING CODES...
C37. ROOFING WORK SHALL BE PERFORMED AND ALL PENETRATIONS THROUGH THE ROOFING MEMBRANE SHALL BE PATCHED OR FLASHED AS PER THE MANUFACTURER'S STANDARDS...
C38. ROOF OBSTRUCTIONS SUCH AS TELEVISION ANTENNAE, SOLAR PANELS, AND GUY WIRES SHALL NOT BE LOCATED OR INSTALLED IN SUCH A WAY AS TO PREVENT FIRE DEPARTMENT ACCESS OR EGRESS...

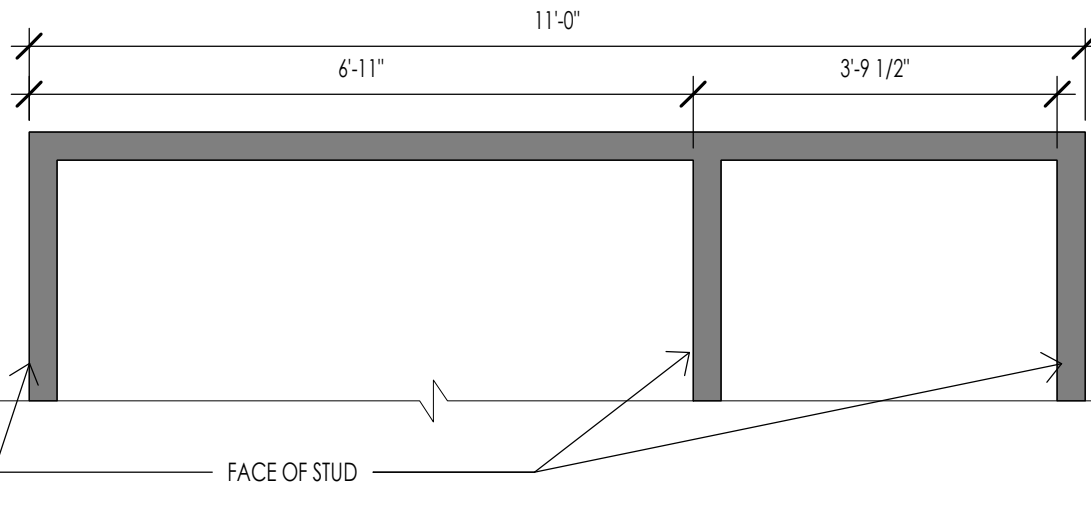

TYPICAL DIMENSION METHOD

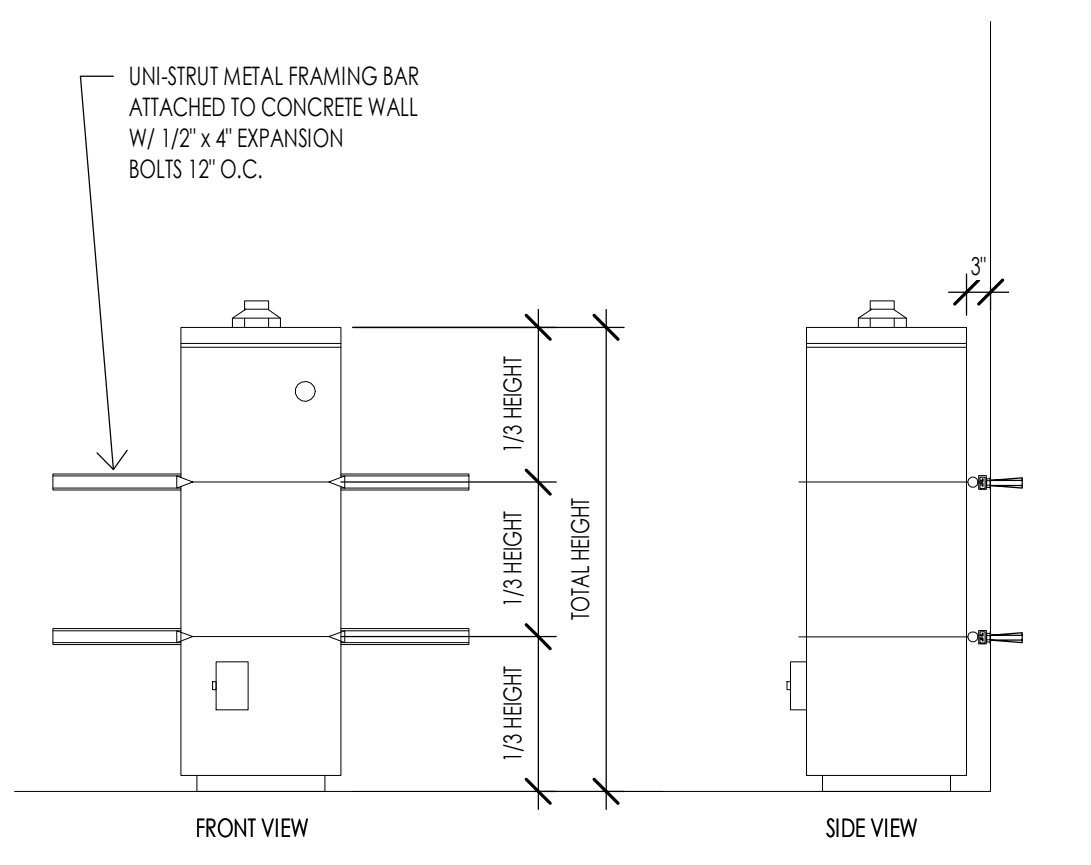

WATER HEATER SEISMIC STRAPPING

INSULATION SCHEDULE

ENERGY STRATEGY:

PRESCRIPTIVE PER IRC [] RESCHECK - 2015 IECC [] RESCHECK - UTAH 2012 [x]

Table with 5 columns: LOCATION, TYPE, THICKNESS, "R" VALUE, REMARKS. Contains 14 rows of insulation specifications for various building components like foundation walls, exterior walls, roof deck, and interior walls.

INSULATION NOTES:
1. COORDINATE WITH PROJECT SPECIFICATION SECTIONS FOR INSULATION FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
2. ALL INSULATION SHALL BE TIGHT, AND NO GAPS SHALL BE LEFT.
3. ALL INSULATION AT PIPES SHALL BE INSTALLED TO A WARM SIDE ONLY.
PROVIDE SEALING OF THE BUILDING THERMAL ENVELOPE FOR LEAKAGE BY THE REQUIREMENTS BELOW:
1. AIR BLOWER DOOR TEST FOR BUILDING ENVELOPE AT FINAL WITH A MAXIMUM AIR LEAKAGE OF 5 AIR CHANGES PER HOUR...

RESCHECK/ ENERGY COM CHECK

REScheck Software Version 4.7.2 Compliance Certificate. Project: Warm Springs # 35. Includes project details, compliance status, and envelope assemblies table.

Envelope Assemblies table with columns: Assembly, Gross Area, Cavity, Cont., Prog., Req., Prep. Includes rows for slab on grade, floor level, roof level, and basement walls.

Table with columns: Assembly, Gross Area, Cavity, Cont., Prog., Req., Prep. Includes rows for door elevations and window elevations.

Project Title: Warm Springs #35
Data Filename: C:\Users\jaceren\THINKAE\Desktop\rescheck Temp\Warm Springs Residence #35.rck
Report Date: 06/06/22
Page 1 of 10



Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highland Parkway, Suite 300
Scary, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkae.com



The designs shown and described herein including all technical drawings, graphic representations & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced...

WARM SPRINGS RESIDENCE #35
190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30

SHEET TITLE: GENERAL NOTES

SHEET NUMBER: G002

© 2021 THINK ARCHITECTURE INC.




Think Architecture

Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Sandwich, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkaoc.com


The designs shown and described herein including all technical drawings, graphic representations & models thereof, are proprietary & can not be copied, duplicated, or commercially republished in whole or in part without the sole and express written permission from THINK ARCHITECTURE, INC.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

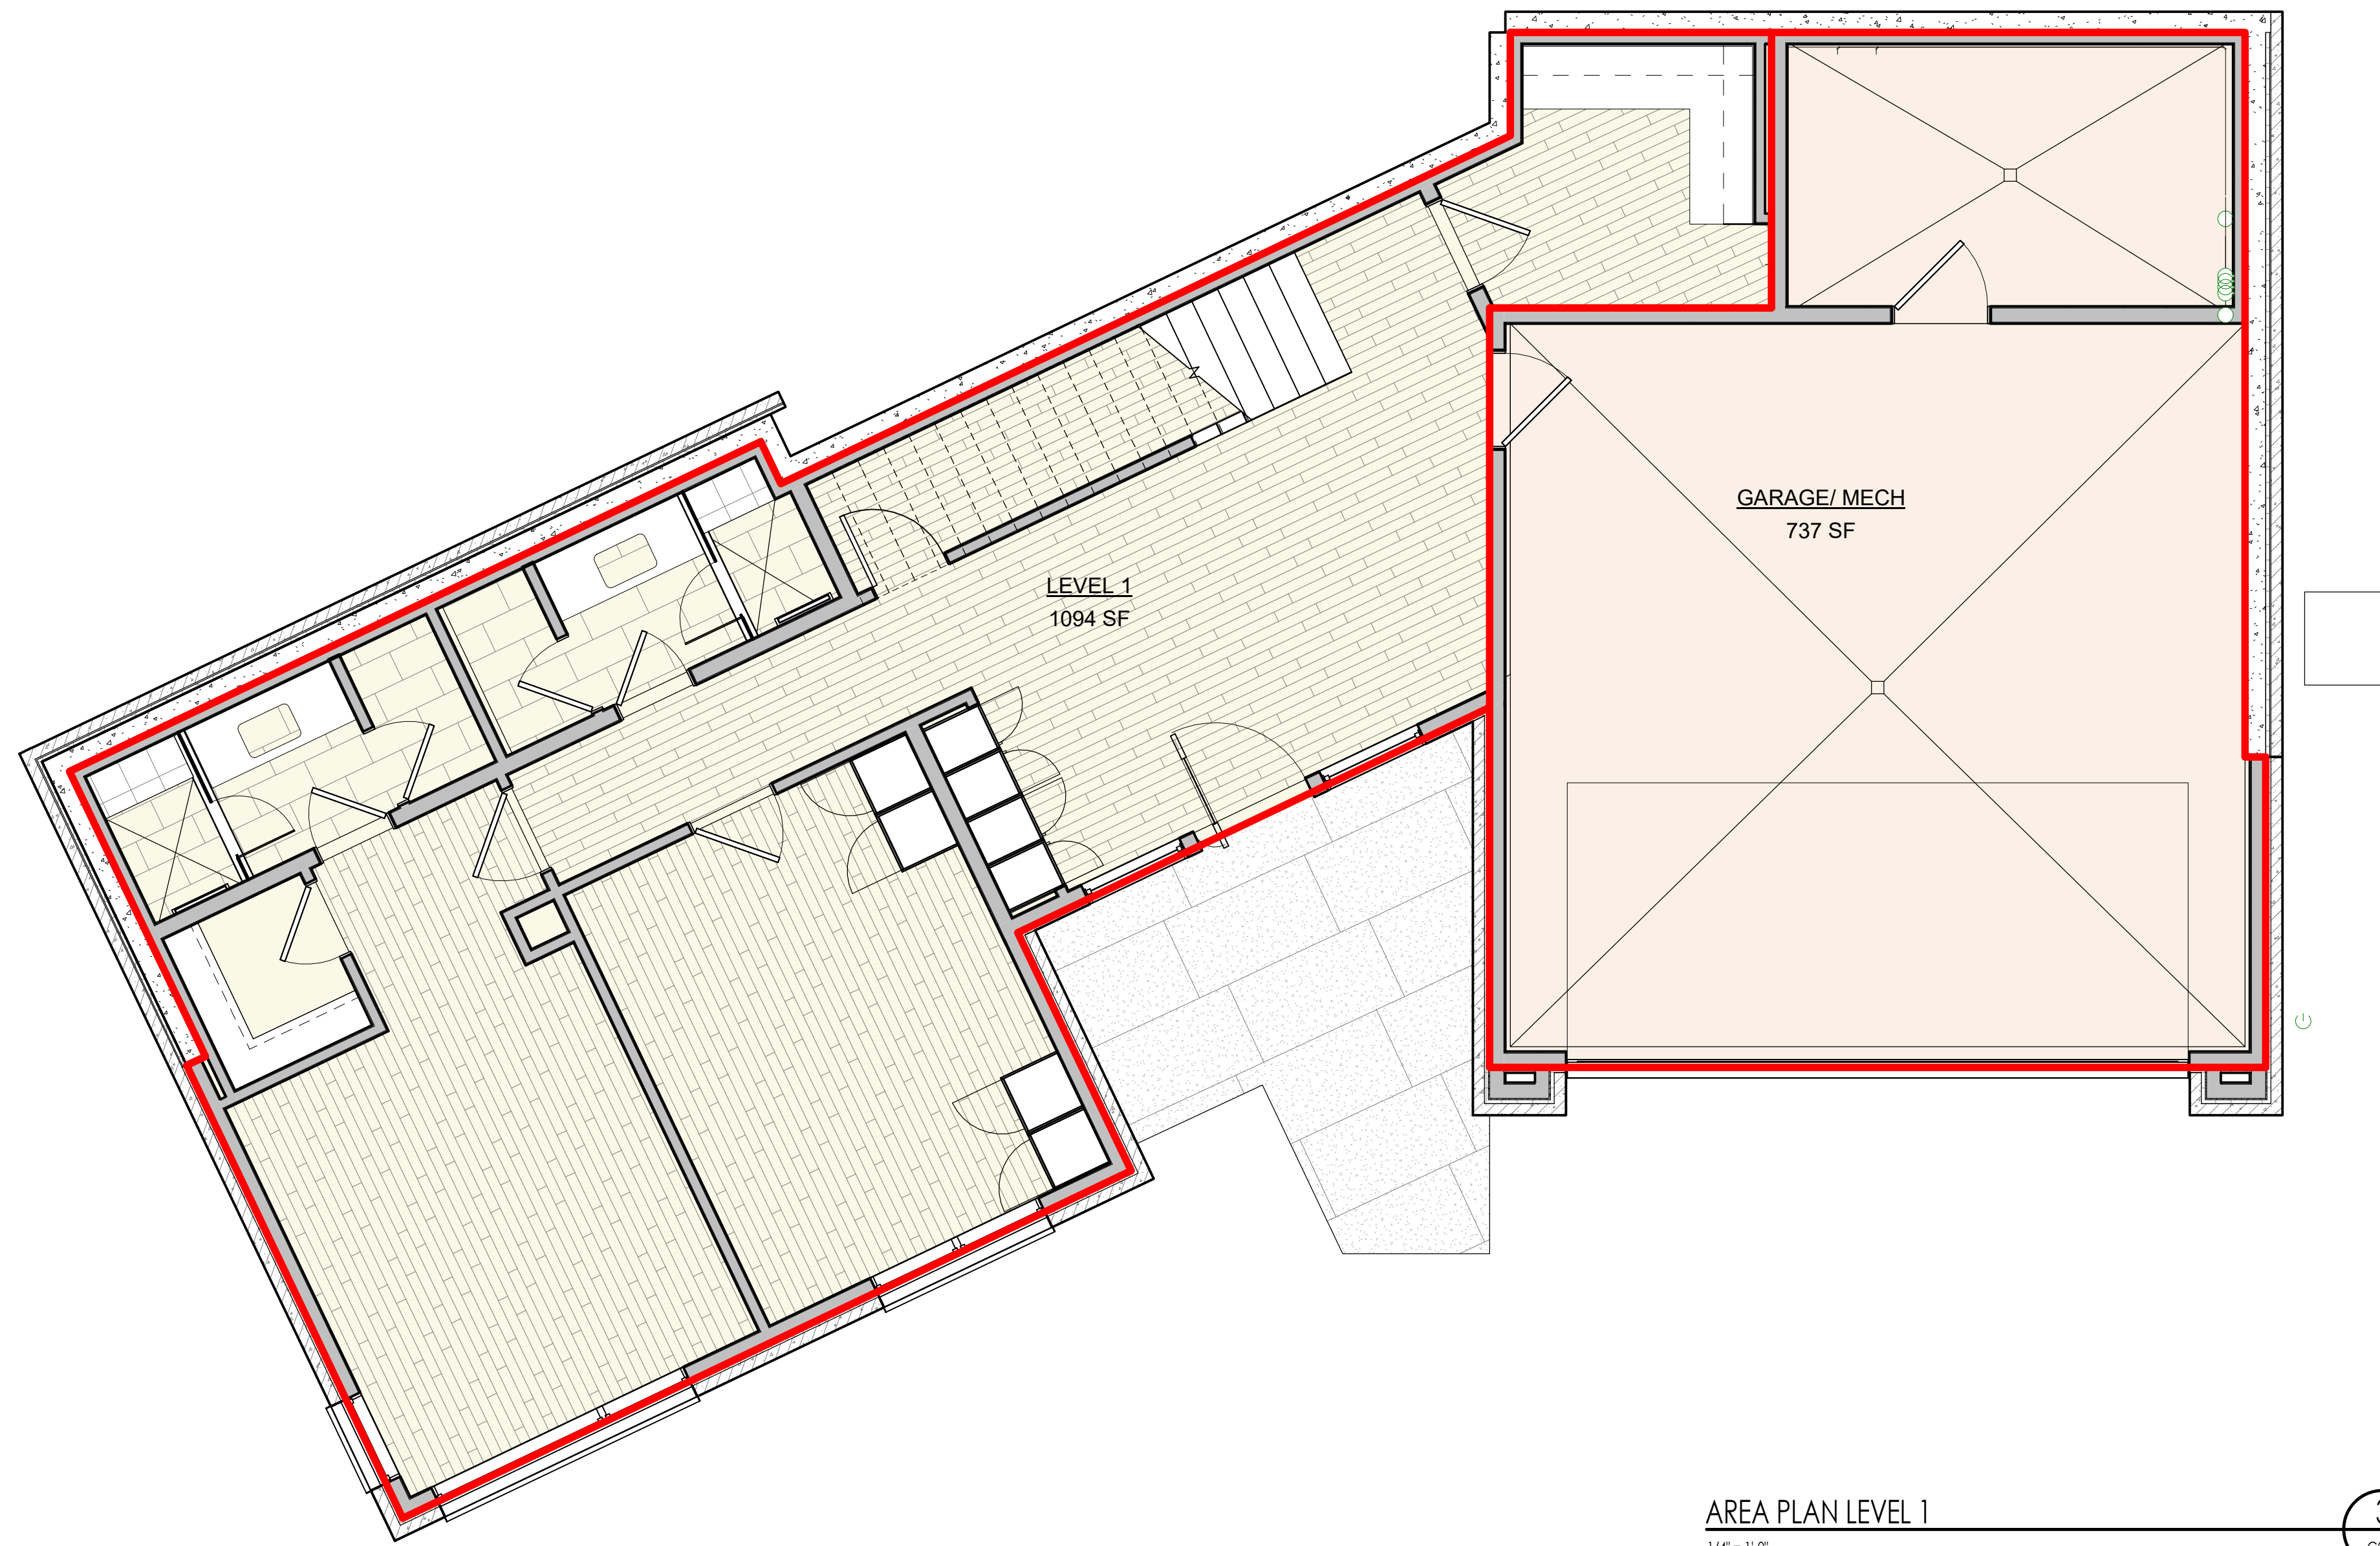

AREA PLAN LEVEL 1
1/4" = 1'-0"

3
G003

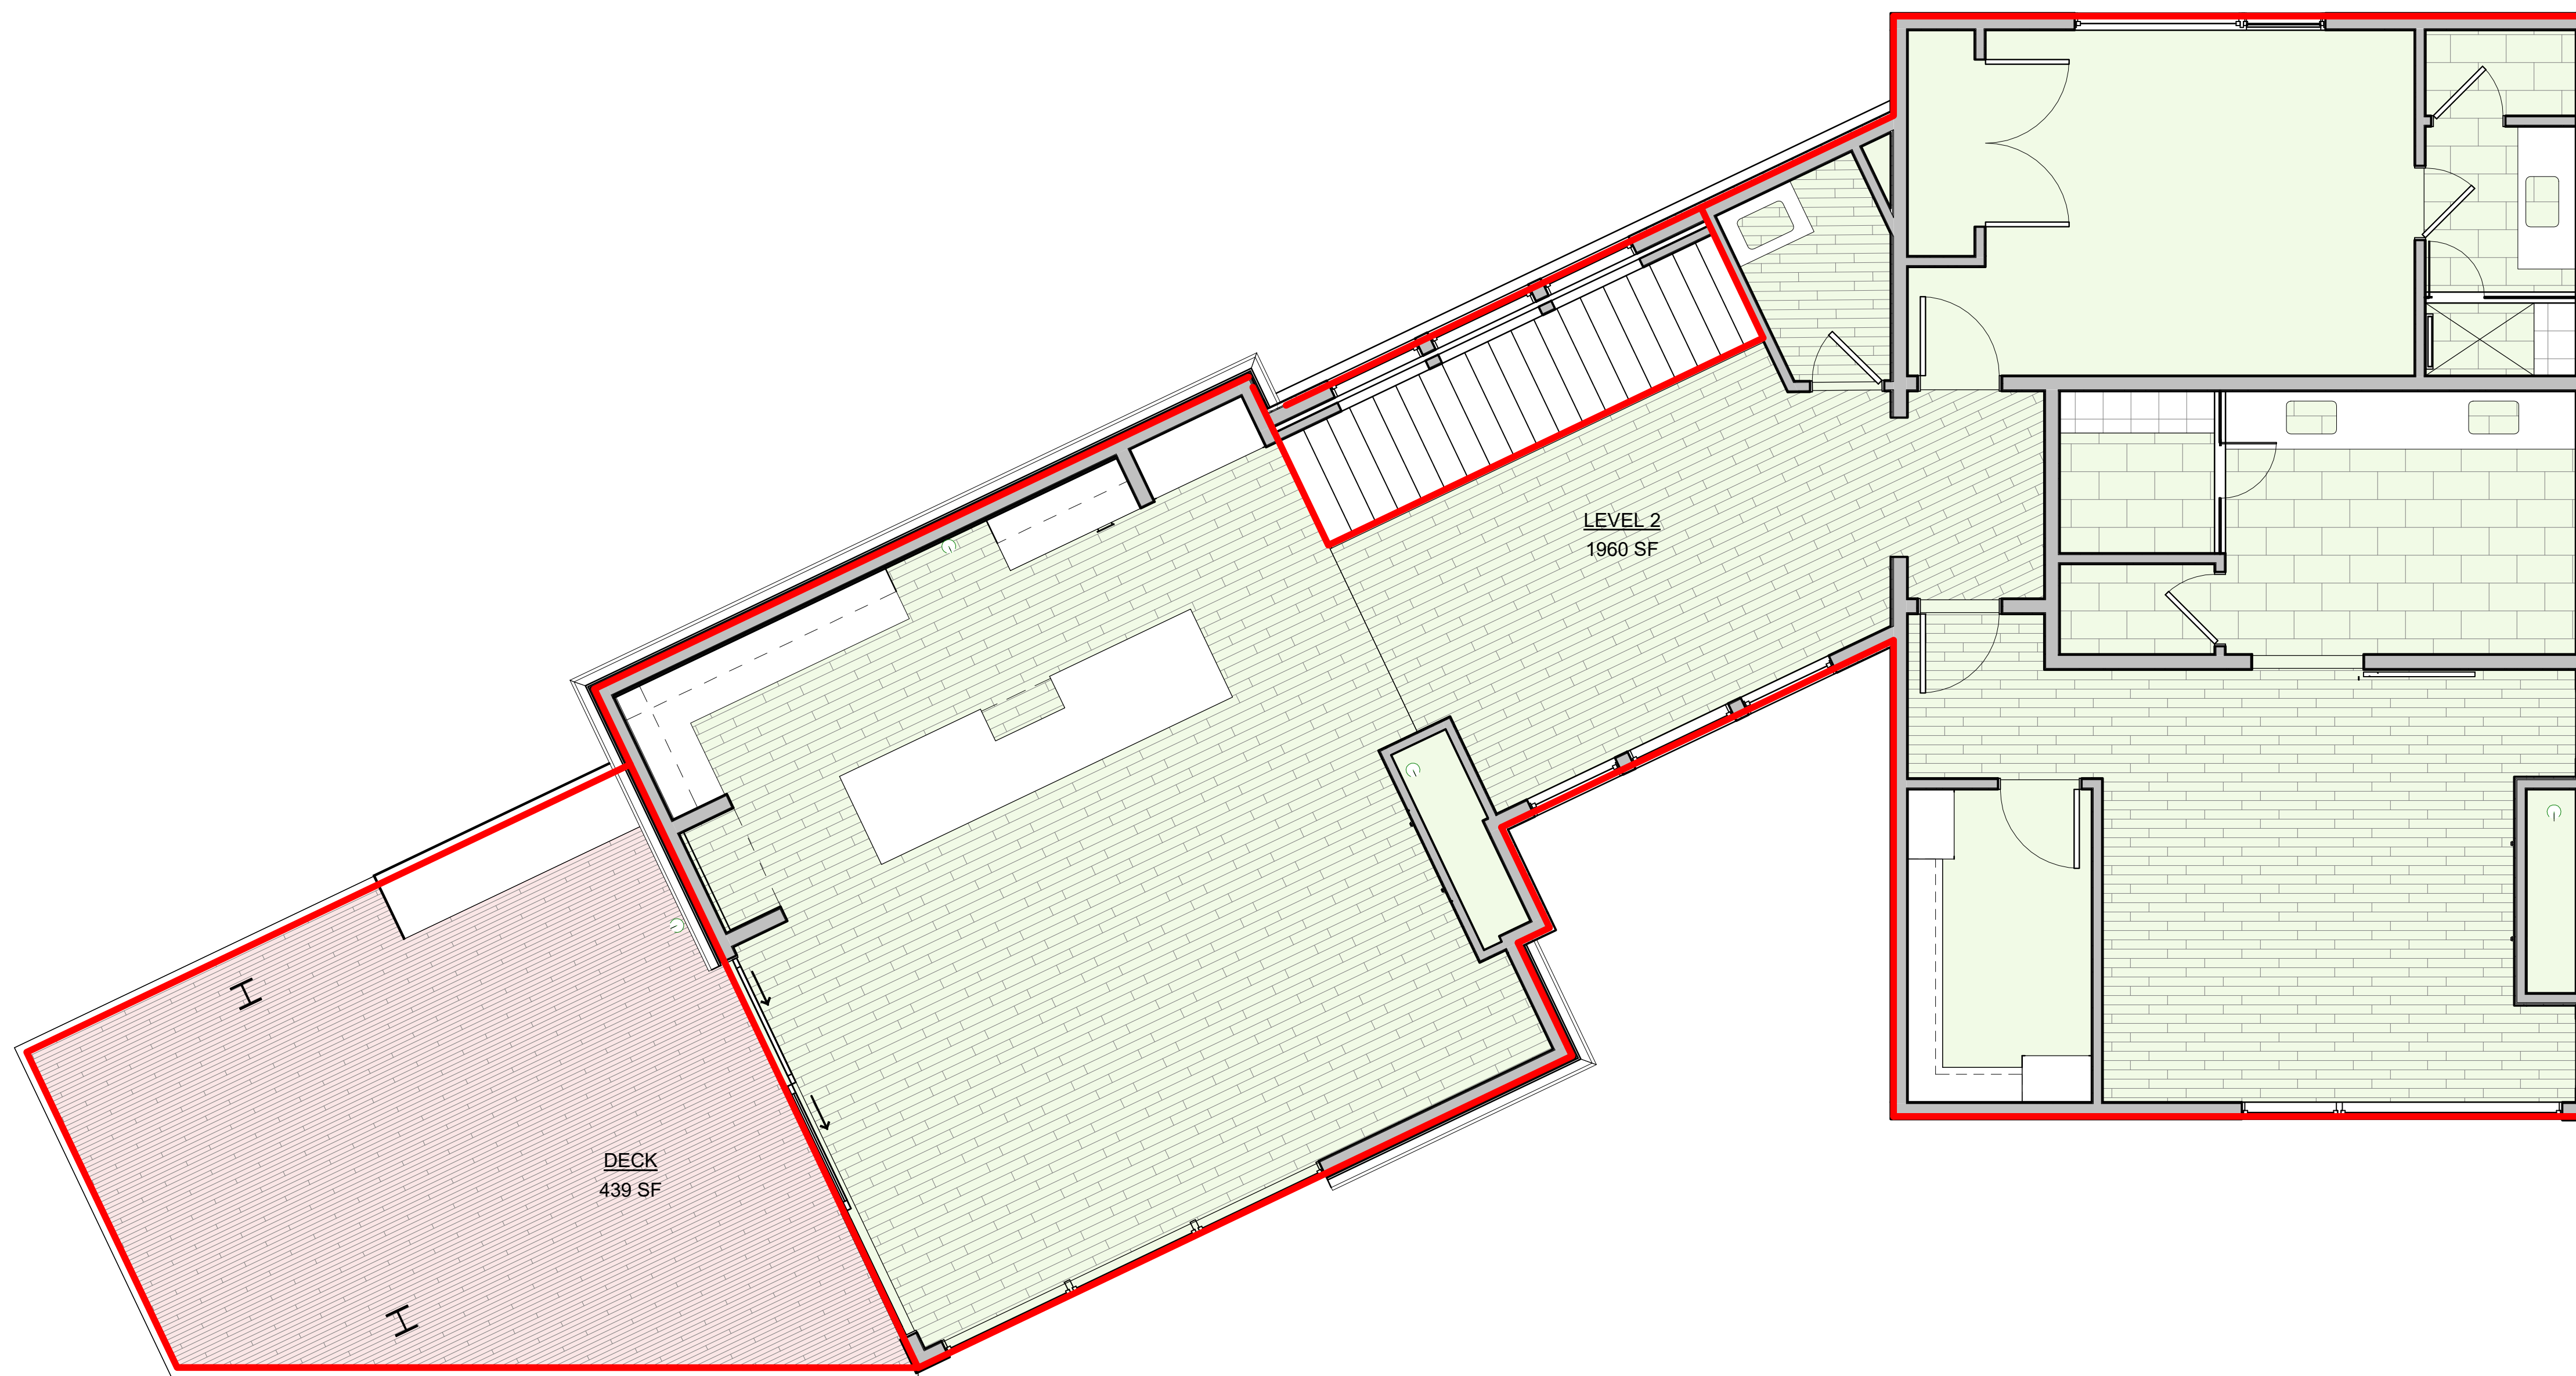

AREA PLAN LEVEL 2
1/4" = 1'-0"

2
G003

BUILDING AREA - FINISHED	
AREA	FINISHED
LEVEL 1	1094 SF
LEVEL 2	1960 SF
	3054 SF

BUILDING AREA - UNFINISHED	
AREA	UNFINISHED
GARAGE/MECH	737 SF
	737 SF

BUILDING AREA - TOTAL	
TOTAL	
	3791 SF

EXTERIOR AREA - DECK	
AREA	EXTERIOR
DECK	439 SF
	439 SF

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30

REVISIONS:

SHEET TITLE:
BUILDING AREA
ANALYSIS

SHEET NUMBER:

G003

© 2021 THINK ARCHITECTURE, INC.

PERMIT SET




Think Architecture

Architecture Interior Design Landscape Architecture Land Planning Construction Management

7927 So. Highpoint Parkway, Suite 300
Scary, Utah 84094
ph. 801.269.0555
fax. 801.269.1425
www.thinkaia.com

The designs shown and described herein including all technical drawings, graphic representations & models thereof... are the property of Think Architecture, Inc.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

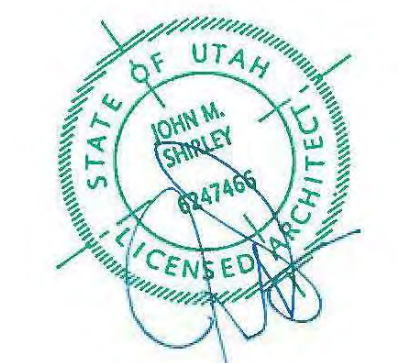

ANCHOR STONE MASONRY TO CONCRETE, CMU AND STUD WALL FRAMING AS INDICATED ON DETAILS WITHIN DRAWINGS.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

© 2021 THINK ARCHITECTURE, INC.

PROJECT NO. 22023

DATE: 2023.06.30

REVISIONS:

SHEET TITLE: SPECIFICATIONS

SHEET NUMBER: G005

PERMIT SET

04-48, 04-49 STONE VENEER COMPONENTS

GENERAL PRODUCTS
STONE VENEER COMPONENTS ARE:
CUT STONE WALL CAPS- CHOPPED SANDSTONE
CUT STONE WINDOW HEADERS- CHOPPED SANDSTONE
CUT STONE COLUMN CAPS- CHOPPED SANDSTONE
CUT STONE WINDOW /DOOR HEADERS- CHOPPED SANDSTONE

STONE TO BE: QUARTZITE FROM LOCAL QUARRY
STONE COLOR TO BE: MIX OF BUFF AND GRAY

MORTAR COLOR: TO BE DETERMINED BY ARCHITECT AT TIME OF MOCKUP.

JOINTS IN STONE VENEER TO BE: DRY-STACK AS APPROVED BY ARCHITECT AT TIME OF MOCKUP.
FLASHING: SEE SECTION 07 FOR FLASHING SPECIFICATIONS, SCHEDULE, REQUIREMENTS, ETC.
SEE DETAILS ON DRAWINGS FOR PROFILES OF FLASHING AT LOCATION SPECIFIED AND SHOWN ON DRAWINGS.

DETAILS ON DRAWINGS FOR PROFILES OF FLASHING AT LOCATION SPECIFIED AND SHOWN ON DRAWINGS.
SUBMITTALS
PROVIDE SAMPLE OF EACH COMPONENT TO BE INCLUDED WITHIN THE SAMPLE BOARD FOR REVIEW BY OWNER AND ARCHITECT.

EXCLUSION
WALL CAPS SHALL BE INSTALLED WHERE INDICATED ON DRAWINGS. INSTALL ALL CAPS LEVEL AND SHALL SLOPE AS INDICATED ON DRAWINGS OR WITH A MINIMUM OF 1/8" PER FT. FOR DRAINAGE. IF NOT SPECIFIED PROVIDE TOP TO SLOPE TO PROVIDE DRAINAGE AWAY FROM BUILDING.

WINDOW SILLS SHALL BE INSTALLED WHERE INDICATED ON DRAWINGS. INSTALL ALL SILLS LEVEL AND SHALL SLOPE AS INDICATED ON DRAWINGS FOR DRAINAGE. IF NOT SPECIFIED PROVIDE TOP TO SLOPE TO PROVIDE DRAINAGE AWAY FROM BUILDING

COLUMN CAPS SHALL BE INSTALLED WHERE INDICATED ON DRAWINGS. INSTALL ALL CAPS TO SLOPE AS INDICATED ON DRAWINGS OR WITH A MINIMUM OF 1/8" PER FT. FOR DRAINAGE. COLUMN CAPS SHALL BE PROVIDED IN 4 PICES WITH ALL JOINTS AT CORNERS, UNLESS SHOWN OTHERWISE ON DRAWINGS. TOP SHALL SLOPE AWAY FROM CENTER TO EDGES AS NOTED ON DRAWINGS.

WINDOW AND DOOR HEADERS SHALL BE INSTALLED WHERE INDICATED ON DRAWINGS. INSTALL DOOR AND WINDOW HEADERS LEVEL.

ANCHOR STONE MASONRY TO CONCRETE, CMU AND STUD WALL FRAMING AS INDICATED ON DETAILS WITHIN DRAWINGS.
SET STONE IN FULL BED OF MORTAR WITH FULL HEAD JOINTS UNLESS OTHERWISE INDICATED. BUILD ANCHORS INTO MORTAR JOINTS AS SHOWN IN SET.

MORTAR TO BE SLUSHED INTO SPACE BETWEEN STONE FACE AND DRAIN PANE AND WEATHER BARRIER.

RAKE OUT JOINTS AS DIRECTED BY ARCHITECT.

CLEAN STONE MASONRY AS WORK PROGRESSES. REMOVE MORTAR DUST AND SMEARS BEFORE TOOLING JOINTS. AFTER MORTAR IS THOROUGHLY SET AND CURED, CLEAN STONE MASONRY AS FOLLOWS:

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

DIVISION 4 MASONRY

04-40 EXTERIOR STONE VENEER

GENERAL PRODUCTS
EXTERIOR CONCRETE STEPS TO BE 4000 PSI. AND SHALL HAVE NORMAL WEIGHT 3/4" AGGREGATE.

STONE TO BE: QUARTZITE FROM LOCAL QUARRY

PATTERN: RANDOM HORIZONTAL ASHLEAF LAY TO BE VERIFIED BY THE ARCHITECT FROM MOCK-UP

COLOR: MIX OF BUFF AND GRAY

MORTAR COLOR: TO BE DETERMINED BY ARCHITECT AT TIME OF MOCKUP.

JOINTS IN STONE VENEER TO BE: DRY-STACK AS APPROVED BY ARCHITECT AT TIME OF MOCKUP.

FLASHING: SEE SECTION 07 FOR FLASHING SPECIFICATIONS, SCHEDULE, REQUIREMENTS, ETC.

SEE DETAILS ON DRAWINGS FOR PROFILES OF FLASHING AT LOCATION SPECIFIED AND SHOWN ON DRAWINGS.

DETAILS ON DRAWINGS FOR PROFILES OF FLASHING AT LOCATION SPECIFIED AND SHOWN ON DRAWINGS.
SUBMITTALS
PROVIDE SAMPLE OF EACH COMPONENT TO BE INCLUDED WITHIN THE SAMPLE BOARD FOR REVIEW BY OWNER AND ARCHITECT.

EXCLUSION
WALL CAPS SHALL BE INSTALLED WHERE INDICATED ON DRAWINGS. INSTALL ALL CAPS LEVEL AND SHALL SLOPE AS INDICATED ON DRAWINGS OR WITH A MINIMUM OF 1/8" PER FT. FOR DRAINAGE. IF NOT SPECIFIED PROVIDE TOP TO SLOPE TO PROVIDE DRAINAGE AWAY FROM BUILDING.

WINDOW SILLS SHALL BE INSTALLED WHERE INDICATED ON DRAWINGS. INSTALL ALL SILLS LEVEL AND SHALL SLOPE AS INDICATED ON DRAWINGS FOR DRAINAGE. IF NOT SPECIFIED PROVIDE TOP TO SLOPE TO PROVIDE DRAINAGE AWAY FROM BUILDING

COLUMN CAPS SHALL BE INSTALLED WHERE INDICATED ON DRAWINGS. INSTALL ALL CAPS TO SLOPE AS INDICATED ON DRAWINGS OR WITH A MINIMUM OF 1/8" PER FT. FOR DRAINAGE. COLUMN CAPS SHALL BE PROVIDED IN 4 PICES WITH ALL JOINTS AT CORNERS, UNLESS SHOWN OTHERWISE ON DRAWINGS. TOP SHALL SLOPE AWAY FROM CENTER TO EDGES AS NOTED ON DRAWINGS.

WINDOW AND DOOR HEADERS SHALL BE INSTALLED WHERE INDICATED ON DRAWINGS. INSTALL DOOR AND WINDOW HEADERS LEVEL.

ANCHOR STONE MASONRY TO CONCRETE, CMU AND STUD WALL FRAMING AS INDICATED ON DETAILS WITHN DRAWINGS.
SET STONE IN FULL BED OF MORTAR WITH FULL HEAD JOINTS UNLESS OTHERWISE INDICATED. BUILD ANCHORS INTO MORTAR JOINTS AS SHOWN IN SET.

MORTAR TO BE SLUSHED INTO SPACE BETWEEN STONE FACE AND VAPOR BARRIER.

RAKE OUT JOINTS AS DIRECTED BY ARCHITECT.

CLEAN STONE MASONRY AS WORK PROGRESSES. REMOVE MORTAR DUST AND SMEARS BEFORE TOOLING JOINTS. AFTER MORTAR IS THOROUGHLY SET AND CURED, CLEAN STONE MASONRY AS FOLLOWS:

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

REMOVE LARGE MORTAR PARTICLES BY HAND WITH WOODEN PADDLES AND NONMETALLIC SCRAPER HOES OR CHISELS. TEST CLEANING METHODS ON MOCKUP... BEFORE FINISHING.

03-12 EXTERIOR CAST IN PLACE CONCRETE STEPS

GENERAL PRODUCTS
CONCRETE FOOTINGS TO BE 4000 PSI. MINIMUM COMPRESSIVE STRENGTH UNLESS SPECIFIED OTHERWISE ON STRUCTURAL DRAWINGS. STRUCTURAL DRAWINGS SHALL TAKE PRECEDENCE, UNLESS NOT SPECIFIED. ALL FOOTINGS SHALL HAVE NORMAL WEIGHT 1" AGGREGATE.

REINFORCING SHALL BE PER STRUCTURAL DRAWINGS. PROVIDE #3 @ 24" O.C. PROVIDE #3 AT EACH HOUSING OF STAIRS. PROVIDE MINIMUM OF 2" COVERAGE OF CONCRETE TO ALL STEEL. STRUCTURAL DRAWINGS SHALL TAKE PRECEDENCE OVER MINIMUM SPECIFICATION FOR ALL REINFORCEMENT.

SUBMITTALS
DESIGN MIXTURES FOR EACH CONCRETE MIX.

EXCLUSION
ALL FOOTINGS TO BEAR ON UNDISTURBED SOIL OR ENGINEERED COMPACTED FILL. (CERTIFIED 95% COMPACTION). ANY QUESTIONABLE SOIL SHALL BE REVIEWED BY SOIL ENGINEER PRIOR TO PLACEMENT OF FOOTING. THE CONTRACTOR SHALL COORDINATE AND REQUEST A SITE OBSERVATION REPORT FROM GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF FOOTINGS

PROVIDE TURNED DOWN GRADE BEAM AT EDGES. DOWEL SLAB INTO FOUNDATION WALLS WITH #4 BARS AT 24" O.C.

STEPS TO HAVE RISER MAXIMUM HEIGHT OF 7" AND MINIMUM TREAD OF 12". SEE ARCHITECTURAL DETAILS FOR RISE AND RUN FOR EACH STEP.

REPAIR PLACING CONCRETE. VERIFY THAT INSTALLATION OF FORM WORK, REINFORCEMENT, AND EMBEDDED ITEMS IS COMPLETE AND THAT REQUIRED INSPECTIONS HAVE BEEN PERFORMED.

TROWEL FINISH: AS SPECIFIED ON LANDSCAPE DRAWINGS.

PROTECT FRESHLY PLACED CONCRETE FROM PREMATURE DRYING AND EXCESSIVE COLD OR HOT TEMPERATURES.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

NO JOINTS IN STAIRS.

03-14 CAST IN PLACE RETAINING WALLS

GENERAL PRODUCTS
CONCRETE FOUNDATION TO BE 3000 PSI MINIMUM COMPRESSIVE STRENGTH, AND SHALL HAVE NORMAL WEIGHT 1" AGGREGATE UNLESS NOTED OTHERWISE ON STRUCTURAL DRAWINGS. STRUCTURAL DRAWINGS SHALL TAKE PRECEDENCE OVER MINIMUM STANDARDS SPECIFIED.

REINFORCING SHALL BE AS PER THE FOUNDATION WALL SCHEDULE--SEE STRUCTURAL DRAWINGS.

SUBMITTALS
DESIGN MIXTURES FOR EACH CONCRETE MIX.

EXCLUSION
TYPICAL WALLS SHALL BE A MINIMUM OF 8" THICK U.S.O. ON PLANS. REFER TO BOTH ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR THICKNESS OF WALLS. REFER TO TOP OF WALL DETAILS ON ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR SPECIFIED DETAILS AND REQUIREMENTS.

COORDINATE WITH ARCHITECTURAL FOUNDATION PLANS FOR ALL TOP OF WALL ELEVATIONS. TOP OF FOUNDATION WALL TO BE A MINIMUM OF 6" ABOVE FINISH GRADE.

PROVIDE WATERPROOFING AT EXTERIOR OF FOUNDATION WALLS BELOW FINISH GRADE AT ALL HABITABLE SPACES. SEE DIVISION 7 OF SPECIFICATIONS.

PROVIDE PERIMETER FOUNDATION DRAIN --SEE DIVISION 7 OF SPECIFICATIONS.

PROVIDE RIGID INSULATION AT INDOOR FACE OF FOUNDATION BELOW FLOOR SLAB WHERE EXPOSED TO EXTERIOR. COORDINATE WITH ARCHITECTURAL DETAILS AND INSULATION SPECIFICATIONS FOR THICKNESS REQUIRED PER ENERGY CALCULATIONS.

PROVIDE PERIMETER FOUNDATION DRAIN --SEE DIVISION 7 OF SPECIFICATIONS.

PROVIDE RIGID INSULATION AT INDOOR FACE OF FOUNDATION BELOW FLOOR SLAB WHERE EXPOSED TO EXTERIOR. COORDINATE WITH ARCHITECTURAL DETAILS AND INSULATION SPECIFICATIONS FOR THICKNESS REQUIRED PER ENERGY CALCULATIONS.

PROTECT FRESHLY PLACED CONCRETE FROM PREMATURE DRYING AND EXCESSIVE COLD OR HOT TEMPERATURES. DEFECTIVE CONCRETE: REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

REPAIR AND PATCH DEFECTIVE AREAS WHEN APPROVED BY ARCHITECT. REMOVE AND REPLACE CONCRETE THAT CANNOT BE REPAIRED AND PATCHED TO ARCHITECT'S APPROVAL.

BUILDING KEYNOTES AND SPECIFICATIONS

DIVISION 5 METALS

05-01 STRUCTURAL STEEL WIDE BEAMS

GENERAL PRODUCTS
STRUCTURAL STEEL BEAMS (ASTM A 572/A 572M, GRADE 50)

SUBMITTALS
SHOP DRAWINGS: SHOW FABRICATION OF STRUCTURAL STEEL COMPONENTS, INCLUDE DETAILS OF CUTS, CONNECTIONS, SPICES, CAMBER, HOLES, AND OTHER PERTINENT DATA, WITH EMBEDMENT DRAWINGS.

INDICATE WELDS BY STANDARD AWS SYMBOLS, DISTINGUISHING BETWEEN SHOP AND FIELD WELDS, AND SHOW SIZE, LENGTH, AND TYPE OF EACH WELD.

INDICATE TYPE, SIZE, AND LENGTH OF BOLTS, BOLTS, NUTS, AND WASHERS. ASTM A325, HEAVY HEX STEEL STRUCTURAL BOLTS; ASTM A563 HEAVY HEX CARBON STEEL NUTS; AND ASTM F436 HARDENED CARBON STEEL WASHERS.

CONTRACTOR SHALL ASSURE THAT FABRICATOR, ERECTOR ARE CERTIFIED INSTALLERS TO PERFORM THE WORK, AND PROVIDE CERTIFICATION WITH SUBMITTAL.

EXECUTION
ALL STEEL MEMBERS SHALL BE PRIMED, PRIOR TO DELIVERY TO SITE. EXPOSED STEEL SHALL BE FINISHED SSPC-PAIN 25, TYPE 1, COLOR OF EXPOSED STEEL TO BE: BENJAMIN MOORE- SATIN HC-167, "AMHERST GRAY".

PROVIDE BEAMS OF SIZES AND SHAPES INDICATED. FABRICATE CONNECTIONS TO COMPLY WITH DETAILS SHOWN OR AS REQUIRED TO SUIT TYPE OF STRUCTURE INDICATED.

CONTRACTOR WILL ENGAGE AN INDEPENDENT TESTING AND INSPECTING AGENCY TO PERFORM SHOP TESTS AND INSPECTIONS AND PREPARE TEST REPORTS. VERIFY ELEVATIONS OF CONCRETE AND MASONRY BEARING SURFACES AND LOCATIONS OF ANCHOR RODS, BEARING PLATES, AND OTHER EMBEDMENTS, PROCEED WITH INSTALLATION ONLY AFTER UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED.

PROVIDE ALL NECESSARY BRACING AND SHORING FOR ERECTION, AND DO NOT REMOVE UNTIL FINAL ERECTION IS COMPLETE. CAMBER STRUCTURAL STEEL MEMBERS WHERE INDICATED. ALL MEMBERS SHALL BE LEVEL AND PLUMB IN ACCORDANCE WITH THE DRAWINGS AND PROJECT CONDITIONS.

FABRICATE WITH EXPOSED SURFACES SMOOTH, SQUARE, AND FREE OF SURFACE BLEMISHES INCLUDING PITTING, RUST, SCALE, SEAM MARKS, ROLLER MARKS, ROLLED TRADE NAMES, AND ROUGHNESS. REMOVE BLEMISHES BY FILLING OR GRINDING, BEFORE CLEANING, TREATING, AND SHOP PRIMING.

BOLT HOLES: CUT, DRILL, OR PUNCH STANDARD BOLT HOLES PERPENDICULAR TO METAL SURFACES. PROVIDE HOLES REQUIRED FOR SECURING OTHER WORK TO STRUCTURAL STEEL AND FOR PASSAGE OF OTHER WORK THROUGH STEEL FRAMING MEMBERS. DO NOT THERMALLY CUT BOLT HOLES OR ENLARGE HOLES BY BURNING.

05-02, 05-03, 05-04 STRUCTURAL STEEL COLUMNS

GENERAL PRODUCTS
STRUCTURAL STEEL COLUMNS: TUBE, PIPE, WIDE FLANGE, AS NOTED ON STRUCTURAL DRAWINGS.

ARCHITECTURALLY EXPOSED STRUCTURAL STEEL

SUBMITTALS
SHOP DRAWINGS: SHOW FABRICATION OF STRUCTURAL STEEL COMPONENTS

INCLUDE DETAILS OF CUTS, CONNECTIONS, SPICES, CAMBER, HOLES, AND OTHER PERTINENT DATA, WITH EMBEDMENT DRAWINGS.

INDICATE WELDS BY STANDARD AWS SYMBOLS, DISTINGUISHING BETWEEN SHOP AND FIELD WELDS, AND SHOW SIZE, LENGTH, AND TYPE OF EACH WELD.

INDICATE TYPE, SIZE, AND LENGTH OF BOLTS, DISTINGUISHING BETWEEN SHOP AND FIELD BOLTS.

CONTRACTOR SHALL ASSURE THAT FABRICATOR, ERECTOR ARE CERTIFIED INSTALLERS TO PERFORM THE WORK,

EXECUTION
ALL STEEL MEMBERS SHALL BE PRIMED, PRIOR TO DELIVERY TO SITE. EXPOSED STEEL SHALL BE FINISHED AS FOLLOWS:

1. Pigmented Polyurethane over Epoxy System with shopcoat primer:
 - a. Prime Coat: Primer, rust-inhibitive, water based, MPI # 107; S-W Pro-Cyl Universal Primer, 866-310 Series, at 2.0 to 4.0 mils dry, per coat.
 - b. Intermediate Coat: Epoxy, high-build, low gloss, S-W Macropoxy 646-100, B58-600 Series, 8-73-620 Series, at 3.0 to 10.0 mils dry, per coat.
 - c. Topcoat: Polyurethane, two-component, pigmented, gloss, (Gloss Level 4); S-W Waterbased Acrolon 100 Polyurethane, 865-720 Series, at 2.0 to 4.0 mils dry, per coat.
B. COLOR: BENJAMIN MOORE- SATIN HC-167, "AMHERST GRAY".

PROVIDE COLUMNS OF SIZES AND SHAPES INDICATED. FABRICATE CONNECTIONS TO COMPLY WITH DETAILS SHOWN OR AS REQUIRED TO SUIT TYPE OF STRUCTURE INDICATED.

CONTRACTOR WILL ENGAGE AN INDEPENDENT TESTING AND INSPECTING AGENCY TO PERFORM SHOP TESTS AND INSPECTIONS AND PREPARE TEST REPORTS.

VERIFY ELEVATIONS OF CONCRETE- AND MASONRY-BEARING SURFACES AND LOCATIONS OF ANCHOR RODS, BEARING PLATES, AND OTHER EMBEDMENTS, THEN PROCEED WITH INSTALLATION ONLY AFTER UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED.

PROVIDE ALL NECESSARY BRACING AND SHORING FOR ERECTION, AND DO NOT REMOVE UNTIL FINAL ERECTION IS COMPLETE. ALL MEMBERS SHALL BE LEVEL AND PLUMB IN ACCORDANCE WITH THE DRAWINGS AND PROJECT CONDITIONS.

ALL STEEL COLUMNS IN WALLS SHALL RECEIVE 1/2" DIAMETER THREADED BOLTS WELDED TO THE COLUMN AT 2'-0" O.C. VERTICAL. STUD WALLS SHALL START AND STOP AT COLUMN AND BOLT TO COLUMN. BOLTS SHALL EXTEND THROUGH TWO STUDS MINIMUM AT ALL LOCATIONS EXCEPT AT WINDOWS AT EXTERIOR WALL. BOLTS MAY EXTEND THROUGH ONE STUD.

05-06 STRUCTURAL STEEL CHANNELS

GENERAL PRODUCTS
STRUCTURAL STEEL CHANNELS (ASTM A 572/A 572M, GRADE 50)

SUBMITTALS
SHOP DRAWINGS: SHOW FABRICATION OF STRUCTURAL STEEL COMPONENTS

INCLUDE DETAILS OF CUTS, CONNECTIONS, SPICES, CAMBER, HOLES, AND OTHER PERTINENT DATA, WITH EMBEDMENT DRAWINGS.

INDICATE WELDS BY STANDARD AWS SYMBOLS, DISTINGUISHING BETWEEN SHOP AND FIELD WELDS, AND SHOW SIZE, LENGTH, AND TYPE OF EACH WELD.

CONTRACTOR SHALL ASSURE THAT FABRICATOR, ERECTOR ARE CERTIFIED INSTALLERS TO PERFORM THE WORK, AND PROVIDE CERTIFICATION WITH SUBMITTAL.

EXECUTION
ALL STEEL MEMBERS SHALL BE PRIMED, PRIOR TO DELIVERY TO SITE. EXPOSED STEEL SHALL BE FINISHED AS FOLLOWS:

1. Pigmented Polyurethane over Epoxy System with shopcoat primer:
 - a. Prime Coat: Primer, rust-inhibitive, water based, MPI # 107; S-W Pro-Cyl Universal Primer, 866-310 Series, at 2.0 to 4.0 mils dry, per coat.
 - b. Intermediate Coat: Epoxy, high-build, low gloss, S-W Macropoxy 646-100, B58-600 Series, 8-73-620 Series, at 3.0 to 10.0 mils dry, per coat.
 - c. Topcoat: Polyurethane, two-component, pigmented, gloss, (Gloss Level 4); S-W Waterbased Acrolon 100 Polyurethane, 865-720 Series, at 2.0 to 4.0 mils dry, per coat.
B. COLOR: BENJAMIN MOORE- SATIN HC-167, "AMHERST GRAY".

PROVIDE CHANNELS OF SIZES AND SHAPES INDICATED. FABRICATE CONNECTIONS TO COMPLY WITH DETAILS SHOWN OR AS REQUIRED TO SUIT TYPE OF STRUCTURE INDICATED.

VERIFY ELEVATIONS OF CONCRETE- AND MASONRY-BEARING SURFACES AND LOCATIONS OF ANCHOR RODS, BEARING PLATES, AND OTHER EMBEDMENTS, PROCEED WITH INSTALLATION ONLY AFTER UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED. PROVIDE ALL NECESSARY BRACING AND SHORING FOR ERECTION, AND DO NOT REMOVE UNTIL FINAL ERECTION IS COMPLETE. ALL MEMBERS SHALL BE LEVEL AND PLUMB IN ACCORDANCE WITH THE DRAWINGS AND PROJECT CONDITIONS.

FABRICATE WITH EXPOSED SURFACES SMOOTH, SQUARE, AND FREE OF SURFACE BLEMISHES INCLUDING PITTING, RUST, SCALE, SEAM MARKS, ROLLER MARKS, ROLLED TRADE NAMES, AND ROUGHNESS.

REMOVE BLEMISHES BY FILLING OR GRINDING OR BY WELDING AND GRINDING, BEFORE CLEANING, TREATING, AND SHOP PRIMING.

BOLT HOLES: CUT, DRILL, OR PUNCH STANDARD BOLT HOLES PERPENDICULAR TO METAL SURFACES. PROVIDE HOLES REQUIRED FOR SECURING OTHER WORK TO STRUCTURAL STEEL AND FOR PASSAGE OF OTHER WORK THROUGH STEEL FRAMING MEMBERS. DO NOT THERMALLY CUT BOLT HOLES OR ENLARGE HOLES BY BURNING.

05-08 STRUCTURAL STEEL ANGLE LINTELS

GENERAL PRODUCTS
STRUCTURAL STEEL LINTELS

SUBMITTALS
SHOP DRAWINGS: SHOW FABRICATION OF STRUCTURAL STEEL COMPONENTS, INCLUDE DETAILS OF CUTS, CONNECTIONS, SPICES, CAMBER, HOLES, AND OTHER PERTINENT DATA, WITH EMBEDMENT DRAWINGS.

INDICATE WELDS BY STANDARD AWS SYMBOLS, DISTINGUISHING BETWEEN SHOP AND FIELD WELDS, AND SHOW SIZE, LENGTH, AND TYPE OF EACH WELD.

CONTRACTOR SHALL ASSURE THAT FABRICATOR, ERECTOR ARE CERTIFIED INSTALLERS TO PERFORM THE WORK, AND PROVIDE CERTIFICATION WITH SUBMITTAL.

EXECUTION
ALL STEEL LINTELS TO BE HOT-DIPPED GALVANIZED, WHEN PART OF THE LEG IS EXPOSED TO VIEW DUPLEX COAT LINTEL AND OVER THE GALVANIZING-PRIME LINTEL. PRIOR TO DELIVERY TO SITE, EXPOSED STEEL SHALL BE FINISHED SSPC-PAIN 25, TYPE 1, COLOR OF EXPOSED STEEL TO BE: BENJAMIN MOORE- SATIN HC-167, "AMHERST GRAY" OR AS SELECTED BY ARCHITECT.

PROVIDE LINTELS OF SIZES AND SHAPES INDICATED.

VERIFY ELEVATIONS OF CONCRETE- AND MASONRY-BEARING SURFACES AND LOCATIONS OF ANCHOR RODS, BEARING PLATES, AND OTHER EMBEDMENTS, PROCEED WITH INSTALLATION ONLY AFTER UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED.

PROVIDE ALL NECESSARY BRACING AND SHORING FOR ERECTION, AND DO NOT REMOVE UNTIL FINAL ERECTION IS COMPLETE. ALL MEMBERS SHALL BE LEVEL AND PLUMB IN ACCORDANCE WITH THE DRAWINGS AND PROJECT CONDITIONS.

FABRICATE WITH EXPOSED SURFACES SMOOTH, SQUARE, AND FREE OF SURFACE BLEMISHES INCLUDING PITTING, RUST, SCALE, SEAM MARKS, ROLLER MARKS, ROLLED TRADE NAMES, AND ROUGHNESS. REMOVE BLEMISHES BY FILLING OR GRINDING OR BY WELDING AND GRINDING, BEFORE CLEANING, TREATING, AND SHOP PRIMING.

BOLT HOLES: CUT, DRILL, OR PUNCH STANDARD BOLT HOLES PERPENDICULAR TO METAL SURFACES. PROVIDE HOLES REQUIRED FOR SECURING OTHER WORK TO STRUCTURAL STEEL AND FOR PASSAGE OF OTHER WORK THROUGH STEEL FRAMING MEMBERS. DO NOT THERMALLY CUT BOLT HOLES OR ENLARGE HOLES BY BURNING.

05-10 ANCHOR BOLTS

GENERAL PRODUCTS
ANCHOR BOLTS AS SHOWN ON STRUCTURAL DRAWINGS.

EXECUTION
ANCHOR BOLTS SHALL BE PLACED FOR 5' MINIMUM EMBEDMENT COVERAGE OR AS PER STRUCTURAL DRAWINGS (MOST STRINGENT CONDITIONS APPLY). PROVIDE: 5' MINIMUM UNLESS NOTED OTHERWISE ON STRUCTURAL DRAWINGS.

ANCHORS BOLTS SHALL BE MINIMUM OF 3/4" DIA. A307 TYPE BOLTS.

05-11 EXPANSION ANCHORS

GENERAL PRODUCTS
EXPANSION AS SHOWN ON STRUCTURAL DRAWINGS.

EXECUTION
EXPANSION ANCHORS SHALL BE PLACED FOR 5' MINIMUM EMBEDMENT COVERAGE OR AS PER STRUCTURAL DRAWINGS (MOST STRINGENT CONDITIONS APPLY).

ANCHORS BOLTS SHALL BE MINIMUM OF 3/4" DIA. A307 TYPE BOLTS.

05-18 STEEL GUARDRAILS & HAND RAILINGS

GENERAL PRODUCTS
STEEL AND ORNAMENTAL RAILINGS AS SHOWN ON DRAWINGS AND DETAILS.

STEEL AND ORNAMENTAL RAILINGS FINISH SHALL BE:

- A. Epoxy-Modified Latex System:
 - 1) Prime Coat: Primer, rust-inhibitive, water based, MPI # 107; S-W Pro-Cyl Universal Primer, 866-310 Series, at 2.0 to 4.0 mils dry, per coat.
 - 2) Intermediate Coat: Epoxy-modified latex, interior, gloss matching topcoat.
 - 3) Topcoat: Epoxy-modified latex, exterior, eggshell, (Gloss Level 3), MPI #254MPI #254K-Greens S Pro Industrial Waterbased Catalyzed Epoxy Eggshell, 875-300 Series, at 2.0 to 4.0 mils dry, per coat.
- B. COLOR: BENJAMIN MOORE- SATIN HC-167, "AMHERST GRAY" OR AS SELECTED BY INTERIOR DESIGNER.

BRACKETS, FLANGES, AND ANCHORS. SAME METAL AND FINISH AS SUPPORTED RAILS UNLESS OTHERWISE INDICATED.

TOP CAP TO BE INTERIOR: CONTINUOUS WOOD RAIL CAP WITH WOOD TO MATCH THAT OF WOOD FLOOR, FINISHED AS SELECTED BY INTERIOR DESIGNER.
EXTERIOR: CONTINUOUS COMPOSITE "TRUGRAN" RAIL CAP. SEE DETAIL FOR SIZE. FINISHED AS SELECTED BY ARCHITECT.

HANDRAILS AND GUARDRAILS SHALL MEET FOLLOWING DESIGN LOADS:
UNIFORM LOAD OF 50 LBF/ FT. APPLIED IN ANY DIRECTION.
CONCENTRATED LOAD OF 200 LBF APPLIED IN ANY DIRECTION.

TOP RAILS OF GUARDS:
UNIFORM LOAD OF 50 LBF/ FT. APPLIED IN ANY DIRECTION.
CONCENTRATED LOAD OF 200 LBF APPLIED IN ANY DIRECTION.

INFILL OF GUARDS:
CONCENTRATED LOAD OF 50 LBS APPLIED HORIZ. ON AN AREA OF 1 SQ. FT.
UNIFORM LOAD OF 25 LBF/SQ. FT. APPLIED HORIZONTALLY.

SUBMITTALS
FOR RAILINGS ASSEMBLED FROM STANDARD COMPONENTS, GROUT, ANCHORING CEMENT, AND PAINT PRODUCTS.

SHOP DRAWINGS: INCLUDE PLANS, ELEVATIONS, SECTIONS, DETAILS, AND ATTACHMENTS TO OTHER WORK.

SAMPLES: FOR EACH EXPOSED FINISH REQUIRED.

EXECUTION
HANDRAILS SHALL MEET THE FOLLOWING REQUIREMENTS, SEE I.R.C. SECTION R311.7.7:

A. HANDRAILS SHALL BE MOUNTED A MINIMUM OF 34 INCHES AND A MAXIMUM OF 38 INCHES ABOVE THE NOSING OF THE TREAD AND SHALL BE PROVIDED ON AT LEAST ONE SIDE OF STAIRWAYS. ALL REQUIRED HANDRAILS SHALL BE CONTINUOUS THE FULL LENGTH OF THE STAIRS WITH FOUR OR MORE RISERS. A POINT DIRECTLY ABOVE THE TOP RISER OF THE FLIGHT TO A POINT DIRECTLY ABOVE THE LOWEST RISER. ENDS SHALL BE RETURNED OR SHALL TERMINATE IN NEVEL POSTS, VOLUTES, TURNOUT OR STARTING FINISHES SHALL BE ALLOWED OVER THE LOWEST TREAD.

B. ALL REQUIRED HANDRAILS SHALL BE ONE OF THE FOLLOWING TYPES OF PROVIDE EQUIVANT GRASPABILITY:

1. TYPE I. HANDRAILS WITH A CIRCULAR CROSS SECTION SHALL HAVE AN OUTSIDE DIAMETER OF AT LEAST 1 1/2 INCHES (32 MM) AND NOT GREATER THAN 2 INCHES (51 MM). IF THE HANDRAIL IS NOT CIRCULAR, IT SHALL HAVE A PERIMETER DIMENSION OF AT LEAST 4 INCHES (102 MM) AND NOT GREATER THAN 6 1/4 INCHES (160 MM) WITH A MAXIMUM CROSS SECTION OF DIMENSION OF 2 INCHES (51 MM). EDGES SHALL HAVE A MINIMUM RADIUS OF 0.01 INCH (0.25 MM).
2. TYPE II. HANDRAILS WITH A PERIMETER GREATER THAN 6 1/4 INCHES (160 MM) SHALL HAVE A GRASPABLE FINGER RECESS AREA ON BOTH SIDES OF THE PROFILE. THE FINGER RECESS SHALL BEGIN WITHIN A DISTANCE OF 1/4 INCH (19 MM) MEASURED VERTICALLY FROM THE PORTION OF THE PROFILE AND ACHIEVE A DEPTH OF AT LEAST 5/16 INCH (8 MM) WITH 7/8 INCH (22 MM) BELOW THE WIDEST PORTION OF THE PROFILE. THE REQUIRED DEPTH SHALL CONTINUE FOR AT LEAST 3/8 INCH (10 MM) TO A LEVEL THAT IS NOT LESS THAN 1/4 INCHES (6.3 MM) BELOW THE TALLEST PORTION OF THE PROFILE. THE MINIMUM WIDTH OF THE HANDRAIL ABOVE THE RECESS SHALL BE 1 1/4 INCHES (32 MM) TO A MINIMUM RADIUS OF 0.01 INCH (0.25 MM).

C. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE OF NOT LESS THAN 1 1/2 INCHES BETWEEN THE WALL AND THE HANDRAIL.

05-37 MISC. METAL FABRICATIONS

GENERAL PRODUCTS
STEEL FABRICATIONS AS NOTED IN THE DRAWINGS AND AS FOLLOWS:

1. CHIMNEY COVER CHASE, FINISH AS NOTE #2 BELOW.
2. STEEL STAIR ELEMENTS, FINISH AS NOTE #1 BELOW.

SUBMITTALS
SHOP DRAWINGS: SHOW FABRICATION OF STEEL FABRICATIONS.

INCLUDE DETAILS OF CUTS, CONNECTIONS, SPICES, CAMBER, HOLES, AND OTHER PERTINENT DATA, WITH EMBEDMENT DRAWINGS.

INDICATE WELDS BY STANDARD AWS SYMBOLS, DISTINGUISHING BETWEEN SHOP AND FIELD WELDS, AND SHOW SIZE, LENGTH, AND TYPE OF EACH WELD.
INDICATE TYPE, SIZE, AND LENGTH OF BOLTS, BOLTS, NUTS, AND WASHERS. ASTM A 325, HEAVY HEX STEEL STRUCTURAL BOLTS; ASTM A 563 HEAVY HEX CARBON STEEL NUTS; AND ASTM F 436 HARDENED CARBON STEEL WASHERS.

CONTRACTOR SHALL ASSURE THAT FABRICATOR, ERECTOR ARE CERTIFIED INSTALLERS TO PERFORM THE WORK, AND PROVIDE CERTIFICATION WITH SUBMITTAL.

EXECUTION
FINISH: NOTE #1: PRIMED, PRIOR TO DELIVERY TO SITE. EXPOSED STEEL SHALL BE FINISHED AS FOLLOWS:

- A. Pigmented Polyurethane over Epoxy System with shopcoat primer:
 - 1) Prime Coat: Primer, rust-inhibitive, water based, MPI # 107; S-W Pro-Cyl Universal Primer, 866-310 Series, at 2.0 to 4.0 mils dry, per coat.
 - 2) Intermediate Coat: Epoxy, high-build, low gloss, S-W Macropoxy 646-100, B58-600 Series, 8-73-620 Series, at 3.0 to 10.0 mils dry, per coat.
 - 3) Topcoat: Polyurethane, two-component, pigmented, gloss, (Gloss Level 4); S-W Waterbased Acrolon 100 Polyurethane, 865-720 Series, at 2.0 to 4.0 mils dry, per coat.
B. COLOR: BENJAMIN MOORE- SATIN HC-167, "AMHERST GRAY".

NOTE#2: PROVIDE DUPLEX COATING OF HOT -DIPPED GALVANIZED AND COAT THE EXTERIOR SURFACE EXPOSED TO VIEW AS FOLLOWS:

- A. Water-based Light Industrial Coating System:
 - 1) Prime Coat: Primer, water-based, anti-corrosive for metal, MPI # 107; S-W Pro Industrial Pro-Cyl Universal Primer, 866-310 Series, 5.0 to 10.0 mils wet, 2.0 to 4.0 mils dry.
 - 2) Prime Coat: Shop primer specified in section where substrate is specified.
 - 3) Intermediate Coat: Light industrial coating, exterior, water based, matching topcoat.
 - 4) Topcoat: Light Industrial coating, exterior, water based, semi-gloss, (Gloss Level 5), MPI # 163-S-W Pro Industrial Acrylic Semi-Gloss Coating, 866-650 Series, at 2.5 to 4.0 mils dry, per coat.
- B. COLOR: BENJAMIN MOORE- SATIN HC-167, "AMHERST GRAY".

PROVIDE FABRICATIONS OF SIZES AND SHAPES INDICATED. FABRICATE CONNECTIONS TO COMPLY WITH DETAILS SHOWN OR AS REQUIRED TO SUIT TYPE OF STRUCTURE INDICATED.

VERIFY ELEVATIONS OF CONCRETE AND MASONRY-BEARING SURFACES AND LOCATIONS OF ANCHOR RODS, BEARING PLATES, AND OTHER EMBEDMENTS, PROCEED WITH INSTALLATION ONLY AFTER UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED. PROVIDE ALL NECESSARY BRACING AND SHORING FOR ERECTION, AND DO NOT REMOVE UNTIL FINAL ERECTION IS COMPLETE. ALL MEMBERS SHALL BE LEVEL AND PLUMB IN ACCORDANCE WITH THE DRAWINGS AND PROJECT CONDITIONS.

FABRICATE WITH EXPOSED SURFACES SMOOTH, SQUARE, AND FREE OF SURFACE BLEMISHES INCLUDING PITTING, RUST, SCALE, SEAM MARKS, ROLLER MARKS, ROLLED TRADE NAMES, AND ROUGHNESS.

REMOVE BLEMISHES BY FILLING OR GRINDING OR BY WELDING AND GRINDING, BEFORE CLEANING, TREATING, AND SHOP/HOLD WOOD FRAMING AWAY FROM CONCRETE FOUNDATION WALL 1/2 INCH.

BOLT HOLES: CUT, DRILL, OR PUNCH STANDARD BOLT HOLES PEPPINDICULAR TO METAL SURFACES. PROVIDE HOLES REQUIRED FOR SECURING OTHER WORK TO STRUCTURAL STEEL AND FOR PASSAGE OF OTHER WORK THROUGH STEEL FRAMING MEMBERS. DO NOT THERMALLY CUT BOLT HOLES OR ENLARGE HOLES BY BURNING.

05-55 CUSTOM STEEL STAIRS

GENERAL PRODUCTS
STAIR COMPONENTS AS FOLLOWS:

- STRINGERS
- 3" X 10" WOOD TREADS AS PER DETAILS.
- TREADS
- OPEN RISER THAT DOES NOT EXCEED 4"

SUBMITTALS
SHOP DRAWINGS: INCLUDE PLANS, ELEVATIONS, SECTIONS, DETAILS, AND ATTACHMENTS TO OTHER WORK.

EXECUTION
PROVIDE COMPLETE STAIR ASSEMBLIES, INCLUDING METAL FRAMING, HANGERS, STRUTS, RAILINGS, CLIPS, BRACKETS, BEARING PLATES, AND OTHER COMPONENTS NECESSARY TO JOIN AND ANCHOR STAIRS AND FINISHES ON SUPPORTING STRUCTURE. BOLTS SHALL BE FABRICATED AND 5/16" DIA BOLTS ARE NOT EXPOSED ON FINISHED SURFACES.

METAL SURFACES: GENERAL: PROVIDE MATERIALS WITH SMOOTH, FLAT SURFACES WITHOUT BLEMISHES.

FINISH: FACTORY PRIMED FOR A HIGH-PERFORMANCE COATING WITH COLOR AS SELECTED BY ARCHITECT.

PROVIDE METAL STAIRS CAPABLE OF WITHSTANDING THE EFFECTS OF GRAVITY LOADS AND THE FOLLOWING LOADS AND STRESSES WITHIN LIMITS AND UNDER CONDITIONS INDICATED: UNIFORM LOAD: 100 LB/ SFQ. FT. CONCENTRATED LOAD: 300 LBF APPLIED ON AN AREA OF 4 SQ. IN.

LIMIT DEFLECTION OF TREADS, PLATFORMS, AND FRAMING MEMBERS 1/8 INCH.

STRUCTURAL PERFORMANCE OF RAILINGS: PROVIDE RAILINGS CAPABLE OF WITHSTANDING THE EFFECTS OF GRAVITY LOADS AND STRESSES WITHIN LIMITS AND UNDER CONDITIONS INDICATED.

PROVIDE A MINIMUM OF 7'-6" HEAD CLEARANCE AT ALL POINTS.

DIVISION 6-WOOD, PLASTICS & COMPOSITES

06-01, 06-02, 06-03, 06-04, 06-05, 06-06 STUD WALL ROUGH FRAMING

GENERAL PRODUCTS
TIMBER BEAMS/COLUMNS/ TRUSSES/ROOF PURLINS/JAUNCHES AS SHOWN ON ARCHITECTURAL/STRUCTURAL DRAWINGS AND DETAILS.

TIMBER BEAMS TO BE #1 OR BETTER, KILN DRIED 15% MOISTURE OR LESS.

TIMBER TO BE: DOUG FIR
TIMBER TO BE: S4S

COLOR: STAINED WITH SHERMAN WILLIAMS SEMI-TRANSPARENT "HAWTHORNE"

SUBMITTALS
SHOP DRAWINGS: ALL TIMBER JOISTS SHALL BE SUBMITTED FOR APPROVAL PRIOR TO FABRICATION.

EXECUTION
TIMBER CONTRACTOR/GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL DIMENSIONS PRIOR TO FABRICATION OF TIMBERS. COORDINATE WITH ARCHITECTURAL/STRUCTURAL DRAWINGS FOR CONNECTIONS AT EACH TIMBER.

ALL JOINTS SHALL BE TRUE AND SQUARE WITH TOLERANCES OF LESS THAN 1/8" WITH JOINT.

06-32 WOOD DECKING
GENERAL PRODUCTS
WOOD DECKING AT ALL EXTERIOR DECKS/WALKWAYS

WOOD DECKING SHALL BE: "GOLF DECKING" BY TRUGRAN REYSITA

COLOR: AS SELECTED BY ARCHITECT

SUBMITTALS
SAMPLE OF ACTUAL SAMPLE WITH STAIN SAMPLE SELECTED FOR ARCHITECT APPROVAL.

EXECUTION
ATTACH WOOD DECKING TO FRAMING (SEE STRUCTURAL PLANS FOR SIZE) WITH HIDDEN FASTENER SYSTEM AS RECOMMENDED BY MANUFACTURER.

06-38 PLYWOOD/ OSB WALL SHEATHING

GENERAL PRODUCTS
WALL SHEATHING TO BE: 1/2" EXTERIOR GRADE A.P.A. RATED SHEATHING OR AS PER STRUCTURAL DRAWINGS. SHEATHING TO BE: EXTENT OF WALL SHEATHING AS SHOWN ON THE STRUCTURAL AND ARCHITECTURAL DRAWINGS. SHEATHING MAY BE FIRE-TREATED AS PER FIRE-RATED WALL REQUIREMENTS.

EXECUTION
NAILING OF SHEATHING SHALL BE PER STRUCTURAL DRAWINGS. COORDINATE WITH STRUCTURAL DRAWINGS FOR SHEAR WALL LOCATIONS.

PROVIDE BLOCKING AT ALL PANEL EDGES.

06-41 PLYWOOD/ OSB ROOF SHEATHING
GENERAL PRODUCTS
ROOF SHEATHING TO BE: 5/8" EXTERIOR GRADE A.P.A. RATED SHEATHING OR AS PER STRUCTURAL

EXTENT OF ROOF SHEATHING AS SHOWN ON THE STRUCTURAL AND ARCHITECTURAL DRAWINGS. SHEATHING MAY BE FIRE-TREATED AS PER FIRE-RATED WALL REQUIREMENTS.

EXECUTION
NAILING OF SHEATHING SHALL BE PER STRUCTURAL DRAWINGS, AND SHEATHING SHALL BE INSTALLED PERPENDICULAR TO ROOF JOISTS/TRUSSES.

PROVIDE BLOCKING AT ALL PANEL EDGES

COORDINATE WITH STRUCTURAL DRAWINGS FOR ALL HOLD DOWNS, HURRICANE TIES.

06-07, 06-08, 06-09 WOOD BLOCKING/FIREBLOCKING

GENERAL PRODUCTS
FIRE BLOCKING SHALL BE CONSTRUCTED OF 2" NOMINAL LUMBER OR (2) THICKNESS OF 1" NOMINAL LUMBER WITH BROKEN LAP JOINTS (R302.1.1) OR OTHER MATERIALS APPROVED OR TESTED, INSTALLED PER R302.1.1. FIRE BLOCKING SHALL BE PROVIDED AT LOCATIONS AS PER IRC.

EXECUTION
FIRE BLOCKING SHALL BE INSTALLED AT THE FOLLOWING LOCATIONS, CONTRACTOR SHALL COORDINATE THESE LOCATIONS:

- A. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FINISHED SPACES, AT THE CEILING AND FLOOR LEVELS AND AT 16' FOOT INTERVALS BOTH VERTICAL AND HORIZONTAL. (IRC 302.1.1 (1))
- B. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVE CEILINGS. (IRC 302.1.1 (2))

C. IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN AND BETWEEN STUDS, ALONG AND IN LINE WITH THE RUN OF STAIRS IF THE WALLS UNDER THE STAIRS ARE UNFINISHED. (IRC 302.1.1 (3) AND IRC 302.7)

D. IN OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS, PREPLACES AND SIMILAR OPENINGS WHICH AFFORD A PASSAGE FOR FIRE AT CEILING AND FLOOR LEVELS, WITH NON COMBUSTIBLE MATERIALS. (IRC 302.1.1 (4))

E. AT OPENINGS BETWEEN ATTIC SPACES AND CHIMNEY CHASES FOR FACTORY-BUILT CHIMNEYS. (IRC 302.1.1 (5))

F. WHERE WOOD SLEEPERS ARE USED FOR LAYING WOOD FLOORING ON MASONRY OR CONCRETE FIRE-RESISTIVE FLOORS. THE SPACE BETWEEN THE FLOOR S0 AND THE UNDERSIDE OF THE WOOD FLOORING SHALL BE FILLED WITH NON COMBUSTIBLE MATERIAL OR FIRE BLOCKED IN SUCH A MANNER THAT THERE WILL BE NO OPEN SPACES UNDER THE FLOORING WHICH WILL EXCEED 1000 SQUARE FEET IN AREA AND SUCH SPACE SHALL BE FILLED SOLIDLY UNDER ALL PERMANENT PARTITIONS SO THAT THERE IS NO COMMUNICATION UNDER THE FLOORING BETWEEN ADJOINING ROOMS. (IRC 302.1.2 (2))

G. WALLS HAVING PARALLEL OR STAGGERED STUDS FOR SOUND TRANSMISSION CONTROL SHALL HAVE FIRE BLOCKS OF MINERAL OR GLASS FIBER OR OTHER APPROVED NON-RIGID MATERIAL. (IRC 302.1.1 (11))

H. FIRE BLOCKING OF CORNICES OF A TWO-FAMILY DWELLING IS REQUIRED AT THE LINE OF THE DWELING UNIT SEPARATION. (IRC 302.1.1 (6))

06-15 WOOD FRAMING

GENERAL PRODUCTS
2X4 AND 2 X 6 DOUGLAS FIR, HEM FIR #2 OR BETTER WOOD STUDS AS SHOWN ON DRAWINGS.

EXECUTION
PROVIDE 2X WOOD STUDS AT 16" O.C. U.N.O.

PROVIDE 2X SOLID WOOD FIRE BLOCKING AT EVERY 10'-0", AND PROVIDE SOLID BLOCKING AT MID SPAN FOR ANY STUD EXCEEDING 10'-0" IN HEIGHT.

FOUNDATION PLATES OR SILLS AND SLEEPERS ON A CONCRETE OR MASONRY SLAB, WHICH IS IN DIRECT CONTACT WITH EARTH, AND OTHER EMBEDMENTS, PROCEED WITH INSTALLATION ONLY AFTER UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED. PROVIDE ALL MARKED OR BRANDED BY AN APPROVED AGENCY, WHERE NOT SUBJECT TO WATER SPLASH OR TO INTERIOR MOISTURE AND LOCATED ON CON

BUILDING KEYNOTES AND SPECIFICATIONS

DIVISION 7-THERMAL AND MOISTURE PROTECTION

07-45, 07-46, 07-47, 07-49, 07-50, 07-51, 07-52, 07-53, 07-54 THERMAL INSULATION

GENERAL PRODUCTS
SEE INSULATION SCHEDULE BELOW FOR LOCATION AND INSULATION REQUIREMENT

A PERMANENT CERTIFICATE SHALL BE POSTED ON OR IN THE ELECTRICAL DISTRIBUTION PANEL LISTING THE PREDOMINANT R-VALUES OF INSULATION INSTALLED IN OR ON THE CEILING/ROOF, WALLS, FOUNDATION SLAB, BASEMENT WALLS, CRAWL SPACE WALLS AND/OR FLOOR, AND THE DUCTS OUTSIDE THE CONDITIONED SPACE. U-FACTORS OF THE WINDOWS, THE TYPE OF HEATING AND EFFICIENCY OF HEATING AND WATER HEATING EQUIPMENT SHALL ALSO BE LISTED. (I.R.C. N1101.8)

LOCATION	TYPE	THICKNESS	R-VALUE
SLAB ON GRADE	FOAM-IN-PLACE	2"	R-10

INSTALL UNDER HEATED SLAB ON GRADE LOCATIONS. OWENS CORNING FORMULA 250

FINISHER OF FOUNDATION	RIGID	F'	R-10
------------------------	-------	----	------

INSTALL ON INSIDE FACE OF EXTERIOR FOUNDATION FROM TOP OF FOOTING TO BOTTOM OF CONCRETE SLAB AT LIVING SPACE-BURIED -OWENS CORNING FORMULA 250

FLOOR INSULATION	VERIFY	R-30
------------------	--------	------

FLOOR OVER UNHEATED BASEMENT UNFACED BATS

FLOOR UNDER RADIANT HEAT	UNFACED	12"	R-38
--------------------------	---------	-----	------

FLOOR OVER OUTSIDE OR UNHEATED AIR

FLOOR INSULATION	VERIFY	R-38
------------------	--------	------

WALL INSULATION AT EXTERIOR FRAMED WALLS	2X WOOD EXTERIOR WALLS BLOWN-IN (DOWN TO BE CERTAINEED OPTIMA BLOWN-IN BB SYSTEM)	5 1/2"	R-22.5
	2 X 4 WOOD FURRED-EXTERIOR WALLS CLOSED-CELL FOAM (CERTAINEED Certastopw/ with 22 pcf and R-value of 4.5 per inch)	3 1/2"	R-22.75

ROOF INSULATION	VERIFY	R-60
-----------------	--------	------

ROOF AT SHALL OWER JOISTS: MULTI-LAYERS OF CONTINUOUS RIGID INSULATION WITH TOP LAYER OF NAILABLE RIGID INSULATION (HUNTER H-SHIELD PANELS) PLUS FULL FULL DEPTH OF JOIST CAVITY (CERTAINEED OPTIMA BLOWN-IN BB SYSTEM)

ROOF AT DEEPER JOISTS:	VERIFY	R-24.5
MULTI-LAYERS OF CONTINUOUS RIGID INSULATION WITH TOP LAYER OF NAILABLE RIGID INSULATION (HUNTER H-SHIELD PANELS) PLUS FULL FULL DEPTH OF JOIST CAVITY (CERTAINEED OPTIMA BLOWN-IN BB SYSTEM)		R-24.5

ROOF AT DEEPER JOISTS:	VERIFY	R-30.0
MULTI-LAYERS OF CONTINUOUS RIGID INSULATION WITH TOP LAYER OF NAILABLE RIGID INSULATION (HUNTER H-SHIELD PANELS) PLUS FULL FULL DEPTH OF JOIST CAVITY (CERTAINEED OPTIMA BLOWN-IN BB SYSTEM)		R-30.0

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

MECHANICAL TYPE ROOMS WALLS AND CEILING(S) WHERE APPLICABLE	SOUND	BATS	5"	R19
---	-------	------	----	-----

BATHROOMS SOUND BATS	SOUND	BATS	5"	R19
----------------------	-------	------	----	-----

07-133 WOOD SIDING

GENERAL PRODUCTS
HORIZONTAL SIDING: 1/8" SHIP-LAP JOINTED (WITH 1/4" REVEAL) HORIZONTAL SIDING. TO BE CLEAR CEDAR STAINED SEMI-TRANSPARENT WITH SHERMAN WILLIAMS OR EQUAL. COLOR- CEDAR BARK.

VERTICAL SIDING: 1/8" SHIP-LAP JOINTED (WITH 1/8" REVEAL) VERTICAL SIDING. TO BE CLEAR CEDAR STAINED SEMI-TRANSPARENT WITH SHERMAN WILLIAMS OR EQUAL. COLOR- "CROSSGRADES"

SUBMITTALS	PROVIDE 12" X 12" SAMPLE OF EACH SIDING SPECIFIED WITH COLOR SPECIFIED.
------------	---

EXECUTION
FOLLOW INSTALLATION INSTRUCTIONS SPECIFIED BY THE PRODUCT MANUFACTURER.

EXAMINE SUBSTRATES FOR COMPLIANCE WITH REQUIREMENTS FOR INSTALLATION TOLERANCES AND OTHER CONDITIONS AFFECTING PERFORMANCE OF SIDING AND RELATED ACCESSORIES, AND PROCEED WITH INSTALLATION ONLY AFTER UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED. AS FOR THE VERTICAL SIDING PROVIDE HORIZONTAL BLOCKING AT ALL LOCATIONS AS REQUIRED BY MNFR. RECOMMENDATIONS.

INSTALL EXTERIOR SIDING FINISH OVER EXTERIOR WALL VENTILATION MATRIX OVER BUILDING WEATHER BARRIER AS PER MANUFACTURE SPECIFICATIONS AND INDUSTRY STANDARDS.

SEE STRUCTURAL NOTES FOR DIAPHRAGM NAILING, HURRICANE Tie HOLD-DOWNS.

CLEAR FINISHED SURFACES ACCORDING TO MANUFACTURERS WRITTEN INSTRUCTIONS AND MAINTAIN IN A CLEAN CONDITION DURING CONSTRUCTION.

COORDINATE WITH RELATED TRADES, SCRIBE AND COPE SIDING BOARDS FOR ACCURATE FIT. ALLOW INSTALLATION OF RELATED WORK TO AVOID CUTTING AND PATCHING.

SELECT SIDING BOARDS OF LONGEST POSSIBLE LENGTHS. DISCARD BOARDS THAT ARE WARPED, TWISTED, BOWED, CROOKED OR OTHERWISE DEFECTIVE.

INSTALLATION MUST COMPLY WITH LOCAL BUILDING CODES AND REGULATIONS.

FINISH MATERIALS ON ALL SIDES AND ENDS. APPLY TOUCH-UP COATING ON NEW CUTS. FACTORY PRIMED OR FINISHING IS PREFERRED.

EXPLAIN PROPER MAINTENANCE PROCEDURES TO OWNER OR OWNER'S REPRESENTATIVE AT PROJECT CLOSOUT.

THE USE OF PRESSURE WASHERS IS NOT RECOMMENDED.

07-155 SINGLE-PLY TPO DECK MEMBRANE

GENERAL PRODUCTS
PROVIDE INSTALLED ROOFING MEMBRANE AND FLASHINGS THAT REMAIN WATERIGHT; DO NOT PERMIT THE PASSAGE OF WATER AND RESIST SPECIFIED UPURT PRESSURES. THERMALLY INDUCED MOVEMENT AND EXPOSURE TO WEATHER WITHOUT FAILURE.

PROVIDE ROOFING MATERIALS THAT ARE COMPATIBLE WITH ONE ANOTHER UNDER SERVICE AND APPLICATION REQUIREMENTS AS DEMONSTRATED BY ROOFING MEMBRANE MANUFACTURER BASED ON TESTING AND FIELD EXPERIENCE.

ROOF SYSTEM DESIGN AND SUCCESSFULLY TESTED BY A QUALIFIED TESTING AND INSPECTING AGENCY TO WITHSTAND UPURT FORCES AS CALCULATED USING THE CURRENT VERSION OF ASCE 7.

ROOF SYSTEM WILL ACHIEVE A UL FIRE RATING WITHIN IN ACCORDANCE WITH UL-790 AS REQUIRED BY LOCAL BUILDING CODE. MINIMUM RATINGS SHALL BE A UL CLASS B RATINGS.

PROVIDE A ROOF SYSTEM WITH POSITIVE DRAINAGE WHERE ALL STANDING WATER DSSIPATES AFTER PRECIPITATION ENDS.

BUILDING CODES: ROOF SYSTEM WILL MEET THE REQUIREMENTS OF ALL FEDERAL, STATE AND LOCAL CODE BOODIES HAVING JURISDICTION.

MANUFACTURER WITH A MINIMUM OF TEN YEARS EXPERIENCE IN THE MANUFACTURING OF SINGLE-PLY HEAT WELDABLE MEMBRANES.

ROOFING CONTRACTOR SHALL BE AUTHORIZED BY ROOFING SYSTEM MANUFACTURER TO INSTALL ASSEMBLY; PROVIDE LETTER ON MANUFACTURERS LETTERHEAD OF AUTHORIZED STATUS OF CONTRACTOR.

PROVIDE ROOFING SYSTEM THAT IS LISTED ON THE DOE'S ENERGY STAR ROOF PRODUCTS QUALIFIED PRODUCT LIST FOR LOW-SLOPE ROOF APPLICATIONS.

ACCEPTABLE MANUFACTURER: FIBREIT/LOW ROOFING SYSTEMS, CARLISLE ROOFING, OR APPROVED EQUIV. REQUESTS FOR SUBSTITUTIONS WILL BE CONSIDERED IN ACCORDANCE WITH PROVISIONS OF SUBSTITUTION MATERIALS.

ROOFING MEMBRANE SHALL BE MANUFACTURED WITH THE FOLLOWING PROPERTIES:

A. MEMBRANE TYPE, KEE

B. MEMBRANE THICKNESS: 30 MIL.

C. CORE: REINFORCED EPOXY/FRIBOND

D. FLASHINGS MEMBRANE SHALL: 0.60MM (1/2MM) THICK REINFORCED MEMBRANE FOR WALLS AND CURBS REGARDLESS OF ROOF COVER SHEET THICKNESS. SHALL BE .600 INCH (1/2 MM) THICK UNSUPPORTED MEMBRANE FOR FIELD-FABRICATED DETAILS USED FOR MAKING FLED FLASHINGS THAT REQUIRE HIGHER EXTRUSIBILITY THAN IS ALLOWED WITH SCRIB-REINFORCED MEMBRANE.

E. COVER BOARD; DENSEDEK ROOF BOARD; G P GYPSUM CORPORATION 1/2 INCH (1/2 MM) DENSEDEK ROOF BOARD. GLASS MAT FACED GYPSUM WITH SPECIALLY TREATED GYPSUM CORE THAT RESISTS MOISTURE AND MILD GROWTH.

SUBMITTALS
PRODUCT DATA, INCLUDING MANUFACTURERS DATA SHEETS ON EACH PRODUCT TO BE USED; PREPARATION INSTRUCTIONS AND RECOMMENDATIONS; STORAGE AND HANDLING REQUIREMENTS AND RECOMMENDATIONS; AND INSTALLATION METHODS.

SAMPLES FOR VERIFICATION FOR THE FOLLOWING PRODUCTS INCLUDING MANUFACTURERS STANDARD SAMPLE SIZE OF SHEET ROOFING OF COLOR SPECIFIED; MANUFACTURERS STANDARD SAMPLE SIZE OF ROOF INSULATION; MANUFACTURERS STANDARD SAMPLE SIZE OF WALKWAY PADS OR ROLLS.

SHOP DRAWINGS INCLUDING OUTLINE AND SIZE OF THE ROOF, LOCATION AND TYPE OF PENETRATIONS, PERIMETER AND PENETRATION FLASHING DETAIL REFERENCES TO MANUFACTURERS STANDARD, DETAILS WHICH DO NOT CONFORM TO ROOFING MANUFACTURERS STANDARDS SHALL BE IDENTIFIED WITH SEPARATE APPROVAL FROM ROOFING MANUFACTURER. DETAILS TO BE EMPLOYED ON THE PROJECT SHALL BE APPROVED BY ROOFING MANUFACTURER.

SUBMIT WARRANTY CERTIFICATION FROM MANUFACTURER OF APPROVAL OF PROJECT DESIGN AND INTENT TO ISSUE WARRANTY, AND FASTENER PULL TESTS FROM AN INDEPENDENT TESTING AGENCY SHALL BE APPROVED BY THE ROOFING MANUFACTURER.

EXECUTION
DO NOT BEGIN INSTALLATION UNTIL SUBSTRATES HAVE BEEN PROPERLY PREPARED. HAZELDS AND BLOCKING SHALL BE INSTALLED LEVEL, TRUE TO LINE AND ELEVATION, SECURED TO ROOF STRUCTURE TO RESIST ROOF INSTALLATION AND SERVICE CONDITIONS. IF SUBSTRATE PREPARATION IS THE RESPONSIBILITY OF ANOTHER INSTALLER, NOTIFY ARCHITECT OF UNSATISFACTORY PREPARATION BEFORE PROCEEDING. SURFACES TO BE BONDED SHALL BE DRY, CLEAN AND FREE OF DEBRIS. SUITABLE SURFACES ARE USUALLY CONSIDERED TO BE SMOOTH, CURED MASONRY, WOOD AND METAL, PLUS INSULATION BOARDS FASTENED PER THE SPECIFIC MANUFACTURERS RECOMMENDATIONS FOR RECEIVING ADHESIVE ROOFING MEMBRANES.

ALL FASTENERS SHOULD BE INSTALLED WITH A DEPTH-SENSING SCREW GUN TO PREVENT OVER DRIVING OR UNDER DRIVING. BLOCK OFF OR SHUT DOWN POSITIVE PRESSURE BUILDING VENTILATION SYSTEMS DURING APPLICATION TO PREVENT SHEET FROM BLOWING DURING APPLICATION.

VERIFY ALL ROOFING MECHANICAL UNITS ARE TO HAVE THEIR CONDENSATION LINES PIPED TO DRAINS, OR OFF THE ROOF WITH RAINWOOD MUST BE EXTERIOR GRADE WITH AN A OR B FINISH SIDE UP AND WITH NO JOINTS GAPPED GREATER THAN 1/4 INCH, AND PREPARE SURFACES USING THE METHODS RECOMMENDED BY THE MANUFACTURER FOR ACHIEVING THE BEST RESULT FOR THE SUBSTRATE UNDER THE PROJECT CONDITIONS.

PROVIDE TYPICAL BALLAST IN PARTIALLY COMPLETED SECTIONS TO CONTROL WIND EFFECTS DURING CONSTRUCTION.

07-164 METAL SHEET BATTEN-SEAM ROOFING

07-164 METAL SHEET BATTEN-SEAM ROOFING
GENERAL PRODUCTS
ARCHITECTURAL METAL ROOFING: BONDERIZED METAL
MFC- MANUFACTURE
COLOR TO MATCH BERLINMAN MOORE HC-167 "AMHERST GRAY".
DETAILS- CRAFTSMAN SERIES S8

SECONDARY ROOFING MEMBRANE - GRACE ICE & WATER SHIELD HD

SUBMITTALS
SAMPLES FOR VERIFICATION OF SHINCLES SIZE AND COLOR
WARRANTIES, SAMPLE OF SPECIAL WARRANTIES.

EXECUTION
ROOFING AND RELATED ITEMS TO BE INSTALLED AS PER MANUFACTURER

ROOFING TO BE INSTALLED OVER SECONDARY ROOFING MEMBRANE (ENTIRE ROOFING SURFACE)

ROOFING SYSTEM TO BE INSTALLED OVER EXTERIOR GRADE A P.A. RATED SHEATHING (RUN PERPENDICULA BATTERS) OVER ROOF FRAMING AS PER STRUCTURAL PLANS.

SEE STRUCTURAL NOTES FOR DIAPHRAGM NAILING, HURRICANE Tie HOLD-DOWNS.

07-170, 171, 172, 173, 174, 175, 176, SHEET METAL FLASHING AND TRIM

GENERAL PRODUCTS
APPROVED CORROSION RESISTANT FLASHING SHALL BE PROVIDED IN THE EXTERIOR WALL ENVELOPE IN SUCH A MANNER AS TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS.

VALLEY FLASHING
DRIP METAL
WINDWOOD HEAD FLASHING
DOOR HEAD FLASHING
TRANSITIONAL FLASHING

SUBMITTALS
VERIFY ALL DOOR ROUGH OPENINGS BEFORE ORDERING
PROVIDE WARRANTY INFORMATION FOR GLAZING, WOOD COMPONENTS, HARDWARE, CLADDING, AND EXTERIOR PAINT FINISH (ADHESION, CHALK, AND FADE)

EXECUTION
FOLLOW INSTALLATION LAYOUTS OF SHEET METAL FLASHING AND TRIM, INCLUDING PLANS, ELEVATIONS, EXPANSION/JOINT LOCATIONS, AND KEYED DETAILS. DISTINGUISH BETWEEN SHOP- AND FIELD-ASSEMBLED WORK.

BUILDING KEYNOTES AND SPECIFICATIONS

DIVISION 10- SPECIALTIES

10-99 BATH HARDWARE

GENERAL PRODUCTS
EXTENT OF BATHROOM HARDWARE INDICATED ON INTERIOR DESIGN DRAWINGS NOT INCLUDED WITHIN ARCHITECTURAL DRAWINGS.
OWNER/CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE WITH INTERIOR DESIGNER FOR ALL FINISH ITEMS.
COMPLETE INSTALLATION DETAILS ARE THE RESPONSIBILITY OF THE INTERIOR DESIGNER AND TO REVIEW ALL MATERIAL AND SUBMITTALS FOR CODE COMPLIANCE AND APPROVAL.
SUBMITTALS
PROVIDE HARDWARE SPECIFICATION CUT SHEETS FOR APPROVAL BY ARCHITECT/INTERIOR DESIGNER AND OWNER PRIOR TO ORDERING.
EXECUTION
INSTALL ACCESSORIES ACCORDING TO MANUFACTURER'S WRITTEN INSTRUCTIONS, USING FASTENERS APPROPRIATE TO SUBSTRATE INDICATED AND RECOMMENDED BY UNIT MANUFACTURER. INSTALL UNITS LEVEL, PLUMB, AND FIRMLY ANCHORED IN LOCATIONS AND AT HEIGHTS INDICATED.

DIVISION 11- EQUIPMENT

11-32 FIREPLACES

GENERAL PRODUCTS
GAME ROOM FIREPLACE TO BE: MONITGO P-SERIES SEALED GAS - SEE ID DRAWINGS (TOP VENT TO EXTERIOR WALL)
GREAT ROOM FIREPLACE TO BE: MONITGO P-SERIES SEALED GAS - SEE ID DRAWINGS (TOP VENT TO CHIMNEY CHASE)
MASTER BEDROOM FIREPLACE TO BE: MONITGO PANORAMA 3-SIDED GLASS CUSTOM SEALED GAS - SEE ID DRAWINGS (REAR-VENT TO EXTERIOR WALL)

SUBMITTALS
SUBMIT CUT SHEETS FOR EACH APPLIANCE SPECIFIED.
EXECUTION
BEDROOM APPLICATIONS: PROVIDE SEALED GLASS DOORS.

ALL WOOD BURNING FIREPLACES (EXCEPT IN BEDROOM APPLICATIONS); TO BE PROVIDED WITH GAS STARTERS

GAS LOG FIREPLACES SHALL BE PROVIDED WITH A SHUT OFF VALVE LOCATED OUTSIDE OF THE FIREBOX AND WITHIN 6" OF THE APPLIANCE, UNLESS APPROVED BY THE FIREPLACE MANUFACTURER.

GAS LIGHTERS ARE USED. FLUES MUST BE PERMANENTLY HELD OPEN.

ALL GAS LOGS, LIGHTERS OR FIREPLACES REQUIRE OUTSIDE COMBUSTION AIR.

ALL FLUES MUST EQUAL 1 SQUARE INCH PER 1000 BTUS.

ALL ROOMS WHERE GAS LOGS, LIGHTERS, OR FIREPLACES ARE INSTALLED MUST EQUAL 50 CUBIC FEET OF VOLUME PER 1000 BTU'S IN ADDITION TO THE REQUIREMENT FOR OUTSIDE AIR.

PROVIDE FLUES, COMBUSTION AIR SPARK ARRESTOR, CLEARANCES, AND ETC. AS PER MANUFACTURER'S RECOMMENDATIONS.

PROVIDE CHIMNEY CAP FLASHING AND SURROUND. (SEE SECTION 07-34) THE CONTRACTOR SHALL BE RESPONSIBLE TO VERIFY AND FOLLOW ALL MANUFACTURER'S REQUIREMENTS FOR INSTALLATION OF FIREPLACE EQUIPMENT, INCLUDING FINISH MATERIALS SUCH AS HEARHS, MANTLES, AND OTHER COMBUSTIBLE PROJECTIONS, ETC. AND PROVIDE PROPER SETBACKS, CLEARANCES, AND PROTECTION.

THE CHIMNEY TERMINATION MUST EXTEND AT LEAST 2 FEET HIGHER THAN ANY PORTION OF THE BUILDING WITHIN 10 FEET. AT WOOD BURNING FIREPLACES, AS REQUIRED BY I.R.C. G242.5.3.

11-34 RESIDENTIAL APPLIANCES

GENERAL PRODUCTS
RESIDENTIAL APPLIANCES AS SELECTED BY INTERIOR DESIGNER.

SUBMITTALS
PRODUCT DATA FOR EACH TYPE OF PRODUCT INDICATED.
APPLIANCE SCHEDULE: USE SAME DESIGNATIONS INDICATED ON DRAWINGS

GAS-BURNING APPLIANCES: COMPLY WITH ANS Z21 SERIES STANDARDS.

RESIDENTIAL APPLIANCES: COMPLY WITH NAECA STANDARDS.

EXECUTION
INSTALLER QUALIFICATIONS: AN EMPLOYER OF WORKERS TRAINED AND APPROVED BY MANUFACTURER FOR INSTALLATION AND MAINTENANCE OF UNITS REQUIRED FOR THIS PROJECT
PROVIDE CLEARANCE FROM APPLIANCES TO COMBUSTIBLE MATERIALS AS PER MANUFACTURER'S INSTALLATION REQUIREMENTS. PROVIDE MINIMUM CLEARANCE OF 30" ABOVE COOKING TOP TO COMBUSTIBLE MATERIALS. (I.R.C. M1306 & M1901)

INSTALL ACCESSORIES ACCORDING TO MANUFACTURER'S WRITTEN INSTRUCTIONS, USING FASTENERS APPROPRIATE TO SUBSTRATE INDICATED AND RECOMMENDED BY UNIT MANUFACTURER. INSTALL UNITS LEVEL, PLUMB, AND FIRMLY ANCHORED IN LOCATIONS AND AT HEIGHTS INDICATED.

BUILT-IN EQUIPMENT: SECURELY ANCHOR UNITS TO SUPPORTING CABINETS OR COUNTERTOPS WITH CONCEALED FASTENERS. VERIFY THAT CLEARANCES ARE ADEQUATE FOR PROPER FUNCTIONING AND ROUGH OPENINGS ARE COMPLETELY CONCEALED.

FREESTANDING EQUIPMENT: PLACE UNITS IN FINAL LOCATIONS AFTER FINISHES HAVE BEEN COMPLETED IN EACH AREA. VERIFY THAT CLEARANCES ARE ADEQUATE TO PROPERLY OPERATE EQUIPMENT.

11-42 PROJECTION SCREENS

GENERAL PRODUCTS
EXTENT OF PROJECTION SCREENS ARE INDICATED ON INTERIOR DESIGN DRAWINGS NOT INCLUDED WITHIN ARCHITECTURAL DRAWINGS

OWNER/CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE WITH INTERIOR DESIGNER FOR ALL FINISH ITEMS.
COMPLETE INSTALLATION DETAILS ARE THE RESPONSIBILITY OF THE INTERIOR DESIGNER AND TO REVIEW ALL MATERIAL AND SUBMITTALS FOR CODE COMPLIANCE AND APPROVAL.

DIVISION 12- FURNISHINGS

12-27 WOOD KITCHEN CABINETS

GENERAL PRODUCTS
EXTENT OF CABINETS AS SHOWN ON INTERIOR FINISH PLANS AND DRAWINGS.

SEE INTERIOR ELEVATIONS FOR DESIGN OF CABINETS

COORDINATE WITH CABINET FINISH SCHEDULE FOR FINISH OF ALL CABINETS.

SUBMITTALS
CABINET SUPPLIER SHALL PROVIDE SHOP DRAWINGS FOR EACH CABINET FOR APPROVAL BY ARCHITECT/INTERIOR DESIGNER/OWNER PRIOR TO FABRICATION OF CABINET.

PROVIDE 12 X 12 SAMPLE OF EACH CABINET FINISH SPECIFIED FOR APPROVAL.

PROVIDE 1 DOOR SAMPLE FOR EACH DOOR TYPE SPECIFIED FOR APPROVAL.

12-40 STONE COUNTERTOPS

GENERAL PRODUCTS
EXTENT OF STONE COUNTERTOPS AS SHOWN ON INTERIOR FINISH PLANS AND DRAWINGS.

SUBMITTALS
SAMPLES FOR EACH STONE TYPE INDICATED. IN SETS OF SAMPLES NOT LESS THAN 12 INCHES SQUARE. INCLUDE TWO OR MORE SAMPLES IN EACH SET AND SHOW THE FULL RANGE OF VARIATIONS IN APPEARANCE CHARACTERISTICS EXPECTED IN COMPLETED WORK.

EXECUTION
USE ONLY ADHESIVES FORMULATED FOR STONE AND CERAMIC TILE AND RECOMMENDED BY THEIR MANUFACTURER FOR THE APPLICATION INDICATED. EXAMINE SUBSTRATES INDICATED TO RECEIVE STONE COUNTERTOPS AND CONDITIONS UNDER WHICH STONE COUNTERTOPS WILL BE INSTALLED, WITH INSTALLER PRESENT, FOR COMPLIANCE WITH REQUIREMENTS FOR INSTALLATION TOLERANCES AND OTHER CONDITIONS AFFECTING PERFORMANCE.

SET STONE TO COMPLY WITH REQUIREMENTS INDICATED ON DRAWINGS AND SHOP DRAWINGS. SHIM AND ADJUST STONE TO LOCATIONS INDICATED, WITH UNIFORM JOINTS OF WIDTHS INDICATED AND WITH EDGES AND FACES ALIGNED ACCORDING TO ESTABLISHED RELATIONSHIPS AND INDICATED TOLERANCES

REMOVE AND REPLACE STONE COUNTERTOPS OF THE FOLLOWING DESCRIPTION: BROKEN, CHIPPED, STAINED, OR OTHERWISE DAMAGED STONE, DEFECTIVE COUNTERTOPS, DEFECTIVE JOINTS, INCLUDING MISALIGNED JOINTS, INTERIOR STONE COUNTERTOPS AND JOINTS NOT MATCHING APPROVED SAMPLES AND MOCKUPS.

CLEAN STONE COUNTERTOPS NOT LESS THAN TWO DAYS AFTER COMPLETION OF INSTALLATION, USING CLEAN WATER AND SOFT BRAS. APPLY STONE SEALER TO COMPLY WITH STONE PRODUCERS AND SEALER MANUFACTURER'S WRITTEN INSTRUCTIONS.

ONE AND TWO FAMILY DWELLINGS AND MANUFACTURED HOMES AS DEFINED BY NFA 130.

UNDERGROUND WATER PRESSURE SERVICE AS DEFINED BY NFPA 24.

ALL SUPPLY, WASTE, & GAS LINE MATERIALS, WORKMANSHIP, AND INSTALLATION AS PER INDUSTRY STANDARDS. ALL WATER LINES TO BE TYPE 1; HARD DRAWN COPPER OR POLYETHYLENE CROSS-LINK PIPING FOR ABOVE GROUND APPLICATIONS OR APPROVED EQUAL. PROVIDE TYPE "X" COPPER OR POLYETHYLENE CROSS-LINK PIPING FOR UNDERGROUND. PROVIDE CONTINUOUS LINE WITH NO JOINTS FOR UNDERGROUND APPLICATIONS, UNLESS APPROVED. ALL FITTINGS TO BE COPPER WITH SWEAT SOLDER JOINTS FOR COPPER PIPING OR BRASS FITTINGS WITH COMPRESSION BOLTS FOR POLY PIP. ALL WASTE LINES TO BE PVC OR ABS PLASTIC PIPE.

WASTE LINES SHALL BE PROVIDED WITH A CLEAN OUT AS REQUIRED. EXTEND CLEAN OUTS TO ACCESSIBLE SURFACE. DO NOT PLACE CLEAN OUTS IN FLOOR UNLESS APPROVED.

PLUMBING CONTRACTOR SHALL PROVIDE A TURN OFF VALVE AND DRAIN AT THE LOWEST LEVEL OF THE FACILITY. ALL FIXTURES SHALL BE ABLE TO DRAIN AT THIS POINT. PROVIDE FLOOR DRAIN AT LOCATION OF PLUMBING SYSTEM DRAIN.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

DIVISION 21 - FIRE SUPPRESSION

21-01 FIRE SPRINKLERS

GENERAL PRODUCTS
DESCRIPTION

THE PROJECT SHALL HAVE FULL NFPA 72 SPRINKLER SYSTEM INSTALLED THROUGH OUT AS REQUIRED.

CPVC FIRE SPRINKLER PIPE AND FITTINGS ARE EXTRUDED/MOLDED FROM CPVC COMPOUNDS MANUFACTURED BY ULTRON. ADVANCED MATERIALS OR EQUAL. THE PIPE AND FITTING COMPOUNDS SHALL MEET CELL CLASS 23547 AND 24447 RESPECTIVELY, AS DEFINED BY ASTM D1784, AND SHALL BE CERTIFIED BY NSF INTERNATIONAL FOR USE WITH POTABLE WATER. BOTH PIPE AND FITTING COMPOUNDS SHALL BE PRESSURE RATED BY PLASTICS PIPE INSTITUTE (PPI).

PIPE AND FITTINGS

PIPE SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM F442 IN STANDARD DIMENSION RATIO (SDR) 13.5.

FITTINGS SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM F437 (SCHEDULE 80 THREADED), ASTM F438 (SCHEDULE 40 SOCKET) AND ASTM F439 (SCHEDULE 160 SOCKET).

BOTH PIPE AND FITTINGS SHALL BE LISTED BY UNDERWRITERS LABORATORIES FOR USE IN WET AUTOMATIC FIRE SPRINKLER SYSTEMS AND SHALL

BEAR THE LOGO OF THE LISTING AGENCY. SEE UL FIRE PROTECTION EQUIPMENT DIRECTORY, CATEGORIES V1M7 AND HP18.

ANCILLARY PRODUCTS COMING INTO CONTACT WITH PIPE AND FITTINGS MUST BE CHEMICALLY COMPATIBLE AS DETERMINED BY CPVC PIPE AND FITTINGS MANUFACTURER OR COMPOUND MANUFACTURER, AND LISTED ON PIPE, FITTINGS OR COMPOUND MANUFACTURER'S CHEMICAL COMPATIBILITY PROGRAM (I.E. IGG/8M/CTM) SYSTEM COMPATIBLE PROGRAM).

SOLVENT CEMENT

ALL SOCKET TYPE JOINTS SHALL BE MADE UP EMPLOYING SOLVENT CEMENTS THAT MEET OR EXCEED THE REQUIREMENTS OF ASTM F493. THE STANDARD PRACTICE FOR SAFE HANDLING OF SOLVENT CEMENTS SHALL BE IN ACCORDANCE WITH ASTM F492. SOLVENT CEMENT SHALL BE LISTED BY NSF INTERNATIONAL FOR USE WITH POTABLE WATER, AND APPROVED BY THE MANUFACTURER. THE SOLVENT CEMENTS SHALL BE COMPATIBLE WITH THEIR CPVC PIPE AND FITTINGS.

FOLLOW MANUFACTURER'S INSTRUCTIONS FOR SET AND CURE TIMES FOR SOLVENT CEMENT JOINTS. AVOID SIGNIFICANT STRESSES DURING SET AND CURE TIMES. DO NOT APPLY ANY STRESS THAT WILL DISTURB AN UNCURED JOINT. SPRINKLER FITTINGS SHALL BE ALLOWED TO CURE IN ACCORDANCE WITH THE MANUFACTURER'S GUIDELINES AND THE CONTRACTOR SHALL ASSURE THE OUTLETS ARE CLEAR OF ANY EXCESS CEMENT PRIOR TO INSTALLING SPRINKLERS.

BASIC USE

CPVC PIPE AND FITTINGS SHALL BE LISTED BY UL AND ALSO EITHER UL-C OR UL-F FOR USE IN:

ONE AND TWO FAMILY DWELLINGS AND MANUFACTURED HOMES AS DEFINED BY NFA 130.

UNDERGROUND WATER PRESSURE SERVICE AS DEFINED BY NFPA 24.

ALL SUPPLY, WASTE, & GAS LINE MATERIALS, WORKMANSHIP, AND INSTALLATION AS PER INDUSTRY STANDARDS. ALL WATER LINES TO BE TYPE 1; HARD DRAWN COPPER OR POLYETHYLENE CROSS-LINK PIPING FOR ABOVE GROUND APPLICATIONS OR APPROVED EQUAL. PROVIDE TYPE "X" COPPER OR POLYETHYLENE CROSS-LINK PIPING FOR UNDERGROUND. PROVIDE CONTINUOUS LINE WITH NO JOINTS FOR UNDERGROUND APPLICATIONS, UNLESS APPROVED. ALL FITTINGS TO BE COPPER WITH SWEAT SOLDER JOINTS FOR COPPER PIPING OR BRASS FITTINGS WITH COMPRESSION BOLTS FOR POLY PIP. ALL WASTE LINES TO BE PVC OR ABS PLASTIC PIPE.

WASTE LINES SHALL BE PROVIDED WITH A CLEAN OUT AS REQUIRED. EXTEND CLEAN OUTS TO ACCESSIBLE SURFACE. DO NOT PLACE CLEAN OUTS IN FLOOR UNLESS APPROVED.

PLUMBING CONTRACTOR SHALL PROVIDE A TURN OFF VALVE AND DRAIN AT THE LOWEST LEVEL OF THE FACILITY. ALL FIXTURES SHALL BE ABLE TO DRAIN AT THIS POINT. PROVIDE FLOOR DRAIN AT LOCATION OF PLUMBING SYSTEM DRAIN.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS ABOVE BATHUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A NON-ABRASIVE SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 72" INCHES ABOVE THE FLOOR. SHOWER PAN LINERS AND SITE BUILT PAN LINERS SHALL EXTEND A MINIMUM OF 3" ABOVE SHOWER DOOR THRESHOLD. PROVIDE SOLID BLOCKING BEHIND LINER. ALL SHOWER PAN LINERS SHALL BE INSTALLED ON SLOPED BUILT UP FLOOR AND MUST BE INSPECTED.

PLUMBING CONTRACTOR TO ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FIXTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.

PROVIDE CULINARY WATER SOFTENERS SYSTEM THROUGH OUT RESIDENCE AS REQUIRED. SYSTEM TO BE INTERMOUNTAIN WATER INC.'S MODEL "PABROT" SYSTEM. INSTALLATION AS PER MANUFACTURE. O.A.E.

PROVIDE FIRE SPRINKLER SYSTEM AS REQUIRED BY BUILDING DEPARTMENT. SYSTEM TO BE BUILT TO NFPA 13D APPROVED. PROVIDE ENGINEERING, LAYOUT, SPECIFICATIONS, ETC. FOR APPROVAL PRIOR TO INSTALLATION. PROVIDE CONCEALED HEADS.

STEAM SHOWER UNITS TO BE "NICHLE" STEAM GENERATOR K-1734 OR EQUAL. INSTALL AS PER MANUFACTURE REQUIREMENTS. MEETS OR EXCEEDS UL-499/CSA C22.2 NO. 88.

BATHUB AND SHOWER FLOORS AND WALLS

BUILDING KEYNOTES AND SPECIFICATIONS

DIVISION 23- HEATING AND COOLING

23-00 GENERAL MECHANICAL NOTES

THE MECHANICAL SYSTEM SHALL COMPLY WITH 2012 I.B.C. AND IFGC AND BE INSTALLED IN STRICT ACCORDANCE WITH LOCAL, STATE AND NATIONAL CODES. THE CONTRACTOR SHALL PROVIDE AND INSTALL ALL ITEMS, RELATED TO THE PROJECT, AS PER INDUSTRY STANDARDS.

THE MECHANICAL CONTRACTOR TO BE RESPONSIBLE FOR THE COMPLETE MECHANICAL INSTALLATION AND PROVIDE A 1 YEAR WARRANTY AFTER OWNERS ACCEPTANCE. THE CONTRACTOR SHALL SUPPLY THE OWNER WITH OPERATION AND MAINTENANCE MANUALS.

VISIT THE JOB SITE PRIOR TO BIDDING THE PROJECT TO BECOME FAMILAR WITH THE EXISTING CONDITIONS AND ANY INTERFERENCE.

DRYER EXHAUST DUCT TO BE VENTED TO EXTERIOR. DUCTS TO BE RIGID ALUMINUM WITH SMOOTH INTERIOR SURFACES. NO HOOK SCREENS OR FASTENERS SHALL PENETRATE INTO THE DUCT. DOWN DRAFT IN DIRECTION OF AIR FLOW. MAXIMUM LENGTH SHALL NOT EXCEED 35'-0" EXCLUDING FLEXIBLE TRANSITION DUCT. THE MAXIMUM LENGTH OF THE DUCT SHALL BE REDUCED BY 2.5 FEET FOR EACH 45 DEGREE BEND AND 5 FEET FOR EACH 90 DEGREE BEND. TRANSITION DUCTS SHALL NOT BE CONCEALED WITH CONSTRUCTION. (I.R.C. M.I.302)

BATHROOM EXHAUST DUCT TO BE ALUMINUM, GALVANIZED STEEL OR APPROVED BRASS GLASS. KITCHEN HOOD EXHAUST DUCTS TO BE GALVANIZED STEEL, STAINLESS STEEL OR COPPER. DUCTS TO BE AIR TIGHT AND EQUIPPED WITH A BACK DRAFT DAMPER. ALL DUCTS TO TERMINATE AT OUTSIDE. BATHROOM VENTILATION SYSTEM SHALL BE RATED AT 50 CFM (INTERMEDIATE VENTILATION) (I.R.C. CHAPTER 15 AND R303)

LINE VOLTAGE AND LOW VOLTAGE CONTROL WIRING IS BY THE MECHANICAL CONTRACTOR. COORDINATE WITH THE ELECTRICAL CONTRACTOR.

SUBMIT SPECIFICATION SHEETS ON ALL EQUIPMENT TO BE REVIEWED BY ARCHITECT.

MECHANICAL HEATING SYSTEM TO BE 90% EFFICIENT FORCED AIR FURNACE SYSTEM. THE SYSTEM SHALL BE CAPABLE OF MAINTAINING THE TEMPERATURE WITHIN 1 DEGREE OF THE THERMOSTAT SET POINT. THE CONTRACTOR SHALL GUARANTEE THAT THE SYSTEM SHALL HEAT AND COOL THE FACILITY TO 80 DEGREES FAHRENHEIT HEATING AND 70 DEGREES FAHRENHEIT COOLING AT 3'-0" ABOVE THE FLOOR AND 2'-0" FROM EXTERIOR WALLS THROUGH OUT THE STRUCTURE. SUPPLIER TO PROVIDE HEAT LOSS CALCULATIONS, SHOP DRAWINGS, THERMOSTAT LOCATIONS AND CUT SHEETS ON ALL PROPOSED EQUIPMENT. SIZE EQUIPMENT AS PER I.R.C. M.I.40.3. PROVIDE 1" MINIMUM CLEARANCE AROUND EQUIPMENT AT SIDES AND REAR OF THE APPLIANCE AND 6" MINIMUM CLEARANCE IN FRONT OF THE APPLIANCE. PROVIDE TWO SEPARATE COMBUSTION AIR DUCTS, (FROM EXTERIOR) ONE TERMINATING IN LOWER 12" AND ONE TERMINATING IN UPPER 12" OF THE SPACE AS REQUIRED. EACH DUCT SHALL HAVE A FREE AREA TO ALLOW COMBUSTION AIR AT A RATE OF 1 SQUARE INCH PER 4,000 BTUS (FOR VERTICAL DUCTS) AND 1 SQUARE INCH PER 2,000 BTUS (FOR HORIZONTAL DUCTS) OF TOTAL INPUT RATING OF ALL APPLIANCES IN THE SPACE, OR AS PER MANUFACTURERS SPECIFICATIONS. ALTERNATE COMBUSTION AIR OPTIONS COMPLIANT WITH I.R.C. CHAPTER 17 AND G2407 MAY BE ALLOWED WHEN DEEMED APPROPRIATE AND APPROVED. PROVIDE CLEARANCE BETWEEN COMBUSTIBLE MATERIALS AND VENTS AS PER CODE. (I.R.C. CHAPTER 14, CHAPTER 17)

MECHANICAL HEATING SYSTEM TO BE 80% EFFICIENT BOILER WITH RADIANT IN FLOOR HYDRONIC HEATING SYSTEM. THE SYSTEM SHALL BE CAPABLE OF MAINTAINING THE TEMPERATURE WITHIN 1 DEGREE OF THE THERMOSTAT SET POINT. THE CONTRACTOR SHALL GUARANTEE THAT THE SYSTEM SHALL HEAT AND COOL THE FACILITY TO 80 DEGREES FAHRENHEIT HEATING AND 70 DEGREES FAHRENHEIT COOLING AT 3'-0" ABOVE THE FLOOR AND 2'-0" FROM EXTERIOR WALLS THROUGH OUT THE STRUCTURE. SUPPLIER TO PROVIDE HEAT LOSS CALCULATIONS, SHOP DRAWINGS, THERMOSTAT LOCATIONS AND CUT SHEETS ON ALL PROPOSED EQUIPMENT. SIZE EQUIPMENT AS PER I.R.C. M.I.40.3. PROVIDE 1" MINIMUM CLEARANCE AROUND EQUIPMENT AT SIDES AND REAR OF THE APPLIANCE AND 6" MINIMUM CLEARANCE IN FRONT OF THE APPLIANCE. PROVIDE TWO SEPARATE COMBUSTION AIR DUCTS, (FROM EXTERIOR) ONE TERMINATING IN LOWER 12" AND ONE TERMINATING IN UPPER 12" OF THE SPACE AS REQUIRED. EACH DUCT SHALL HAVE A FREE AREA TO ALLOW COMBUSTION AIR AT A RATE OF 1 SQUARE INCH PER 4,000 BTUS (FOR VERTICAL DUCTS) AND 1 SQUARE INCH PER 2,000 BTUS (FOR HORIZONTAL DUCTS) OF TOTAL INPUT RATING OF ALL APPLIANCES IN THE SPACE, OR AS PER MANUFACTURERS SPECIFICATIONS. ALTERNATE COMBUSTION AIR OPTIONS COMPLIANT WITH I.R.C. CHAPTER 17 AND G2407 MAY BE ALLOWED WHEN DEEMED APPROPRIATE AND APPROVED. PROVIDE CLEARANCE BETWEEN COMBUSTIBLE MATERIALS AND VENTS AS PER CODE. (I.R.C. R303.8, CHAPTER 14, CHAPTER 17)

ALL HABITABLE ROOMS SHALL HAVE NATURAL VENTILATION EQUATING 4% OF THE FLOOR AREA. THIS SHALL BE PROVIDED THROUGH WINDOWS, DOORS, LOUVERS OR OTHER APPROVED OPENINGS TO THE OUTDOORS UNLESS AN APPROVED MECHANICAL VENTILATION SYSTEM IS PROVIDED CAPABLE OF PRODUCING 0.35 AIR CHANGES PER HOUR IN THE ROOM OR A WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM IS INSTALLED.

EXHAUST FANS SHALL BE SIZED FOR A MINIMAL RATE OF 50 CFM. ALL FANS TO BE DUCTED TO OUTSIDE. ALL EXHAUST DUCTS TO HAVE APPROVED TERMINATIONS WITH SCREENS. TERMINATIONS SHALL BE INSTALLED AS NOT TO BE BLOCKED BY SNOW AND ICE. FANS IN UNFINISHED AREAS SHALL BE PROVIDED WITH LOW SPEED MOTOR, PROVIDE ACOUSTICAL INSULATION, GRILLS, CAPS, ETC. AS REQUIRED. (I.R.C. R303.3 AND M1507)

THE CONTRACTOR SHALL LAYOUT AND REFERENCE ALL MECHANICAL DRAWINGS. CONTRACTOR SHALL PROVIDE ALL ENGINEERING REQUIRED TO SIZE DUCTS, GRILLS, REGISTERS, ETC. REVIEW ALL LOCATIONS AND PLACEMENT FOR GRILLS, ETC. WITH OWNER PRIOR TO PLACEMENT. THE ASSOCIATED ARCHITECTURAL MECHANICAL LAYOUTS AND DRAWINGS SHALL BE FOR THE PURPOSE TO SHOW INTENT.

PROJECTS THAT REQUIRE MECHANICAL DUCT WORK SHALL CONFORM TO THE FOLLOWING. ALL DUCT WORK SHALL BE CONSTRUCTED FROM GALVANIZED SHEET STEEL TO CONFORM WITH "SMACNA" LOW PRESSURE DUCT CONSTRUCTION STANDARDS AND I.R.C. CHAPTER 16. FABRICATE SHEET METAL DUCTS WITH CROSS-BREAK OR KINK FLAT SURFACES TO PREVENT VIBRATION AND PULSATION. HANG DUCTS WITH STRAPS OF 18 GAUGE GALVANIZED STEEL OF 1" WIDE. ANCHOR DUCTS SECURELY TO STRUCTURE WITH SCREWS, IN SUCH A MANNER AS TO PREVENT TRANSMISSION WITH VIBRATION. UNDERGROUND ROUND DUCT SHALL BE SCHEDULE 40 P.V.C. PIPE OR P.V.S. PIPE AS REQUIRED BY LOCAL JURISDICTION WITH FUSION WELDED JOINTS AND CONNECTIONS. RUN OUTS TO FLOOR GRILLES SHALL BE FABRICATED FROM SHEET P.V.C. OR P.V.S. OF SAME THICKNESS AS PIPE WITH ALL JOINTS AND CONNECTIONS FUSION WELDED.

REMOVE DEBRIS AND TRASH FROM DUCT WORK AND VACUUM CLEAN DUCTS. RUN SUPPLY AND EXHAUST FANS THROUGH GRILLES AND REGISTERS AFTER INSTALLED AND BEFORE CEILING AND WALLS ARE PAINED. THE ADJUSTMENT OF THE AIR SYSTEMS SHALL BE DONE BY THE MECHANICAL CONTRACTOR SYSTEMS SHALL BE ADJUSTED TO WITHIN PLUS OR MINUS 5% OF THE AIR CAPACITY.

INSULATE ALL HEATING TRUNK AND BRANCH SUPPLY DUCTS IN UNFINISHED AREAS, CRAWLS SPACES, ATTICS AND GARAGES.

ALL GAS LINE MATERIALS, WORKMANSHIP, AND INSTALLATION AS PER INDUSTRY STANDARDS. NATURAL GAS SERVICE LINES SHALL BE LESS THAN 1 1/2 INCH IN DIAMETER. ALL NATURAL GAS LINES TO BE SCHEDULE 40 BLACK STEEL OR FLEX PLASTIC PIPE AS APPROVED BY GAS COMPANY. (I.R.C. CHAPTER 24, R156-56-700 (B) AND STATE AMENDMENT TO IFGC)

ALL GAS APPLIANCES SHALL BE PROVIDED WITH A SHUT OFF VALVE. SHUT OFF VALVES SHALL BE LOCATED IN A PLACE SO AS TO PROVIDE ACCESS FOR OPERATION AND SHALL BE INSTALLED SO AS TO BE PROTECTED FROM DAMAGE.

23-01 RADIANT HEAT

MECHANICAL HEATING SYSTEM TO BE 80% EFFICIENT BOILER WITH RADIANT IN FLOOR HYDRONIC HEATING SYSTEM. THE SYSTEM SHALL BE CAPABLE OF MAINTAINING THE TEMPERATURE WITHIN 1 DEGREE OF THE THERMOSTAT SET POINT. THE CONTRACTOR SHALL GUARANTEE THAT THE SYSTEM SHALL HEAT AND COOL THE FACILITY TO 80 DEGREES FAHRENHEIT HEATING AND 70 DEGREES FAHRENHEIT COOLING AT 3'-0" ABOVE THE FLOOR AND 2'-0" FROM EXTERIOR WALLS THROUGH OUT THE STRUCTURE. SUPPLIER TO PROVIDE HEAT LOSS CALCULATIONS, SHOP DRAWINGS, THERMOSTAT LOCATIONS AND CUT SHEETS ON ALL PROPOSED EQUIPMENT. SIZE EQUIPMENT AS PER I.R.C. M.I.40.3. PROVIDE CLEARANCES AS PER MANUFACTURE. PROVIDE TWO SEPARATE COMBUSTION AIR DUCTS, (FROM EXTERIOR) ONE TERMINATING IN LOWER 12" AND ONE TERMINATING IN UPPER 12" OF THE SPACE AS REQUIRED. EACH DUCT SHALL HAVE A FREE AREA TO ALLOW COMBUSTION AIR AT A RATE OF 1 SQUARE INCH PER 4,000 BTUS (FOR VERTICAL DUCTS) AND 1 SQUARE INCH PER 2,000 BTUS (FOR HORIZONTAL DUCTS) OF TOTAL INPUT RATING OF ALL APPLIANCES IN THE SPACE, OR AS PER MANUFACTURERS SPECIFICATIONS. ALTERNATE COMBUSTION AIR OPTIONS COMPLIANT WITH I.R.C. CHAPTER 17 AND G2407 MAY BE ALLOWED WHEN DEEMED APPROPRIATE AND APPROVED. PROVIDE CLEARANCE BETWEEN COMBUSTIBLE MATERIALS AND VENTS AS PER CODE. (I.R.C. R303.8, CHAPTER 14, CHAPTER 17)

23-02 MECHANICAL HEATING AND COOLING

MECHANICAL HEATING SYSTEM TO BE 90% EFFICIENT FORCED AIR FURNACE SYSTEM. THE SYSTEM SHALL BE CAPABLE OF MAINTAINING THE TEMPERATURE WITHIN 1 DEGREE OF THE THERMOSTAT SET POINT. THE CONTRACTOR SHALL GUARANTEE THAT THE SYSTEM SHALL HEAT AND COOL THE FACILITY TO 80 DEGREES FAHRENHEIT HEATING AND 70 DEGREES FAHRENHEIT COOLING AT 3'-0" ABOVE THE FLOOR AND 2'-0" FROM EXTERIOR WALLS THROUGH OUT THE STRUCTURE. SUPPLIER TO PROVIDE HEAT LOSS CALCULATIONS, SHOP DRAWINGS, THERMOSTAT LOCATIONS AND CUT SHEETS ON ALL PROPOSED EQUIPMENT. SIZE EQUIPMENT AS PER I.R.C. M.I.40.3. PROVIDE CLEARANCES AS PER MANUFACTURE. PROVIDE TWO SEPARATE COMBUSTION AIR DUCTS, (FROM EXTERIOR) ONE TERMINATING IN LOWER 12" AND ONE TERMINATING IN UPPER 12" OF THE SPACE AS REQUIRED. EACH DUCT SHALL HAVE A FREE AREA TO ALLOW COMBUSTION AIR AT A RATE OF 1 SQUARE INCH PER 4,000 BTUS (FOR VERTICAL DUCTS) AND 1 SQUARE INCH PER 2,000 BTUS (FOR HORIZONTAL DUCTS) OF TOTAL INPUT RATING OF ALL APPLIANCES IN THE SPACE, OR AS PER MANUFACTURERS SPECIFICATIONS. ALTERNATE COMBUSTION AIR OPTIONS COMPLIANT WITH I.R.C. CHAPTER 17 AND G2407 MAY BE ALLOWED WHEN DEEMED APPROPRIATE AND APPROVED. PROVIDE CLEARANCE BETWEEN COMBUSTIBLE MATERIALS AND VENTS AS PER CODE. (I.R.C. R303.8, CHAPTER 14, CHAPTER 17)

MECHANICAL HEATING SYSTEM TO BE 80% EFFICIENT BOILER WITH RADIANT IN FLOOR HYDRONIC HEATING SYSTEM. THE SYSTEM SHALL BE CAPABLE OF MAINTAINING THE TEMPERATURE WITHIN 1 DEGREE OF THE THERMOSTAT SET POINT. THE CONTRACTOR SHALL GUARANTEE THAT THE SYSTEM SHALL HEAT AND COOL THE FACILITY TO 80 DEGREES FAHRENHEIT HEATING AND 70 DEGREES FAHRENHEIT COOLING AT 3'-0" ABOVE THE FLOOR AND 2'-0" FROM EXTERIOR WALLS THROUGH OUT THE STRUCTURE. SUPPLIER TO PROVIDE HEAT LOSS CALCULATIONS, SHOP DRAWINGS, THERMOSTAT LOCATIONS AND CUT SHEETS ON ALL PROPOSED EQUIPMENT. SIZE EQUIPMENT AS PER I.R.C. M.I.40.3. PROVIDE CLEARANCES AS PER MANUFACTURE. PROVIDE TWO SEPARATE COMBUSTION AIR DUCTS, (FROM EXTERIOR) ONE TERMINATING IN LOWER 12" AND ONE TERMINATING IN UPPER 12" OF THE SPACE AS REQUIRED. EACH DUCT SHALL HAVE A FREE AREA TO ALLOW COMBUSTION AIR AT A RATE OF 1 SQUARE INCH PER 4,000 BTUS (FOR VERTICAL DUCTS) AND 1 SQUARE INCH PER 2,000 BTUS (FOR HORIZONTAL DUCTS) OF TOTAL INPUT RATING OF ALL APPLIANCES IN THE SPACE, OR AS PER MANUFACTURERS SPECIFICATIONS. ALTERNATE COMBUSTION AIR OPTIONS COMPLIANT WITH I.R.C. CHAPTER 17 AND G2407 MAY BE ALLOWED WHEN DEEMED APPROPRIATE AND APPROVED. PROVIDE CLEARANCE BETWEEN COMBUSTIBLE MATERIALS AND VENTS AS PER CODE. (I.R.C. R303.8, CHAPTER 14, CHAPTER 17)

MECHANICAL HEATING SYSTEM TO BE 80% EFFICIENT BOILER WITH RADIANT IN FLOOR HYDRONIC HEATING SYSTEM. THE SYSTEM SHALL BE CAPABLE OF MAINTAINING THE TEMPERATURE WITHIN 1 DEGREE OF THE THERMOSTAT SET POINT. THE CONTRACTOR SHALL GUARANTEE THAT THE SYSTEM SHALL HEAT AND COOL THE FACILITY TO 80 DEGREES FAHRENHEIT HEATING AND 70 DEGREES FAHRENHEIT COOLING AT 3'-0" ABOVE THE FLOOR AND 2'-0" FROM EXTERIOR WALLS THROUGH OUT THE STRUCTURE. SUPPLIER TO PROVIDE HEAT LOSS CALCULATIONS, SHOP DRAWINGS, THERMOSTAT LOCATIONS AND CUT SHEETS ON ALL PROPOSED EQUIPMENT. SIZE EQUIPMENT AS PER I.R.C. M.I.40.3. PROVIDE CLEARANCES AS PER MANUFACTURE. PROVIDE TWO SEPARATE COMBUSTION AIR DUCTS, (FROM EXTERIOR) ONE TERMINATING IN LOWER 12" AND ONE TERMINATING IN UPPER 12" OF THE SPACE AS REQUIRED. EACH DUCT SHALL HAVE A FREE AREA TO ALLOW COMBUSTION AIR AT A RATE OF 1 SQUARE INCH PER 4,000 BTUS (FOR VERTICAL DUCTS) AND 1 SQUARE INCH PER 2,000 BTUS (FOR HORIZONTAL DUCTS) OF TOTAL INPUT RATING OF ALL APPLIANCES IN THE SPACE, OR AS PER MANUFACTURERS SPECIFICATIONS. ALTERNATE COMBUSTION AIR OPTIONS COMPLIANT WITH I.R.C. CHAPTER 17 AND G2407 MAY BE ALLOWED WHEN DEEMED APPROPRIATE AND APPROVED. PROVIDE CLEARANCE BETWEEN COMBUSTIBLE MATERIALS AND VENTS AS PER CODE. (I.R.C. R303.8, CHAPTER 14, CHAPTER 17)

PROJECTS THAT REQUIRE MECHANICAL DUCT WORK SHALL CONFORM TO THE FOLLOWING. ALL DUCT WORK SHALL BE CONSTRUCTED FROM GALVANIZED SHEET STEEL TO CONFORM WITH "SMACNA" LOW PRESSURE DUCT CONSTRUCTION STANDARDS AND I.R.C. CHAPTER 16. FABRICATE SHEET METAL DUCTS WITH CROSS-BREAK OR KINK FLAT SURFACES TO PREVENT VIBRATION AND PULSATION. HANG DUCTS WITH STRAPS OF 18 GAUGE GALVANIZED STEEL OF 1" WIDE. ANCHOR DUCTS SECURELY TO STRUCTURE WITH SCREWS, IN SUCH A MANNER AS TO PREVENT TRANSMISSION WITH VIBRATION. UNDERGROUND ROUND DUCT SHALL BE SCHEDULE 40 P.V.C. PIPE OR P.V.S. PIPE AS REQUIRED BY LOCAL JURISDICTION WITH FUSION WELDED JOINTS AND CONNECTIONS. RUN OUTS TO FLOOR GRILLES SHALL BE FABRICATED FROM SHEET P.V.C. OR P.V.S. OF SAME THICKNESS AS PIPE WITH ALL JOINTS AND CONNECTIONS FUSION WELDED.

REMOVE DEBRIS AND TRASH FROM DUCT WORK AND VACUUM CLEAN DUCTS. RUN SUPPLY AND EXHAUST FANS THROUGH GRILLES AND REGISTERS AFTER INSTALLED AND BEFORE CEILING AND WALLS ARE PAINED. THE ADJUSTMENT OF THE AIR SYSTEMS SHALL BE DONE BY THE MECHANICAL CONTRACTOR SYSTEMS SHALL BE ADJUSTED TO WITHIN PLUS OR MINUS 5% OF THE AIR CAPACITY.

INSULATE ALL HEATING TRUNK AND BRANCH SUPPLY DUCTS IN UNFINISHED AREAS, CRAWLS SPACES, ATTICS AND GARAGES.

ALL GAS LINE MATERIALS, WORKMANSHIP, AND INSTALLATION AS PER INDUSTRY STANDARDS. NATURAL GAS SERVICE LINES SHALL BE LESS THAN 1 1/2 INCH IN DIAMETER. ALL NATURAL GAS LINES TO BE SCHEDULE 40 BLACK STEEL OR FLEX PLASTIC PIPE AS APPROVED BY GAS COMPANY. (I.R.C. CHAPTER 24, R156-56-700 (B) AND STATE AMENDMENT TO IFGC)

23-05 METAL DUCTWORK

PROJECTS THAT REQUIRE MECHANICAL DUCT WORK SHALL CONFORM TO THE FOLLOWING. ALL DUCT WORK SHALL BE CONSTRUCTED FROM GALVANIZED SHEET STEEL TO CONFORM WITH "SMACNA" LOW PRESSURE DUCT CONSTRUCTION STANDARDS AND I.R.C. CHAPTER 16. FABRICATE SHEET METAL DUCTS WITH CROSS-BREAK OR KINK FLAT SURFACES TO PREVENT VIBRATION AND PULSATION. HANG DUCTS WITH STRAPS OF 18 GAUGE GALVANIZED STEEL OF 1" WIDE. ANCHOR DUCTS SECURELY TO STRUCTURE WITH SCREWS, IN SUCH A MANNER AS TO PREVENT TRANSMISSION WITH VIBRATION. UNDERGROUND ROUND DUCT SHALL BE SCHEDULE 40 P.V.C. PIPE OR P.V.S. PIPE AS REQUIRED BY LOCAL JURISDICTION WITH FUSION WELDED JOINTS AND CONNECTIONS. RUN OUTS TO FLOOR GRILLES SHALL BE FABRICATED FROM SHEET P.V.C. OR P.V.S. OF SAME THICKNESS AS PIPE WITH ALL JOINTS AND CONNECTIONS FUSION WELDED.

REMOVE DEBRIS AND TRASH FROM DUCT WORK AND VACUUM CLEAN DUCTS. RUN SUPPLY AND EXHAUST FANS THROUGH GRILLES AND REGISTERS AFTER INSTALLED AND BEFORE CEILING AND WALLS ARE PAINED. THE ADJUSTMENT OF THE AIR SYSTEMS SHALL BE DONE BY THE MECHANICAL CONTRACTOR SYSTEMS SHALL BE ADJUSTED TO WITHIN PLUS OR MINUS 5% OF THE AIR CAPACITY.

INSULATE ALL HEATING TRUNK AND BRANCH SUPPLY DUCTS IN UNFINISHED AREAS, CRAWLS SPACES, ATTICS AND GARAGES.

ALL GAS LINE MATERIALS, WORKMANSHIP, AND INSTALLATION AS PER INDUSTRY STANDARDS. NATURAL GAS SERVICE LINES SHALL BE LESS THAN 1 1/2 INCH IN DIAMETER. ALL NATURAL GAS LINES TO BE SCHEDULE 40 BLACK STEEL OR FLEX PLASTIC PIPE AS APPROVED BY GAS COMPANY. (I.R.C. CHAPTER 24, R156-56-700 (B) AND STATE AMENDMENT TO IFGC)

ALL GAS APPLIANCES SHALL BE PROVIDED WITH A SHUT OFF VALVE. SHUT OFF VALVES SHALL BE LOCATED IN A PLACE SO AS TO PROVIDE ACCESS FOR OPERATION AND SHALL BE INSTALLED SO AS TO BE PROTECTED FROM DAMAGE.

23-07 EXHAUST FAN

GENERAL PRODUCTS
PROVIDE EXHAUST FANS IN ALL BATHROOMS.

FANS SHALL BE DIRECTLY VENTED TO THE EXTERIOR.

FANS MUST BE CAPABLE OF TO MAINTAIN 50 CFM WITHIN ROOM LOCATED.

RECUITION

COORDINATE WITH MECHANICAL AND PLUMBING PLANS FOR ALL EQUIPMENT AND FIXTURE LOCATIONS. COORDINATE WITH MECHANICAL AND PLUMBING FIXTURE SCHEDULES. COORDINATE WITH MECHANICAL AND PLUMBING KEY NOTES, INTERNATIONAL BUILDING CODE AND RELATED CODES FOR INSTALLATION REQUIREMENTS.

23-08 RECESSED DRYER VENT BOX

GENERAL PRODUCTS

DRYER EXHAUST DUCT TO BE VENTED TO EXTERIOR. DUCTS TO BE RIGID ALUMINUM WITH SMOOTH INTERIOR SURFACES. NO HOOK SCREENS OR FASTENERS SHALL PENETRATE INTO THE DUCT. DOWN DRAFT IN DIRECTION OF AIR FLOW. MAXIMUM LENGTH SHALL NOT EXCEED 35'-0" EXCLUDING FLEXIBLE TRANSITION DUCT. THE MAXIMUM LENGTH OF THE DUCT SHALL BE REDUCED BY 2.5 FEET FOR EACH 45 DEGREE BEND AND 5 FEET FOR EACH 90 DEGREE BEND. TRANSITION DUCTS SHALL NOT BE CONCEALED WITH CONSTRUCTION. (I.R.C. M.I.302)

BATHROOM EXHAUST DUCT TO BE ALUMINUM, GALVANIZED STEEL OR APPROVED BRASS GLASS. KITCHEN HOOD EXHAUST DUCTS TO BE GALVANIZED STEEL, STAINLESS STEEL OR COPPER. DUCTS TO BE AIR TIGHT AND EQUIPPED WITH A BACK DRAFT DAMPER. ALL DUCTS TO TERMINATE AT OUTSIDE. BATHROOM VENTILATION SYSTEM SHALL BE RATED AT 50 CFM (INTERMEDIATE VENTILATION) (I.R.C. CHAPTER 15 AND R303)

RECUITION

FOLLOW MANUFACTURER RECOMMENDED INSTALLATION INSTRUCTIONS.

DRX 1000 - PLASTIC INSTALLATION

- CREDIT BOX TO MATCH DESIRED VENTING DIRECTION. SCORE & REMOVE APPROPRIATE TOP OR REAR INCH OVAL VENT PRESHOCK OUT. ALLOW MINIMUM OF 4 INCHES OF VENT PIPE TO EXTEND INSIDE THE BOX
- IF GAS LINE IS TO BE INSTALLED, LOCATE 1/8 INCH STRAW CLAMP ON TOP OF BOX. CUT THE WEBS BETWEEN THE RINGS WITH UTILITY KNIFE. PUSH THE GAS LINE THROUGH THE STRAW CLAMP. THE RING WILL FLEX FORWARD HOLDING THE PIPE.
- SLIDE BOX INTO POSITION TAKING CARE TO CORRECTLY ALIGN VENT PIPE AND GAS PIPE (IF PRESENT).
- SPACING TABS WILL AUTOMATICALLY POSITION BOX SO THAT BOTTOM, INSIDE EDGE OF FROM 2 1/4 TO 2 1/2 INCHES ABOVE FINISHED FLOOR TO ALLOW CLEARANCE BETWEEN TRIM RING AND INSIDE EDGE. COVERING TABS MAY BE REMOVED IF APPROVED SPACING IS DESIRED.
- ATTACH BOX DIRECTLY TO BOTH RIGHT AND LEFT STUDS USING 3/8 INCH FLANGE SCREW HOLES. SCREWS ARE RECOMMENDED FOR MOUNTING.

TRIM INSTRUCTIONS:

- SNAP OUT LEFT OR RIGHT TRIM RING "CUT OUT" (SEE DETAIL BELOW).
- LEAVE 1/8 INCHES BETWEEN INSIDE EDGE OF BOX AND END OF BASEBOARD TO ALLOW FOR TRIM RING CLEARANCE.
- SNAP TRIM RING INTO OPENING, NO CAULKING REQUIRED.
- LEAVE UNFINISHED OR PAINT WITH DESIRED COLOR.

THE DRX 1000 - METAL BOX INSTALLATION

- CREDIT BOX TO MATCH DESIRED VENTING DIRECTION. ALLOW A MINIMUM OF 4" OF VENT PIPE TO EXTEND INTO THE BOX.
- IF GAS LINE IS TO BE INSTALLED, INSERT INTO KNOCKOUT PROVIDED.
- SLIDE BOX INTO POSITION TAKING CARE TO CORRECTLY ALIGN VENT PIPE AND GAS PIPE (IF PRESENT).
- SET BOX SO THAT THE BOTTOM IS 1/8" ABOVE THE FLOOR TO ALLOW CLEARANCE FOR THE TRIM RING.
- ATTACH BOX DIRECTLY TO EITHER FRAMING MEMBER AND USE STRAPS TO SECURE THE OTHER SIDE TO THE OPPOSITE FRAMING MEMBER.
- SCREWS OR NAILS (1 1/4") IN LENGTH TO ATTACH THE DRX 1000 BOX TO FRAMING.

TRIM INSTALLATION INSTRUCTIONS:

- TRIM CARPENTER TO LEAVE 1/8" BETWEEN INSIDE EDGE OF BOX AND END OF BASEBOARD TO ALLOW TRIM RING CLEARANCE.
- SNAP TRIM RING INTO OPENING, NO CAULKING REQUIRED.
- TRIM RING IS POWDER COATED, NO FINISHING REQUIRED.
- TRIM RING ACCOMMODATES 3/4" OR 3/8" DRINKWALL.

DIVISION 26- ELECTRICAL

26-00 GENERAL ELECTRICAL

ALL DRAWINGS INDICATE LOCATIONS OF ELECTRICAL ITEMS AS DIAGRAMMATIC. LOCATIONS SHALL BE PER APPROPRIATE CODES AND OWNER.

CONTRACTOR SHALL COORDINATE WITH ELECTRICAL PLANS FOR ALL DESIRED LOCATIONS FOR ELECTRICAL SWITCHES, OUTLETS, SCHEMATIC WIRING, EQUIPMENT AND FIXTURE LOCATIONS. COORDINATE WITH ELECTRICAL FIXTURE SCHEDULES AS RELATED BY ARCHITECT OR OWNER. COORDINATE WITH ELECTRICAL KEY NOTES, INTERNATIONAL BUILDING CODE AND SELECTED CODES FOR INSTALLATION REQUIREMENTS, AND ADDITIONAL INFORMATION.

ELECTRICAL CONTRACTOR SHALL INSTALL ALL BOXES FOR OUTLETS, SWITCHES, LIGHTS, DATA, COMMUNICATIONS AND ALL SPECIALTY ITEMS AND SHALL REVIEW AND RECEIVE APPROVAL FROM OWNER/ARCHITECT/DESIGNER PRIOR TO INSTALLATION OF WIRING. RELOCATION OF BOXES AFTER WIRING AS DIRECTED BY OWNER/ARCHITECT/DESIGNER WITHOUT APPROVAL OF LOCATION SHALL BE COMPLETED WITH NOT COST TO THE OWNER.

THE ELECTRICAL SYSTEM SHALL COMPLY WITH 2012 I.B.C. AND 2005 N.E.C. AND BE INSTALLED IN STRICT ACCORDANCE WITH LOCAL, STATE, AND NATIONAL CODES. THE CONTRACTOR SHALL PERFORM ALL WORK IN CONFORMITY WITH THESE REGULATIONS WHETHER OR NOT SUCH WORK IS SPECIFICALLY SHOWN ON THE DRAWINGS.

THE CONTRACTOR SHALL BE RESPONSIBLE TO FURNISH AND INSTALL FEEDERS, PANEL BOARDS, RELAY BRANCH CIRCUIT WIRING, CONDUITS, WIRE, METER BASES, COMPLETE WIRING FOR MOTORS, EXHAUST FANS, LINE VOLTAGE CONNECTIONS FOR HVAC EQUIPMENT, SPECIALTY LIGHTING FIXTURES, OUTLET BOXES, COVER PLATES, WALL SWITCHES, FIXTURES, RECEPTACLES, ETC.

ALL DRAWINGS INDICATE LOCATIONS AS DIAGRAMMATIC. LOCATIONS SHALL BE PER APPROPRIATE CODES AND OWNER. CONTRACTOR TO COORDINATE WITH MECHANICAL CONTRACTOR FOR ALL POWER REQUIREMENTS. (I.R.C. E3801)

PROVIDE A 1/8" GROUND. AN ELECTRODE ENCASED BY AT LEAST 2" OF CONCRETE SHALL BE LOCATED NEAR THE BOTTOM OF THE CONCRETE FOUNDATION SYSTEM AND SHALL BE IN DIRECT CONTACT WITH THE EARTH, CONSISTING OF AT LEAST 20 FEET OF BARE ELECTRICALLY CONDUCTIVE ROD AT LEAST 1/2 INCH IN DIAMETER OR BARE COPPER CONDUCTOR NOT SMALLER THAN 4 AWG. (I.R.C. E3805.3.2 AND N.E.C. 250.50)

ELECTRICAL SERVICE CAPACITY AND SIZE SHALL BE COMPLETED BY METHOD INDICATED IN THE I.R.C. AND NATIONAL ELECTRICAL CODE. PANELS OR CABINETS ENCLOSED FUSES, CIRCUIT BREAKERS, SWITCHES OR OTHER ELECTRICAL SERVICE EQUIPMENT SHALL BE IN AN INCONSPICUOUS ACCESSIBLE AND PROTECTED LOCATION. ELECTRICAL PANEL CLEARANCES TO BE A MINIMUM 30" WIDTH, 36" DEPTH AND 6" FROM FLOOR TOP. ELECTRICAL METER BASE SHALL BE LOCATED IN AN AREA THAT IS PROTECTED FROM OUTSIDE WEATHER. (I.R.C. E3805)

ALL RECEPTACLES LOCATED WITH THE FOLLOWING CONDITIONS TO BE GFCI PROTECTED: ALL KITCHEN COUNTERS, IN BATHROOMS, OUTSIDE AT GRADE LEVEL, UNFINISHED BASEMENTS, CRAWL SPACES, AND IN GARAGES. GARAGE RECEPTACLES TO BE 1' ABOVE FINISHED FLOOR. (I.R.C. E3802)

ALL SWITCHES, RECEPTACLES, TELEPHONE JACKS AND CATV JACKS TO BE LEVITON 5601 ROCKER SERIES IN WHITE. (O.A.E.) DIMMER SWITCHES TO BE LITRON DIVA ROCKER SERIES IN WHITE. (O.A.E.) HEIGHT OF LIGHT SWITCHES FROM FINISHED FLOOR TO TOP OF SWITCH TO BE 48" TYPICAL UNLESS NOTED OTHERWISE. THE MOUNTING FROM THE FINISH FLOOR TO THE CENTER OF OUTLETS INCLUDING TELEPHONE, CATV, ETC. SHALL BE 18" TYPICAL. AT DESKS AND OTHER SURFACES THE OUTLETS SHALL BE 12" TO CENTER ABOVE SURFACE. SWITCHES, OUTLETS, TELEPHONE, CATV, ETC. LOCATIONS SHALL BE APPROVED PRIOR TO COMMENCEMENT OF WIRING.

UNLESS NOTED OTHERWISE, LOCATE AND INSTALL ONE (1) GFCI WEATHER PROTECTED RECEPTACLE AT GRADE LEVEL AND OUTSIDE AT SPOFF AT EACH EXTERIOR DOOR.

ALL FIXTURES SHALL HAVE A U.L. LABEL LISTING. IF NOT U.L. LISTED LIGHTS SHALL NOT BE USED. ALL RECESS DOWN LIGHTS TO BE ICED OUT WHEN EXTERIOR SURFACE. ALL RECESSED DOWN LIGHTS TO BE ICED OUT IN BASE BID WITH TRIM RINGS AS SELECTED BY DESIGNER OR OWNER. ALL LIGHTS IN CLOSETS SHALL MEET I.R.C. E3903.11 REQUIREMENTS. ALL LIGHTS LOCATED IN WET OR DAMP LOCATIONS SHALL MEET I.R.C. E3903.6 - E3903.10 REQUIREMENTS.

SMOKE DETECTORS TO BE HARD WIRED TO BUILDING CIRCUIT AND INTERCONNECTED WITH BATTERY BACK UP. PROVIDE SMOKE DETECTORS AT ALL BUILDING LEVELS. IN ALL BEDROOMS, ACCESS TO ALL BEDROOMS, ETC. (I.R.C. R313)

ALL BRANCH CIRCUITS THAT SUPPLY RECEPTACLE OUTLETS IN BEDROOMS NEED TO BE PROVIDED WITH ARC-FAULT PROTECTION. (I.N.E.C. 210.12) (IRC E3802.12)

ALL STRUCTURED WIRING (IE FIBER SMART CABLE CAT5E, ETC.) TO HAVE A MINIMUM SEPARATION OF 12" BETWEEN HIGH VOLTAGE WIRING.

CARBON MONOXIDE DETECTOR TO BE INSTALLED ON EACH HABITABLE LEVEL OF A DWELLING UNIT EQUIPPED WITH FUEL BURNING APPLIANCE. DETECTOR TO BE HARD WIRED TO BUILDING CIRCUIT WITH BATTERY BACK UP. (I.R.C. 312.2 AND STATE AMENDMENT)

26-01 ELECTRICAL SERVICE EQUIPMENT

ELECTRICAL SYSTEM TO BE INSTALLED IN STRICT ACCORDANCE WITH LOCAL, STATE, AND FEDERAL BUILDING CODES. THE CONTRACTOR SHALL PERFORM ALL WORK IN CONFORMITY WITH THESE REGULATIONS WHETHER OR NOT SUCH WORK IS SPECIFICALLY SHOWN ON THE DRAWINGS.

THE CONTRACTOR SHALL BE RESPONSIBLE TO FURNISH AND INSTALL FEEDERS, PANEL BOARDS, RELAY BRANCH CIRCUIT WIRING, CONDUITS, WIRE, METER BASES, COMPLETE WIRING FOR MOTORS, EXHAUST FANS, LINE VOLTAGE CONNECTIONS FOR HVAC EQUIPMENT, SPECIALTY LIGHTING FIXTURES, OUTLET BOXES, COVER PLATES, WALL SWITCHES, RECEPTACLES, ETC.

ALL DRAWINGS INDICATE LOCATIONS OF ELECTRICAL ITEMS AS DIAGRAMMATIC. LOCATIONS SHALL BE PER APPROPRIATE CODES AND OWNER.

ELECTRICAL SERVICE CAPACITY AND SIZE SHALL BE COMPLETED BY THE METHOD IRC CHAPTER 36.

UNLESS INDICATED IN THE 2012 I.R.C. AND NATIONAL ELECTRICAL CODE, PANELS OR CABINETS ENCLOSED FUSES, CIRCUIT BREAKERS, SWITCHES, OR OTHER ELECTRICAL SERVICE EQUIPMENT SHALL BE IN AN INCONSPICUOUS ACCESSIBLE AND PROTECTED LOCATION. ELECTRICAL PANEL CLEARANCES TO BE A MINIMUM 30" WIDTH, 36" DEPTH AND 6" FROM FINISHED FLOOR. ELECTRICAL METER BASE SHALL BE LOCATED IN AN AREA THAT IS PROTECTED FROM OUTSIDE WEATHER.

26-02 ELECTRICAL LIGHT FIXTURES

GENERAL PRODUCTS
LIGHTING CONTROLS AND MOTORIZED SHADES BY LITRON. MANUFACTURER TO PROVIDE SHOP DRAWINGS AND SPECIFICATIONS TO BE REVIEWED BY ARCHITECT.

PROJECT CONDITIONS
EXISTING UTILITIES DO NOT INTERRUPT UTILITIES SERVING FACILITIES OCCUPIED BY OWNER OR OTHERS UNLESS PERMITTED IN WRITING BY ARCHITECT AND THEN ONLY AFTER ARRANGING TO PROVIDE TEMPORARY UTILITY SERVICES ACCORDING TO REQUIREMENTS INDICATED.

26-03 ELECTRICAL OUTLETS

GENERAL PRODUCTS
LEVITON 5601 ROCKER SERIES IN WHITE
DIMMER SWITCHES - LITRON "DIVA" ROCKER SERIES IN WHITE

ALL RECEPTACLES LOCATED WITH THE FOLLOWING LOCATIONS ARE TO BE GFCI PROTECTED: ALL KITCHEN COUNTERS, IN ALL BATHROOMS, OUTSIDE AT GRADE LEVEL, IN UNFINISHED BASEMENTS, AND IN GARAGES. GARAGE RECEPTACLES TO BE 1' ABOVE FINISHED FLOOR. (I.R.C. E3802)

26-06 TELEPHONE EQUIPMENT

THE TELEPHONE SYSTEM SHALL BE THE RESPONSIBILITY OF THE OWNER/DEVELOPER/CONTRACTOR TO COORDINATE AND PROVIDE DIRECTION FOR INSTALLATION AND LOCATION OF OUTLETS.

26-07 STRUCTURED WIRING

GENERAL PRODUCTS
ALL STRUCTURED WIRING SHALL BE A MINIMUM OF CAT 6
ALL LOCATIONS OF STRUCTURED WIRING SHALL BE THE RESPONSIBILITY OF THE OWNER/DEVELOPER/ CONTRACTOR TO COORDINATE AND PROVIDE DIRECTION FOR INSTALLATION AND LOCATION OF OUTLETS

DIVISION 31- EARTHWORK

31-01 SITE CLEARING

GENERAL PRODUCTS
PROTECT EXISTING TREES, SHRUBS, GROUNDCOVERS, PLANTS, AND GRASS TO REMAIN.

REMOVING EXISTING TREES, SHRUBS, GROUNDCOVERS, PLANTS, AND GRASS.

CLEARING AND GRUBBING.

STRIPPING AND STOCKPILE TOPSOIL.

REMOVING ABOVE- AND BELOW-GRADE SITE IMPROVEMENTS.

DISCONNECTION AND CAPPING OR SEALING SITE UTILITIES.

TEMPORARY EROSION AND SEDIMENTATION CONTROL MEASURES.

PRELIMINARY IMPROVEMENTS: CAREFULLY REMOVE ITEMS IDENTIFIED TO BE SALVAGED AND STORE ON OWNER'S PREMISES WHERE INDICATED.

UTILITY LOCATOR SERVICE: NOTIFY UTILITY LOCATOR SERVICE FOR AREA WHERE PROJECT IS LOCATED.

DO NOT COMMENCE SITE CLEARING OPERATIONS UNTIL TEMPORARY EROSION AND SEDIMENTATION CONTROL MEASURES ARE IN PLACE.

OBTAIN APPROVED BORROW SOIL MATERIALS OFF-SITE WHEN SATISFACTORY SOIL MATERIALS ARE NOT AVAILABLE ON-SITE.

PROTECT AND MAINTAIN BENCHMARKS AND SURVEY CONTROL POINTS FROM DISTURBANCE DURING CONSTRUCTION.

LOCATE AND CLEARLY FLAG TREES AND VEGETATION TO REMAIN OR TO BE RELOCATED.

PROTECT EXISTENT SITE IMPROVEMENTS TO REMAIN FROM DAMAGE DURING CONSTRUCTION. RESTORE DAMAGED IMPROVEMENTS TO THEIR ORIGINAL CONDITION, AS ACCEPTABLE TO OWNER.

TEMPORARY EROSION AND SEDIMENTATION CONTROL
TEMPORARY EROSION AND SEDIMENTATION CONTROL MEASURES TO PREVENT SOIL EROSION AND DISCHARGE OF SOIL-BEARING WATER RUNOFF OR AIRBORNE DUST TO ADJACENT PREMISES AND WALKWAYS.

INSPECT, REPAIR, AND MAINTAIN EROSION AND SEDIMENTATION CONTROL MEASURES DURING CONSTRUCTION UNTIL PERMANENT VEGETATION HAS BEEN ESTABLISHED.

REMOVE EROSION AND SEDIMENTATION CONTROLS AND RESTORE AND STABILIZE AREAS DISTURBED DURING REMOVAL.

TREE PROTECTION
FURNISH, INSTALL, MONITOR, AND MAINTAIN EXCAVATION SUPPORT AND PROTECTION SYSTEM CAPABLE OF SUPPORTING EXCAVATION SIDEWALLS AND OF RESISTING SOIL AND HYDROSTATIC PRESSURE AND SUPERIMPOSED AND CONSTRUCTION LOADS. DESIGN EXCAVATION SUPPORT AND PROTECTION SYSTEMS, INCLUDING COMPREHENSIVE ENGINEERING ANALYSIS BY A QUALIFIED PROFESSIONAL ENGINEER, USING PERFORMANCE REQUIREMENTS AND DESIGN CRITERIA INDICATED.

DO NOT EXCAVATE WITHIN TREE PROTECTION ZONES, UNLESS OTHERWISE INDICATED.

REPAIR OR REPLACE TREES AND VEGETATION IDENTIFIED TO REMAIN THAT ARE DAMAGED BY CON

BUILDING KEYNOTES AND SPECIFICATIONS
DIVISION 32- EXTERIOR IMPROVEMENTS/LANDSCAPING
32-04 UNIT PAVERS/ RETAINING WALLS/ STAIRS

GENERAL PRODUCTS
PAVERS SHALL BE THE FOLLOWING: AS PER LANDSCAPE DRAWINGS
PAVERS SHALL BE INSTALLED IN FOLLOWING PATTERN: AS PER LANDSCAPE DRAWINGS
PAVER COLOR SHALL BE SELECTED BY ARCHITECT. AS PER LANDSCAPE DRAWINGS

SUBMITTALS
SAMPLES FOR UNIT PAVERS, JOINT MATERIALS, AND EDGE RESTRAINTS

EXECUTION
DO NOT USE FROZEN MATERIALS OR BUILD ON FROZEN SUBGRADE OR SETTING BEDS. PROTECT UNIT PAVES WORK AGAINST FREEZING FOR 24 HOURS AFTER INSTALLATION.

MIX PAVERS FROM SEVERAL PALLETS OR CUBES, AS THEY ARE PLACED, TO PRODUCE UNIFORM BLEND OF COLORS AND TEXTURES.

CUT UNIT PAVERS WITH MOTOR-DRIVEN MASONRY SAW EQUIPMENT TO PROVIDE PATTERN INDICATED AND TO FIT ADJOINING WORK NEATLY. USE FULL UNITS WITHOUT CUTTING WHERE POSSIBLE. INSTALL EDGE RESTRAINTS BEFORE PLACING UNIT PAVERS.

TOLERANCES: DO NOT EXCEED 1/16-INCH UNIT-TO-UNIT OFFSET FROM FLUSH (UPPAGE) NOR 1/8 INCH IN 24 INCHES AND 1/4 INCH IN 10 FEET FROM LEVEL OR INDICATED SLOPE, FOR FINISHED SURFACE OF PAVING.

COMPACT SOIL SUBGRADE UNIFORMLY AND PLACE AGGREGATE BASE. COMPACT BY TAMPING WITH PLATE VIBRATOR, AND SCREED TO DEPTH AS INDICATED.

PLACE LEVELING COURSE AND SCREED TO A THICKNESS OF 1 TO 1-1/2 INCHES, TAKING CARE THAT MOISTURE CONTENT REMAINS CONSTANT AND DENSITY IS LOOSE AND CONSTANT UNTIL PAVERS ARE SET AND COMPACTED. TREAT LEVELING COURSE WITH HERBICIDE TO INHIBIT GROWTH OF GRASS AND WEEDS.

SET PAVERS WITH A MINIMUM JOINT WIDTH OF 1/16-INCH AND A MAXIMUM OF 1/8 INCH. BEING CAREFUL NOT TO DISTURB LEVELING BASE. IF PAVERS HAVE SPACER BARS, PLACE PAVERS HAND TIGHT AGAINST SPACER BARS.

VIBRATE PAVERS INTO LEVELING COURSE AND SPREAD DRY SAND AND FILL JOINTS IMMEDIATELY AFTER VIBRATING PAVERS INTO LEVELING COURSE. VIBRATE PAVERS AND ADD SAND UNTIL JOINTS ARE COMPLETELY FILLED, THEN REMOVE EXCESS SAND. LEAVE A SLIGHT SURPLUS OF SAND ON THE SURFACE FOR JOINT FILLING.

32-10 IRRIGATION SYSTEMS
GENERAL PRODUCTS
SEE LANDSCAPE DRAWINGS

ALL IRRIGATION SHALL MEET ALL CITY LANDSCAPE REQUIREMENTS.

32-11 PLANTING
GENERAL PRODUCTS
SEE LANDSCAPE DRAWINGS.

ALL PLANTING SHALL MEET ALL CITY LANDSCAPE REQUIREMENTS.




Architecture

Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Sandwich, Utah 84094
ph. 801.269.0055
fax 801.269.1425
www.thinkaec.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced in whole or in part without the sole and express written permission from THINK Architecture, Inc.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

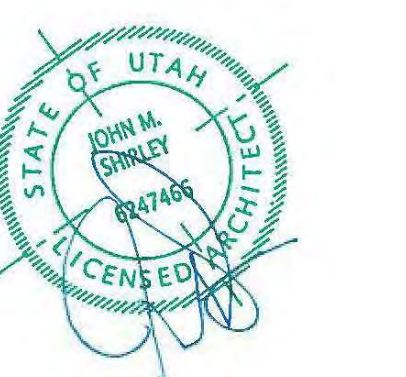

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30

REVISIONS:

SHEET TITLE:
SPECIFICATIONS



SHEET NUMBER:
G010

© 2021 THINK ARCHITECTURE INC.




PERMIT SET

LEGEND	
PROPERTY LINE	---
ADJOINING PROPERTY LINE	---
EASEMENT	---
FENCE	X
EDGE OF PAVEMENT	---
SEWER	S
SEWER MANHOLE (MH)	⊙
WATER	W
WATER GATE VALVE	⊕
HYDRANT	⊕
CURB STOP	⊕
TELEPHONE	T
UTILITY TRENCH	UT
ELEVATION CONTOUR	5775
PROPOSED ELEV CONTOUR	59
SAWCUT LINE	---
CURB TRANSITION	---
FLOW LINE	---
FOOTING DRAIN	FD
STORM DRAIN PIPE	---
DOWN SPOUT	DS
CATCH BASIN-EXIST	⊙
CATCH BASIN	⊙
OIL-WATER SEPARATOR	⊕
DRYWELL	⊕
ASPHALT PAVEMENT	---
PAVERS	---
GRAVEL	---
CONCRETE	---
FG	---
EG	---
FINISHED GRADE	---
EXISTING GROUND	---



- GENERAL NOTES**
- CONTRACTOR SHALL FIELD VERIFY LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING CONSTRUCTION. ANY CONFLICT SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
 - CONTRACTOR SHALL NOTIFY DIGLINE (1-800-342-1585) AT LEAST 48 HOURS PRIOR TO BEGINNING CONSTRUCTION ACTIVITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO EXISTING UTILITIES ENCOUNTERED DURING CONSTRUCTION.
 - CONTRACTOR SHALL BE RESPONSIBLE FOR DUST CONTROL DURING THE CONSTRUCTION OF ALL ITEMS HEREON. DUST CONTROL SHALL BE CONTINUOUS DURING CONSTRUCTION, 24 HOURS PER DAY 7 DAYS PER WEEK.
 - CONTRACTOR SHALL ASSURE POSITIVE DRAINAGE AWAY FROM THE HOUSE.
 - TRENCH DRAIN SHALL BE A 6" WIDE HDPE CHANNEL WITH A 0.75 BUILT IN CHANNEL SLOPE (ZURN FLO-THRU MODEL Z886 OR EQUIVALENT). GRATE SHALL BE DUCTILE IRON WITH A SLOTTED PATTERN. CATCH BASIN SHALL BE 6" WIDE X 20" LONG X 20" DEEP AND SHALL BE MADE OF HDPE. OUTLET PIPE SHALL BE 4" DIAMETER. (FLO-THRU MODEL Z887 OR EQUIVALENT). ALL COMPONENTS SHALL BE RATED FOR H2O LOADING.
 - ALL WORK WITHIN THE CITY RIGHT OF WAY SHALL CONFORM TO CITY OF KETCHUM STANDARDS.
 - AN OIL-WATER SEPARATOR IS REQUIRED FOR THE GARAGE DRAIN PRIOR TO ENTERING THE DRYWELL. OIL-WATER SEPARATOR MAY BE INSTALLED IN GARAGE IF DESIRED.
 - CONCRETE WITHIN CITY RIGHT-OF-WAY SHALL BE TITAN MIX OR EQUAL. ALTERNATE COLD WEATHER MIX WILL NEED TO BE SUBMITTED TO THE CITY FOR REVIEW AND APPROVAL PRIOR TO PLACEMENT.
 - CONCRETE SHALL BE SEALED WITH AN OPAQUE SEALER.
 - 6" ROLLED CURB & GUTTER SHALL BE PER CITY OF KETCHUM STANDARD DETAIL #4.
 - CONCRETE SIDEWALK SHALL BE PER CITY OF KETCHUM STANDARD DETAIL #7.
 - ADA RAMP SHALL BE PER CITY OF KETCHUM STANDARD DETAILS #8 AND #9 AND MODIFIED FOR MID-BLOCK CROSSING.

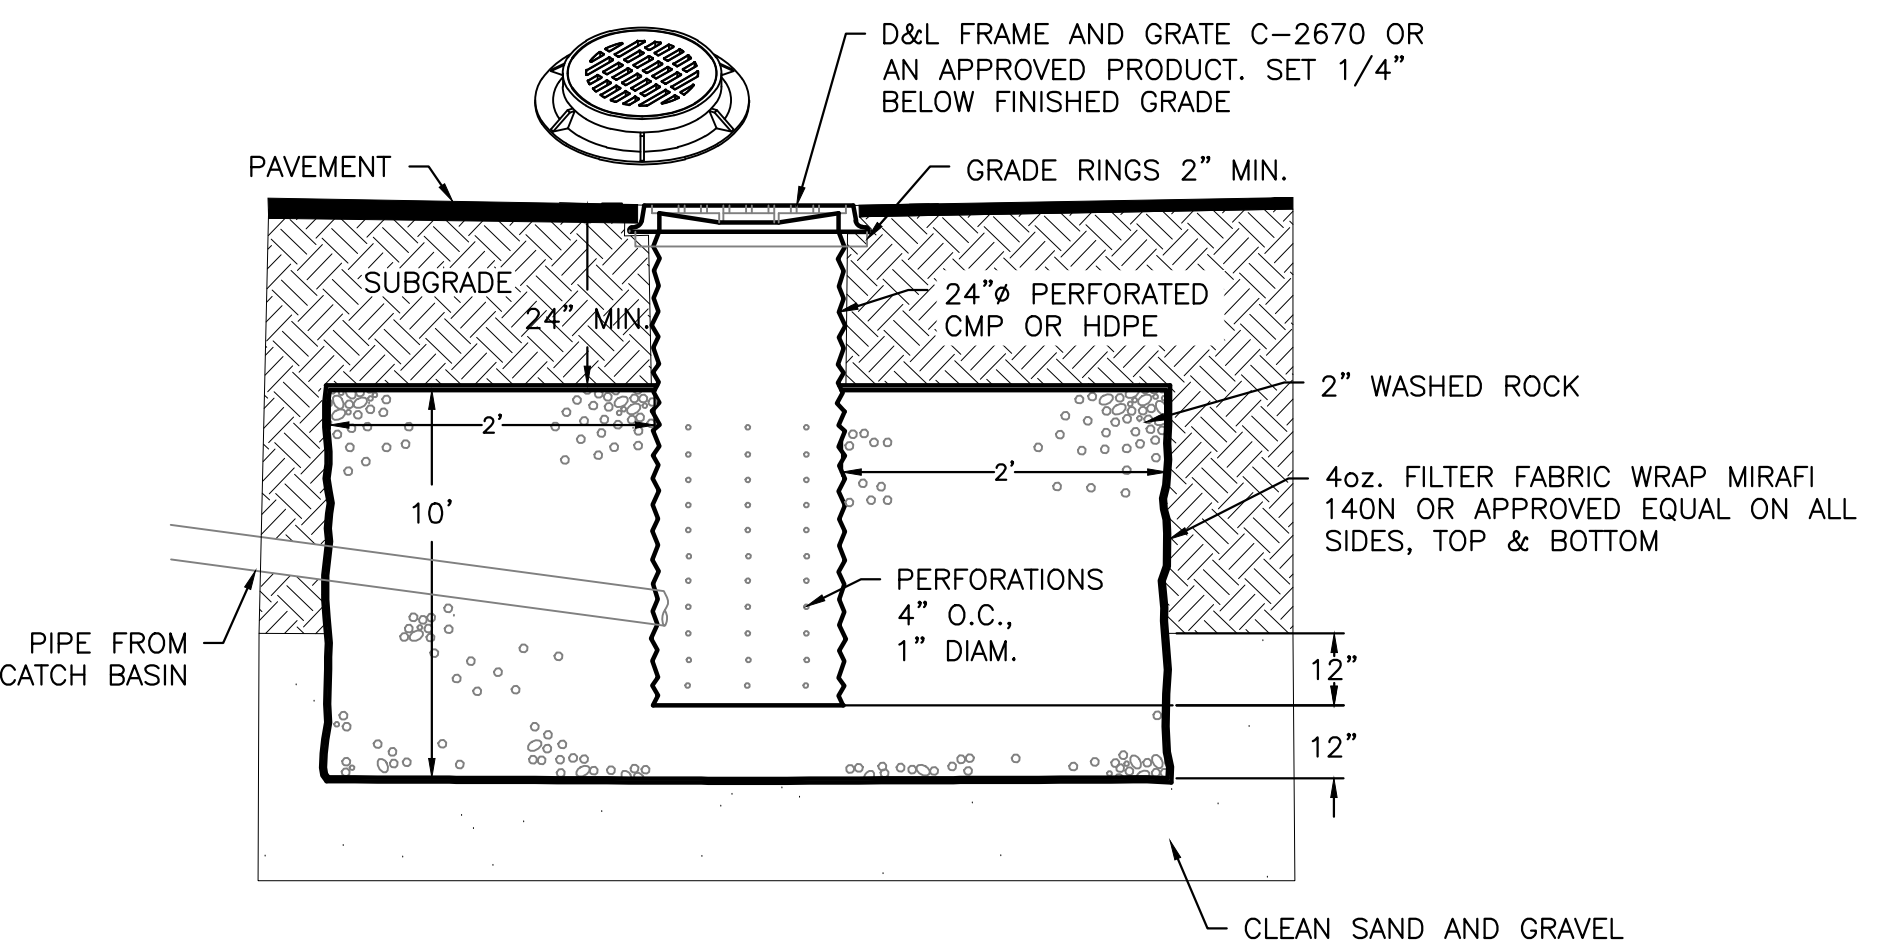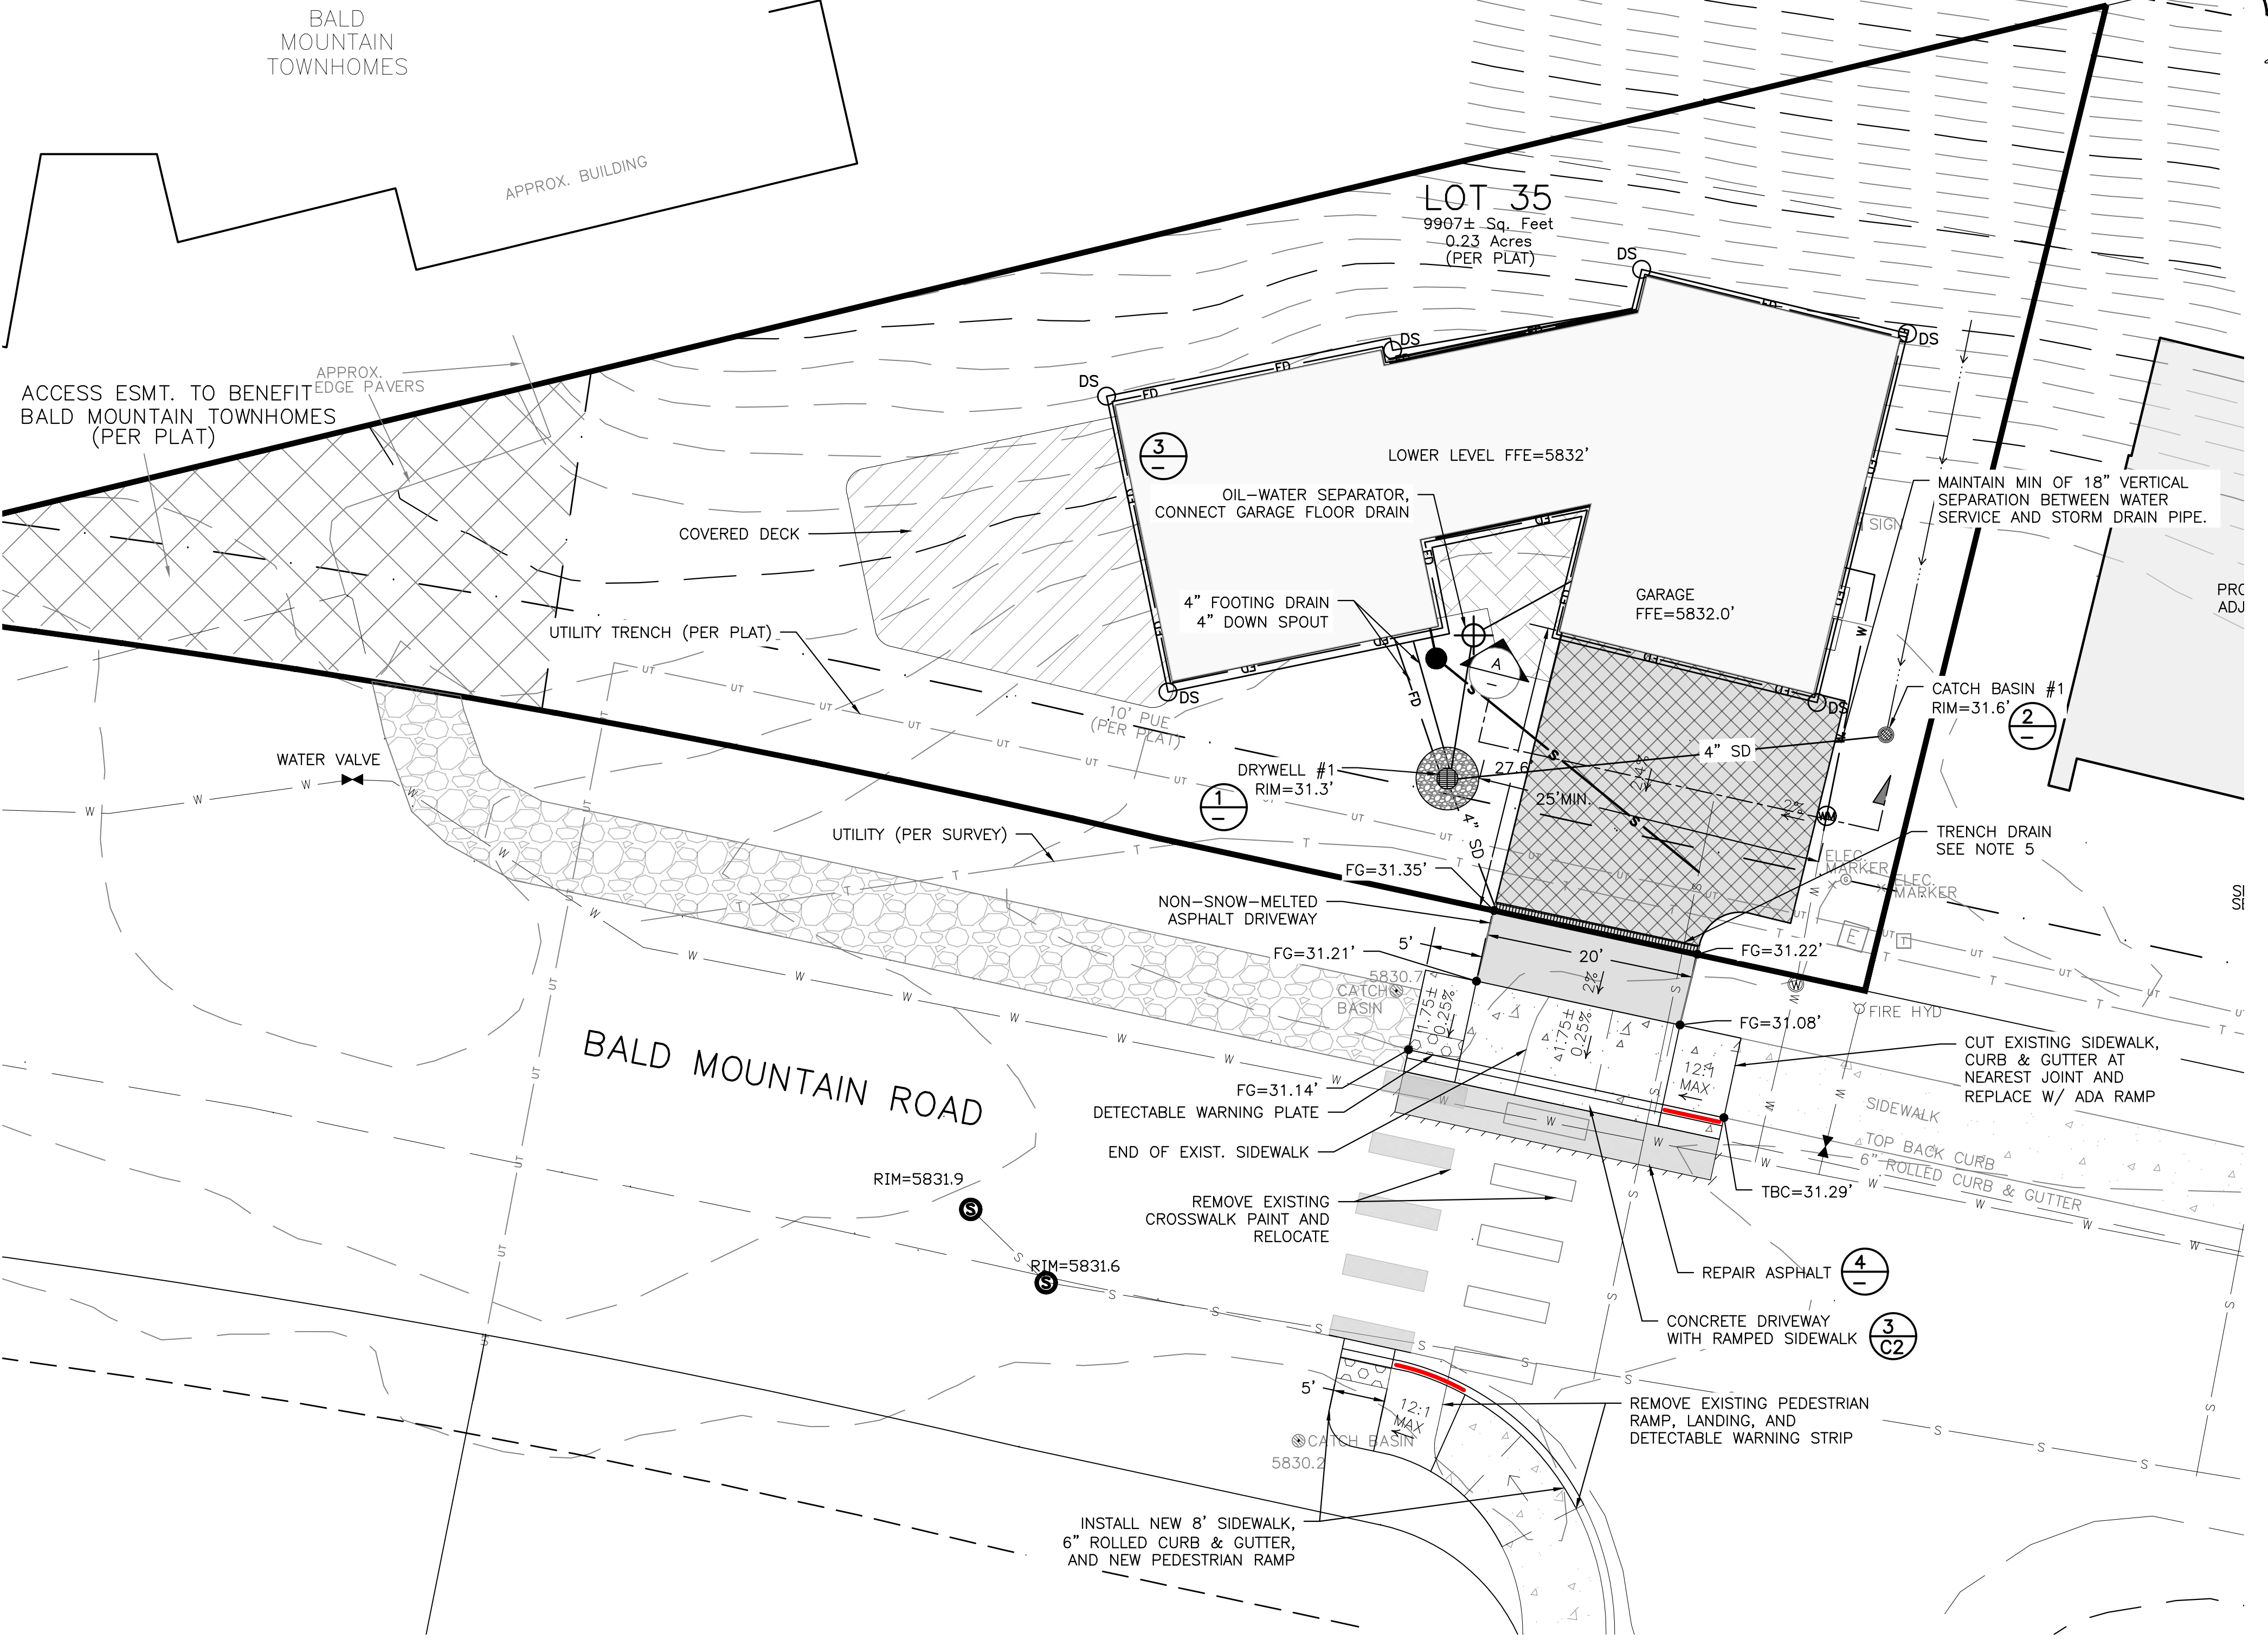

- NOTES:**
- THE BED SHALL BE EXCAVATED A MINIMUM OF 24" INTO CLEAN SAND AND GRAVEL.
 - MAXIMUM DEPTH SHALL NOT EXCEED 12 FEET.
 - IF CLEAN SAND AND GRAVEL IS NOT ENCOUNTERED WITHIN 12 FEET, THE CONTRACTOR SHALL CONTACT THE DESIGN ENGINEER.
 - GRATE OR SOLID LID AS APPROVED BY CITY OF KETCHUM.

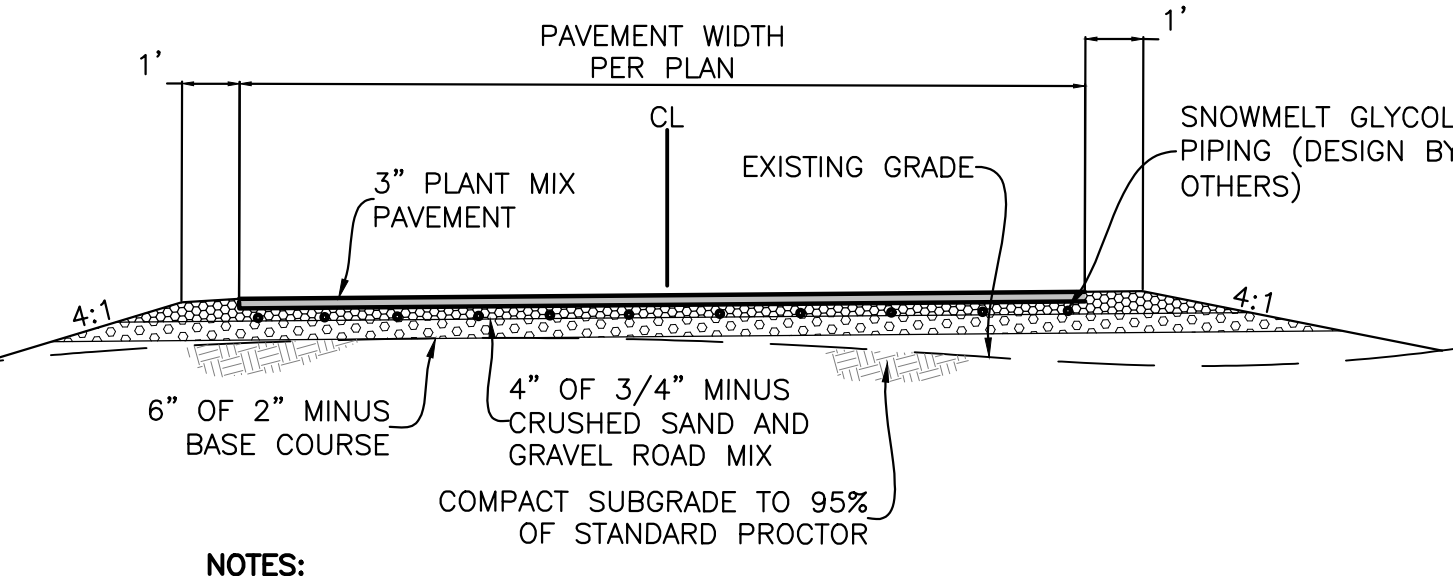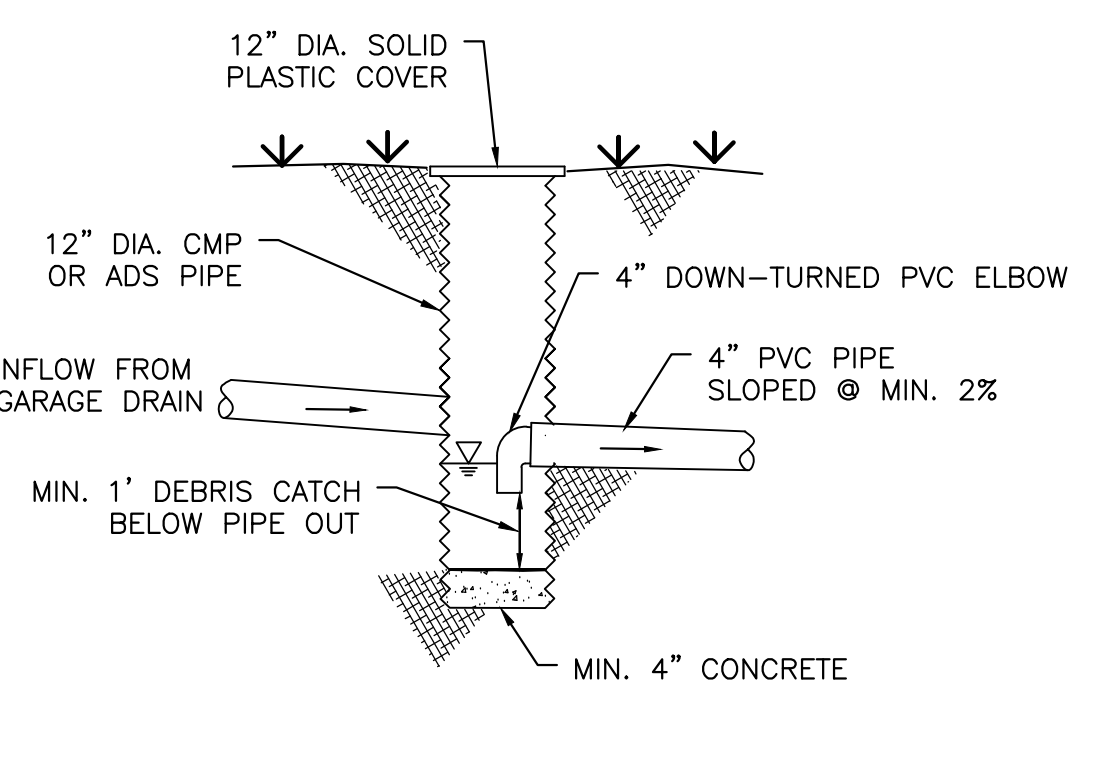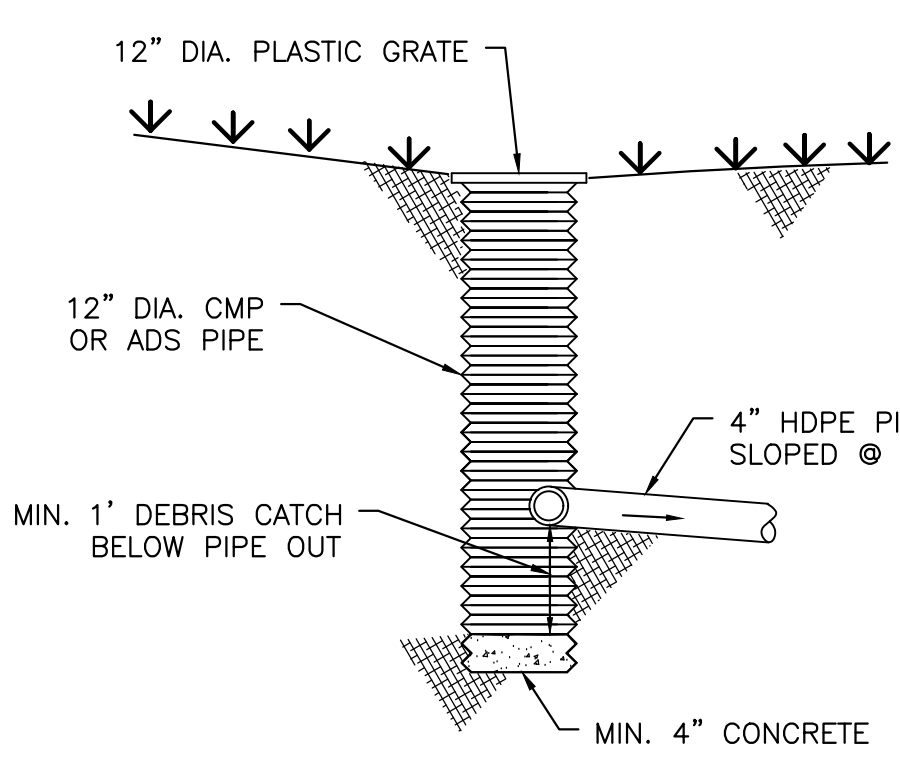

- NOTES:**
- COMPACT DRIVEWAY SUBGRADE AND ALL STRUCTURAL FILL MATERIAL TO AT LEAST 95% OF THE MAXIMUM DENSITY OF EACH MATERIAL ACCORDING TO STANDARD PROCTOR ASTM D-698.

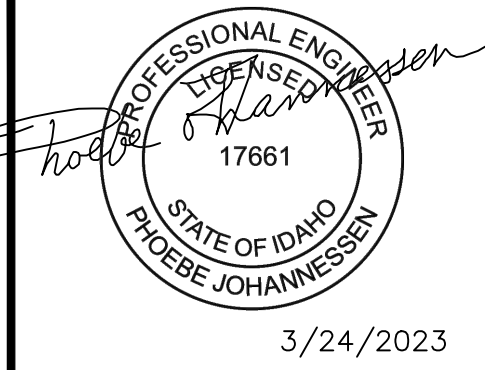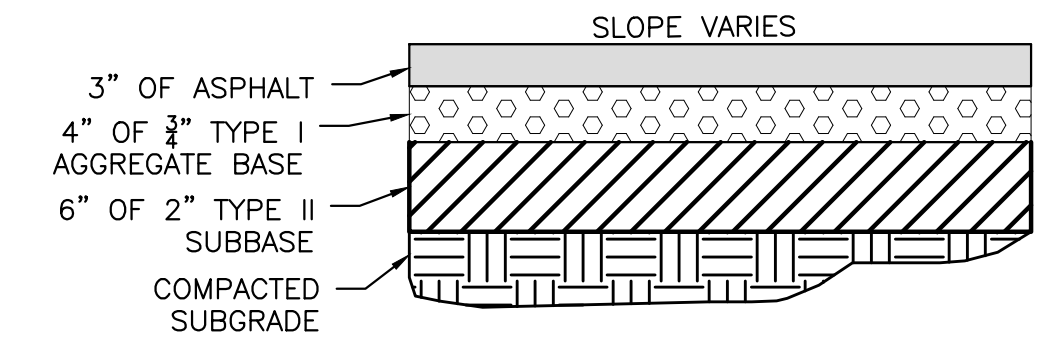

NO.	REVISIONS	DESCRIPTION	DATE	BY
1				

BENCHMARK ASSOCIATES

PREPARED BY:
BENCHMARK ASSOCIATES, P.A.
P.O. BOX 733 100 BELL DRIVE
KETCHUM, IDAHO 83340
(208) 726-9512
FAX 726-9514
WEB: WWW.BMASB.COM
MAIL: WWW.BMASB.COM


GRADING & DRAINAGE PLAN

WARM SPRINGS RANCH LOT 35
T4N, R17E, SEC 12, B.M., BLAINE COUNTY, IDAHO

PREPARED FOR: MAGLEBY CONSTRUCTION

DRAWN BY:	SLS
DESIGNED BY:	SLS
CHECKED BY:	PLJ
DATE:	03/24/2023
PROJECT NO.:	22076


DRAWING NO. **C-1**

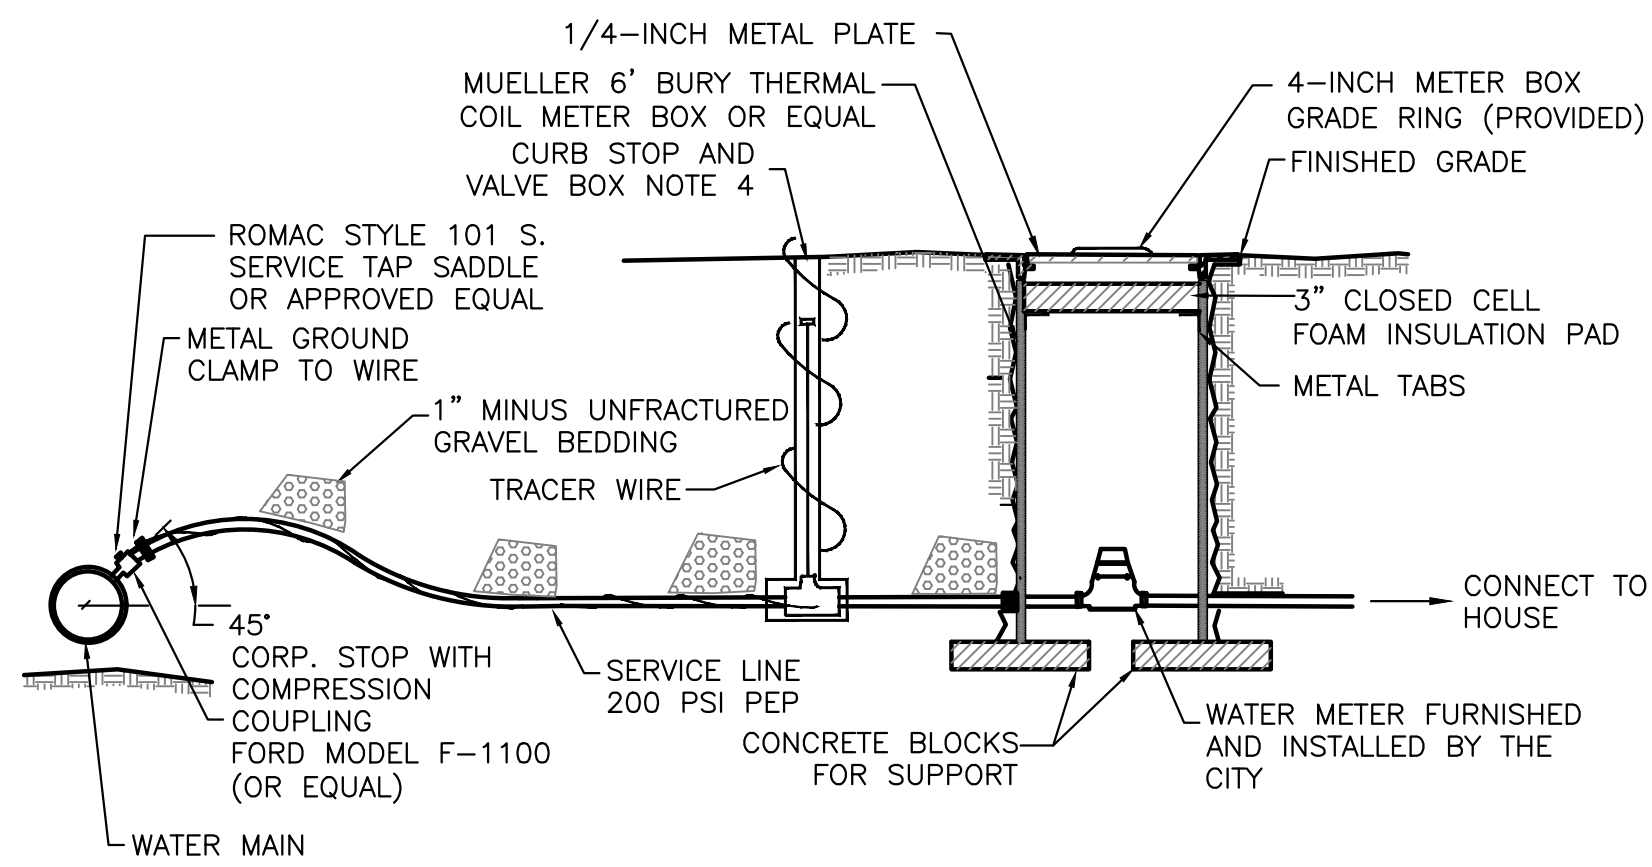

NOTES

1. WATER SERVICE LINE SHALL HAVE A 6" MIN. BURY DEPTH
2. SERVICE LINE SHALL BE 1" DIAMETER POLYETHYLENE PIPE UNLESS OTHERWISE SPECIFIED.
3. WATER SERVICE LINES SHALL BE BEDDED WITH 1" MINUS UNFRACTURED GRAVEL. BEDDING SHALL BE INSTALLED 4" UNDER THE PIPE AND 6" OVER THE PIPE.
4. FORD MODEL B-111 RESILIENT SEAT, CURB BALL VALVE (OR EQUAL), FORD EXTENSION CURB BOX WITH ARCHED BASE, 1-INCH UPPER SECTION, AND 2 HOLE "ERIE" PATTERN LID.

1 WATER SERVICE AND METER CONNECTION
SCALE: N.T.S.


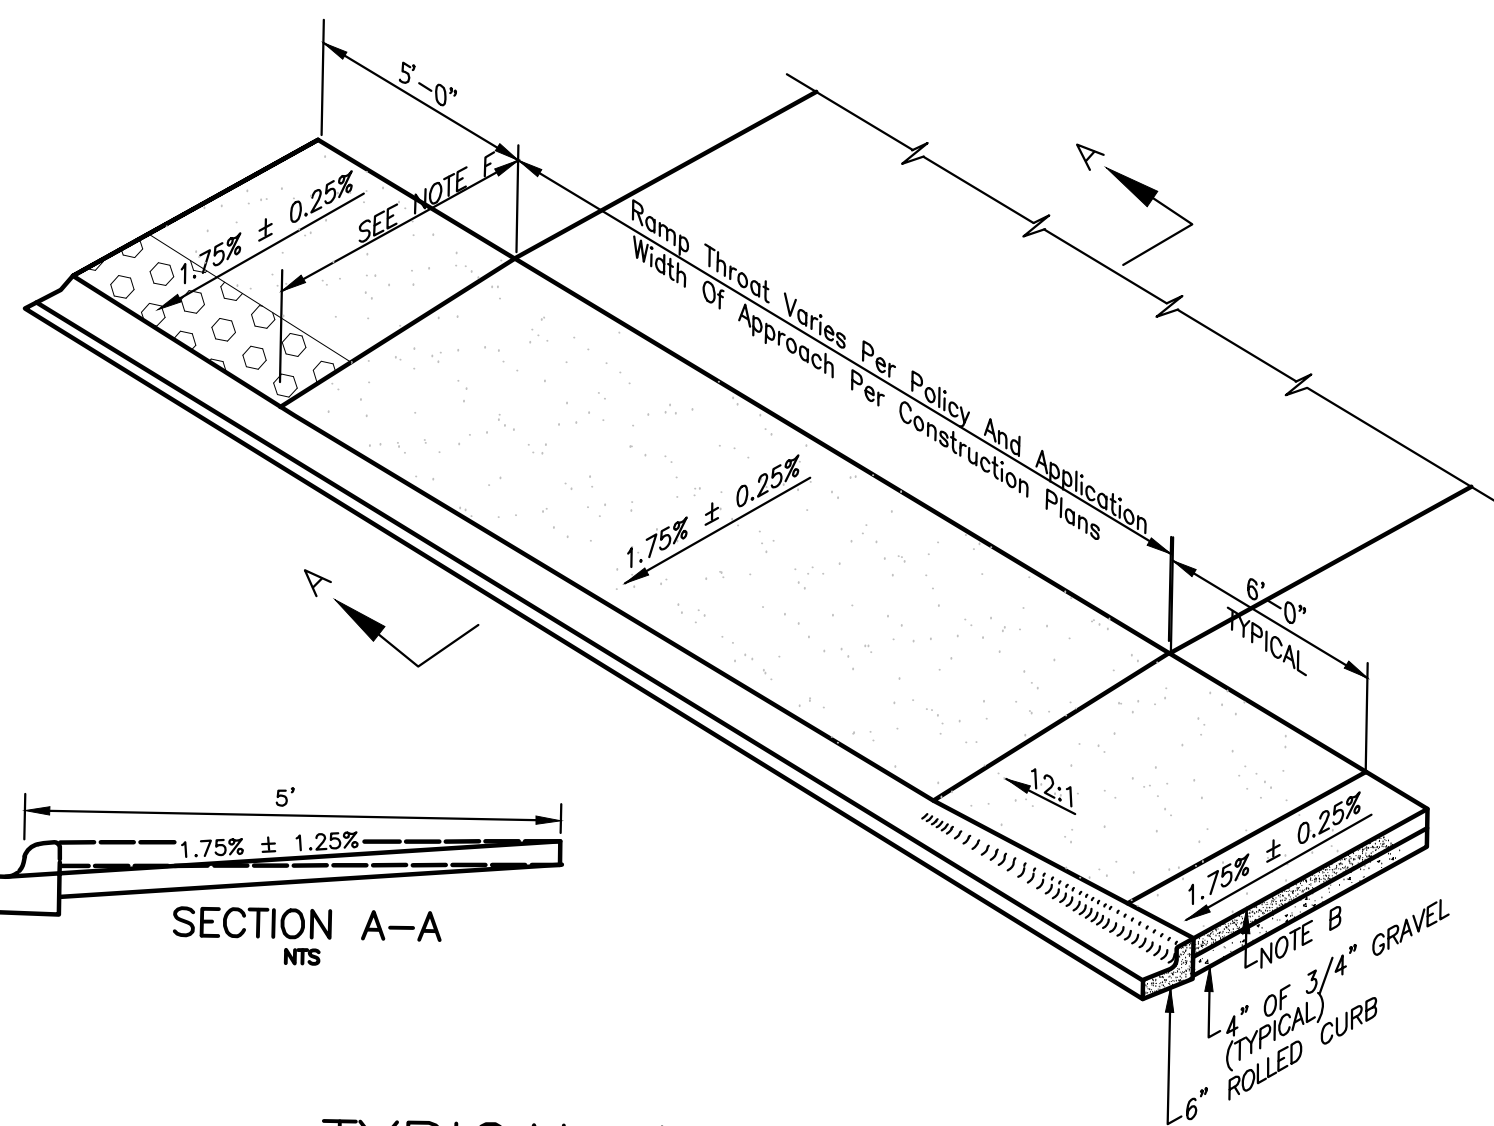


TYPICAL APPROACH

NOTES:

- APPROACH TO CONFORM TO THE LATEST ADA STANDARDS.
- INSTALL EXPANSION JOINT AT TIP OF APPROACH WINGS WHERE SIDEWALK CHANGES THICKNESS.
- BASE TO BE A 4" THICKNESS OF 3/4" MINUS CRUSHED AGGREGATE PER SECTION-802.
- APPROACH THROAT WIDTHS SET BY POLICY AND APPLICATION. ALL CONCRETE TO BE 6" THICK FROM TIP OF WING TO TIP OF WING UP TO THE EXPANSION JOINT. WHEN SIDEWALK IS SEPARATE FROM CURB THE SIDEWALK IMMEDIATELY BEHIND THE APPROACH THROAT SHALL BE 6" THICK ALSO.
- ALL CONCRETE SHALL BE CLASS 3000 PER SECTION-703.
- SIDEWALK WIDTH IS 8 FEET.

3 CONCRETE DRIVEWAY WITH RAMPED SIDEWALK
SCALE: NONE

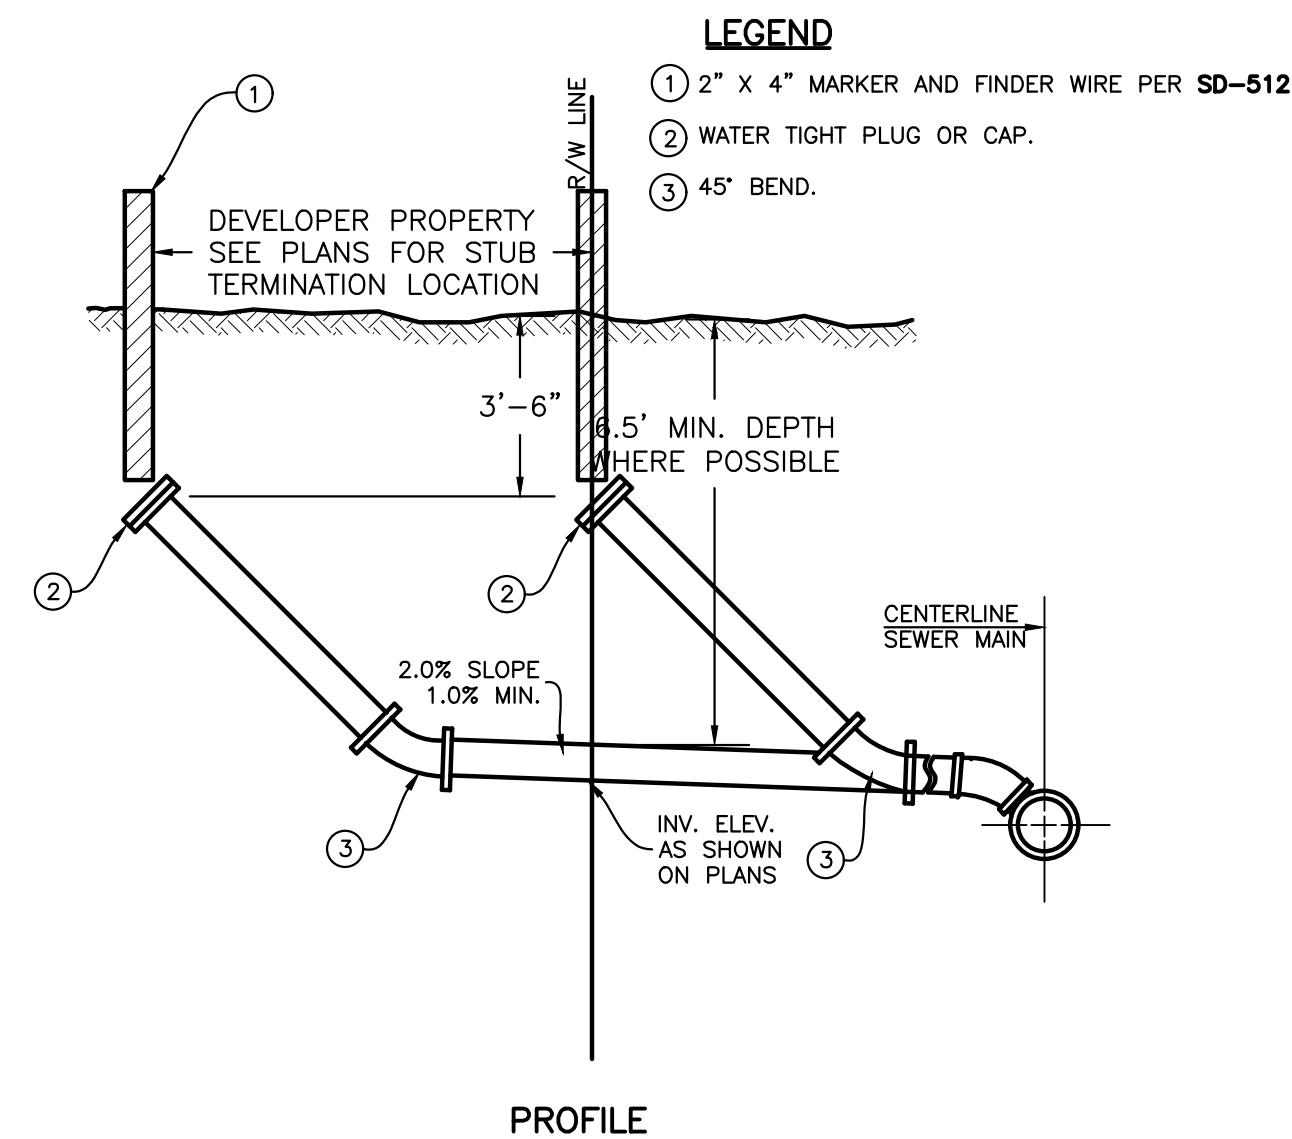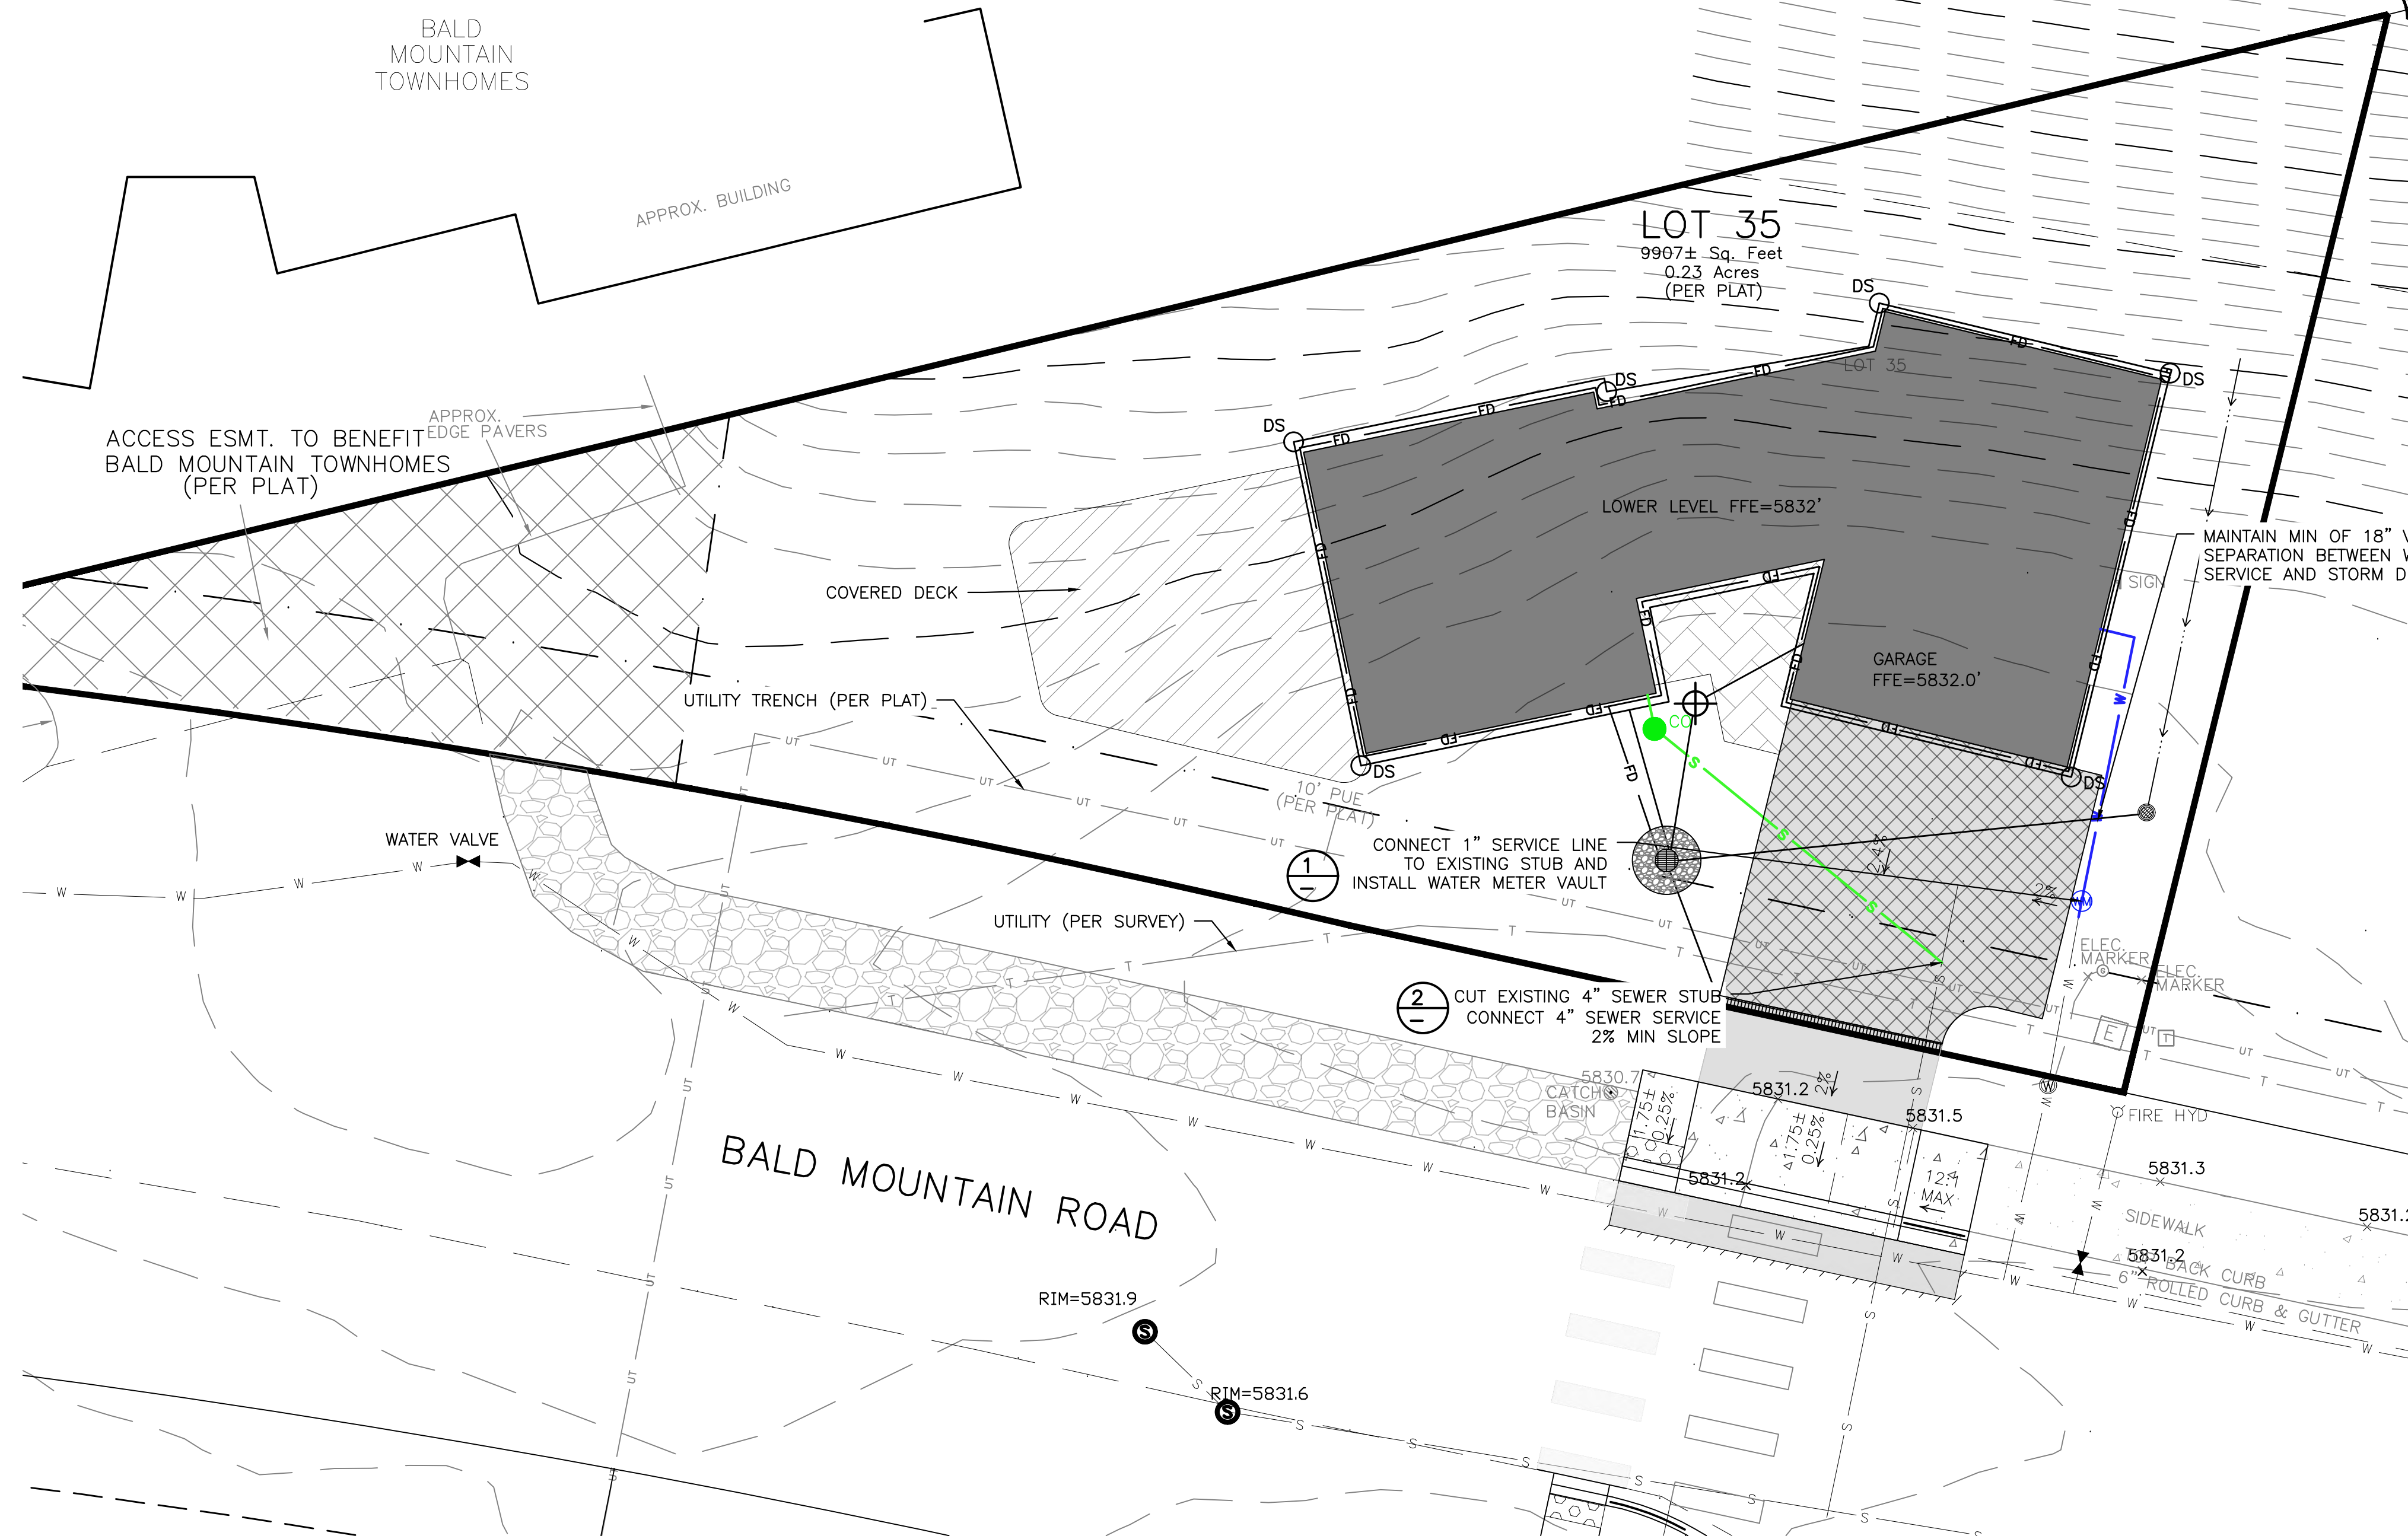

NOTES

1. INSULATION REQUIRED WHERE SEWER LINE BURY DEPTH IS LESS THAN 5'.

2 STANDARD SEWER SERVICE CONNECTION DETAIL
SCALE: NONE

PROFESSIONAL ENGINEER
STATE OF IDAHO
PHILIP JOHANNESSEN
17661
3/24/2023

NO.	REVISIONS	DESCRIPTION	DATE	BY
1				



PREPARED BY:
BENCHMARK ASSOCIATES, P.A.
P.O. BOX 733 100 BELL DRIVE
KETCHUM, IDAHO 83340
(208) 726-9512
FAX 726-9514
WEB: WWW.BMA5B.COM
MAIL: WWW.BMA5B.COM

UTILITY PLAN
WARM SPRINGS RANCH LOT 35
T4N, R17E, SEC 12, B.M., BLAINE COUNTY, IDAHO
PREPARED FOR: MAGLEBY CONSTRUCTION

DRAWN BY: SLS
DESIGNED BY: SLS
CHECKED BY: PLJ
DATE: 03/24/2023
PROJECT NO.: 22076

DRAWING NO.

C-2


Cut And Fill:

Total Cut = 450 Cubic Yards

Total Fill = 100 Cubic Yards

Total Export = 350 Cubic Yards





- General Notes**
1. Base map information taken from survey by Benchmark Associates dated 11/24/21 and from on-site information. Architectural information provided by Think Architecture dated 02/22/22. Contractor shall verify conditions in the field prior to construction.
 2. Landscape architect is not responsible for any deviation from these plans, unless such changes are authorized by the landscape architect in writing.
 3. All existing utilities are underground. All new utilities shall be underground.
 4. Site serviced by City of Ketchum.

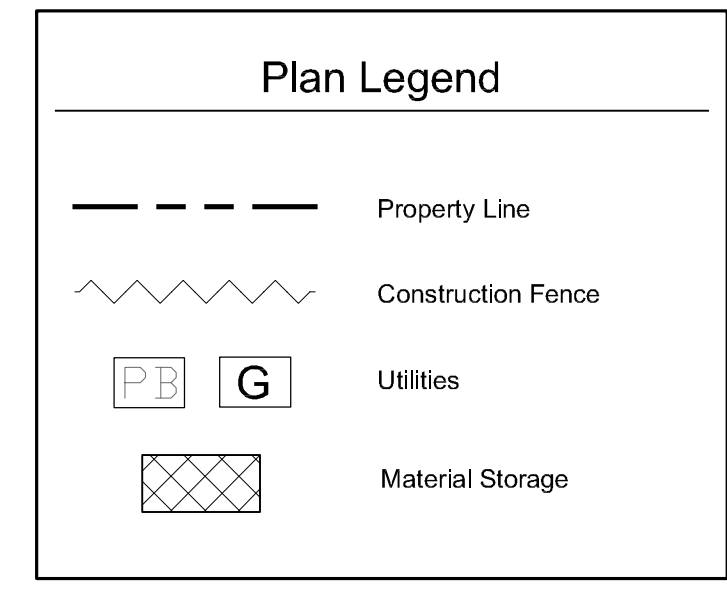

NOTES:

(1) See Civil Plans for All Work in Right of Way.

- CONSTRUCTION ACTIVITY NOTES:**
- (1) Dust Control Using Water Truck as Needed.
 - (2) All Construction Traffic Shall Have Tires Inspected for Mud, Sand, and Gravel Prior to Leaving Site. Any Material Shall be Removed Prior to Entering City Streets.
 - (3) Contractor is Responsible for Snow Removal of Site and Construction Parking.
 - (4) Any Temporary Use Of The Public Right-Of-Way Will Require A Temporary Use Right-Of-Way (TURP) Permit From The City.
 - (5) All Neighbors In The Project Vicinity Shall Be Provided Notice Of The Project, Schedule And The General Contractor's Contact Information In Advance Of Construction.
 - (6) The Job Site Shall be Kept In A Clean And Orderly Condition, Trash Shall be Picked Up On The Site And Surrounding Areas On A Daily Basis, And Materials Shall be Stored In Neat, Tidy Piles.
 - (7) The Condition Of The Right-Of-Way Shall be Documented With Photographs And A Site Visit With Street Department Personnel. Repair Of Damage To The Right-Of-Way Shall be The Responsibility Of The General Contractor.
 - (8) Manholes May Not be Obstructed At Any Time. In Addition, Minimum Three Feet Clear Shall be Maintained On Back And Sides Of Fire Hydrants, And Minimum 15 Feet Clear Shall be Maintained On The Front, Street Side Of Fire Hydrants.
 - (9) Speed Limits For Construction Vehicles Shall be Limited To 15 MPH Within One Block Of The Construction Site, Unless Otherwise Determined Be The Ketchum Police Department.

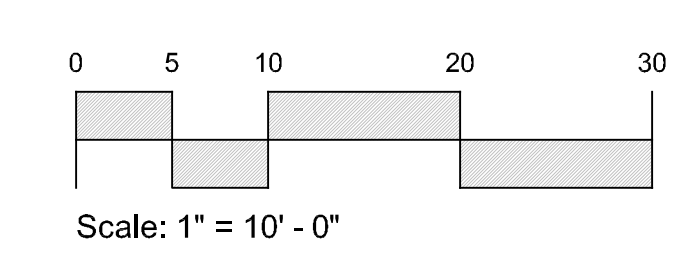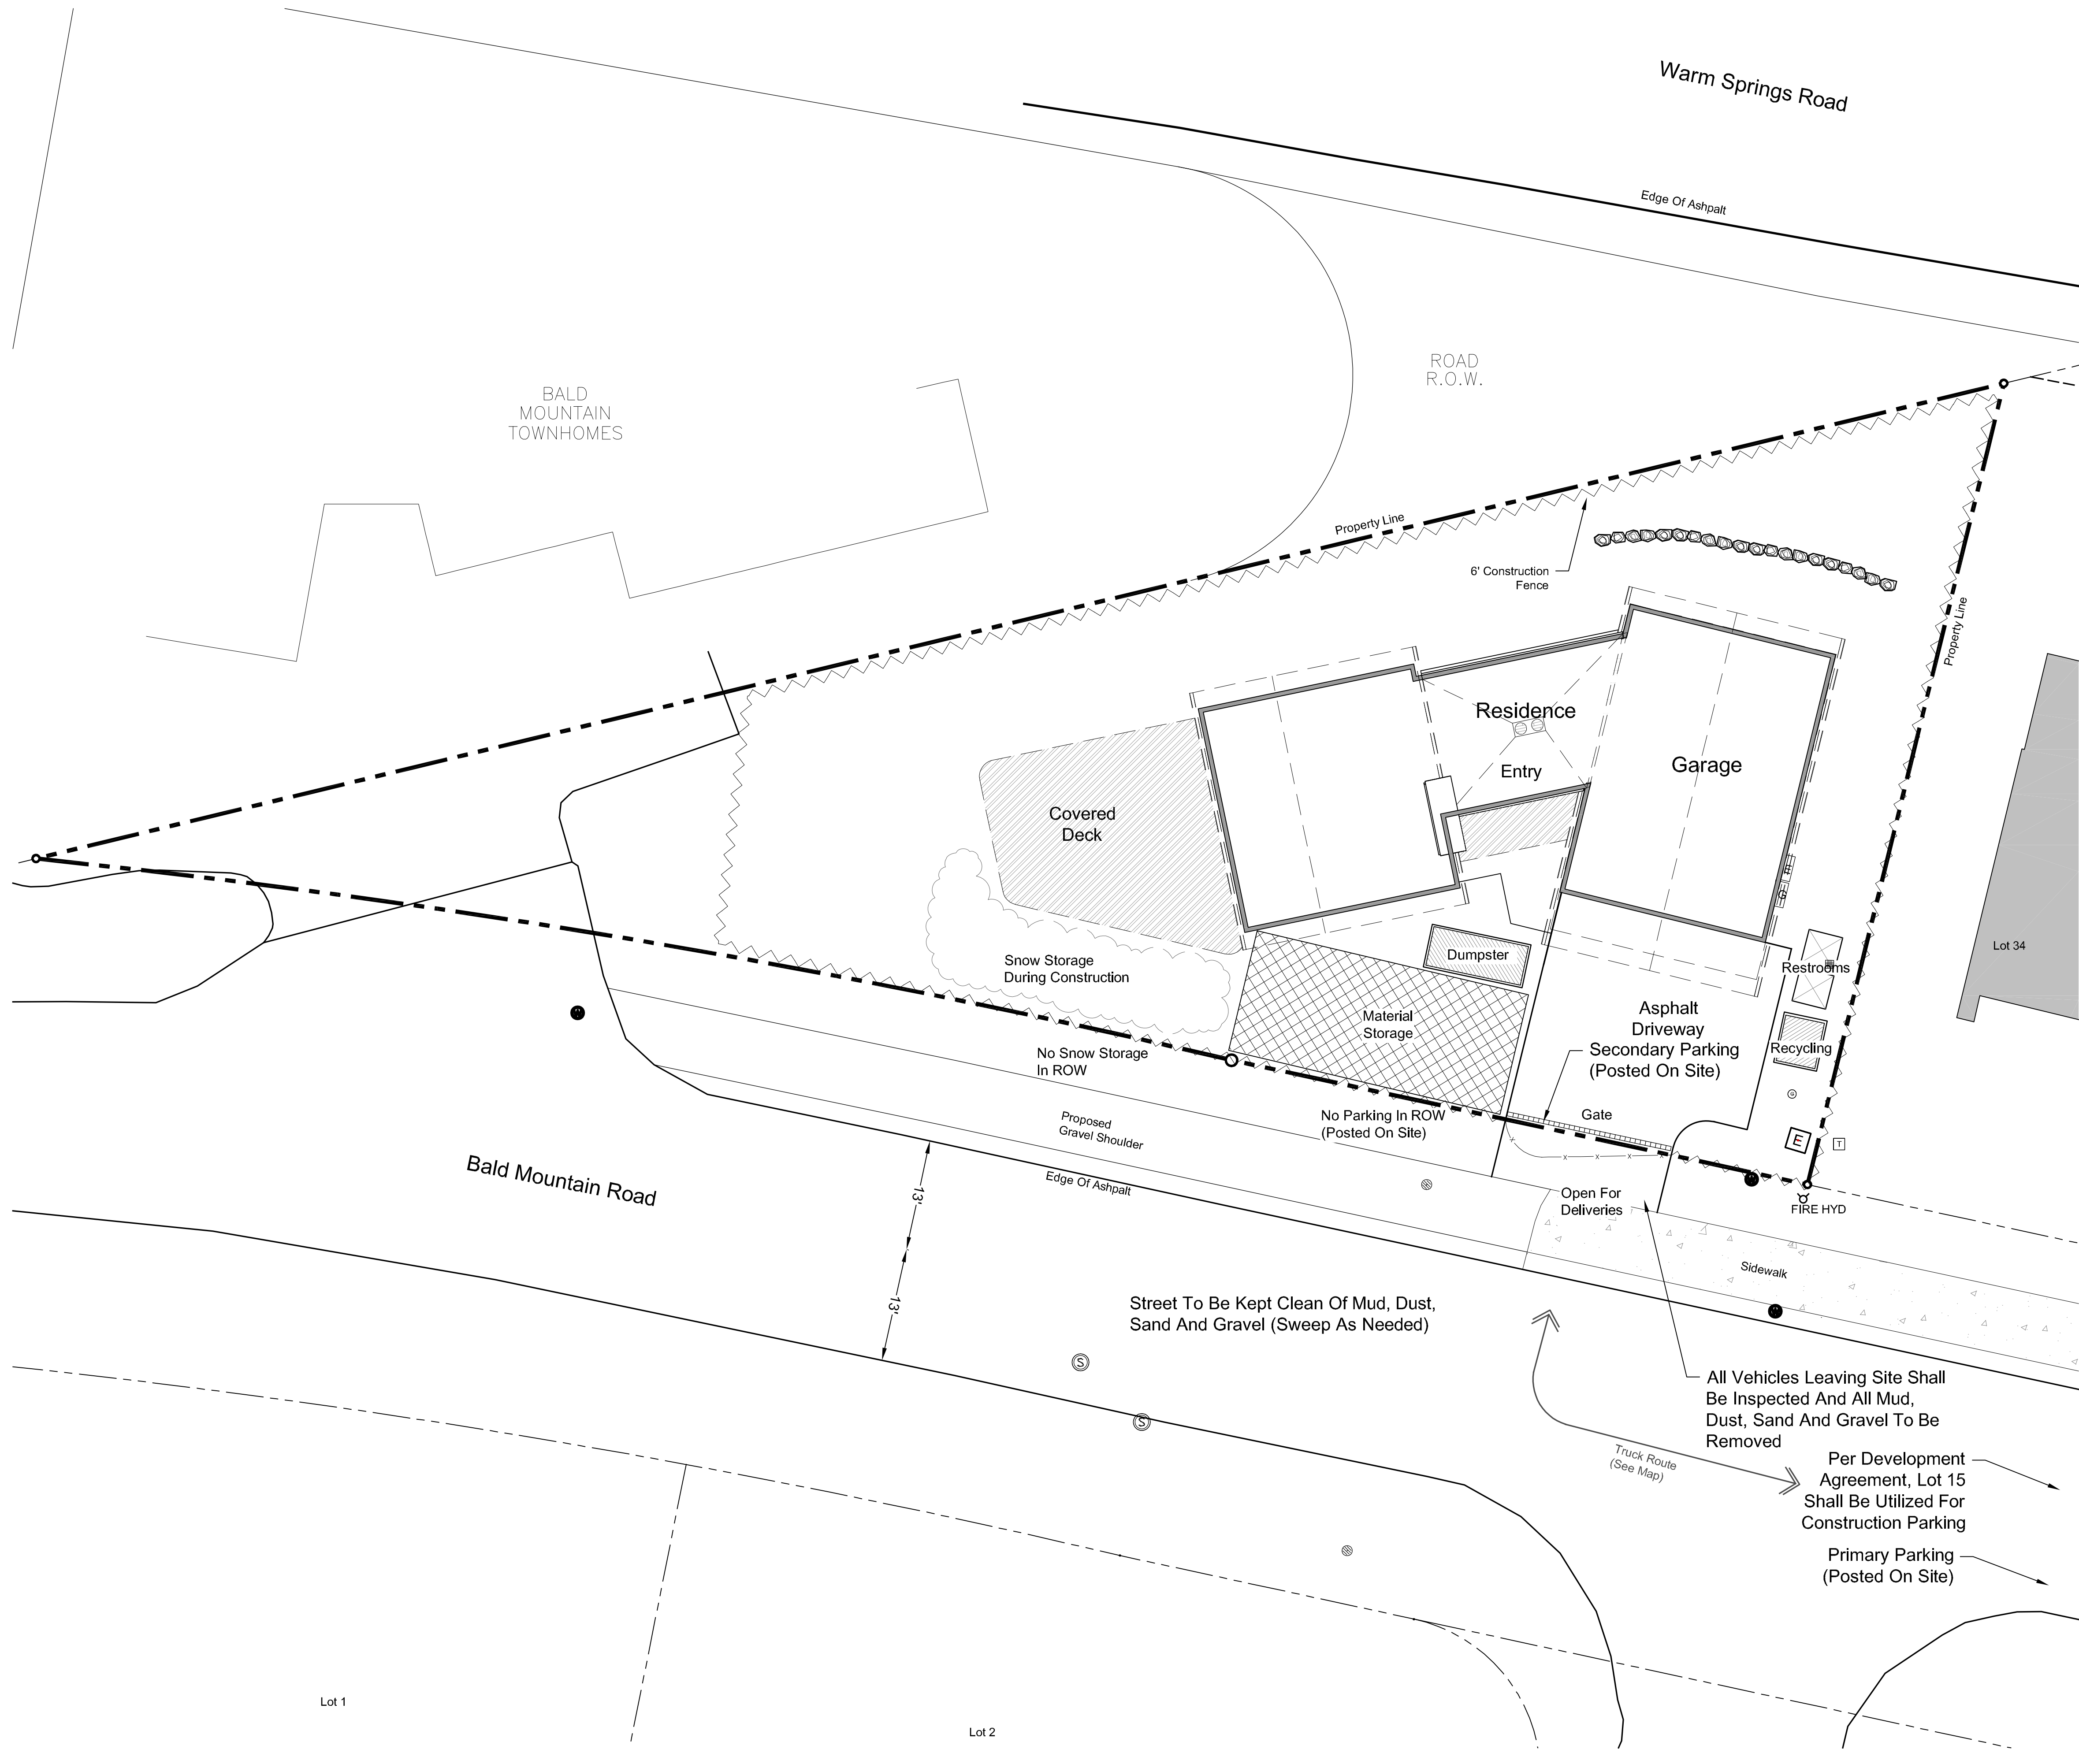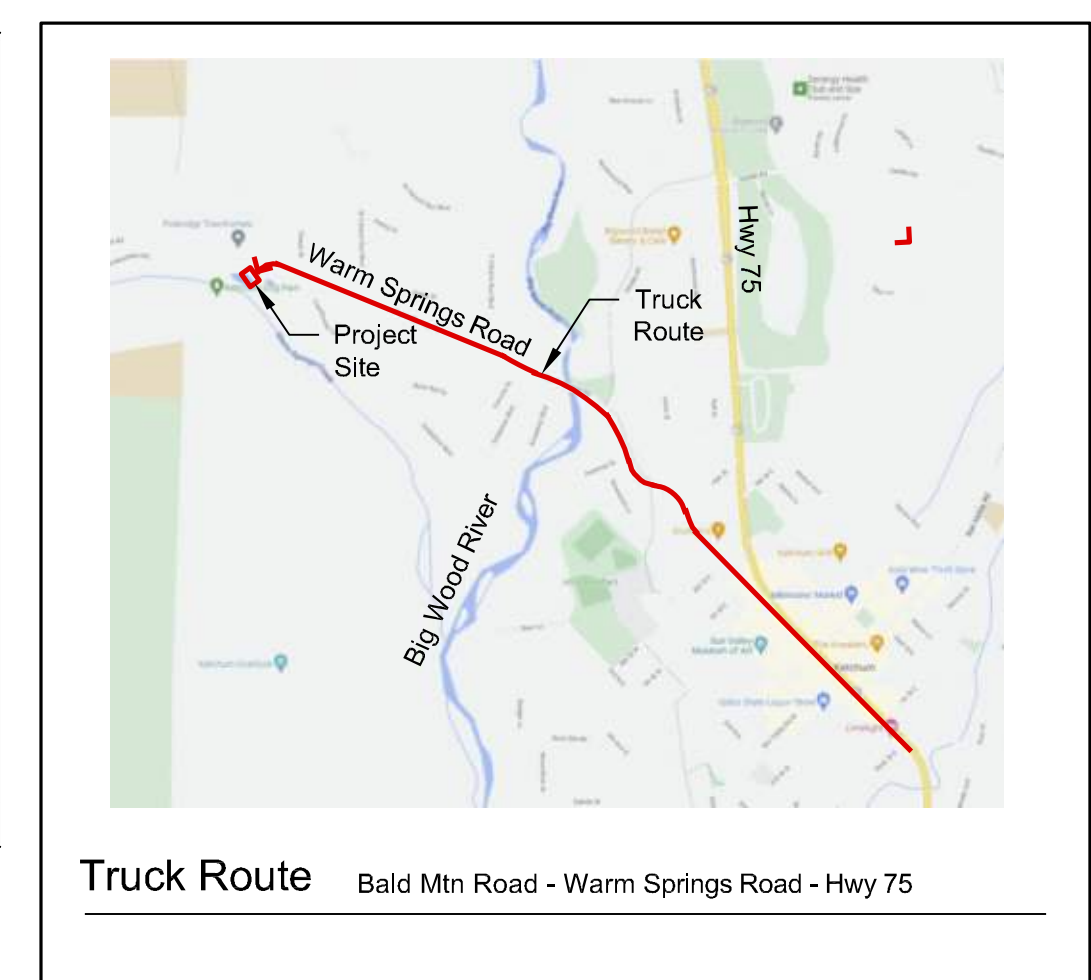


Warm Springs Ranch Residences
Block 1, Lot 35
Ketchum, Idaho

Job No: 22.28

Scale: 1" = 10'-0"


Issue/Revisions	Date
Design Review	05/22/23
RVSD	05/08/23

All information appearing herein shall not be construed, interpreted or otherwise used without the written consent of Eggers Associates P.A.

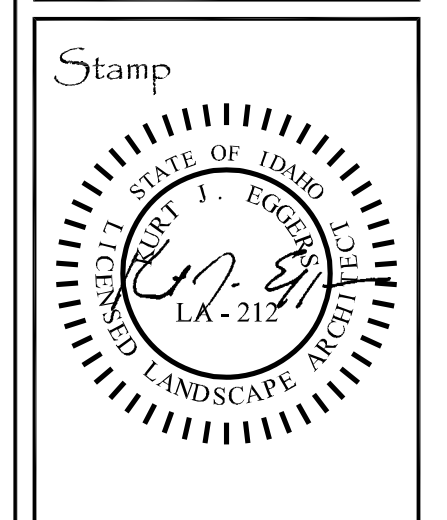

Sheet Title:
Construction Management

Sheet No:
L1

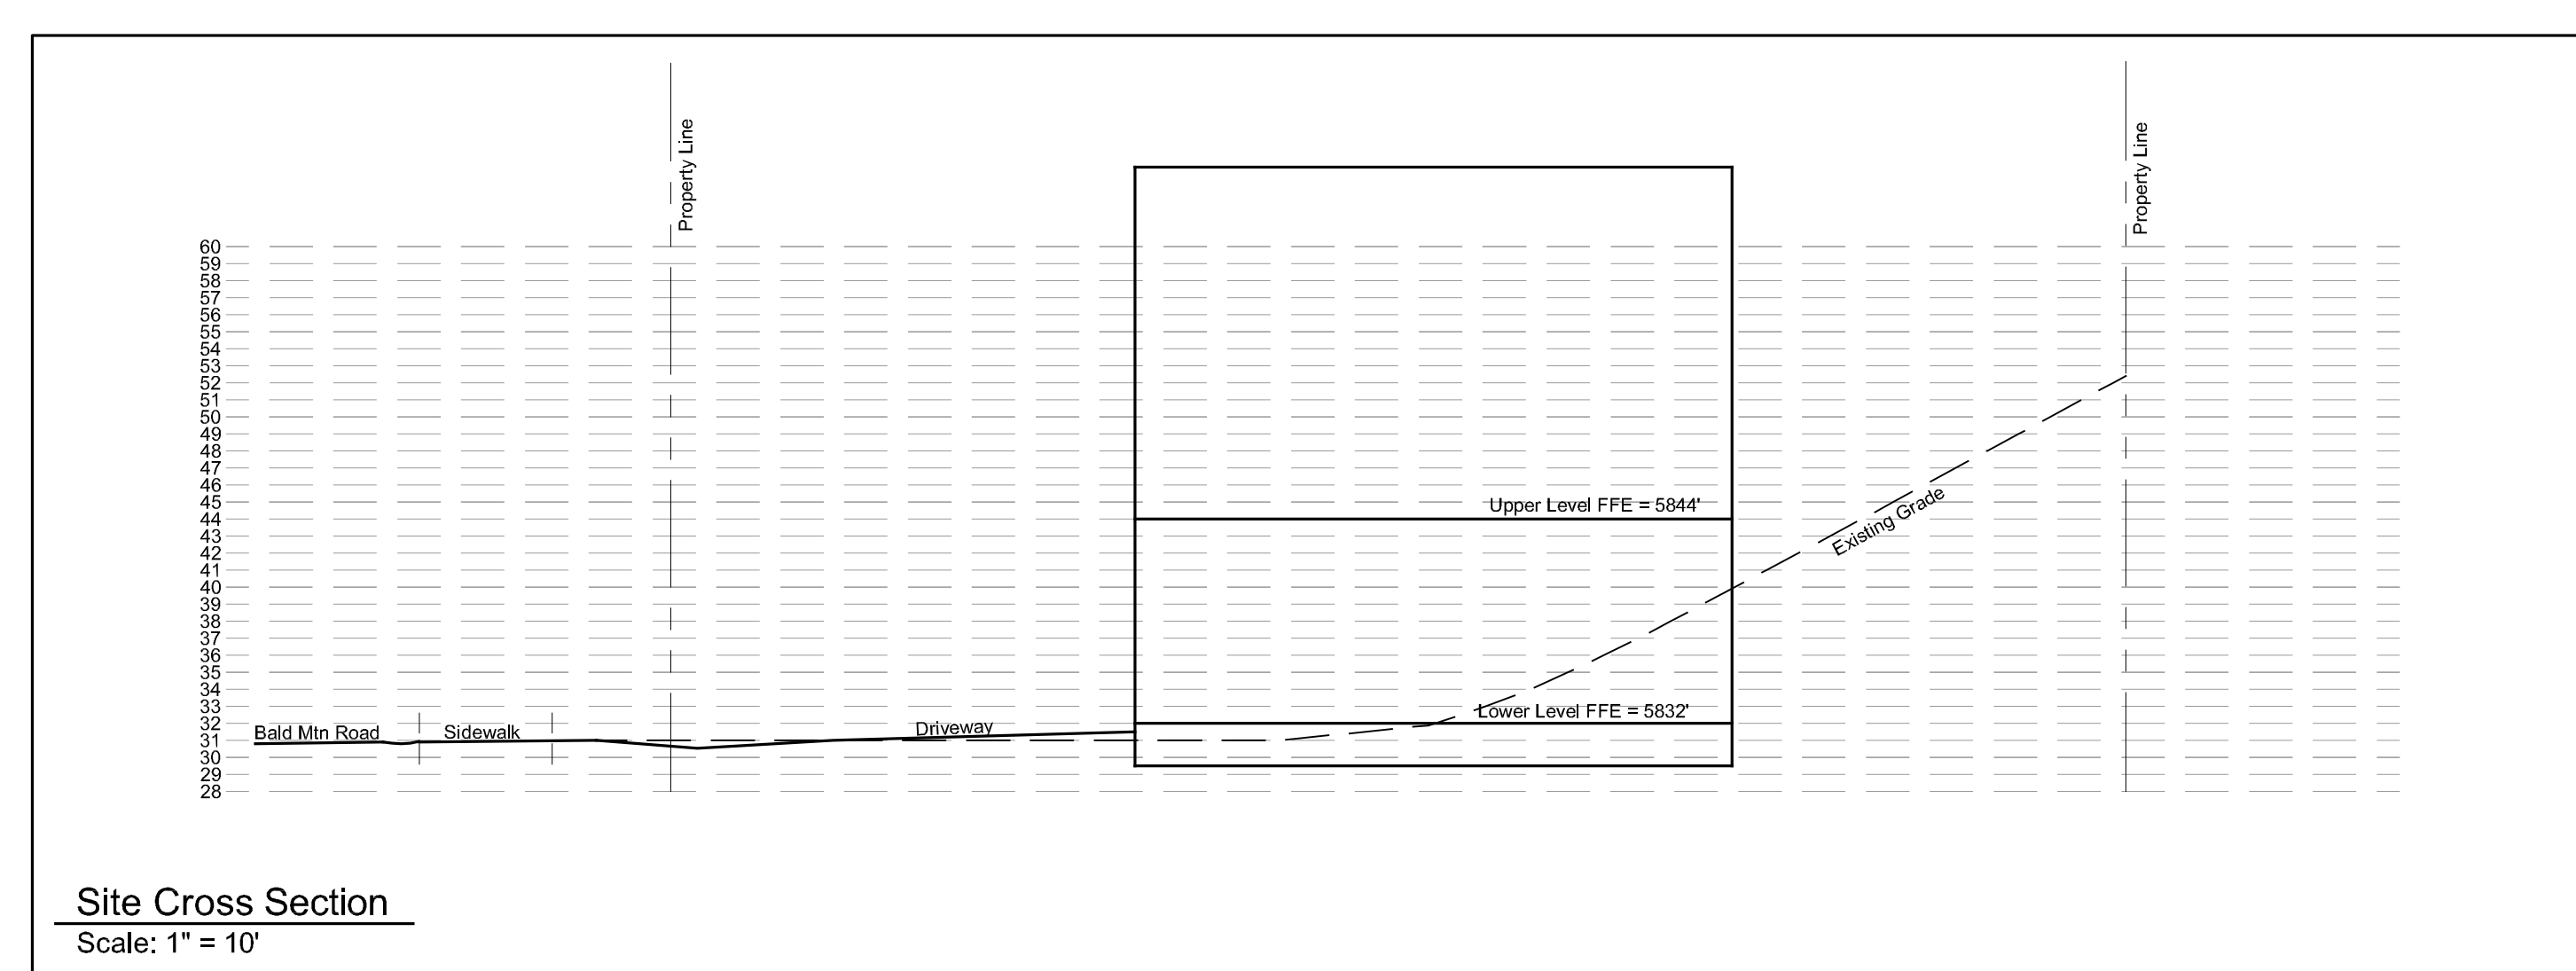

Cut & Fill






Excavation:	
Building/Garage:	450 Cu/Yds
Site:	0 Cu/Yds
Total Cut:	450 Cu/Yds
Fill:	
Site Landscape Fill:	0 Cu/Yds
Driveway:	100 Cu/Yds
Total Fill:	100 Cu/Yds
Total Export:	350 Cu/Yds

- General Notes**
1. Base map information taken from survey by Benchmark Associates dated 11/24/21 and from on-site information. Architectural information provided by Think Architecture dated 02/22/22. Contractor shall verify conditions in the field prior to construction.
 2. Landscape architect is not responsible for any deviation from these plans, unless such changes are authorized by the landscape architect in writing.
 3. All existing utilities are underground. All new utilities shall be underground.
 4. Site serviced by City of Ketchum.

***See Civil Plan (C1) For Site Grading And Drainage**

Plan Legend

---	Property Line
- - - -	Existing Contour
x 92.7	Existing Spot Elevations
● 95	Proposed Contour
⊕	Landscape Drywell
■	Catch Basin
2% Slope	Proposed Drainage Direction With Slope Percentage
+ 92.5	Proposed Spot Elevations
	4" Perforated Footing Drain
---	4" Solid Drain Pipe (Roof & Downspouts)
⊖	Drystack Retaining Wall
— w —	Water Line
— e —	Electrical Service
— g —	Gas Service
— w —	Water Service
— s —	Sewer Service

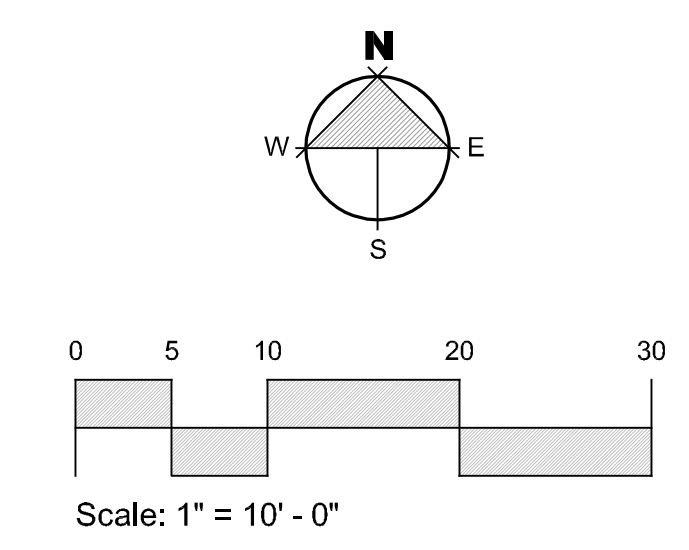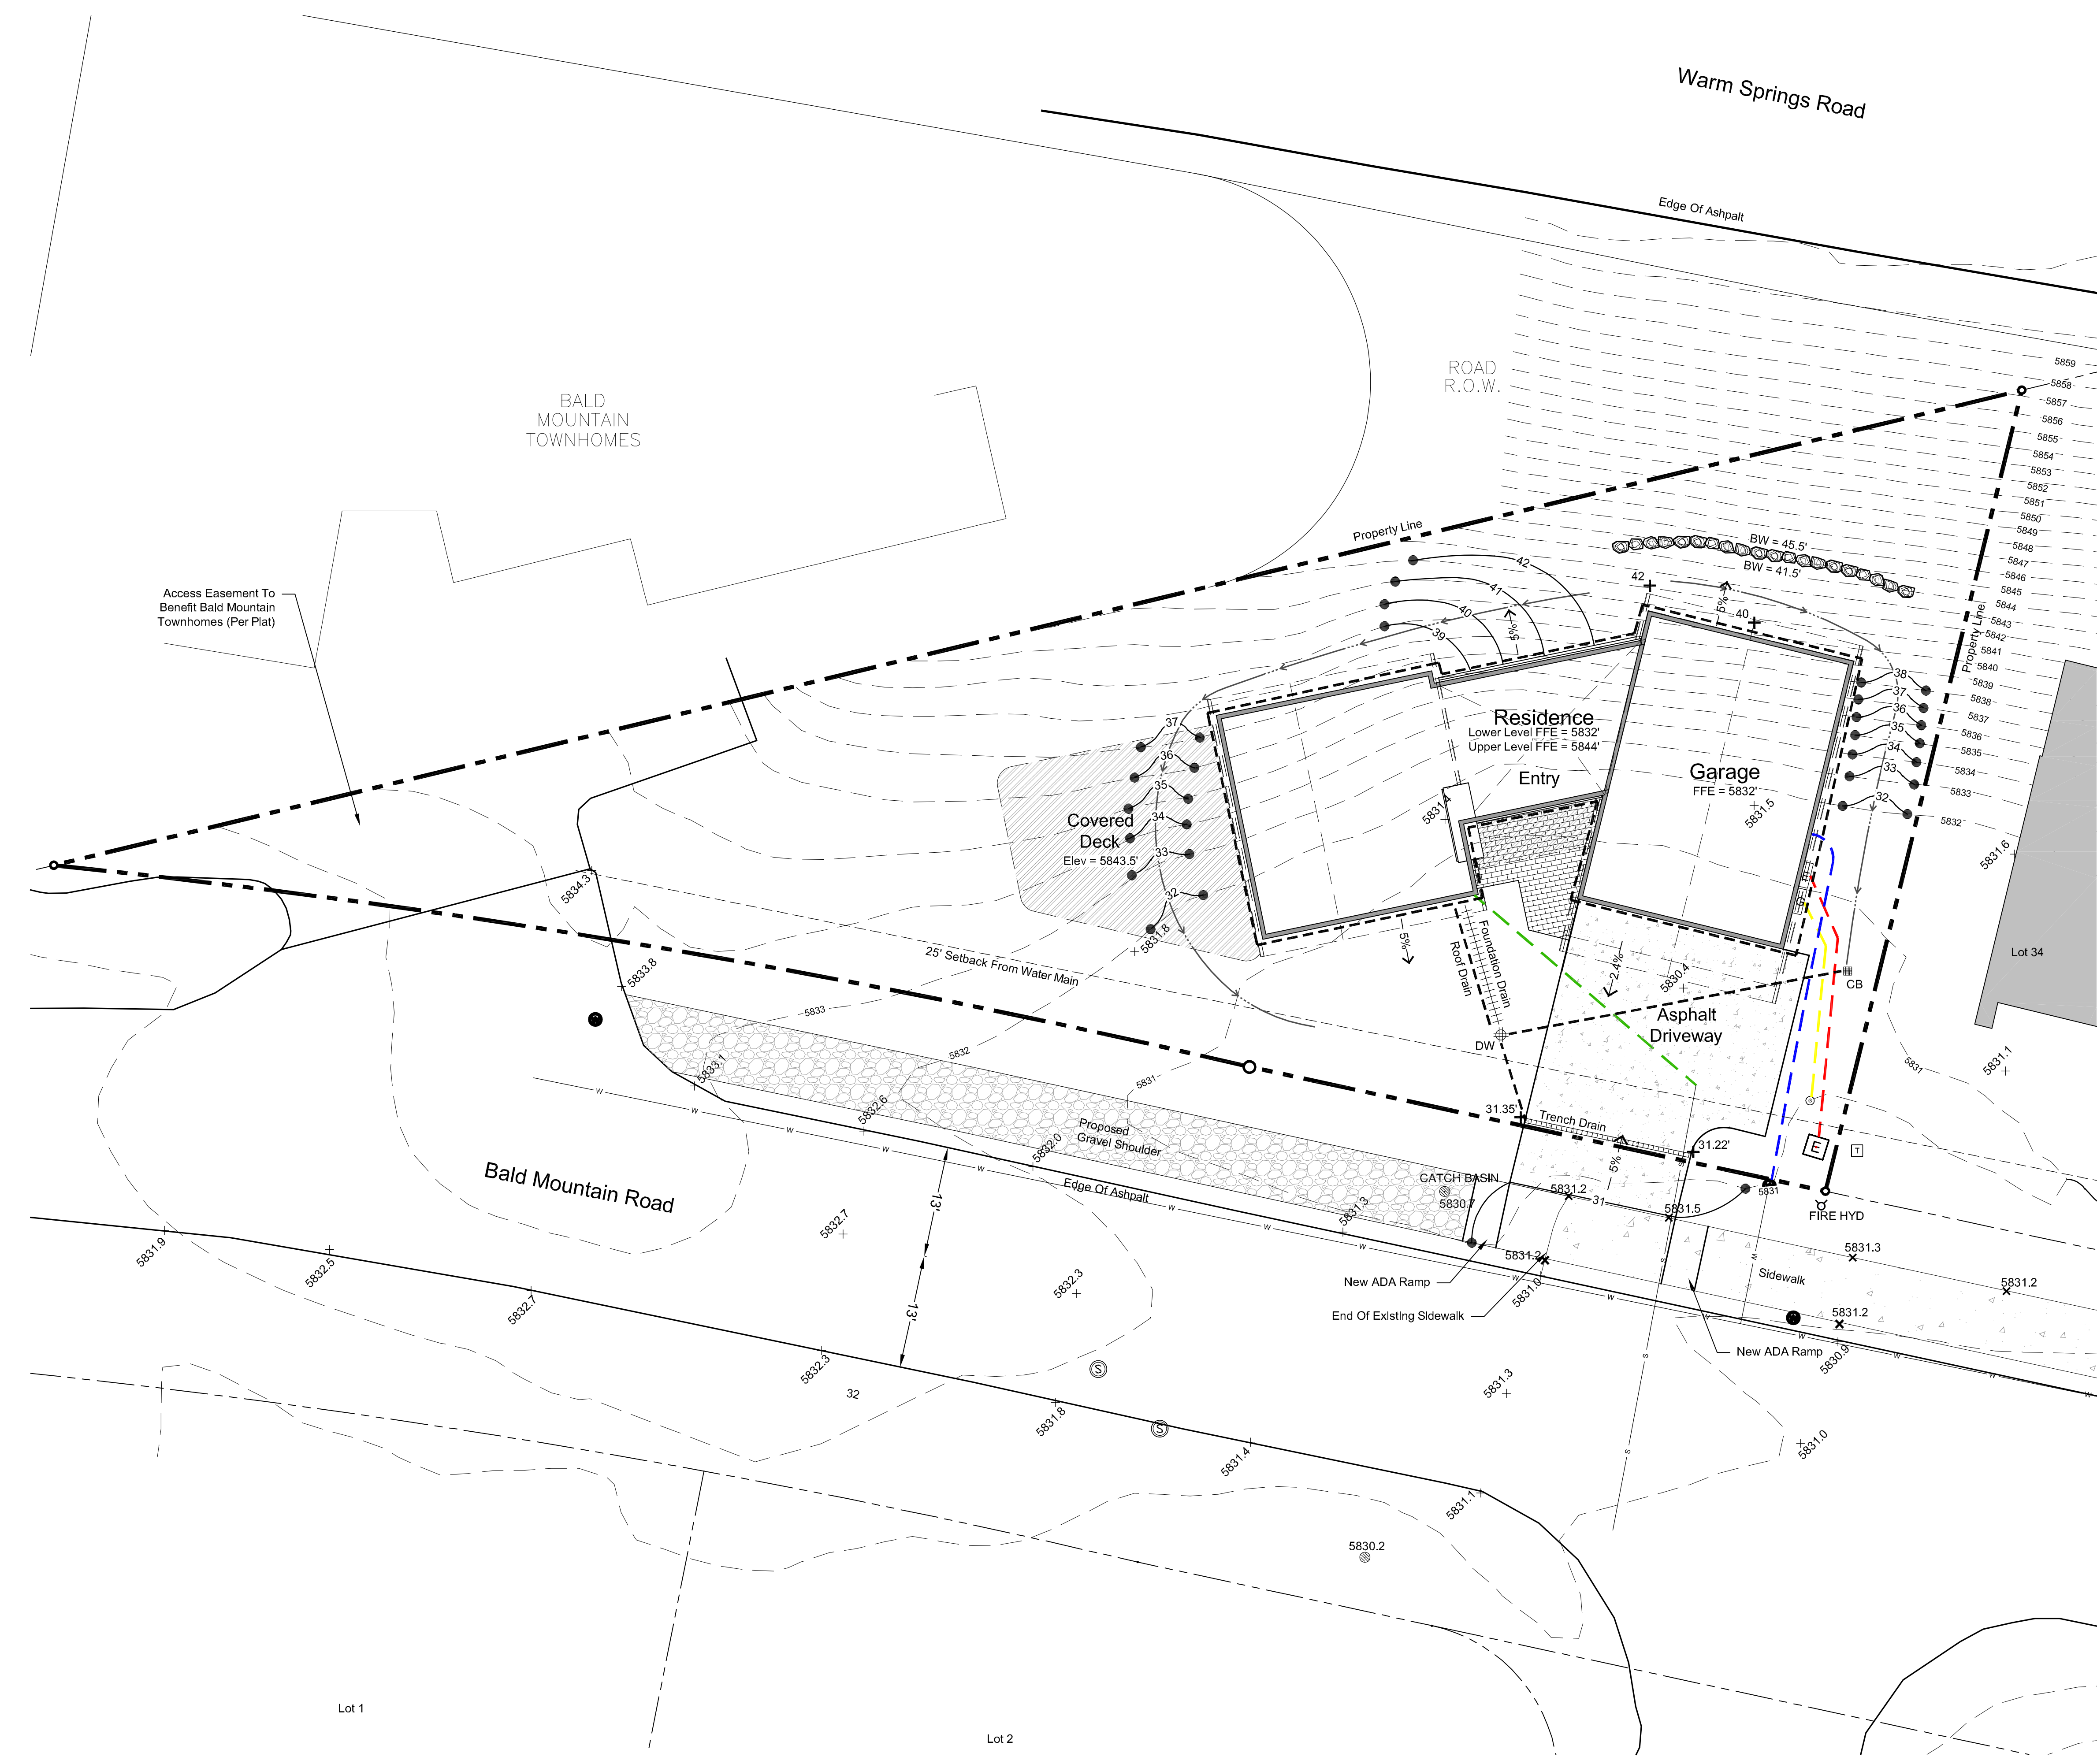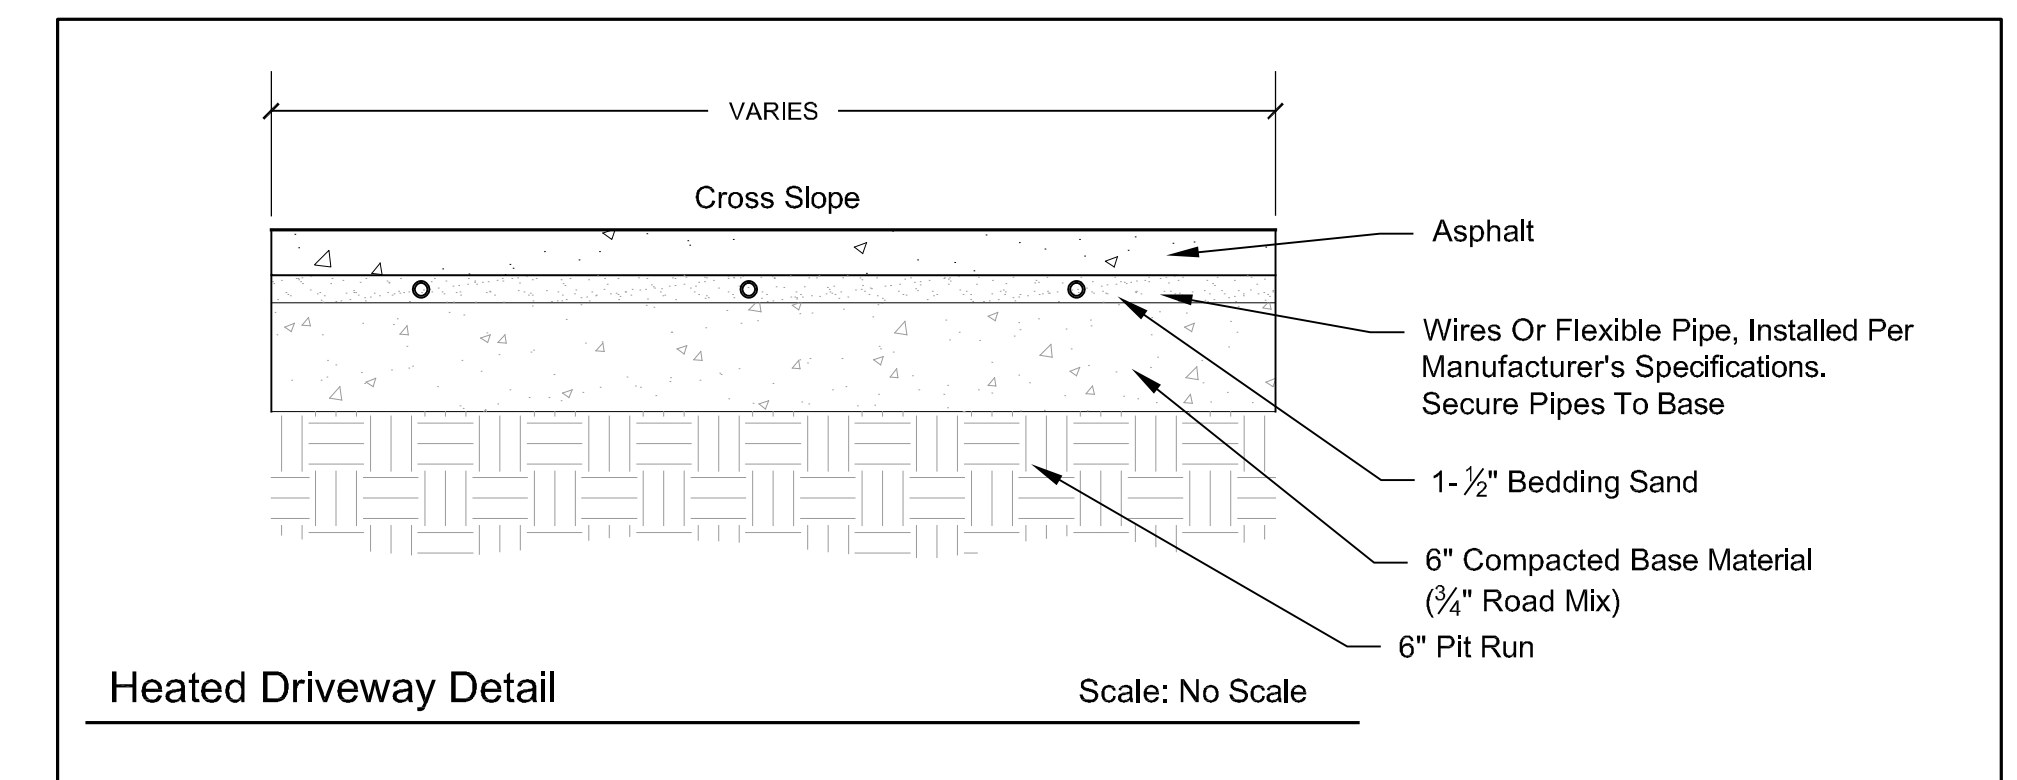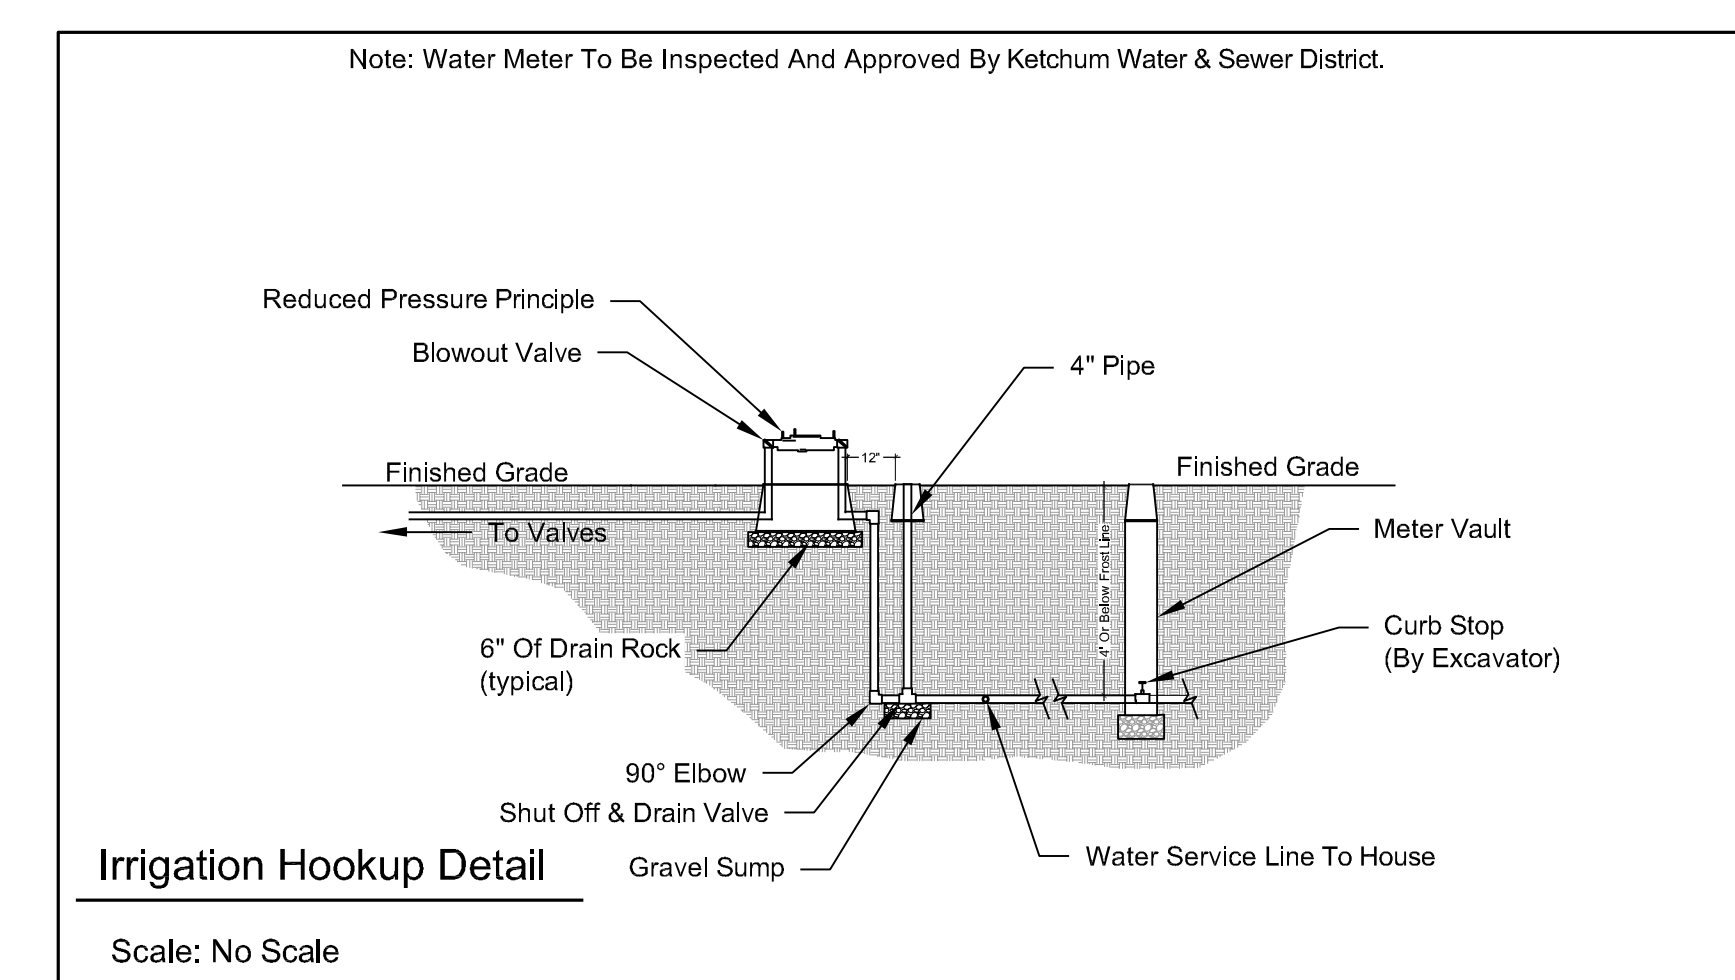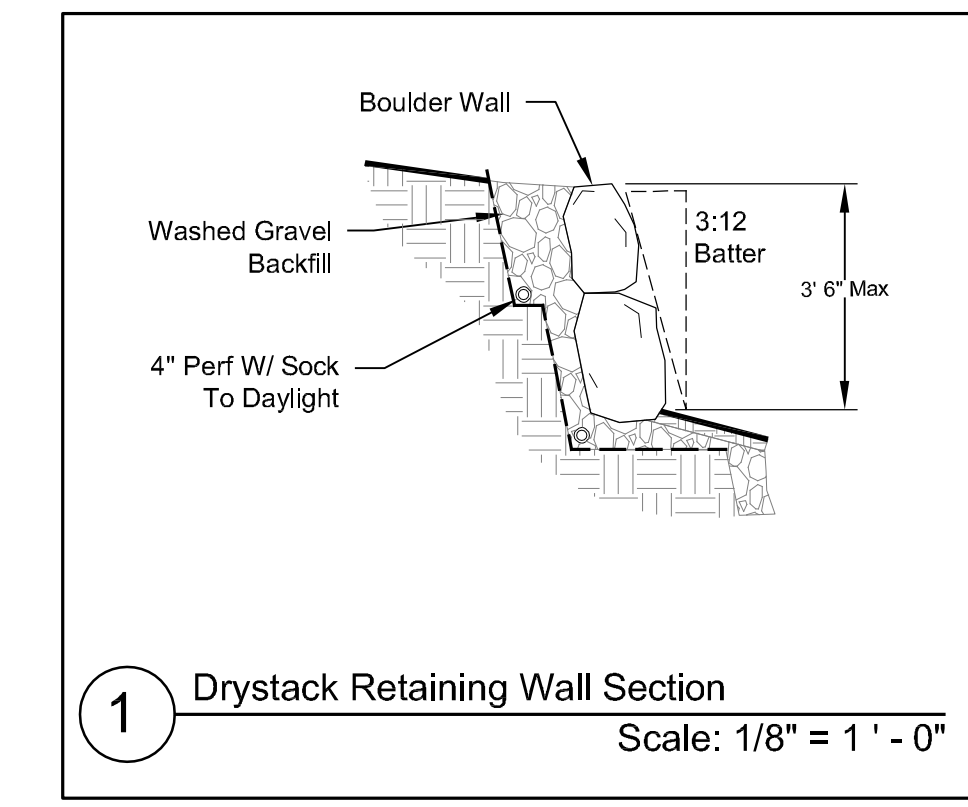

Irrigation Calculation	
(Lot = ±.23 Acres)	
Description	Square Footage
Natural Grass	4,900 sq.ft.
Planter Beds	100 sq.ft.
Total Irrigated Area	5,000 sq.ft.
	+/- .12 Acres

Snow Storage	
Driveway Area:	900 sq ft
Walkway Area:	150 sq ft
	x .30%
Required Area:	315 sq ft
Snow Storage Provided:	400 sq ft

- Per Development Agreement:**
- 1) Landscaping Shall Be Drought Tolerant
 - 2) Irrigation System Shall Be Equipped With Shut Off Valve Not Impacting Water Service To Residence
 - 3) Irrigation System Shall Be Water Efficient In Ground Components, Controller With Rain/Freeze Sensor.
 - 4) Isolate Zones Per Plant Type And Exposure.

- Landscape Notes:**
- 1) The Area 12" Horizontal From The Base Of A Wall Shall Be Finished In A Way To Prevent Any Vegetation Growing, And For Vegetative Debris To Be Easily Removed.
 - 2) Any Trees With Crowns Closer Than 30 Feet To Any Structure Shall Be Limbed Up A Minimum Of 6' From Ground Level.
 - 3) Any Tree Crowns Shall Be Pruned To Have A Minimum 10' Horizontal Clearance From Any Structure.





- General Notes**
1. Base map information taken from survey by Benchmark Associates dated 11/24/21 and from on-site information. Architectural information provided by Think Architecture dated 02/22/22. Contractor shall verify conditions in the field prior to construction.
 2. Landscape architect is not responsible for any deviation from these plans, unless such changes are authorized by the landscape architect in writing.
 3. All existing utilities are underground. All new utilities shall be underground.
 4. Site serviced by City of Ketchum.

Plan Legend

	Property Line
	PUE And Snow Storage Easement
	Proposed Contour
	Landscape Drywell
	Concrete Pavers
	Asphalt
	Gravel

Plant Legend

Qty.	Common Name	Botanical Name	Size
7	Conifer Trees		12' -16'
	Pine	<i>Pinus spp.</i>	
6	Deciduous Trees		12' -16'
	Aspen	<i>Populus tremuloides</i>	
1	Crabapple	<i>Malus spp.</i>	
8	Deciduous Shrubs		5 gal.
	Alpine Currant	<i>Ribes alpinum</i>	
	Burning Bush	<i>Euonymus alatus</i>	
	Cotoneaster	<i>Cotoneaster spp.</i>	
	Dogwood	<i>Cornus spp.</i>	
	Lilac	<i>Syringa spp.</i>	
	Maple	<i>Acer spp.</i>	
	Mockorange	<i>Philadelphus spp.</i>	
	Ninebark	<i>Physocarpus spp.</i>	
	Snowberry	<i>Symphoricarpos spp.</i>	
	Spiraea	<i>Spiraea spp.</i>	
35	Ornamental Grasses		Flats
	Blue Fescue	<i>Festuca ovina gluca</i>	
	Ribbon Grass	<i>Phalaris arundinacea 'Picata'</i>	
	Karl Foerster Feather Reed	<i>C. arundinacea 'Karl Foerster'</i>	
4,900 Sq.Ft.	Grasses & Wildflowers		Sod or Seed
	(20%) Hard Fescue	<i>Festuca trachyphylla</i>	
	(20%) Chewing Fescue	<i>Festuca rubra var. commutata</i>	
	(20%) Sheep Fescue	<i>Festuca ovina</i>	
	(20%) Creeping Red Fescue	<i>Festuca rubra</i>	
	(20%) Wildflowers	Various	
1,600 Sq.Ft.	Grasses - Lawn Mix		Sod or Seed
	(33%) Tall Fescue	<i>Festuca arundinacea</i>	
	(33%) Hard Fescue	<i>Festuca trachyphylla</i>	
	(33%) Chewing Fescue	<i>Festuca rubra var. commutata</i>	

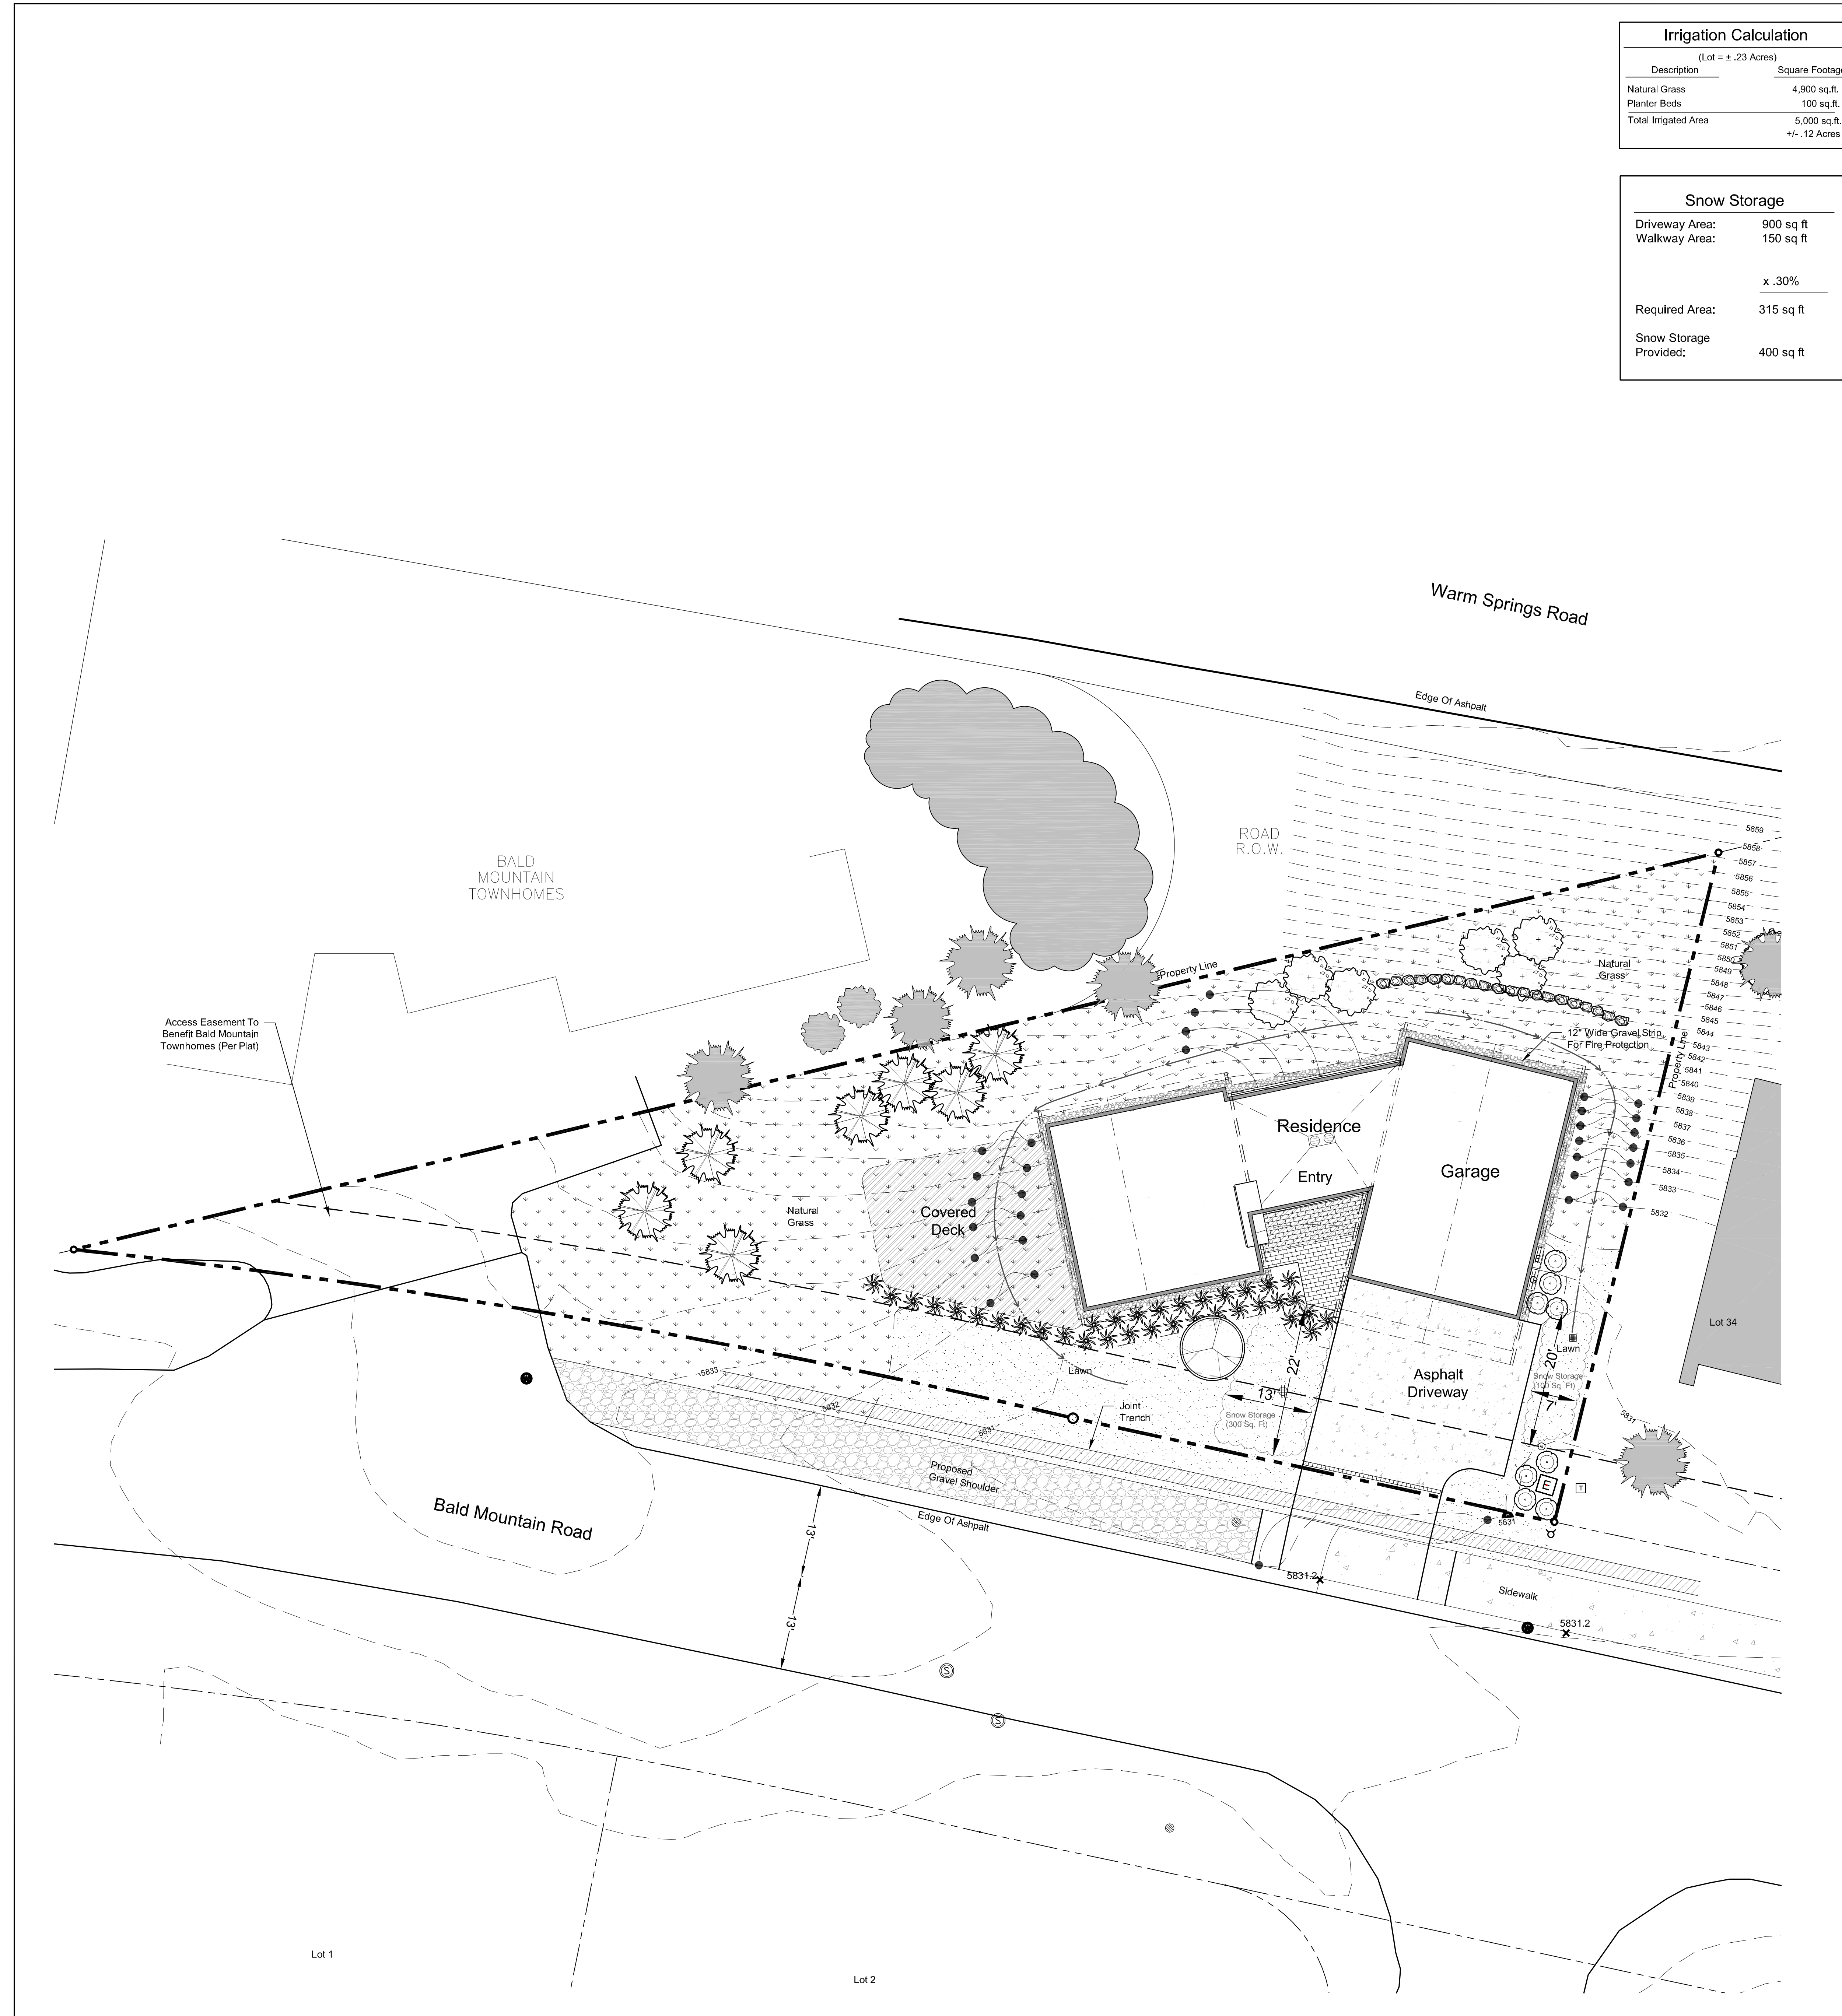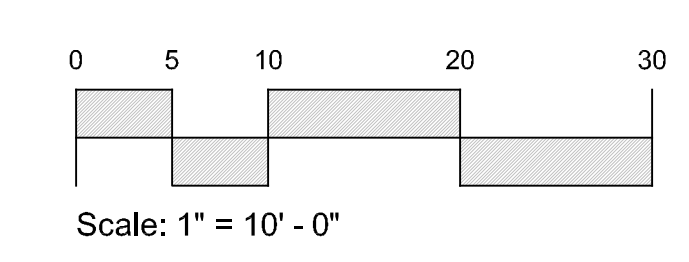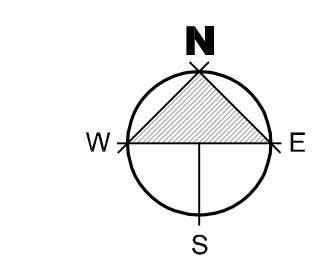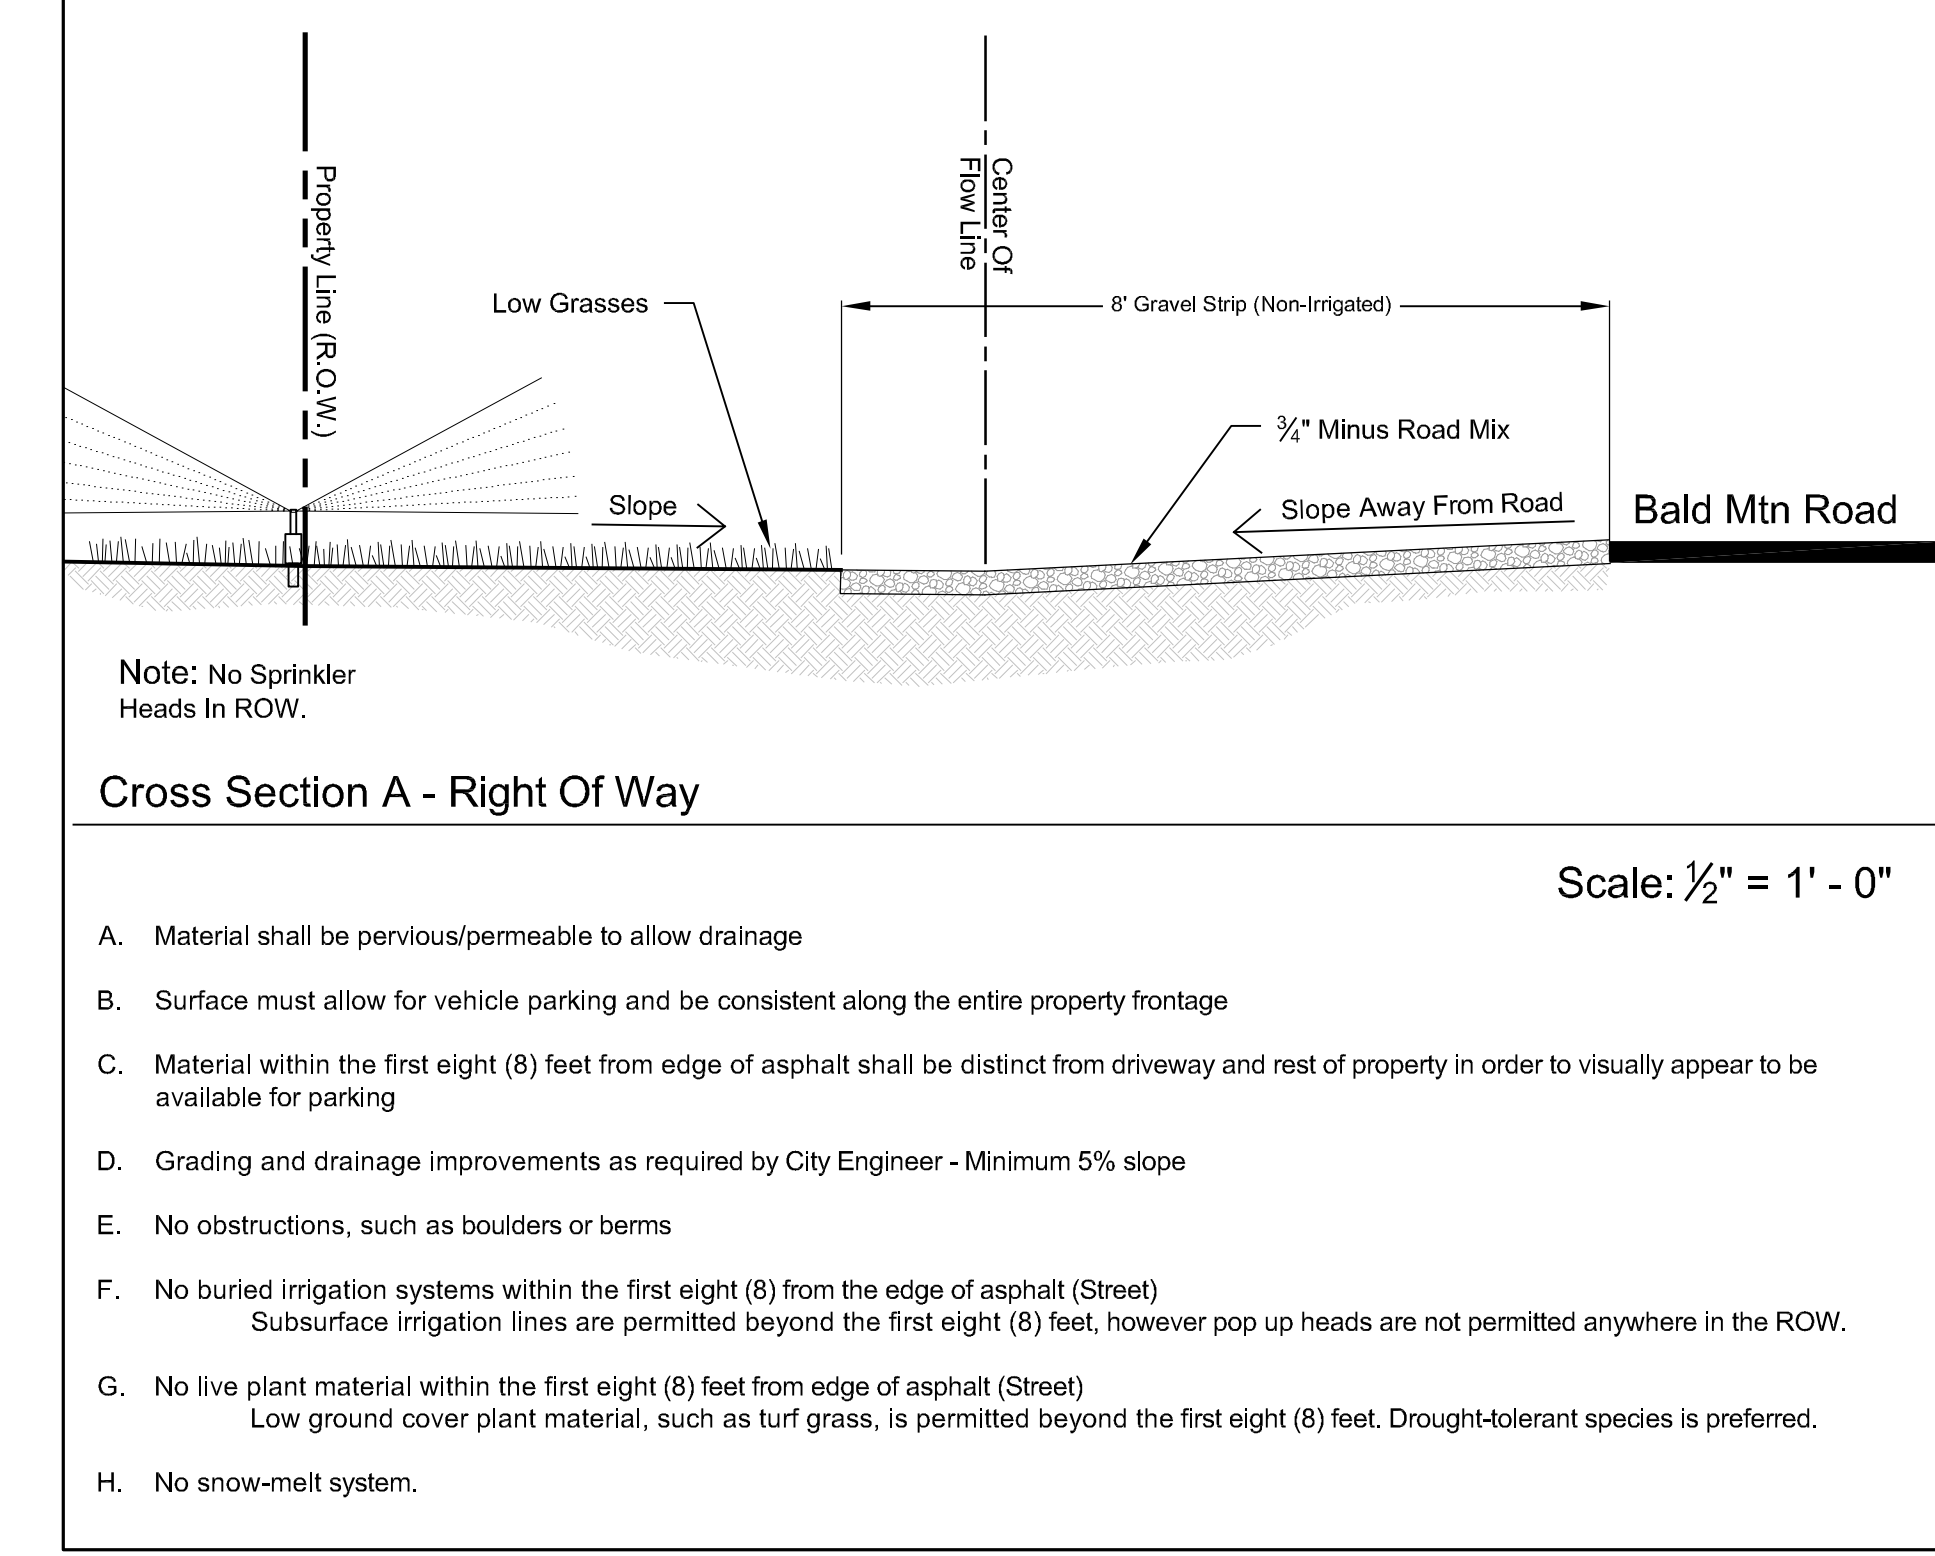

WSR Residences Lot 35

E.GGERS ASSOCIATES, P.A.
landscape architecture

T: (208) 729-0968
F: (208) 729-0972

P.O. Box 973
Ketchum, ID 83340

Warm Springs Ranch Residences
Block 1, Lot 35
Ketchum, Idaho


Job No: 22.28

Scale: 1" = 10'-0"

Issue/Revisions: Date:

Design Review 05/22/23

RVSD 05/08/23


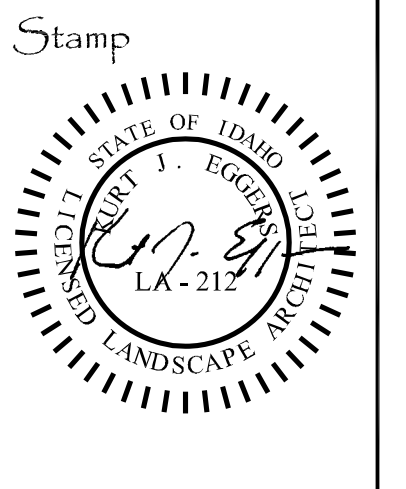


Sheet Title:
Landscape Plan

Sheet No:
L3



REAR FENCE EXAMPLE

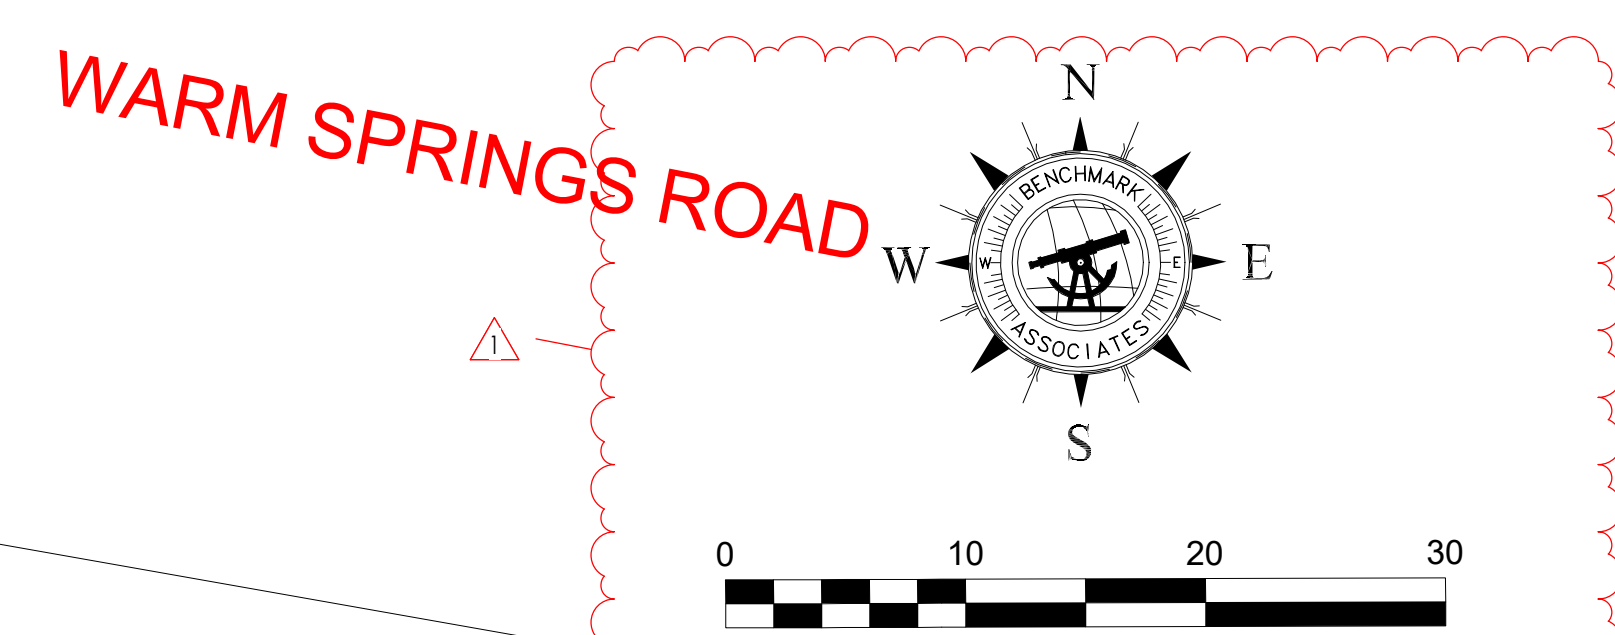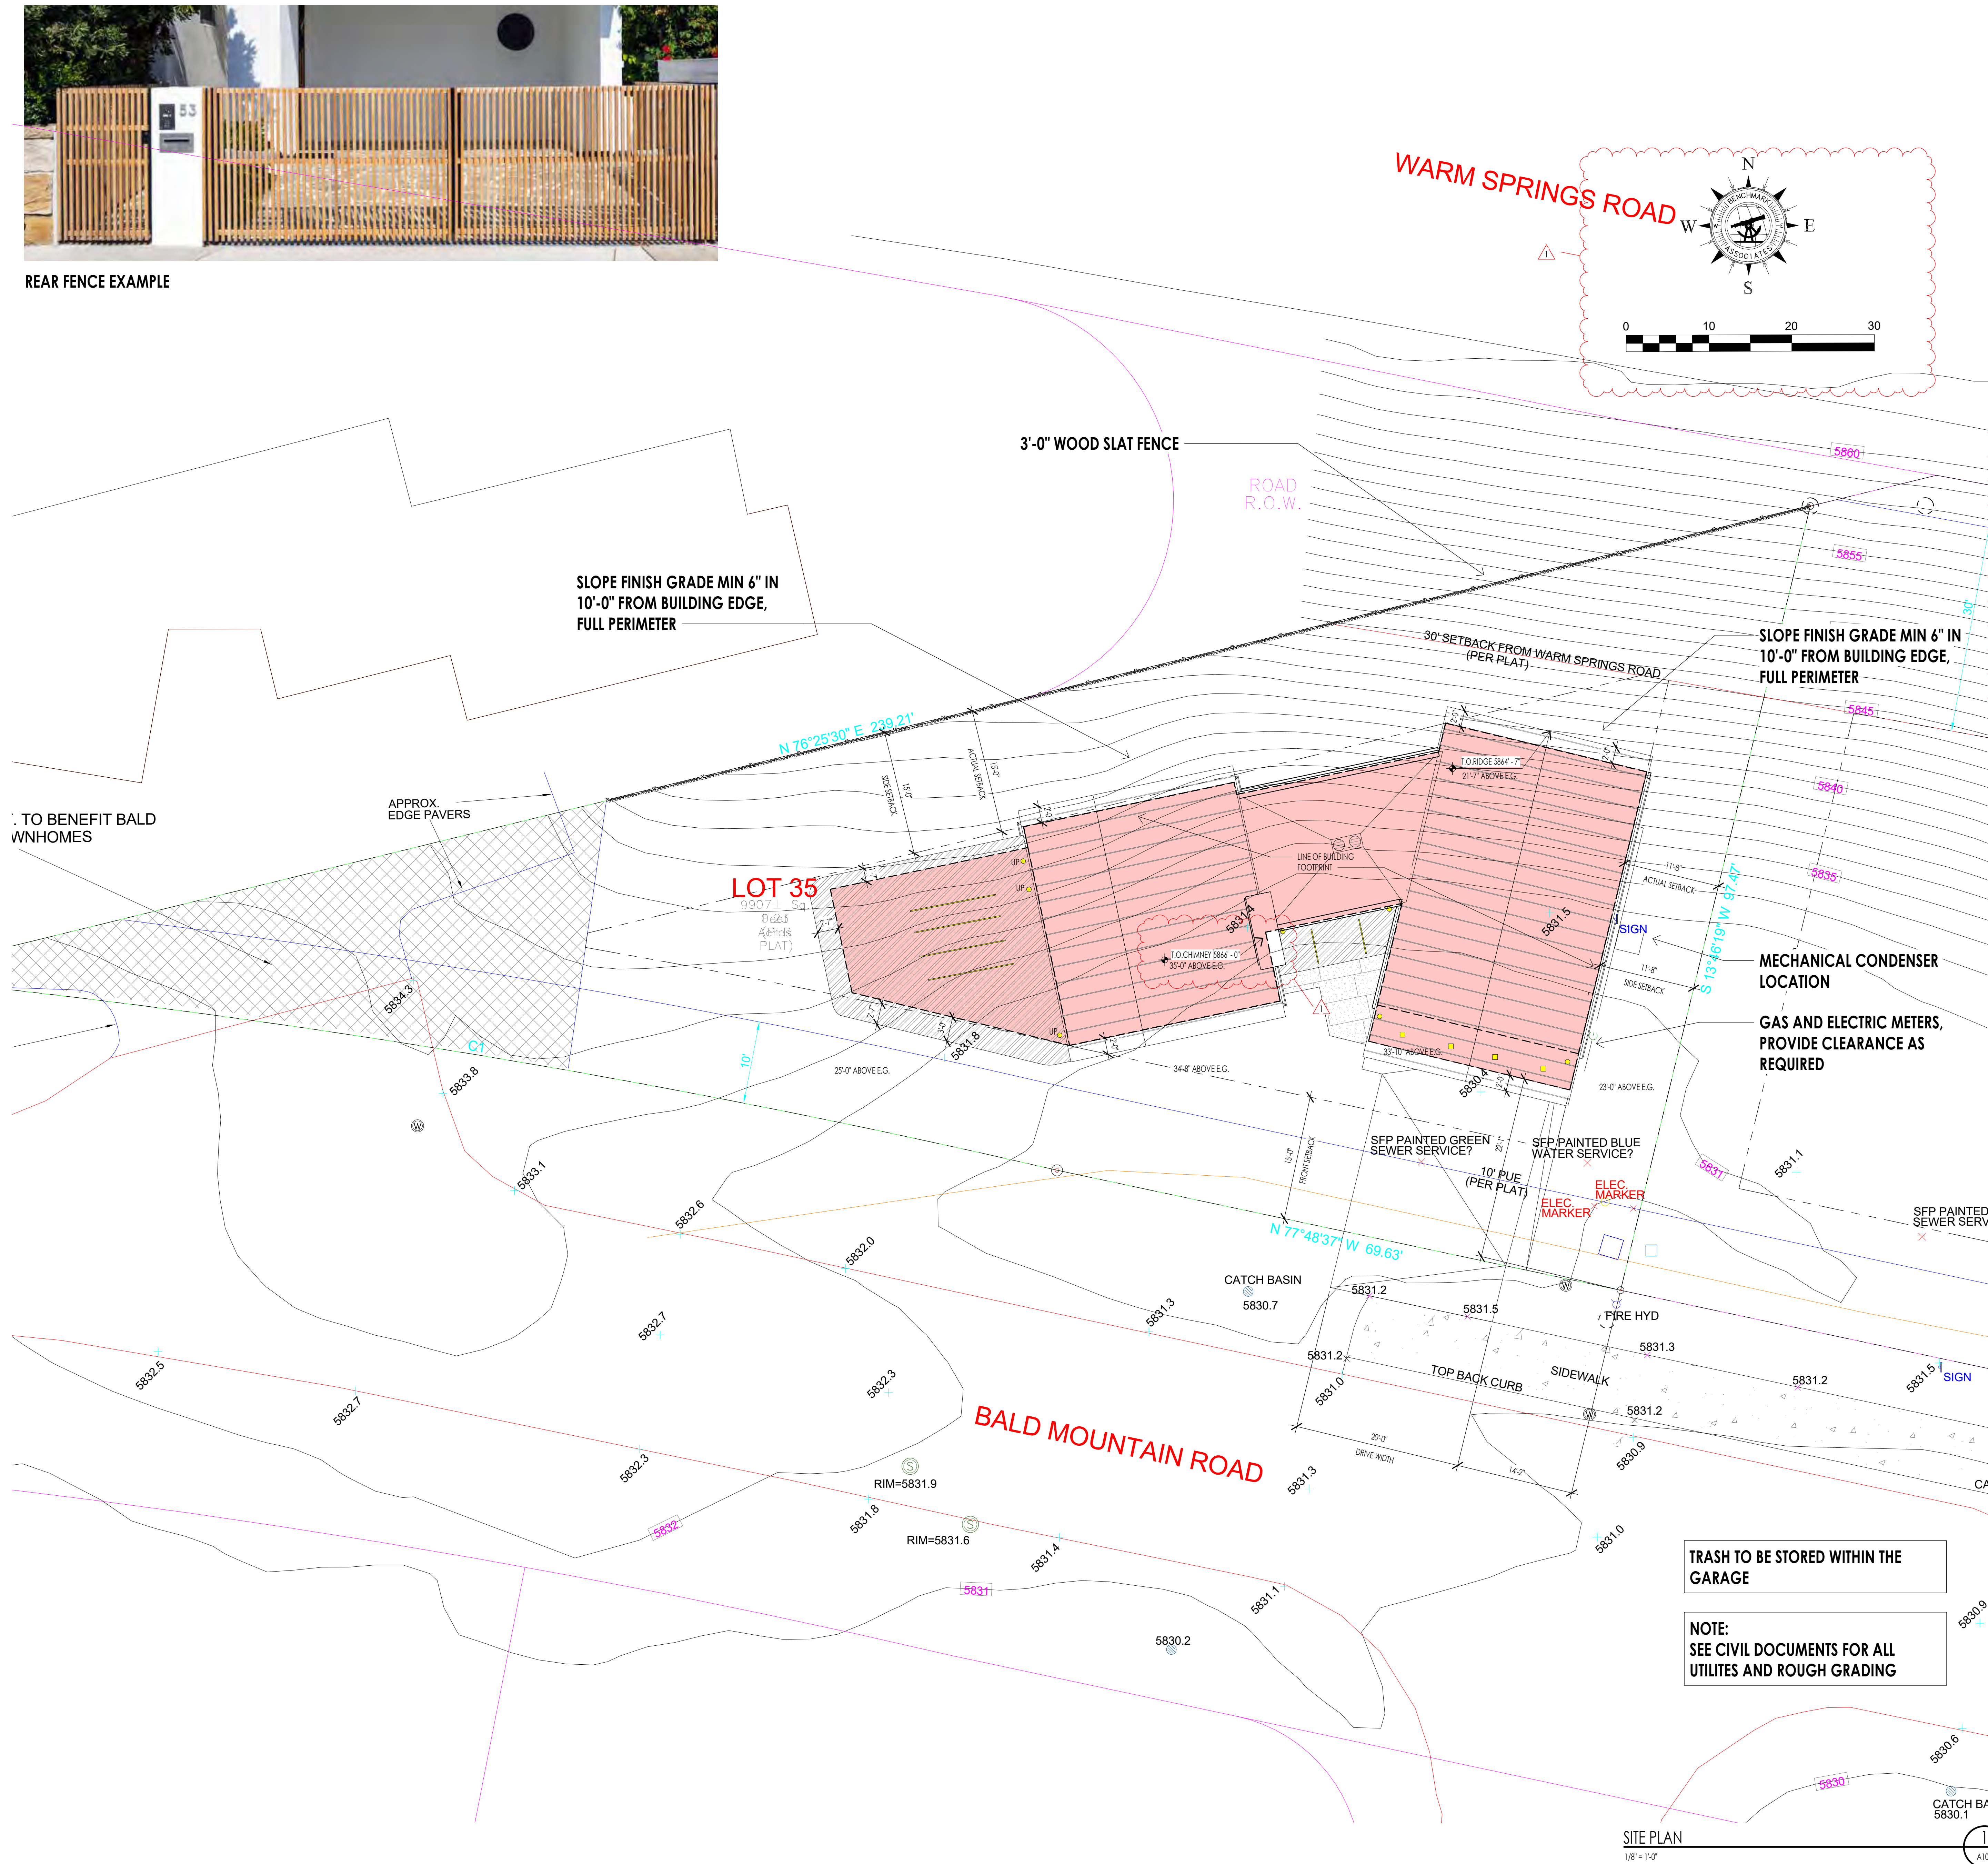

SITE PLAN GENERAL NOTES

1. CONTRACTOR TO VERIFY ALL EXISTING UTILITIES AND LOCATIONS. PROTECT AS REQUIRED.
2. CONTRACTOR TO PROTECT EXISTING TREES TO BE PRESERVED.
3. UTILITY TRENCHING TO BE CONDUCTED IN A WAY TO NOT DISTURB EXISTING TREES.
4. ANY TREES LOCATED WITHIN 10'-0" HORIZONTAL OF THE STRUCTURE MUST BE MIN. 10'-0" HIGHER THAN THE ADJACENT STRUCTURE OR WILL NEED TO BE REMOVED IN ACCORDANCE TO THE FIRE CODE AS DEFENSIBLE SPACE.
5. ALL DEAD WOOD AND COMBUSTIBLE MATERIALS WITHIN 30'-0" OF THE STRUCTURE TO BE REMOVED BY CONTRACTOR AS PER THE FIRE CODE DEFENSIBLE SPACES.
6. INSTALL EROSION CONTROL MAT ON ALL SLOPES 3:1 AND GREATER.

DATUM:

LEVEL 1 100'-0" = 5,832.00 USGS
 LEVEL 2 112'-0" = 5,844.00 USGS

VERIFY FINISHED FLOOR HEIGHT WITH FINAL CIVIL ENGINEER'S DRAWINGS.

SITE PLAN KEY NOTES

LOT SIZE:
 AREA = .23 ACRES OR 9,907 SQ. FT.
 ZONE: GR-1
 HEIGHT LIMIT: 35' MAX

BUILDING PAD:
 AREA = 4,197 SQ. FT.

PROPOSED BUILDING FOOTPRINT:
 AREA = 2,499 SQ. FT.
 LOT COVERAGE ALLOWED: 35%, 3,467 SQ. FT.

- RECESSED LIGHT LOCATION
- WALL SCONCE LOCATION

LEGAL DESCRIPTION:
 LOT 35 BALD MOUNTAIN ROAD

SITE NOTES:

1. ALL CONSTRUCTION TO BE DONE ACCORDING TO TOWN STANDARDS AND SPECIFICATIONS.
2. CONTRACTOR TO VERIFY ALL EXISTING CONDITIONS AND LOCATION OF EXISTING UTILITIES PRIOR TO CONSTRUCTION.
3. CONTRACTOR TO VERIFY PROPER DRAINAGE AWAY FROM HOUSE.
4. PROVIDE DRAINAGE SWALE FROM HIGH TO LOW SIDE OF HOUSE.
5. ZONING: GR-1
6. CONTRACTOR TO VERIFY EXISTING GRADES/TOPOGRAPHY PRIOR TO EXCAVATION AND/OR CONSTRUCTION. VERIFY DRIVEWAY DOES NOT EXCEED 10% GRADE.
7. EXISTING TOPOGRAPHY SHOWN IS BASED ON ROAD DESIGN GRADES & SITE OBSERVATIONS. CONTRACTORS/OWNER TO VERIFY.
8. HEIGHT LIMIT OF 35'-0" OVER EXISTING GRADE. 5'-0" ALLOWANCE FOR CHIMNEYS AND MECHANICAL.

TRASH TO BE STORED WITHIN THE GARAGE

NOTE:
 SEE CIVIL DOCUMENTS FOR ALL UTILITIES AND ROUGH GRADING

SITE PLAN
 1/8" = 1'-0"




Architecture
 Interior Design
 Landscape Architecture
 Land Planning
 Construction Management

7927 So. Highpoint Parkway, Suite 300
 Sandy, Utah 84094
 ph. 801.269.0555
 fax. 801.269.1425
 www.thinkaiaec.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced in whole or in part without the sole and express written permission from THINK ARCHITECTURE, INC.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

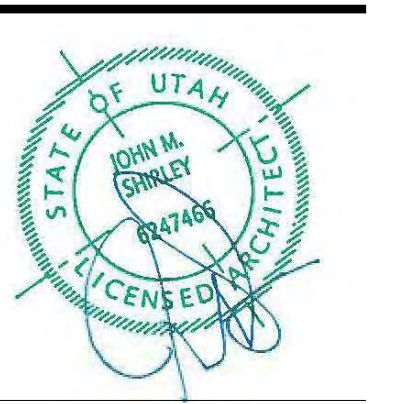

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
 KETCHUM, IDAHO 83340


PROJECT NO. 22023
 DATE: 2023.06.30

REVISIONS:
 1 04-27-2023 PER CITY COMMENTS

SHEET TITLE:
 SITE PLAN

SHEET NUMBER:
 A101

© 2021 THINK ARCHITECTURE, INC.

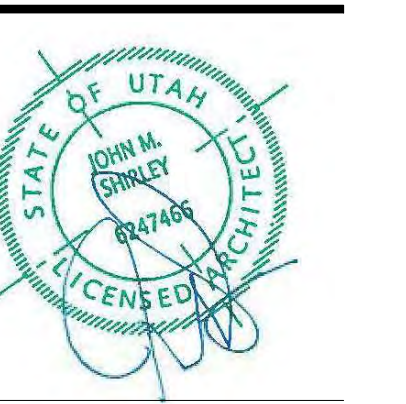


FOUNDATION PLAN LEGEND	
HATCH PATTERN	DESCRIPTION
	POURED IN PLACE CONCRETE
	2" RIGID FOAM INSULATION TO EXTEND FROM BOTTOM OF SLAB DOWN TO FOOTING AND HORIZONTALLY UNDER SLAB 4" MIN. AT PERIMETER OF FOUNDATION.

FOUNDATION PLAN SYMBOLS LEGEND	
SYMBOL	DESCRIPTION
FS - - - FS	FOOTING STEP
WS - - - WS	WALL STEP
T.O.F.	TOP OF FOOTING ELEVATION
T.O.W.	TOP OF WALL ELEVATION
T.O.S.	TOP OF SLAB ELEVATION
T.O. PIER	TOP OF PIER ELEVATION


- FOUNDATION GENERAL NOTES**
- COORDINATE ARCHITECTURAL FOUNDATION PLAN WITH STRUCTURAL FOUNDATION PLAN. CONTRACTOR SHALL REPORT ANY DISCREPANCIES IN THE PLANS TO THE ARCHITECT PRIOR TO COMMENCING RELATED WORK.
 - COORDINATE MECHANICAL, ELECTRICAL, & PLUMBING PRIOR TO CONSTRUCTION OF FOOTINGS & FOUNDATION.
 - VERIFY ELEVATIONS OF FOUNDATION WALLS & FOOTINGS. COORDINATE WITH SITE PLAN & PROPOSED CONTOURS.
 - CONCRETE FLOOR SLABS, EXCEPT THOSE IN UNHEATED ACCESSORY STRUCTURES, SHALL HAVE A VAPOR RETARDER CONSISTING OF 6 MIL POLYETHYLENE (OR APPROVED EQUAL) VAPOR RETARDER WITH JOINTS LAPPED NOT LESS THAN 6 INCHES PLACED BETWEEN THE CONCRETE FLOOR SLAB & THE BASE COURSE OF THE PREPARED SUB-GRADE WHERE NO BASE COURSE EXISTS.
 - FOUNDATION REBAR INSPECTIONS ARE REQUIRED FOR FOUNDATION WALLS OVER 8 FEET HIGH. FORMS ARE NOT TO BE INSTALLED ON ONE SIDE UNTIL AFTER THE REBAR HAS BEEN INSPECTED.

DATUM ELEVATIONS		
ARCHITECTURE	CIVIL	LEVEL
87'-6"	-	LEVEL 00 - TOP OF SLAB
88'-6"	-	LEVEL 0 - TOP OF SLAB
99'-0"	-	TOP OF SLAB AT FRONT OF GARAGE
100'-0"	-	LEVEL 1 - TOP OF PLYWOOD


FOUNDATION PLAN KEYNOTES	
KEYNOTES	
SL-1	CONTRACTOR TO COORDINATE LOCATION OF FLOOR DRAIN - SLOPE SLAB TOWARDS DRAIN AS REQUIRED
SL-2	CAST IN PLACE FOOTINGS TO BEAR ON UNDISTURBED SOIL OR ENG COMPACTED FILL - SEE STRUCTURAL GENERAL NOTES & PROJECT MANUAL
SL-3	CAST IN PLACE FOUNDATION WALLS W/WATER PROOFING AS NOTED - SEE STRUCTURAL NOTES AND DETAILS
SL-4	PROVIDE BLOCKOUT AT FOUNDATION WALL AT DOOR OPENINGS AND POUR SLAB OVER TOP OF WALL - SEE DETAILS
SL-5	CAST IN PLACE INTERIOR CONCRETE SLABS TO BE 4" CONCRETE SLAB REINFORCED WITH FIBER MESH OVER 4" GRAVEL BASE - SEE STRUCTURAL NOTES
SL-6	CAST IN PLACE GARAGE CONCRETE SLABS TO BE 5" CONCRETE SLAB OVER 4" GRAVEL BASE AND FINISH AS NOTED - SEE STRUCTURAL NOTES
SL-8	CONTRACTOR TO COORDINATE FOOTING STEPS TO ASSURE REQUIRED FROST PROTECTION AT EACH FOOTING - NOTIFY ARCHITECT IF FOOTING ELEVATIONS NEED TO CHANGE
SL-9	CONTRACTOR TO COORDINATE FOUNDATION WALL STEPS WITH FINAL GRADING SPECIFIED AND NOTIFY ARCHITECT OF CHANGES PRIOR TO POURING CONCRETE FOUNDATION
SL-18	PROVIDE A U-FER GROUND. AN ELECTRODE ENCASED BY A LEAST 2" OF CONCRETE SHALL BE LOCATED NEAR THE BOTTOM OF THE CONCRETE FOUNDATION SYSTEM AND SHALL BE IN DIRECT CONTACT WITH THE EARTH, CONSISTING OF AT LEAST 20 FEET OF BARE ELECTRICALLY CONDUCTIVE #10 AT LEAST 1/2 INCH IN DIAMETER OR BARE COPPER CONDUCTOR NOT SMALLER THAN 4 AWG. (I.R.C. E3308.1.2 AND N.E.C. 250.53)
SL-19	CONCRETE COLUMN PER STRUCTURAL

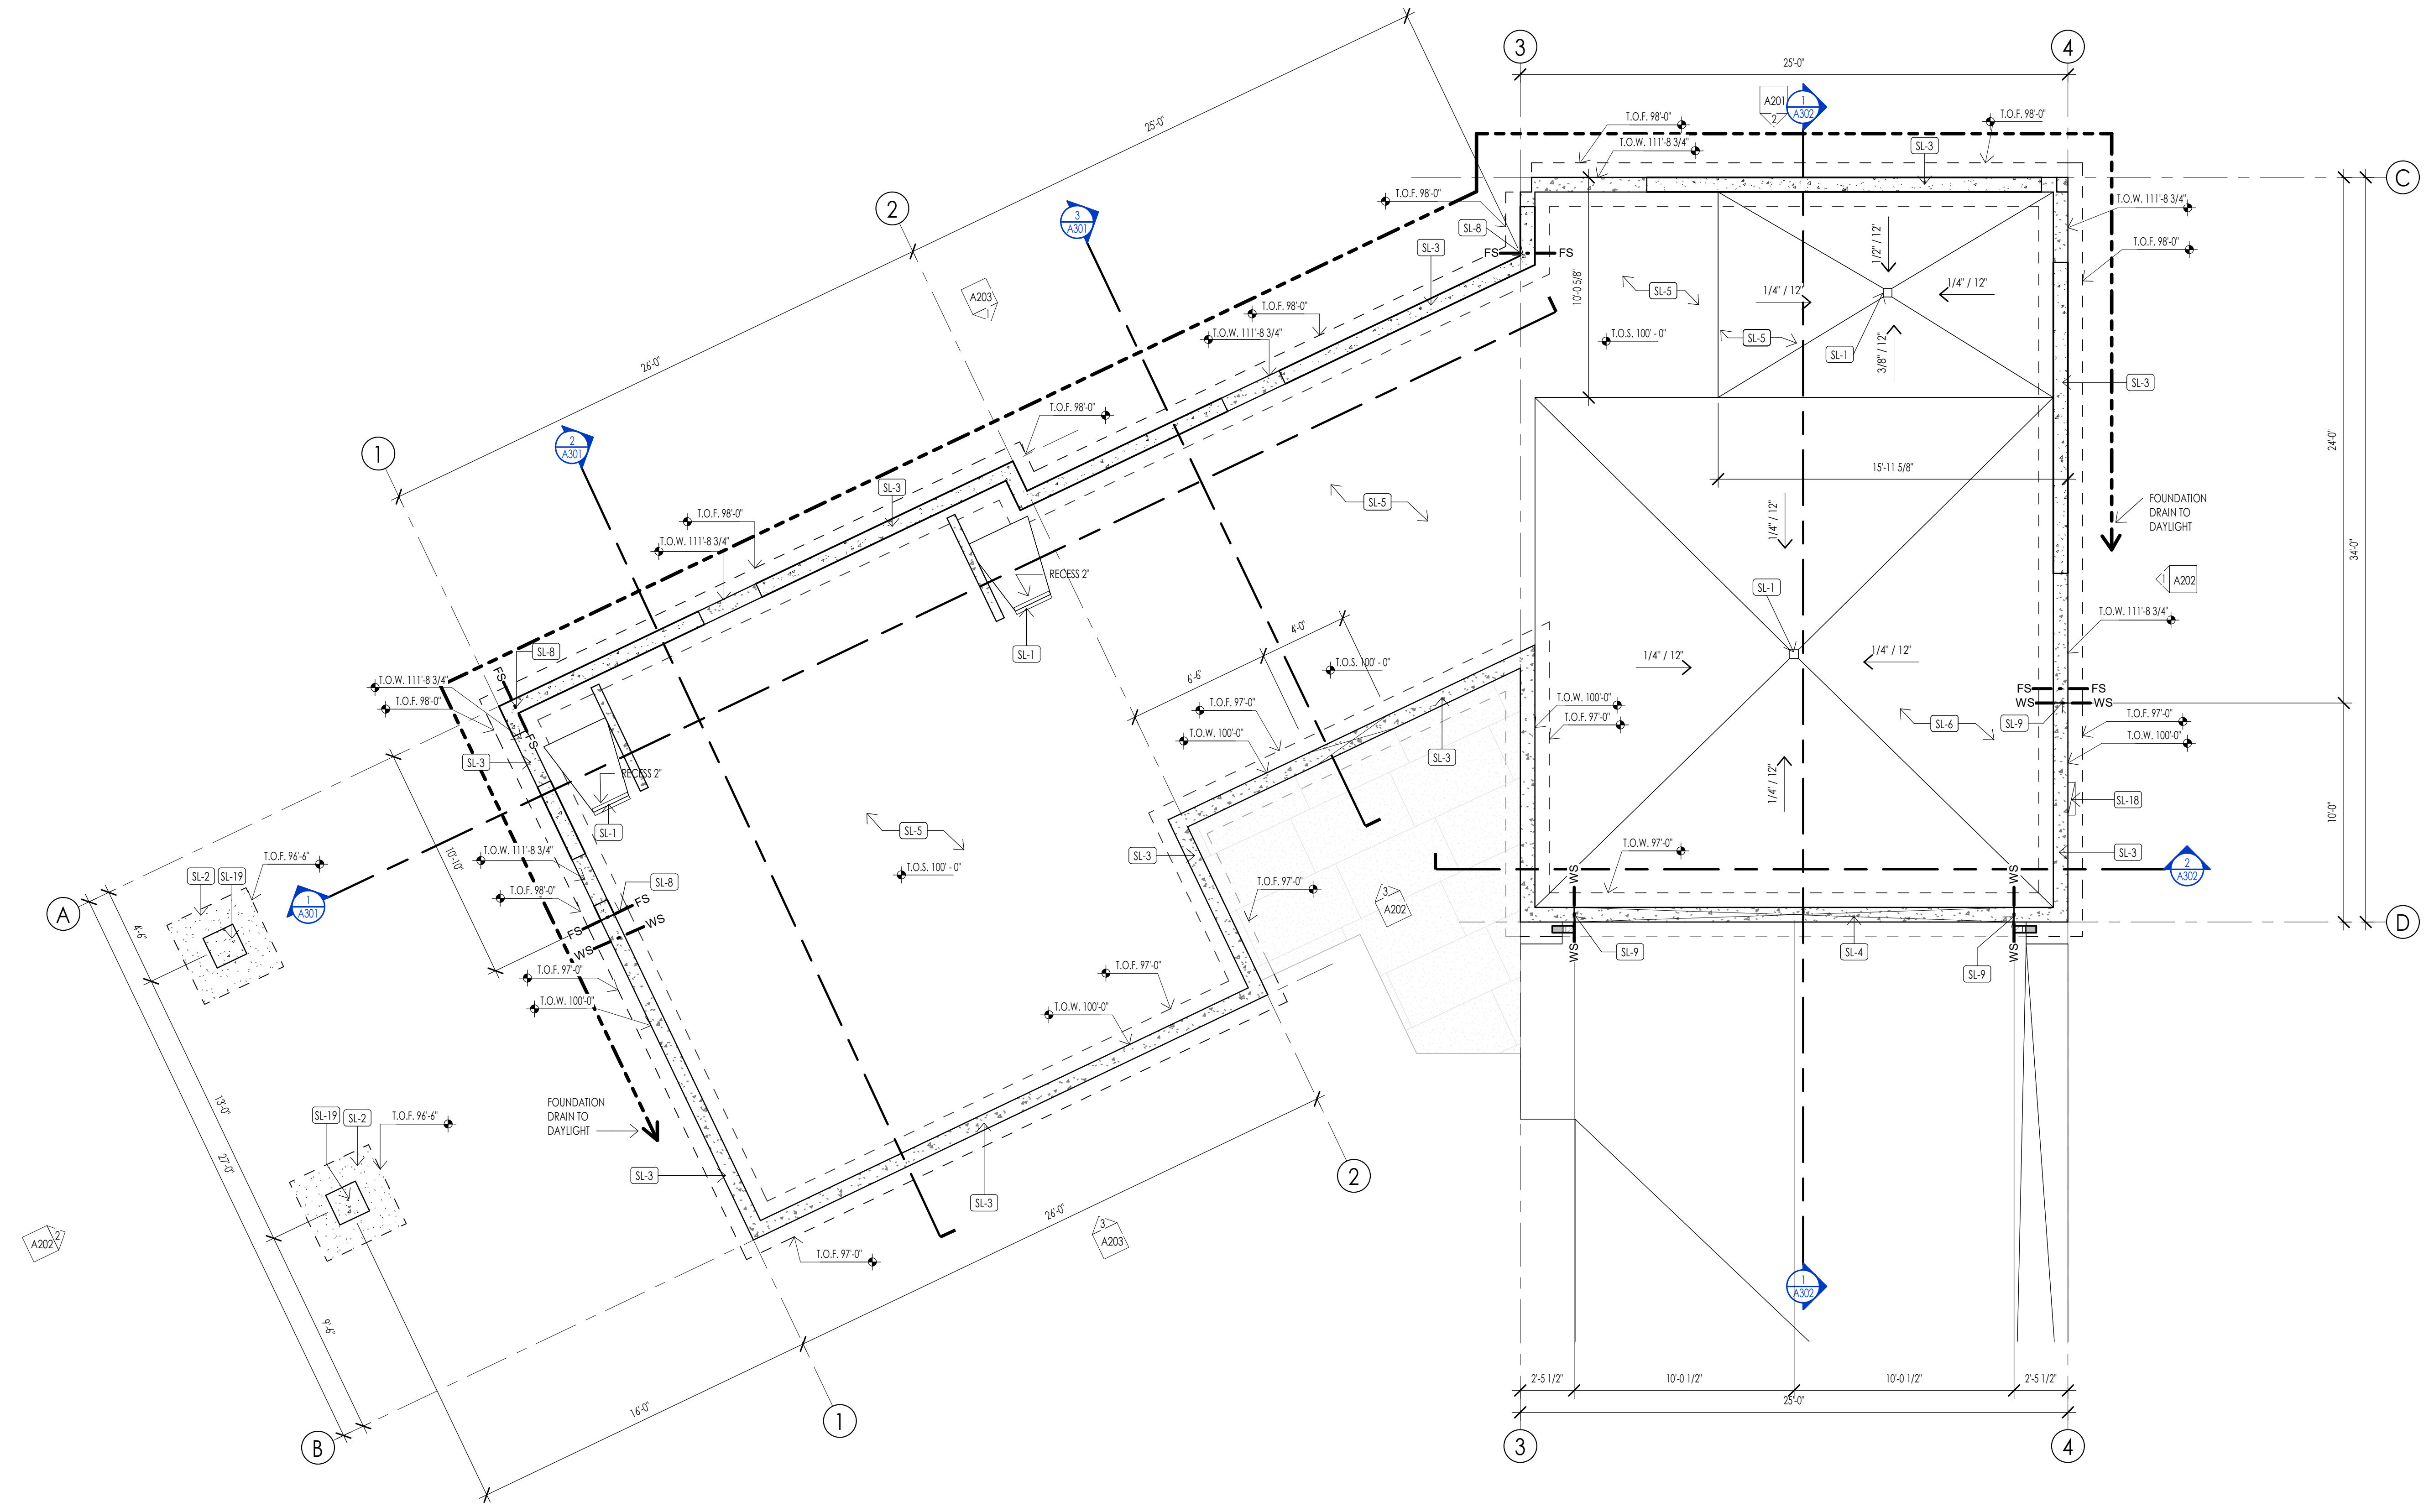


LEVEL 1 - SLAB PLAN
1/4" = 1'-0"

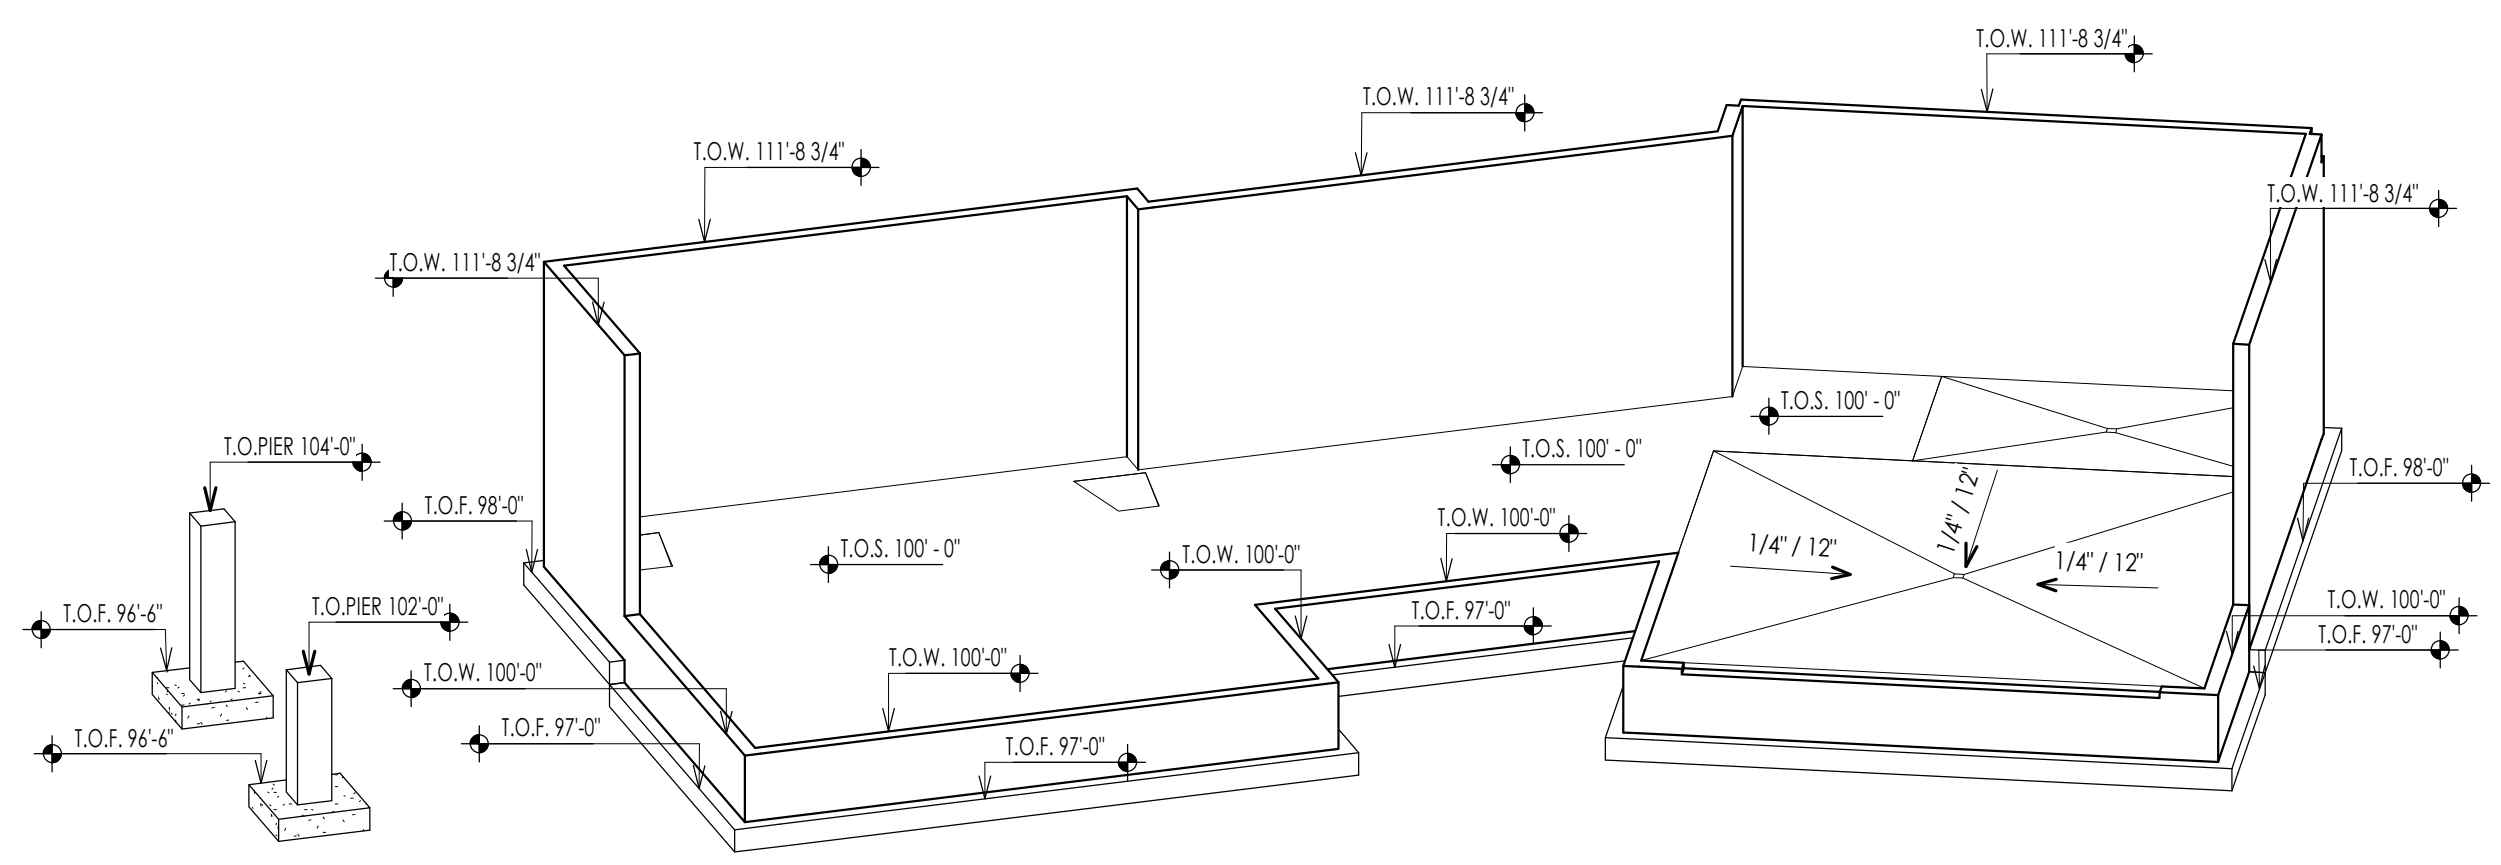

ISOMETRIC A
2
A103

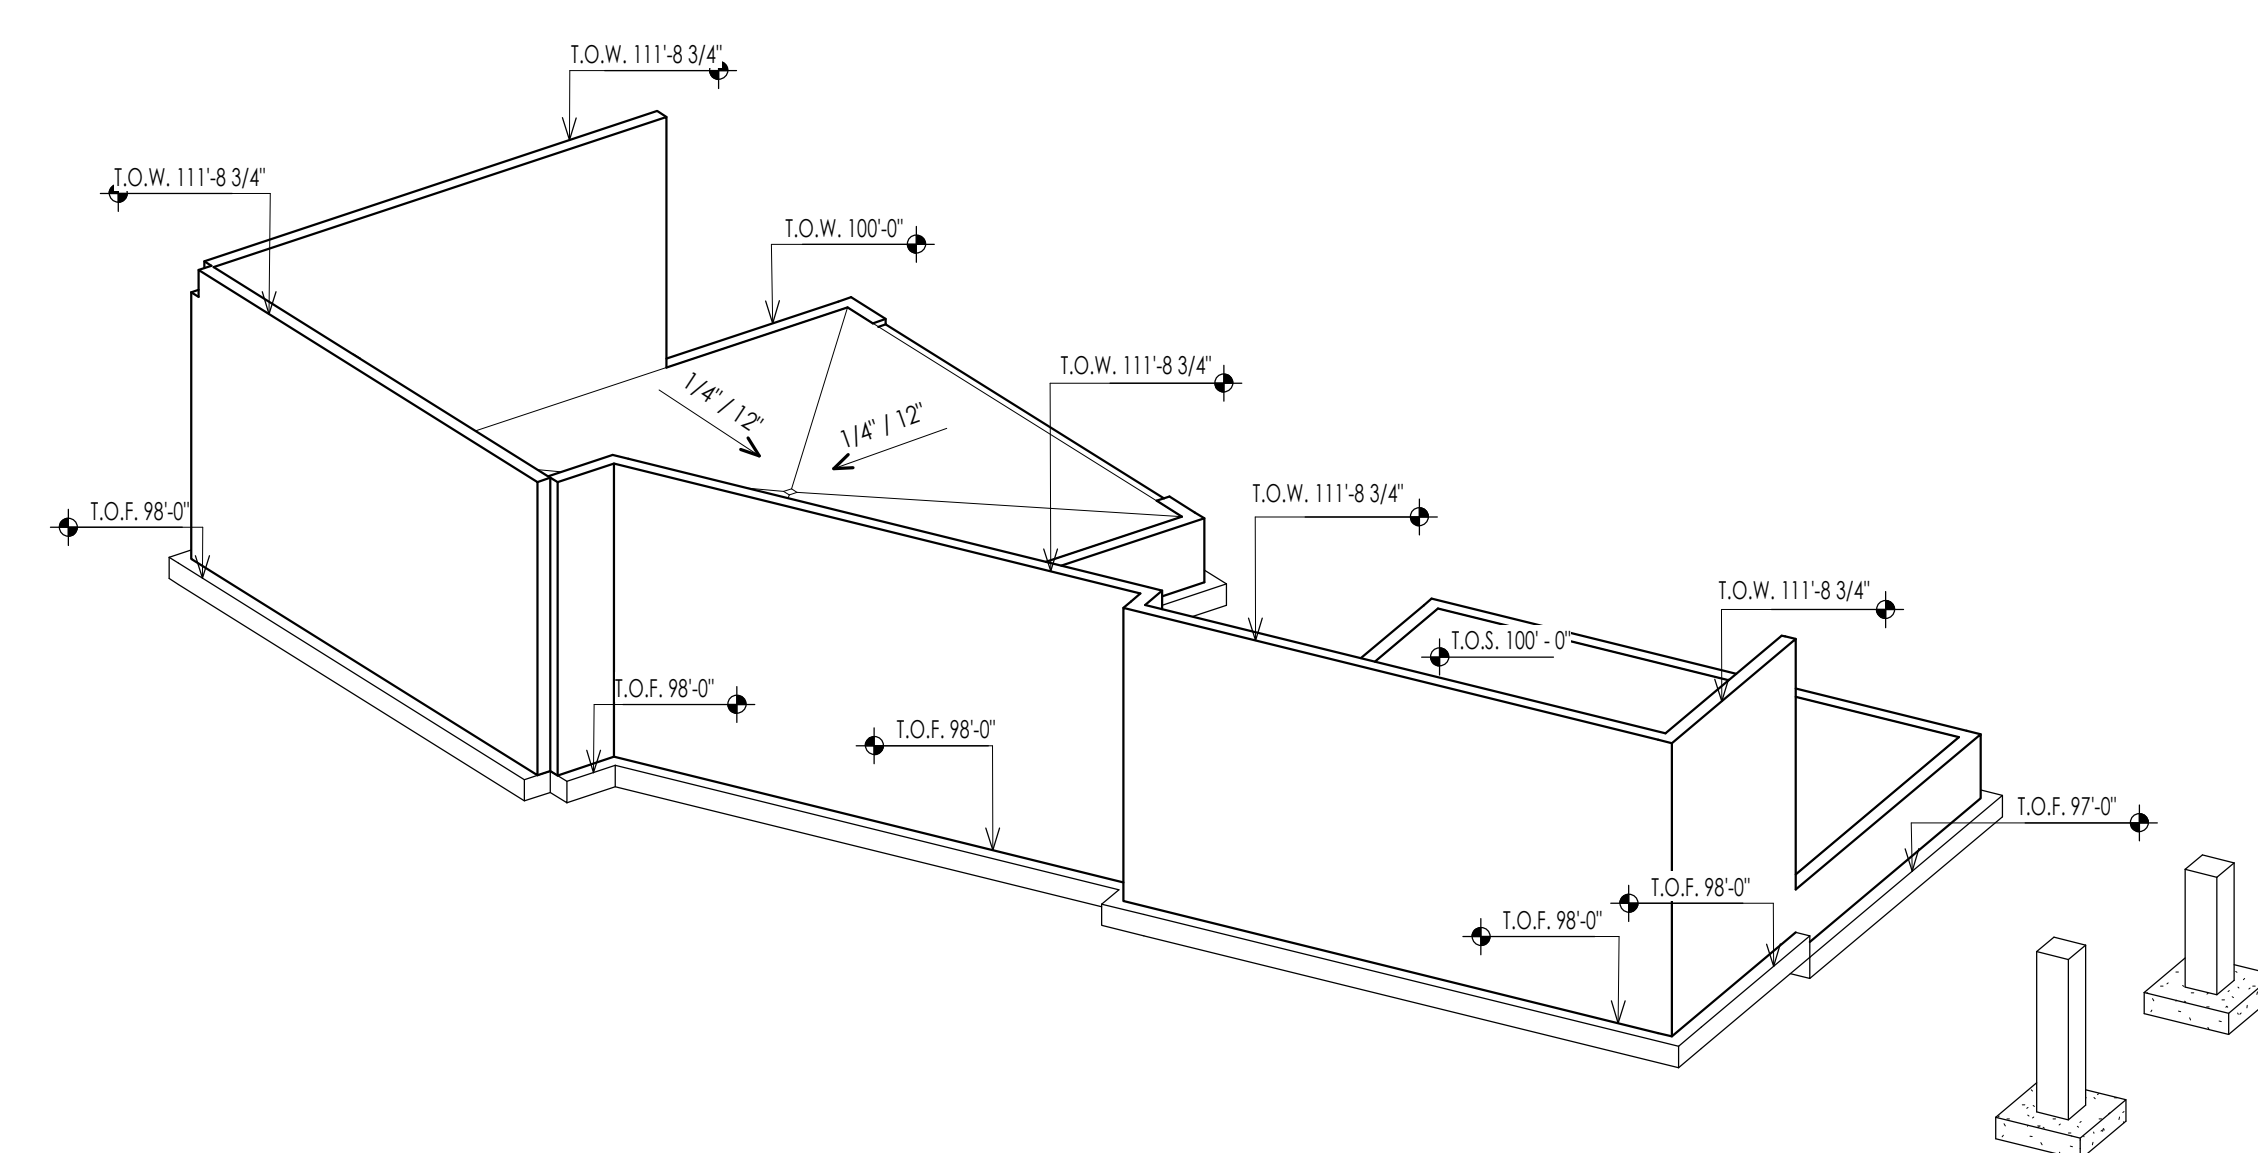

ISOMETRIC B
3
A103

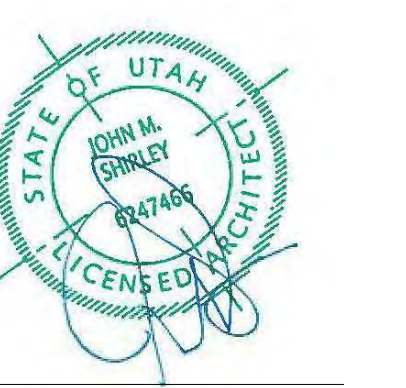


FLOOR PLAN LEGEND			
HATCH PATTERN	DESCRIPTION	HATCH PATTERN	DESCRIPTION
	POURED IN PLACE CONCRETE WALL		CARPET FINISH
	CMU BLOCK WALL		TILE FINISH
	STONE VENEER		EXTERIOR CONCRETE SLABS
	METAL STUD WALL		
	WOOD STUD WALL		

- ### FLOOR PLAN GENERAL NOTES
- ALL DIMENSIONS ARE TO INTERIOR FACE-OF-STUD (F.O.S.) UNLESS NOTED OTHERWISE.
 - CEILING HEIGHTS MEASURED FROM FLYWOOD OR CONCRETE - SEE SECTIONS
 - REFER TO ENLARGED PLANS FOR ALL UNIT DIMENSIONS, WINDOW TYPES, DOORS AND WALLS.
 - REFER TO ENLARGED PLANS FOR ALL DECK/PATIOS.
 - COORDINATE WITH ALL ENLARGED PLANS FOR ADDITIONAL INFORMATION AND DETAILS.
 - ALL TOPPING SLABS MUST BE POURED AFTER ROOF IS COMPLETE AND BUILDING IS DRIED IN.
 - SEE SHEET A202 FOR PROJECT GENERAL NOTES AND SHEET A203 FOR PROJECT KEYNOTES. REVIEW ALL NOTES PRIOR TO CONSTRUCTION.
 - COORDINATE WITH STRUCTURAL FRAMING PLANS AND SHEAR WALL PLANS FOR LOCATIONS OF COLUMNS, BEAMS, SHEAR WALLS, ETC.
 - COORDINATE WITH BUILDER/OWNER FOR ALL INTERIOR FINISHES
 - COORDINATE WITH ELECTRICAL DRAWINGS FOR ALL LIGHTING, POWER AND DATA REQUIREMENTS.
 - ALL EXTERIOR WALLS ARE ASSUMED TO BE 2X4 STUD WALLS UNLESS SHOWN/NOTED OTHERWISE.
 - ALL INTERIOR WALLS ARE ASSUMED TO BE 2X4 STUD WALLS UNLESS SHOWN/NOTED OTHERWISE.
 - ALL ROOF TRUSSES TO HAVE RAISED ENERGY HEEL CONSTRUCTION TO ALLOW FOR FULL DEPTH INSULATION OVER EXTERIOR WALLS (COORDINATE INSULATION REQUIREMENTS WITH RESCHECKS).

FLOOR PLAN KEYNOTES

KEYNOTES
FL-01 CONTRACTOR TO COORDINATE FLOOR PENETRATIONS WITH MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS.
FL-04 CLOSET SHELVING/ ROD - PER INTERIOR DESIGNER
FL-06 BATHROOM SINK - VANITY PER INTERIOR DESIGNER
FL-09 STACKED WASHER AND DRYER. CONTRACTOR TO COORDINATE WITH MECHANICAL AND ELECTRICAL
FL-11 CABINET SYSTEM SHELVING PER INTERIOR DESIGNER
FL-12 PROVIDE SHOWER BENCH AS PER OWNER INTERIOR DESIGN
FL-13 PROVIDE "SCHLITZ" EROSION LINEAR TRENCH DRAIN AGAINST BENCH. INTERIOR DESIGNER TO PROVIDE DRAIN COVER SPEC.
FL-14 SHOWER HEAD PER INTERIOR DESIGN
FL-16 W.C. TO BE "KOHLER" PERIODE CURRY COMFORT
FL-19 BUILT IN INDUCTION CABINETS AS PER INTERIOR DESIGNER
FL-25 PROVIDE HOT/COLD HOOK UP
FL-26 PROVIDE 50 AMP EV CONNECTION POINT
FL-28 STRUCTURAL WIDE FLANGE COLUMN AS PER STRUCT.
FL-30 FIRE EXTINGUISHERS SHALL BE INSTALLED AND MAINTAINED PER 2018 IFC SECTION 906 BOTH DURING CONSTRUCTION AND UPON OCCUPANCY OF THE BUILDING. DURING CONSTRUCTION FIRE EXTINGUISHERS SHALL BE PLACED IN A CONSPICUOUS, EASY TO ACCESS, UNOBSTRUCTED LOCATION THAT IS LESS THAN 75' TRAVEL DISTANCE TO ANY COMBUSTIBLES ON SITE. 30" TO ANY HOT WORK. EXTINGUISHERS SHALL BE MOUNTED IN A CONSPICUOUS, EASY TO ACCESS, UNOBSTRUCTED LOCATION UPON COMPLETION OF PROJECT EVERY SINGLE-FAMILY RESIDENCE SHALL HAVE A MINIMUM OF ONE EXTINGUISHER PER GARAGE AND ONE EXTINGUISHER PER KITCHEN AREA.
FL-36 AN APPROVED KEY BOX SHALL BE INSTALLED, WITH THE APPROPRIATE KEYS FOR EMERGENCY FIRE DEPARTMENT ACCESS IN A LOCATION APPROVED BY THE FIRE DEPARTMENT. THE KEY BOX SHALL BE A KNIX BOX BRAND AND SIZED TO ACCOMMODATE KEYS TO EVERY DOOR OF THE PROJECT. LOCATION NO MORE THAN 3FT HOR. FROM MAIN DOOR AND NO MORE THAN 5.5FT VERTICAL - VERIFY LOCAL CODE.

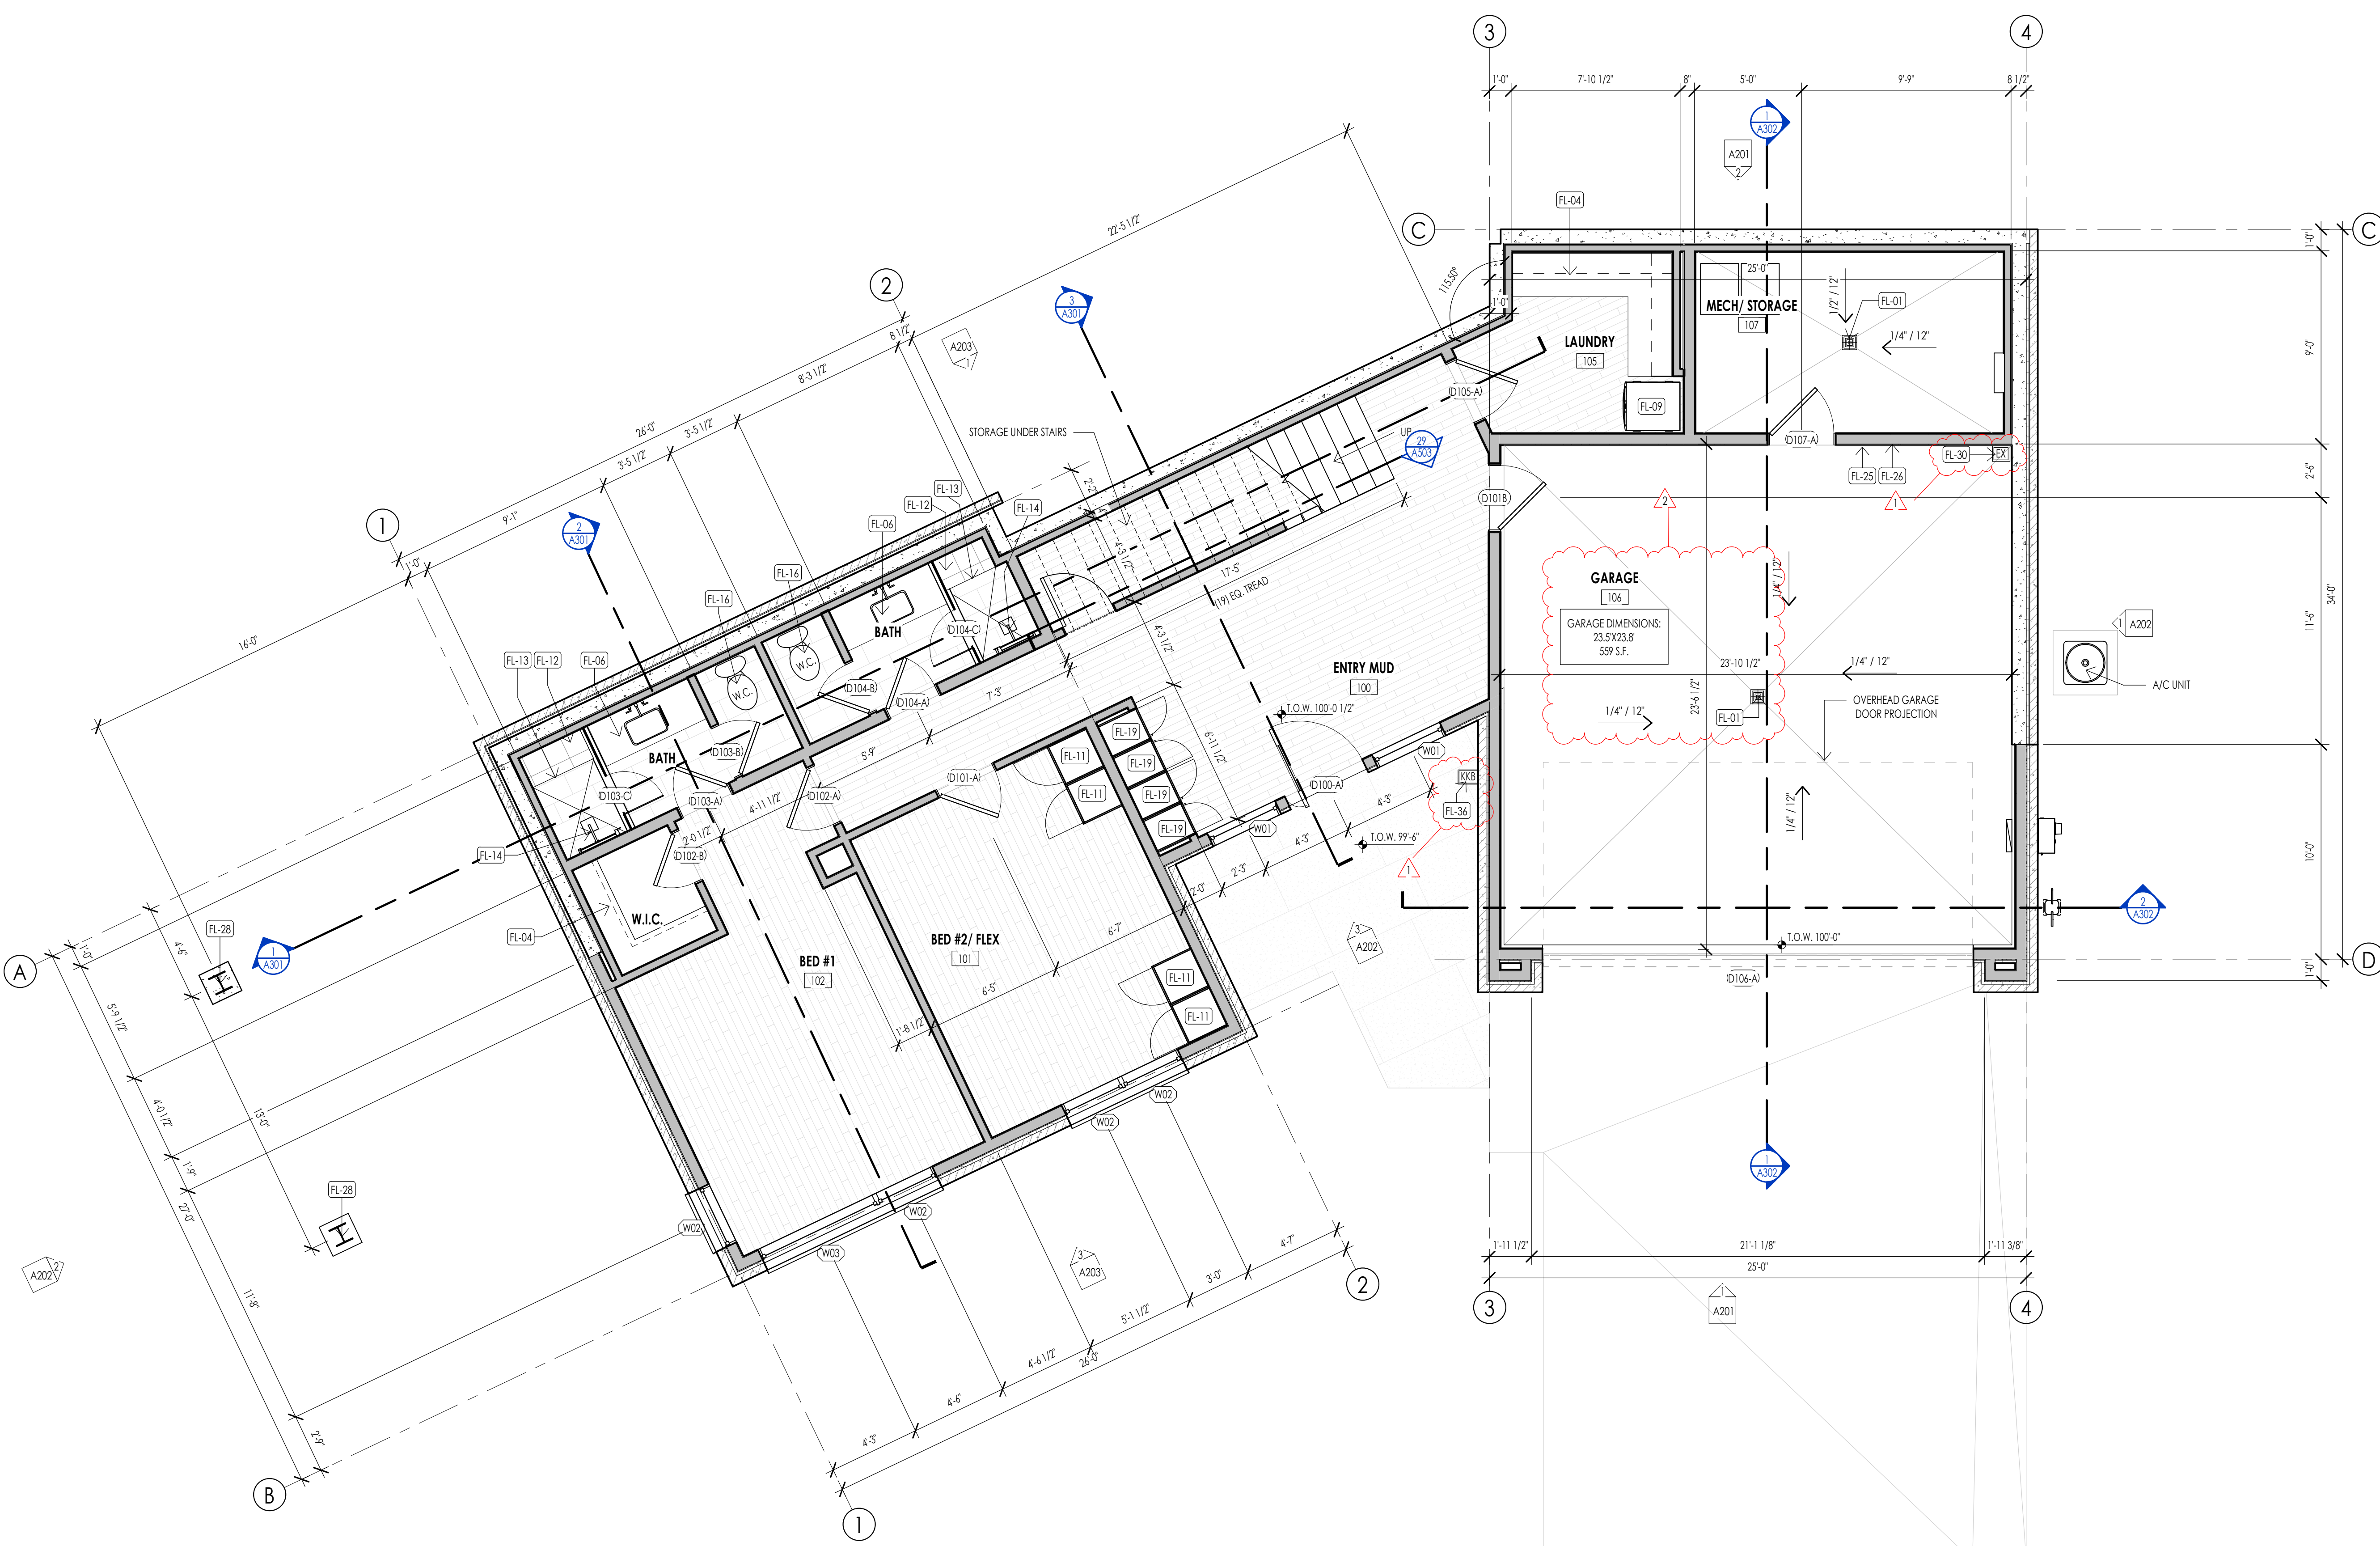


LEVEL 1 - FLOOR PLAN
1/4" = 1'-0"



Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Sandwich, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkaec.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced in whole or in part without the sole and express written permission from THINK Architecture, Inc.
These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

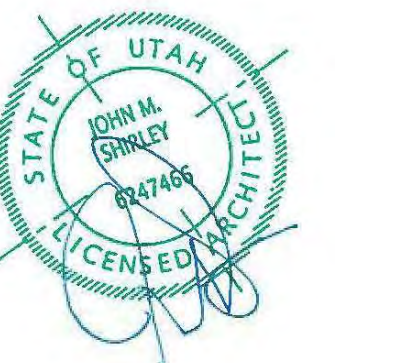


FLOOR PLAN LEGEND			
HATCH PATTERN	DESCRIPTION	HATCH PATTERN	DESCRIPTION
	POURED IN PLACE CONCRETE WALL		CARPET FINISH
	CMU BLOCK WALL		TILE FINISH
	STONE VENEER		EXTERIOR CONCRETE SLABS
	METAL STUD WALL		
	WOOD STUD WALL		

- ### FLOOR PLAN GENERAL NOTES
- ALL DIMENSIONS ARE TO INTERIOR FACE-OF-STUD (F.O.S.) UNLESS NOTED OTHERWISE.
 - CEILING HEIGHTS MEASURED FROM FLYWOOD OR CONCRETE - SEE SECTIONS
 - REFER TO ENLARGED PLANS FOR ALL UNIT DIMENSIONS, WINDOW TYPES, DOORS AND WALLS.
 - REFER TO ENLARGED PLANS FOR ALL DECK/PATIOS.
 - COORDINATE WITH ALL ENLARGED PLANS FOR ADDITIONAL INFORMATION AND DETAILS.
 - ALL TOPPING SLABS MUST BE POURED AFTER ROOF IS COMPLETE AND BUILDING IS DRIED IN.
 - SEE SHEET A202 FOR PROJECT GENERAL NOTES AND SHEET A203 FOR PROJECT KEYNOTES. REVIEW ALL NOTES PRIOR TO CONSTRUCTION.
 - COORDINATE WITH STRUCTURAL FRAMING PLANS AND SHEAR WALL PLANS FOR LOCATIONS OF COLLUMNS, BEAMS, SHEAR WALLS, ETC.
 - COORDINATE WITH BUILDER/OWNER FOR ALL INTERIOR FINISHES
 - COORDINATE WITH ELECTRICAL DRAWINGS FOR ALL LIGHTING, POWER AND DATA REQUIREMENTS.
 - ALL EXTERIOR WALLS ARE ASSUMED TO BE 2X4 STUD WALLS UNLESS SHOWN/NOTED OTHERWISE.
 - ALL INTERIOR WALLS ARE ASSUMED TO BE 2X4 STUD WALLS UNLESS SHOWN/NOTED OTHERWISE.
 - ALL ROOF TRUSSES TO HAVE RAISED ENERGY HEEL CONSTRUCTION TO ALLOW FOR FULL DEPTH INSULATION OVER EXTERIOR WALLS (COORDINATE INSULATION REQUIREMENTS WITH RESCHECKS).

FLOOR PLAN KEYNOTES

KEYNOTES	
FL-02	OVERHEAD CABINETS PROJECTION
FL-06	BATHROOM SINK - VANITY PER INTERIOR DESIGNER
FL-11	CABINET SYSTEMS/SHELVING PER INTERIOR DESIGNER
FL-12	PROVIDE SHOWER BENCH AS PER OWNER/ INTERIOR DESIGNER
FL-13	PROVIDE "SCHLITZ" KEROLINE LINEAR TRENCH DRAIN AGAINST BENCH, INTERIOR DESIGNER TO PROVIDE DRAIN COVER SPEC.
FL-14	SHOWER HEAD PER INTERIOR DESIGNER
FL-16	W.C. TO BE "KOHLER" PERIASE CURBY COMFORT
FL-17	TUB/ SOAKER TUB AS PER INTERIOR DESIGNER
FL-27	PROVIDE COUPLER BUTTIGN SWITCH FOR DISPOSAL UNIT
FL-30	FIRE EXTINGUISHERS SHALL BE INSTALLED AND MAINTAINED PER 2018 IFC SECTION 906 BOTH DURING CONSTRUCTION AND UPON OCCUPANCY OF THE BUILDING. DURING CONSTRUCTION FIRE EXTINGUISHERS SHALL BE PLACED IN A CONSPICUOUS, EASY TO ACCESS, UNOBSTRUCTED LOCATION THAT IS LESS THAN 75' TRAVEL DISTANCE TO ANY COMBUSTIBLES ON SITE. 30' TO ANY HOT WORK. EXTINGUISHERS SHALL BE MOUNTED IN A CONSPICUOUS, EASY TO ACCESS, UNOBSTRUCTED LOCATION. UPON COMPLETION OF PROJECT EVERY SINGLE-FAMILY RESIDENCE SHALL HAVE A MINIMUM OF ONE EXTINGUISHER PER GARAGE AND ONE EXTINGUISHER PER KITCHEN AREA.

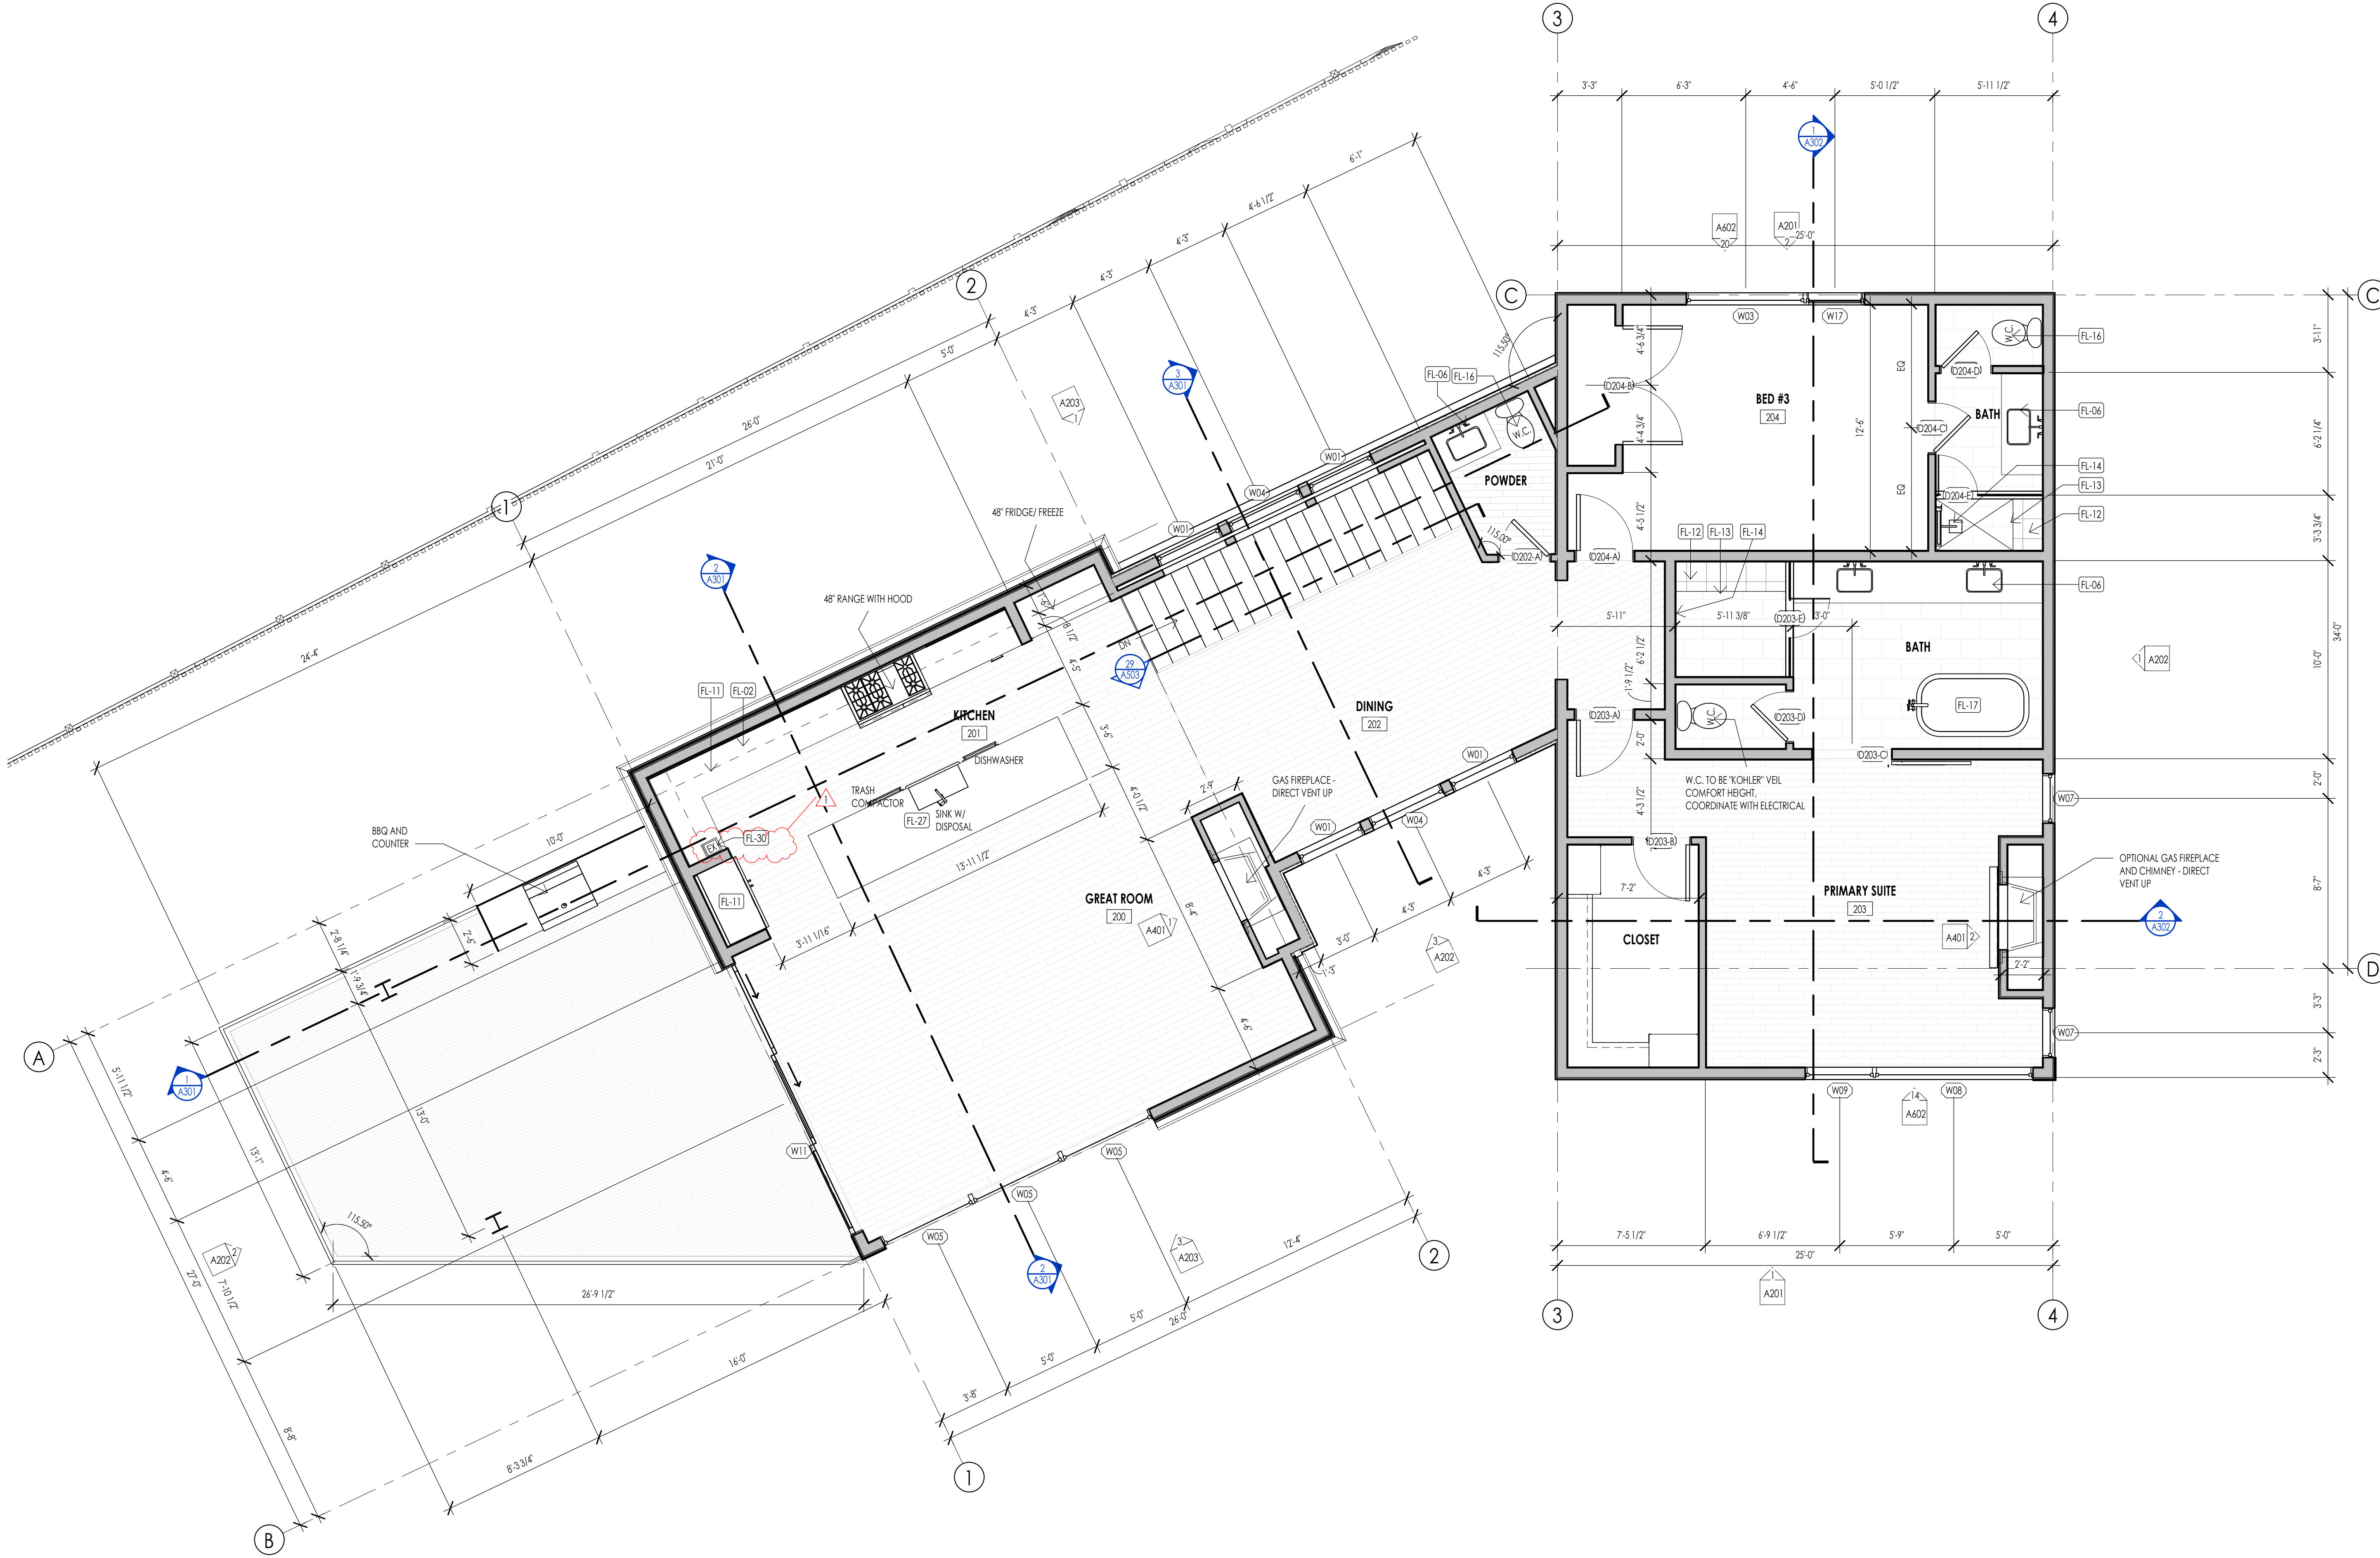

LEVEL 2 - FLOOR PLAN
1/4" = 1'-0"

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30


REVISIONS:
1 04-27-2023 PER CITY COMMENTS

SHEET TITLE:
LEVEL 2 FLOOR PLAN

SHEET NUMBER:
A105

© 2021 THINK ARCHITECTURE, INC.

PERMIT SET

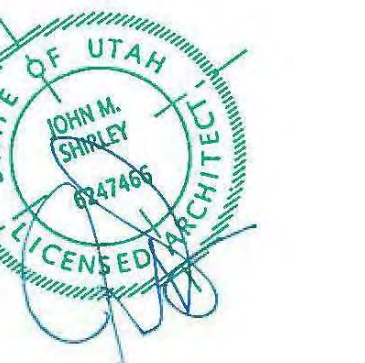

ROOF PLAN LEGEND			
HATCH PATTERN	DESCRIPTION	HATCH PATTERN	DESCRIPTION
	SINGLE PLY ROOFING MEMBRANE		STANDING SEAM METAL ROOFING SYSTEM
	LOCATION OF SNOW RETENTION SYSTEM - TO BE DESIGNED AND ENGINEERED BY OTHERS - SEE DETAILS BELOW		3/8" STEEL PLATE AWNING
	RAIN GUTTER WITH DOWN SPOUT		

TRA SNOW & SUN
1887 South 985 East
American Fork, UT 84003
801-656-8881 | www.tra-snow.com

07.72.53

SNOW DIAMOND CLAMP-ON -1 RAIL

DESCRIPTION:

- Designed for standing seam metal roofs.
- Available for all types including Double Lock, Single Lock, Snap Lock, Skyline, etc.
- Designed for diamond square tubular snow clamp-on rails.
- Allows for full insulation without penetration of the roof surface.
- Powder coated to match roofing material color.
- Overall dimensions: 2 1/2" x 3 1/2" x 1 1/2".
- Height (H) of clamp varies based on its type and height.
- Carriage hole (D) 3/8" DIA. x 1/4" x 1/2".

MATERIALS:

- Zinc Coated Steel: 316" (ASTM A653)
- Stainless Steel: 304" (ASTM A304)

COLORS/FINISHES:

- Color Matched Steel
- Hot Dipped Galvanized Steel
- Mill Finish Stainless Steel
- Powder coating available in many colors visit www.tra-snow.com for color chart.

NOTE: Due to specific job conditions, TRA Snow and Sun will only warranty a snow retention system that has been designed by TRA Snow and Sun.


1 RAIL CLAMP-ON SNOW FENCE SYSTEM

USED ON: STANDING SEAM METAL

INSTALLATION:
CLAMP THE SNOW FENCE TO THE RIB BY USING A TORQUE WRENCH WITH 20 FT.-LBS. OF PRESSURE APPLIED TO EACH RAIL. FOR SPECIFIC ENGINEERING & PLACEMENT CALL TRA SNOW & SUN AT 801-656-8881.

DIMENSIONS

SNOW RETENTION SYSTEMS

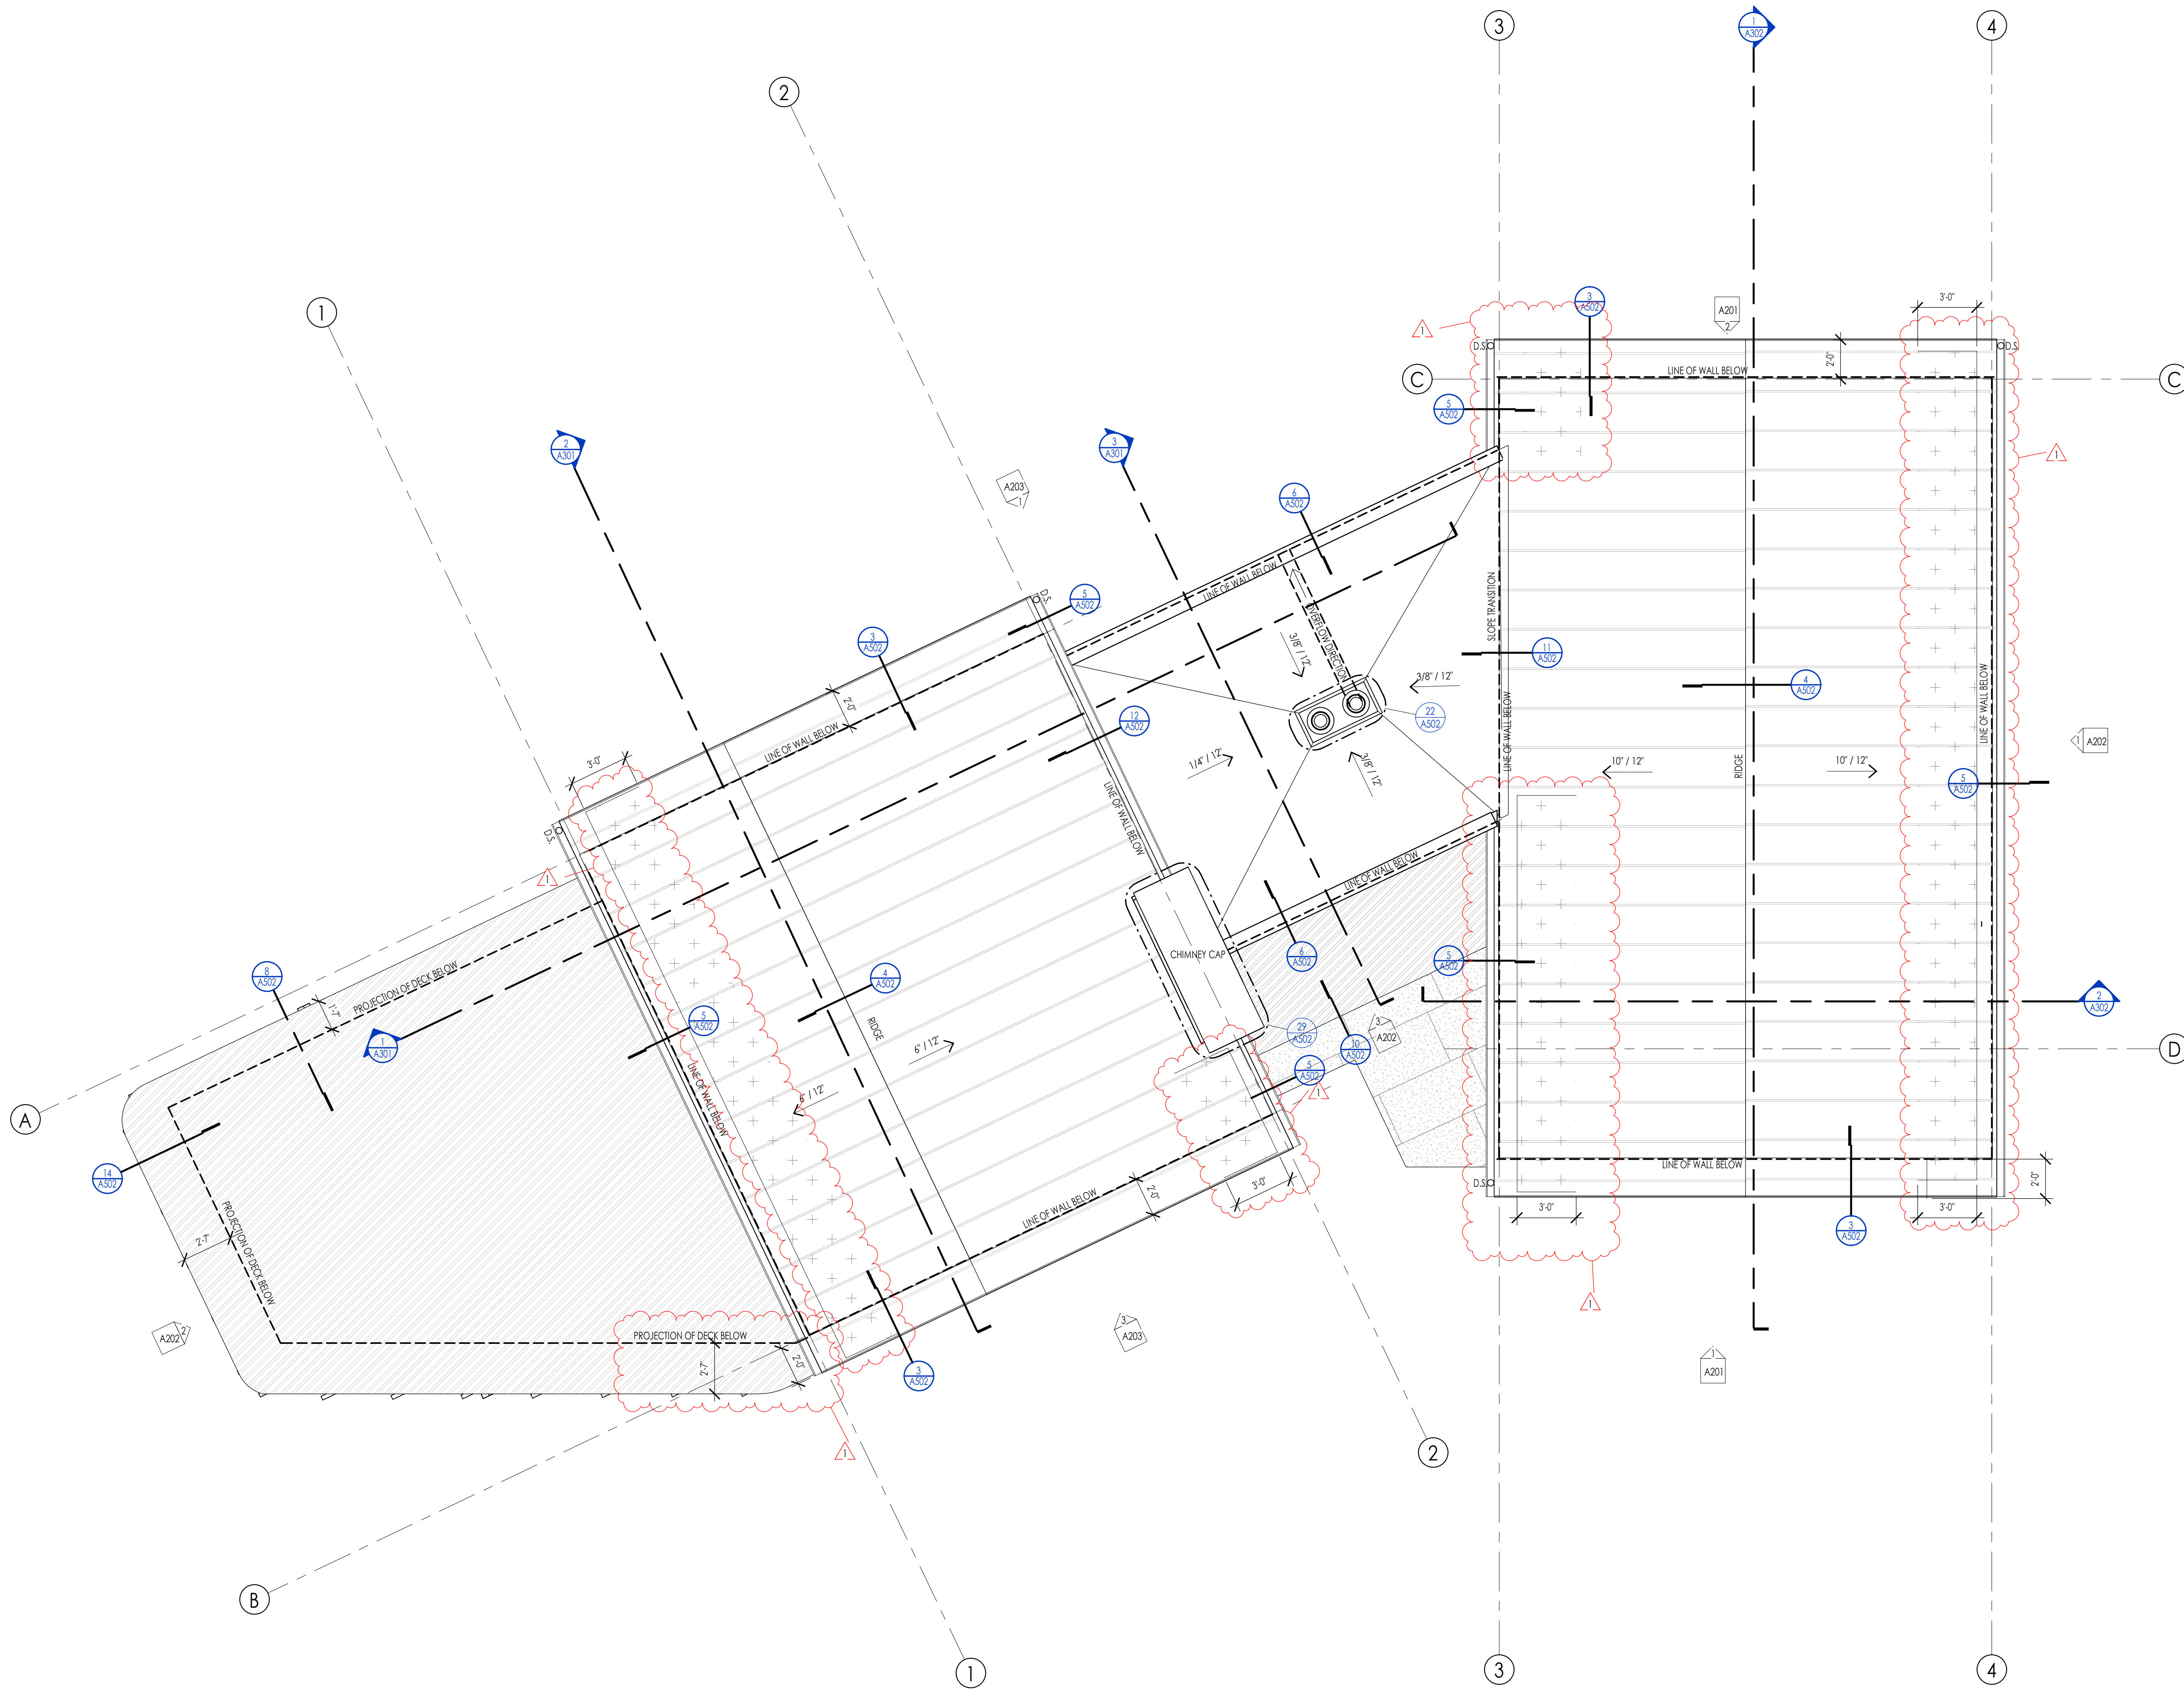

ROOF PLAN GENERAL NOTES	
1.	SEE SHEET 0002 FOR PROJECT GENERAL NOTES. REVIEW ALL NOTES PRIOR TO CONSTRUCTION.
2.	FLASH ALL ROOF PENETRATIONS WHETHER SHOWN OR NOT.
3.	COORDINATE WITH MECHANICAL, PLUMBING, AND ELECTRICAL DRAWINGS FOR ALL ROOF PENETRATIONS.
4.	PROVIDE HEAT TRACE IN ALL RAIN GUTTERS, DOWN SPOUTS AND RAIN CHAINS.
5.	ROOFING CONTRACTOR SHALL REVIEW ALL SUBSTRATES PRIOR TO BEGINNING WORK.
6.	ALL ROOFING SHALL BE REVIEWED PRIOR TO INSTALLATION.
7.	CONTRACTOR IS RESPONSIBLE TO ASSUME THAT NO ROOF SLOPES CREATE DEAD SPOTS OR LOW SPOTS THAT WILL PREVENT DRAINAGE.
8.	ALL ROOF TRUSSES TO HAVE RAISED ENERGY REE CONSTRUCTION TO ALLOW FOR FULL DEPTH INSULATION OVER EXTERIOR WALLS (COORDINATE INSULATION REQUIREMENTS WITH RESCHECKS).
9.	DIMENSIONS SHOWN ON THE ROOF PLAN ARE FROM THE EXTERIOR SIDE OF THE STUD FRAMING BELOW.

ROOF PLAN KEYNOTES	
KEYNOTES	

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30

REVISIONS:
1 04-27-2023 PER CITY COMMENTS


SHEET TITLE:
ROOF PLAN

SHEET NUMBER:
A107

© 2021 THINK ARCHITECTURE, INC.

ROOF PLAN
1/4" = 1'-0"

1
A107

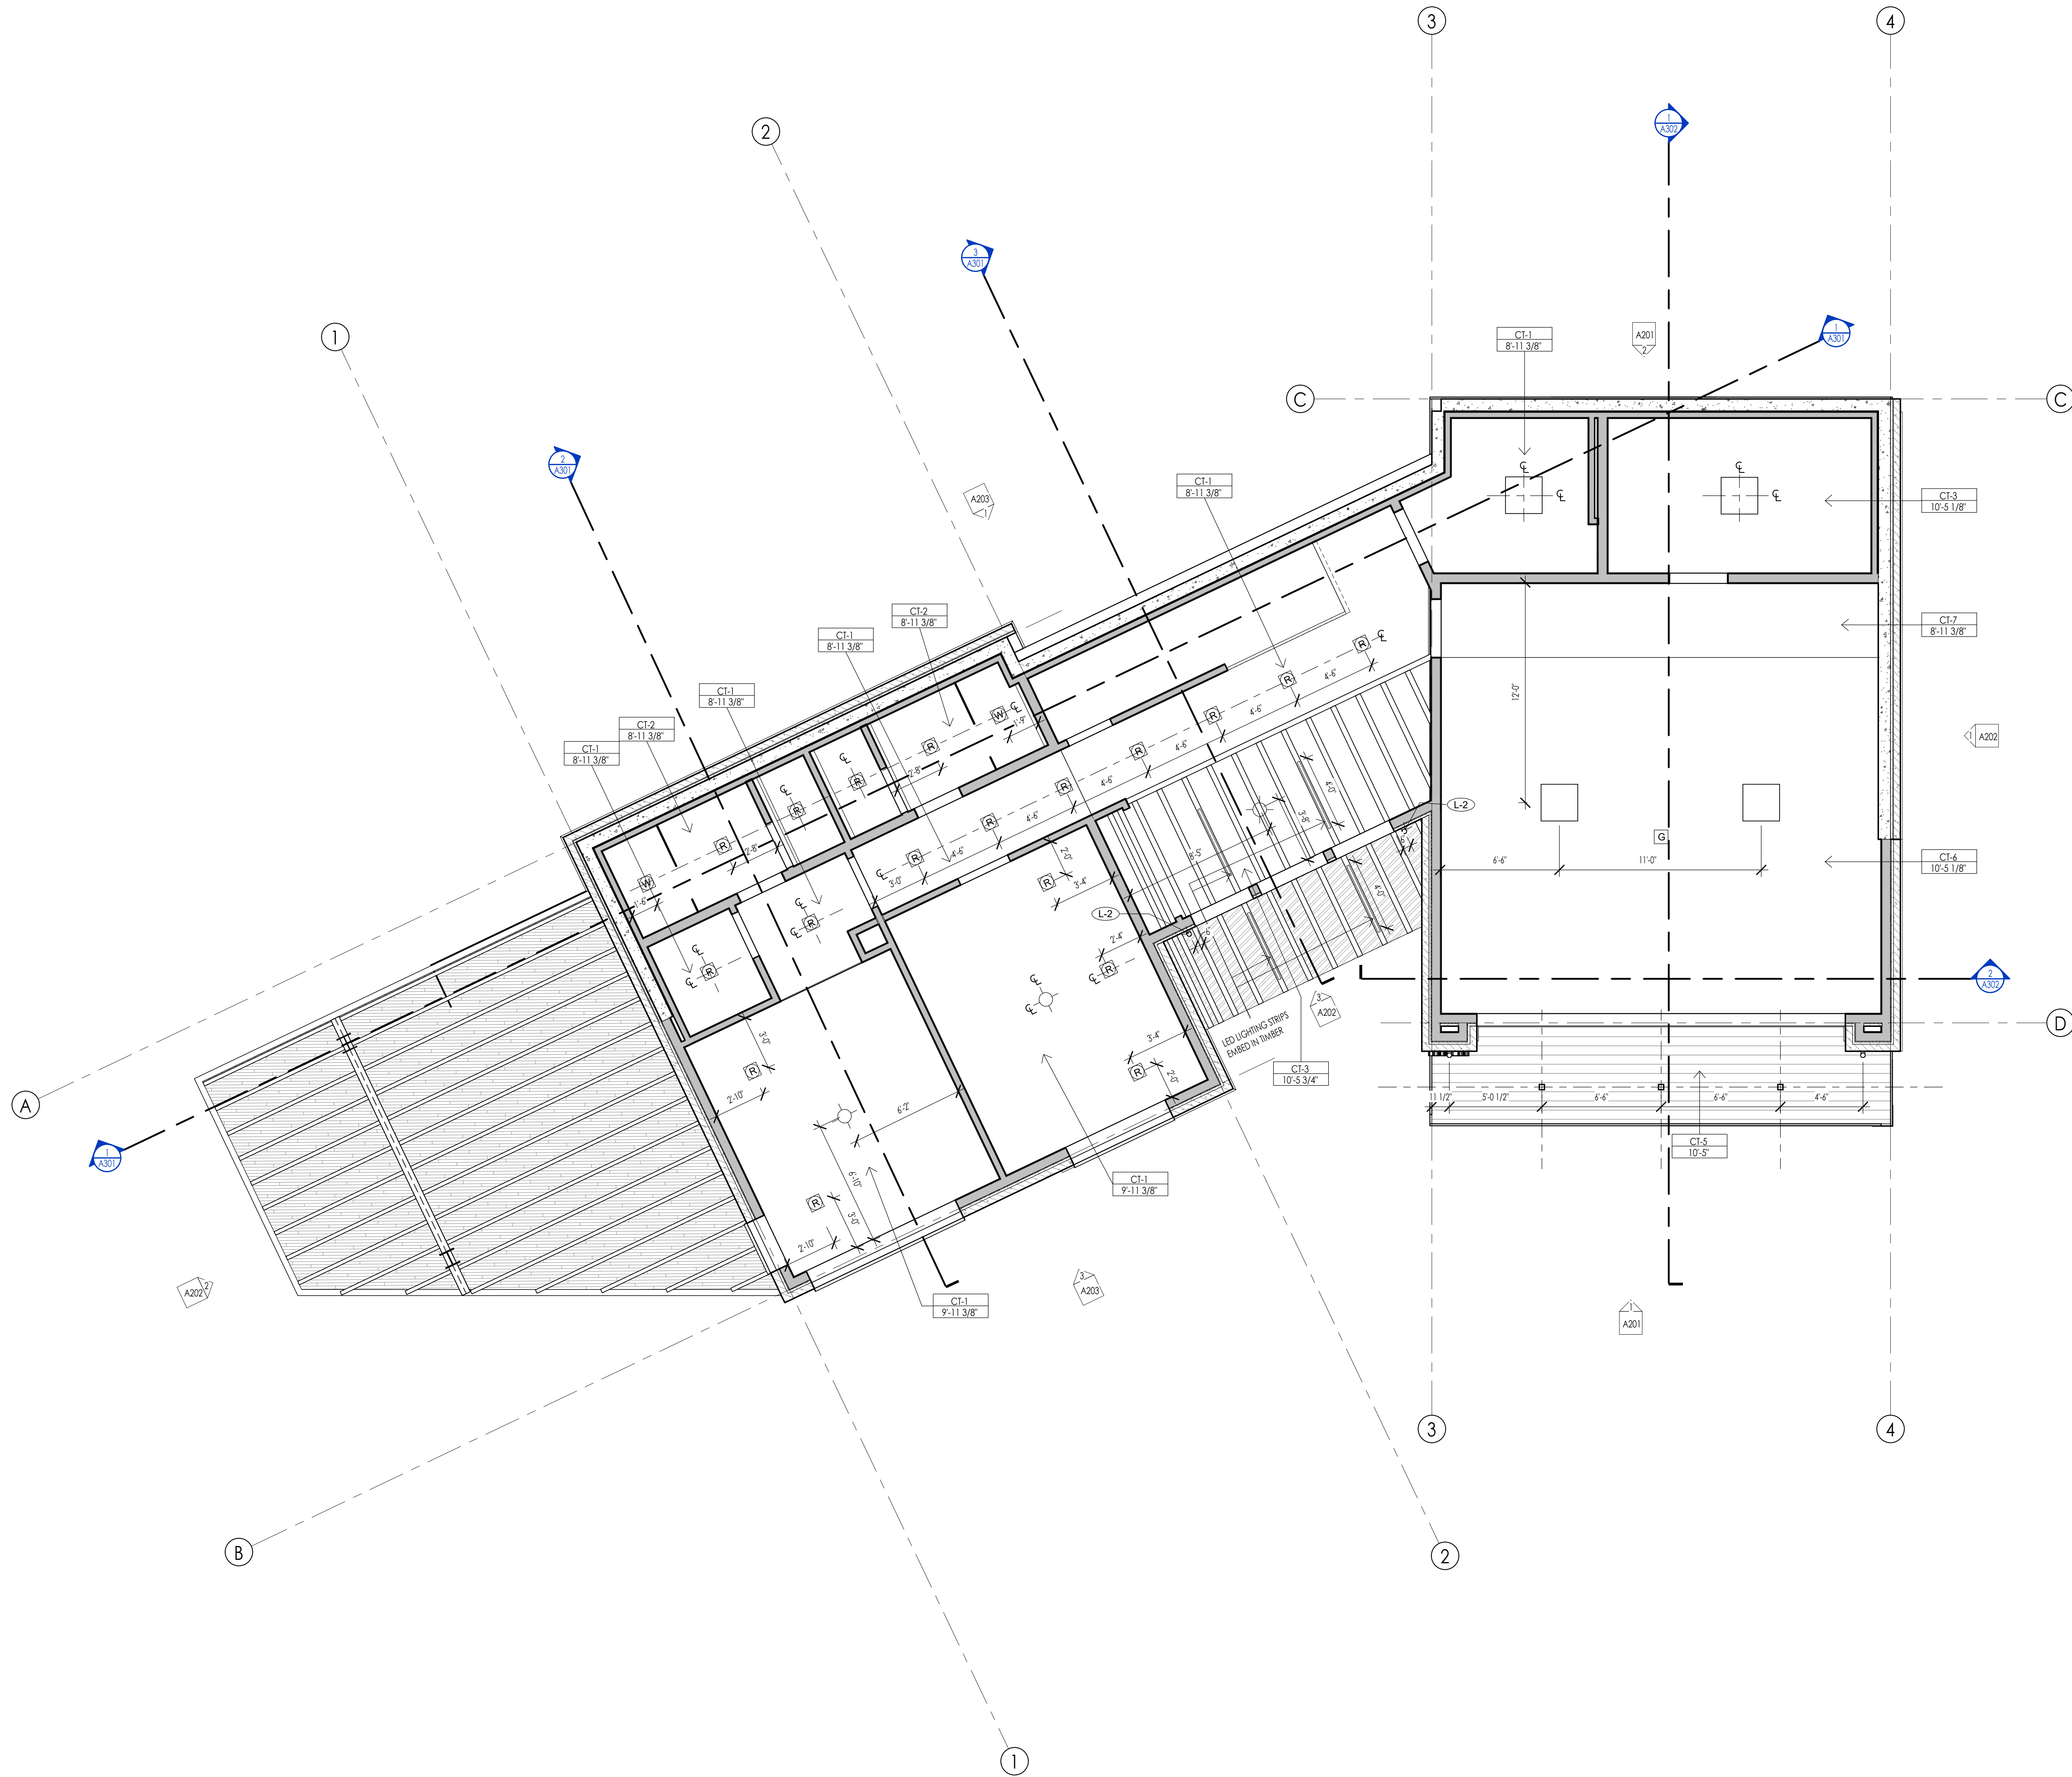

REFLECTED CEILING PLAN MATERIAL LEGEND					
HATCH PATTERN	TYPE	DESCRIPTION	HATCH PATTERN	TYPE	DESCRIPTION
[Hatch Pattern]	CT-1	5/8" GYPSUM BOARD 2x4	[Hatch Pattern]	CT-7	5/8" GYPSUM BOARD 2x4 TYPE X FIRE RESISTANT
[Hatch Pattern]	CT-2	5/8" WATER RESISTANT GYPSUM BOARD 2x4	[Hatch Pattern]	CT-8	EXPOSED STRUCTURE
[Hatch Pattern]	CT-3	5/8" GYPSUM BOARD @ FLOOR OR ROOF			
[Hatch Pattern]	CT-4	3/4" 1-G INTERIOR SOFFIT @ ROOF			
[Hatch Pattern]	CT-5	3/4" 1-G EXTERIOR SOFFIT 2x4			
[Hatch Pattern]	CT-6	5/8" GYPSUM BOARD TYPE X FIRE RESISTANT			

- REFLECTED CEILING PLAN GENERAL NOTES**
- ALL DIMENSIONS ARE TO INTERIOR FACE-OF-STUD (F.O.S.) UNLESS NOTED OTHERWISE.
 - ALL CEILING HEIGHTS MEASURED FROM TOP OF PLYWOOD OR CONCRETE SLAB TO BOTTOM OF CEILING FRAMING, U.N.O. - SEE SECTIONS.
 - REFER TO ENLARGED PLANS FOR ALL UNIT DIMENSIONS, WINDOW TYPES, DOORS AND WALLS.
 - REFER TO ENLARGED PLANS FOR ALL DECKS.
 - COORDINATE WITH ALL ENLARGED PLANS FOR ADDITIONAL INFORMATION AND DETAILS.
 - SEE SHEET G002 FOR PROJECT SPECIFICATION LIST. REVIEW ALL NOTES PRIOR TO CONSTRUCTION.
 - COORDINATE WITH ELECTRICAL DRAWINGS FOR ALL LIGHTING, POWER AND DATA REQUIREMENTS.
 - ALL INTERIOR FINISHES ARE NOTED FOR CONCEPT ONLY. SEE INTERIOR DRAWINGS FOR MATERIAL SPECIFICATIONS, COLORS, PATTERNS, AND OTHER REQUIREMENTS PRIOR TO INSTALLATION.

CEILING TAG SYMBOL	DESCRIPTION
[Symbol]	CEILING TYPE
[Symbol]	HEIGHT

REFLECTED CEILING PLAN KEYNOTES

KEYNOTES

PROJECT NO. 22023
 DATE: 2023.06.30
 REVISIONS:

SHEET TITLE:
 LEVEL 1 CEILING PLAN

SHEET NUMBER:
 A109

© 2021 THINK ARCHITECTURE, INC.




Architecture
 Interior Design
 Landscape Architecture
 Land Planning
 Construction Management

7927 So. Highpoint Parkway, Suite 300
 Sandy, Utah 84094
 ph. 801.269.0555
 fax. 801.269.1425
 www.thinkaec.com


The designs shown and described herein including all technical drawings, graphic representations & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced in whole or in part without the sole and express written permission from THINK Architecture, Inc.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

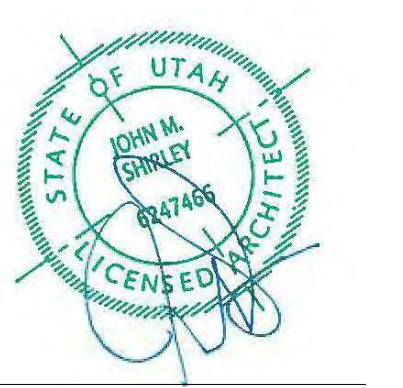

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
 KETCHUM, IDAHO 83340

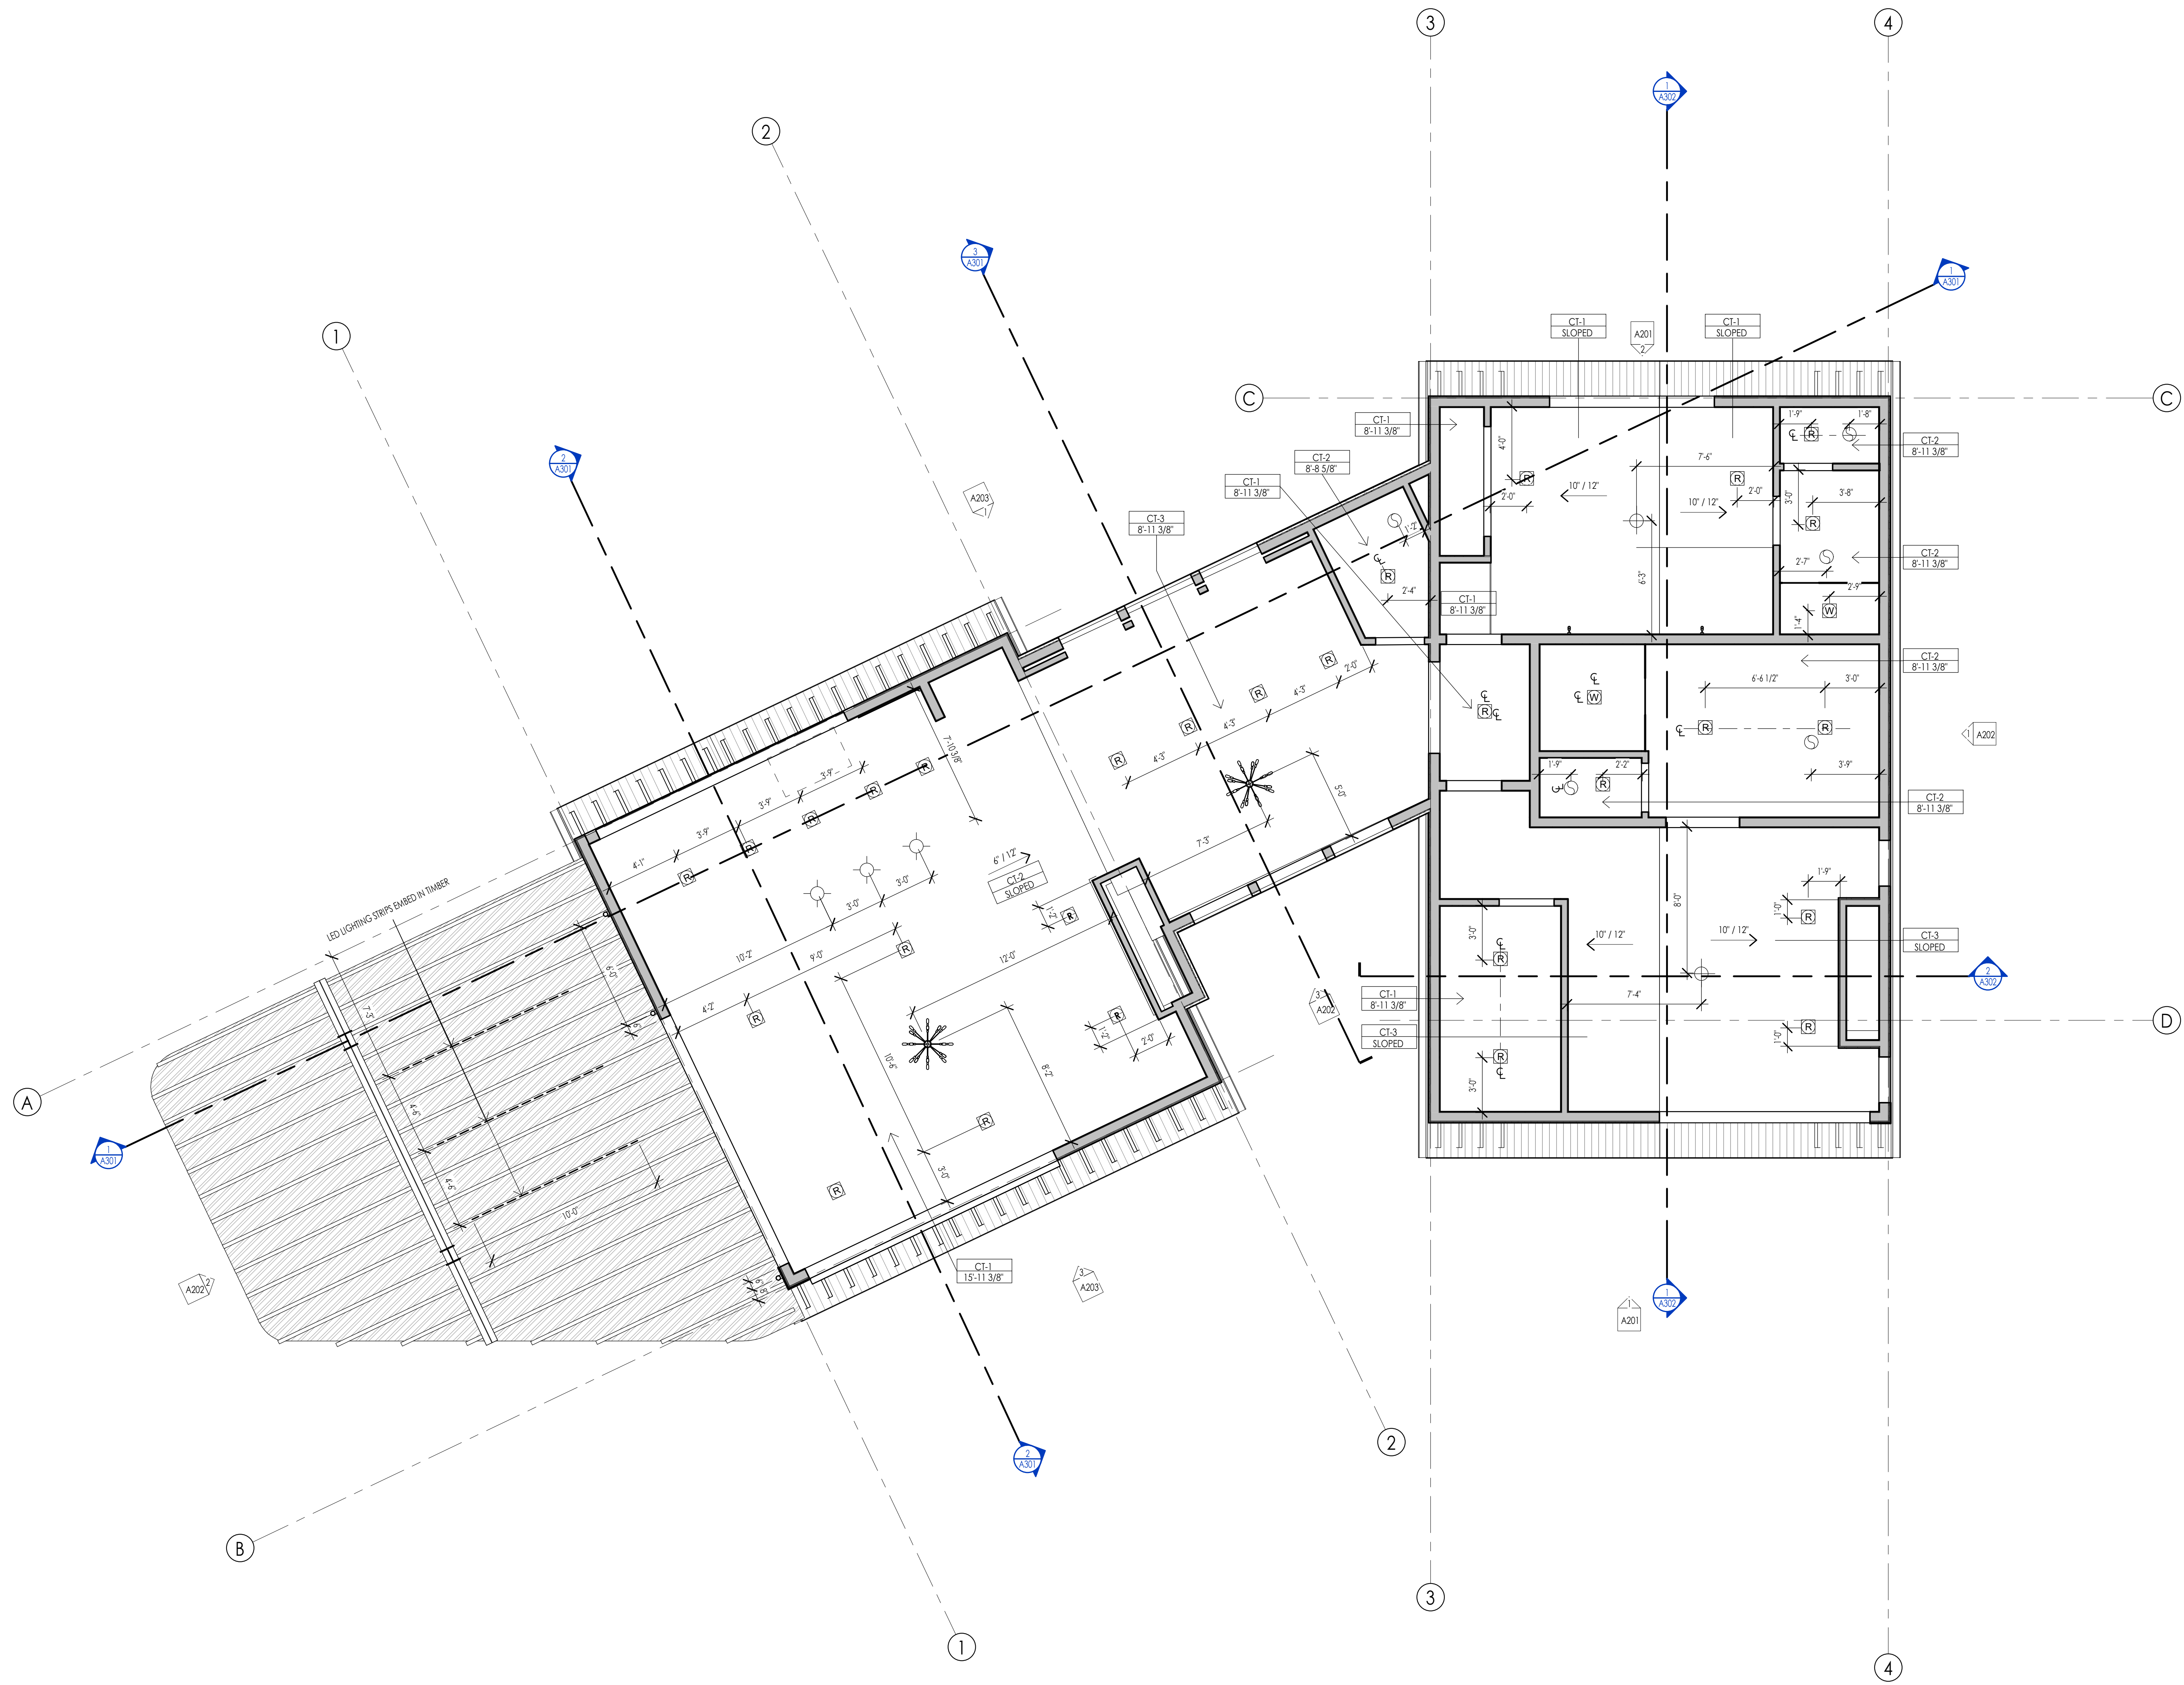

REFLECTED CEILING PLAN MATERIAL LEGEND					
HATCH PATTERN	TYPE	DESCRIPTION	HATCH PATTERN	TYPE	DESCRIPTION
[Hatch Pattern]	CT-1	5/8" GYPSUM BOARD 24	[Hatch Pattern]	CT-7	5/8" GYPSUM BOARD 24 TYPE X FIRE RESISTANT
[Hatch Pattern]	CT-2	5/8" WATER RESISTANT GYPSUM BOARD 24	[Hatch Pattern]	CT-8	EXPOSED STRUCTURE
[Hatch Pattern]	CT-3	5/8" GYPSUM BOARD @ FLOOR OR ROOF			
[Hatch Pattern]	CT-4	3/4" 1-G INTERIOR SOFFIT @ ROOF			
[Hatch Pattern]	CT-5	3/4" 1-G EXTERIOR SOFFIT 24			
[Hatch Pattern]	CT-6	5/8" GYPSUM BOARD TYPE X FIRE RESISTANT			

- REFLECTED CEILING PLAN GENERAL NOTES**
1. ALL DIMENSIONS ARE TO INTERIOR FACE-OF-STUD (F.O.S.) UNLESS NOTED OTHERWISE.
 2. ALL CEILING HEIGHTS MEASURED FROM TOP OF PLYWOOD OR CONCRETE SLAB TO BOTTOM OF CEILING FRAMING, U.N.O. - SEE SECTIONS.
 3. REFER TO ENLARGED PLANS FOR ALL UNIT DIMENSIONS, WINDOW TYPES, DOORS AND WALLS.
 4. REFER TO ENLARGED PLANS FOR ALL DECKS.
 5. COORDINATE WITH ALL ENLARGED PLANS FOR ADDITIONAL INFORMATION AND DETAILS.
 6. SEE SHEET G002 FOR PROJECT SPECIFICATION LIST. REVIEW ALL NOTES PRIOR TO CONSTRUCTION.
 7. COORDINATE WITH ELECTRICAL DRAWINGS FOR ALL LIGHTING, POWER AND DATA REQUIREMENTS.
 8. ALL INTERIOR FINISHES ARE NOTED FOR CONCEPT ONLY. SEE INTERIOR DRAWINGS FOR MATERIAL SPECIFICATIONS, COLORS, PATTERNS, AND OTHER REQUIREMENTS PRIOR TO INSTALLATION.

CEILING TAG SYMBOL	DESCRIPTION
CT-1	CEILING TYPE
1'-0"	HEIGHT

REFLECTED CEILING PLAN KEYNOTES

PERMIT SET

PROJECT NO. 22023
 DATE: 2023.06.30
 REVISIONS:

SHEET TITLE:
 LEVEL 2 CEILING PLAN

SHEET NUMBER:
 A110

© 2021 THINK ARCHITECTURE INC.




THINK Architecture
 Interior Design
 Landscape Architecture
 Land Planning
 Construction Management


7927 So. Highpoint Parkway, Suite 300
 Sandy, Utah 84094
 ph. 801.269.0555
 fax. 801.269.1425
 www.thinkaec.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced in whole or in part without the sole and express written permission from THINK Architecture, Inc.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

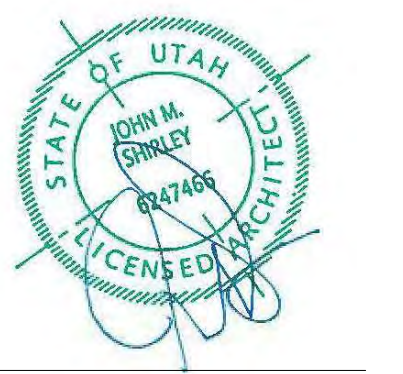

WARM SPRINGS RESIDENCE #35
 190 BALD MOUNTAIN ROAD
 KETCHUM, IDAHO 83340

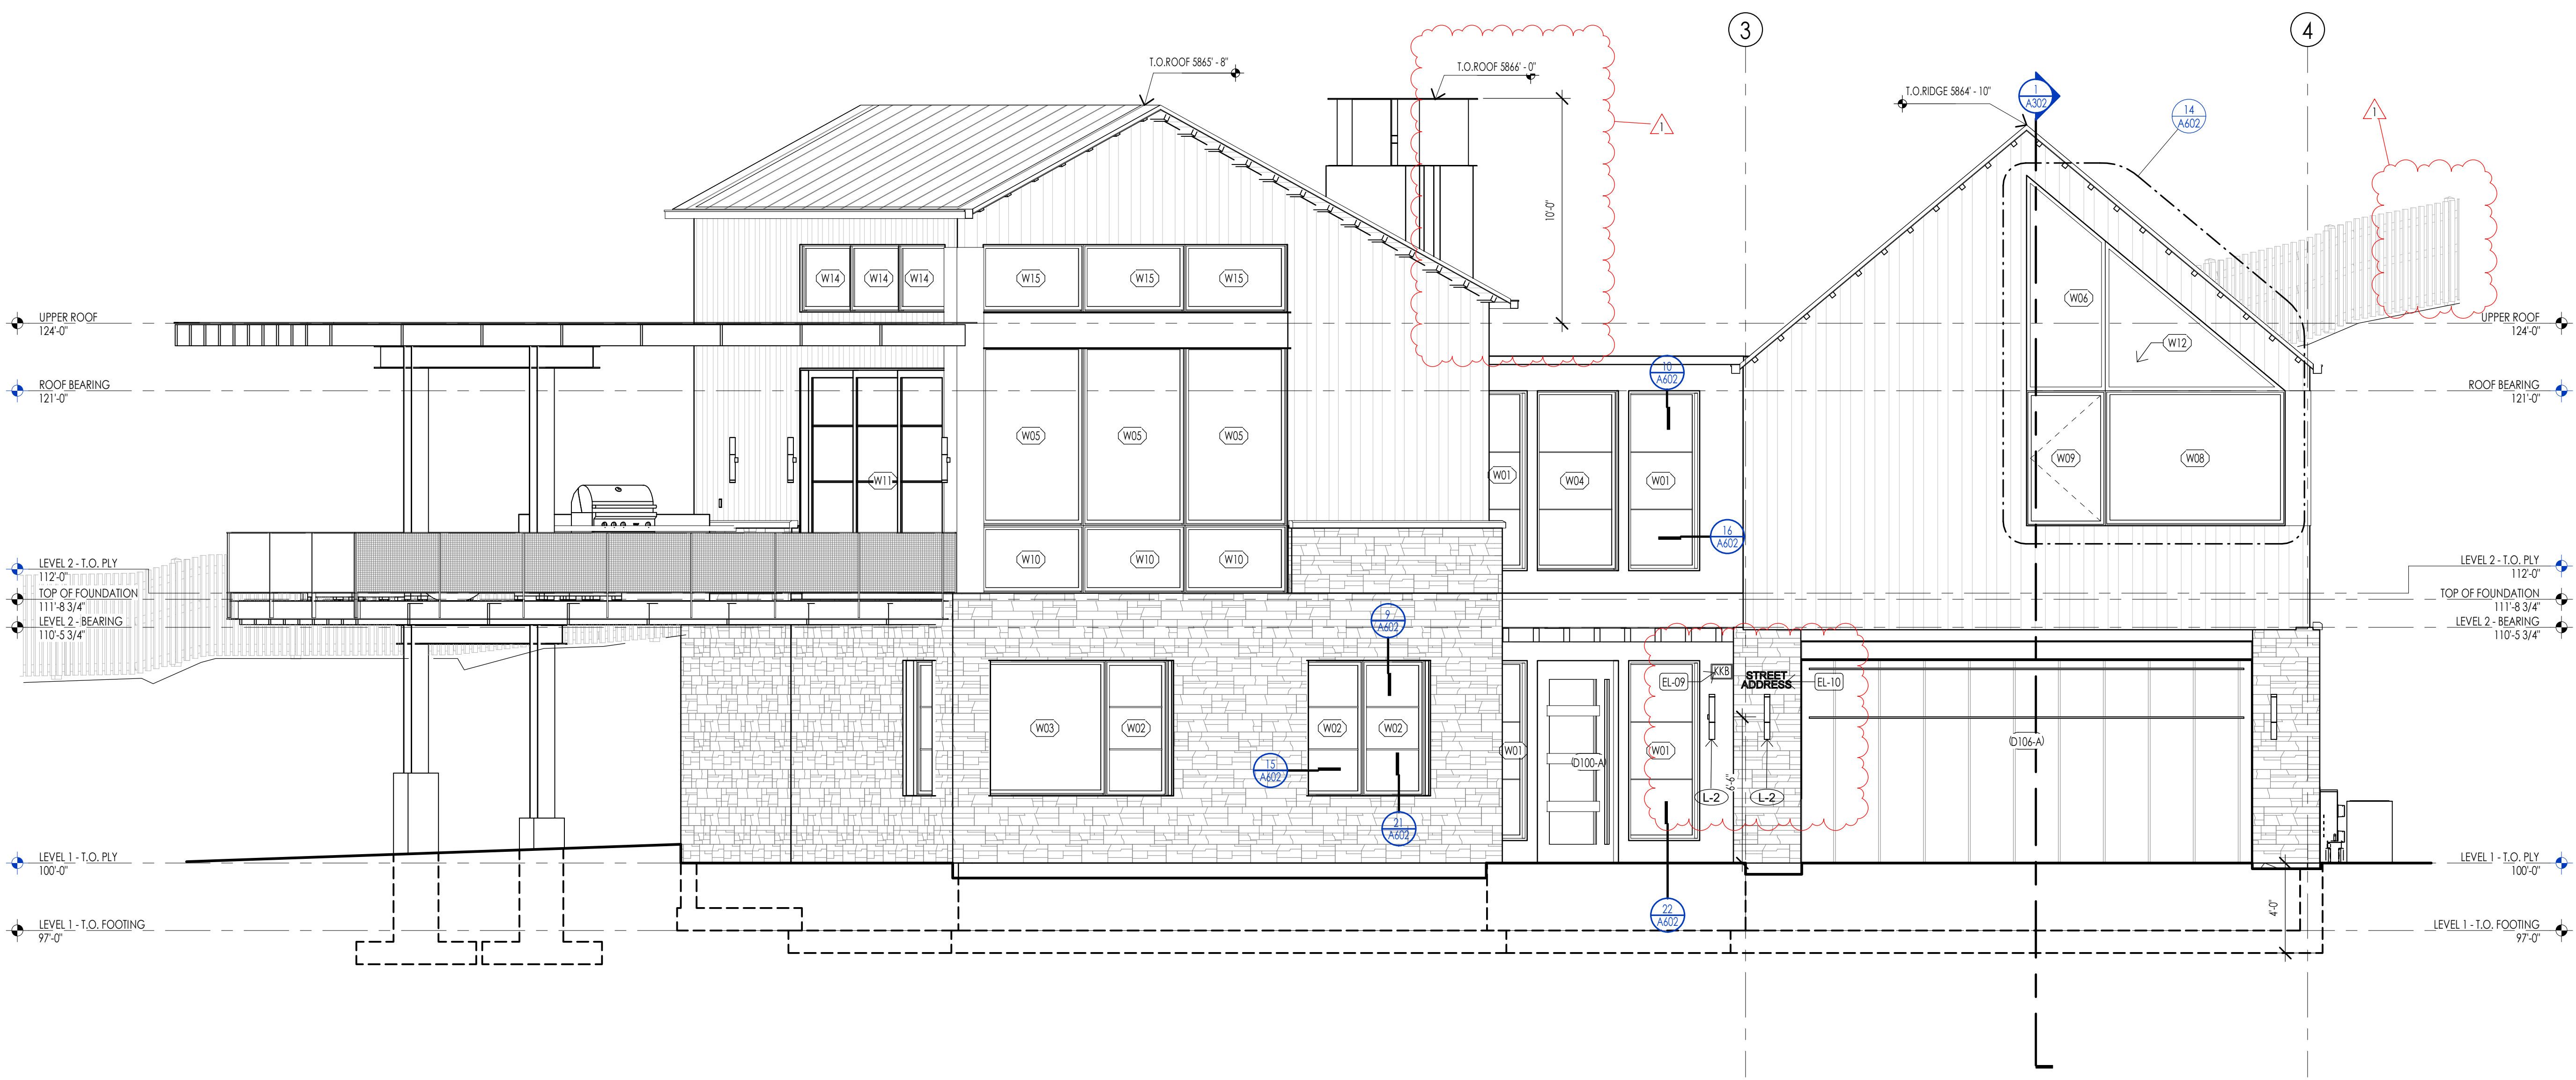


SOUTH ELEVATION
1/4" = 1'-0"

HATCH PATTERN	DESCRIPTION
	STANDING SEAM ROOFING SYSTEM
	SINGLE PLY ROOFING MEMBRANE SYSTEM
	2X10 CEDAR CHANNEL LAP VERTICAL SIDING SYSTEM WITH SQUARE EDGES
	EXTERIOR STONE VENEER
	EXTERIOR METAL PANEL WALL SYSTEM

NOTE: REFER TO MATERIAL SPECIFICATIONS DOCUMENT FOR DETAILED INFORMATION REGARDING EACH FINISH MATERIAL.

ELEVATION/ SECTION KEYNOTES

KEYNOTES	
EL-09	AN APPROVED KEY BOX SHALL BE INSTALLED, WITH THE APPROPRIATE KEYS FOR EMERGENCY FIRE DEPARTMENT ACCESS IN A LOCATION APPROVED BY THE FIRE DEPARTMENT. THE KEY BOX SHALL BE A KNIX BOX BRAND AND SIZED TO ACCOMMODATE KEYS TO EVERY DOOR OF THE PROJECT. LOCATION NO MORE THAN 3FT HOR. FROM MAIN DOOR AND NO MORE THAN 5.3FT VERTICAL. VERIFY LOCAL CODE.
EL-10	APPROVED ADDRESS NUMBERS SHALL BE PLACED IN SUCH A POSITION TO BE PLAINLY VISIBLE AND LEGIBLE FROM THE ROAD FRONTING THE PROPERTY. NUMBERS AND LETTERS SHALL BE A MINIMUM OF FOUR (4) INCHES TALL, HAVE A MINIMUM 1/8" BRUSH STROKE, CONTRAST WITH THEIR BACKGROUND, AND BE POSITIONED A MINIMUM OF FORTY-EIGHT (48) INCHES ABOVE FINIAL GRADE.

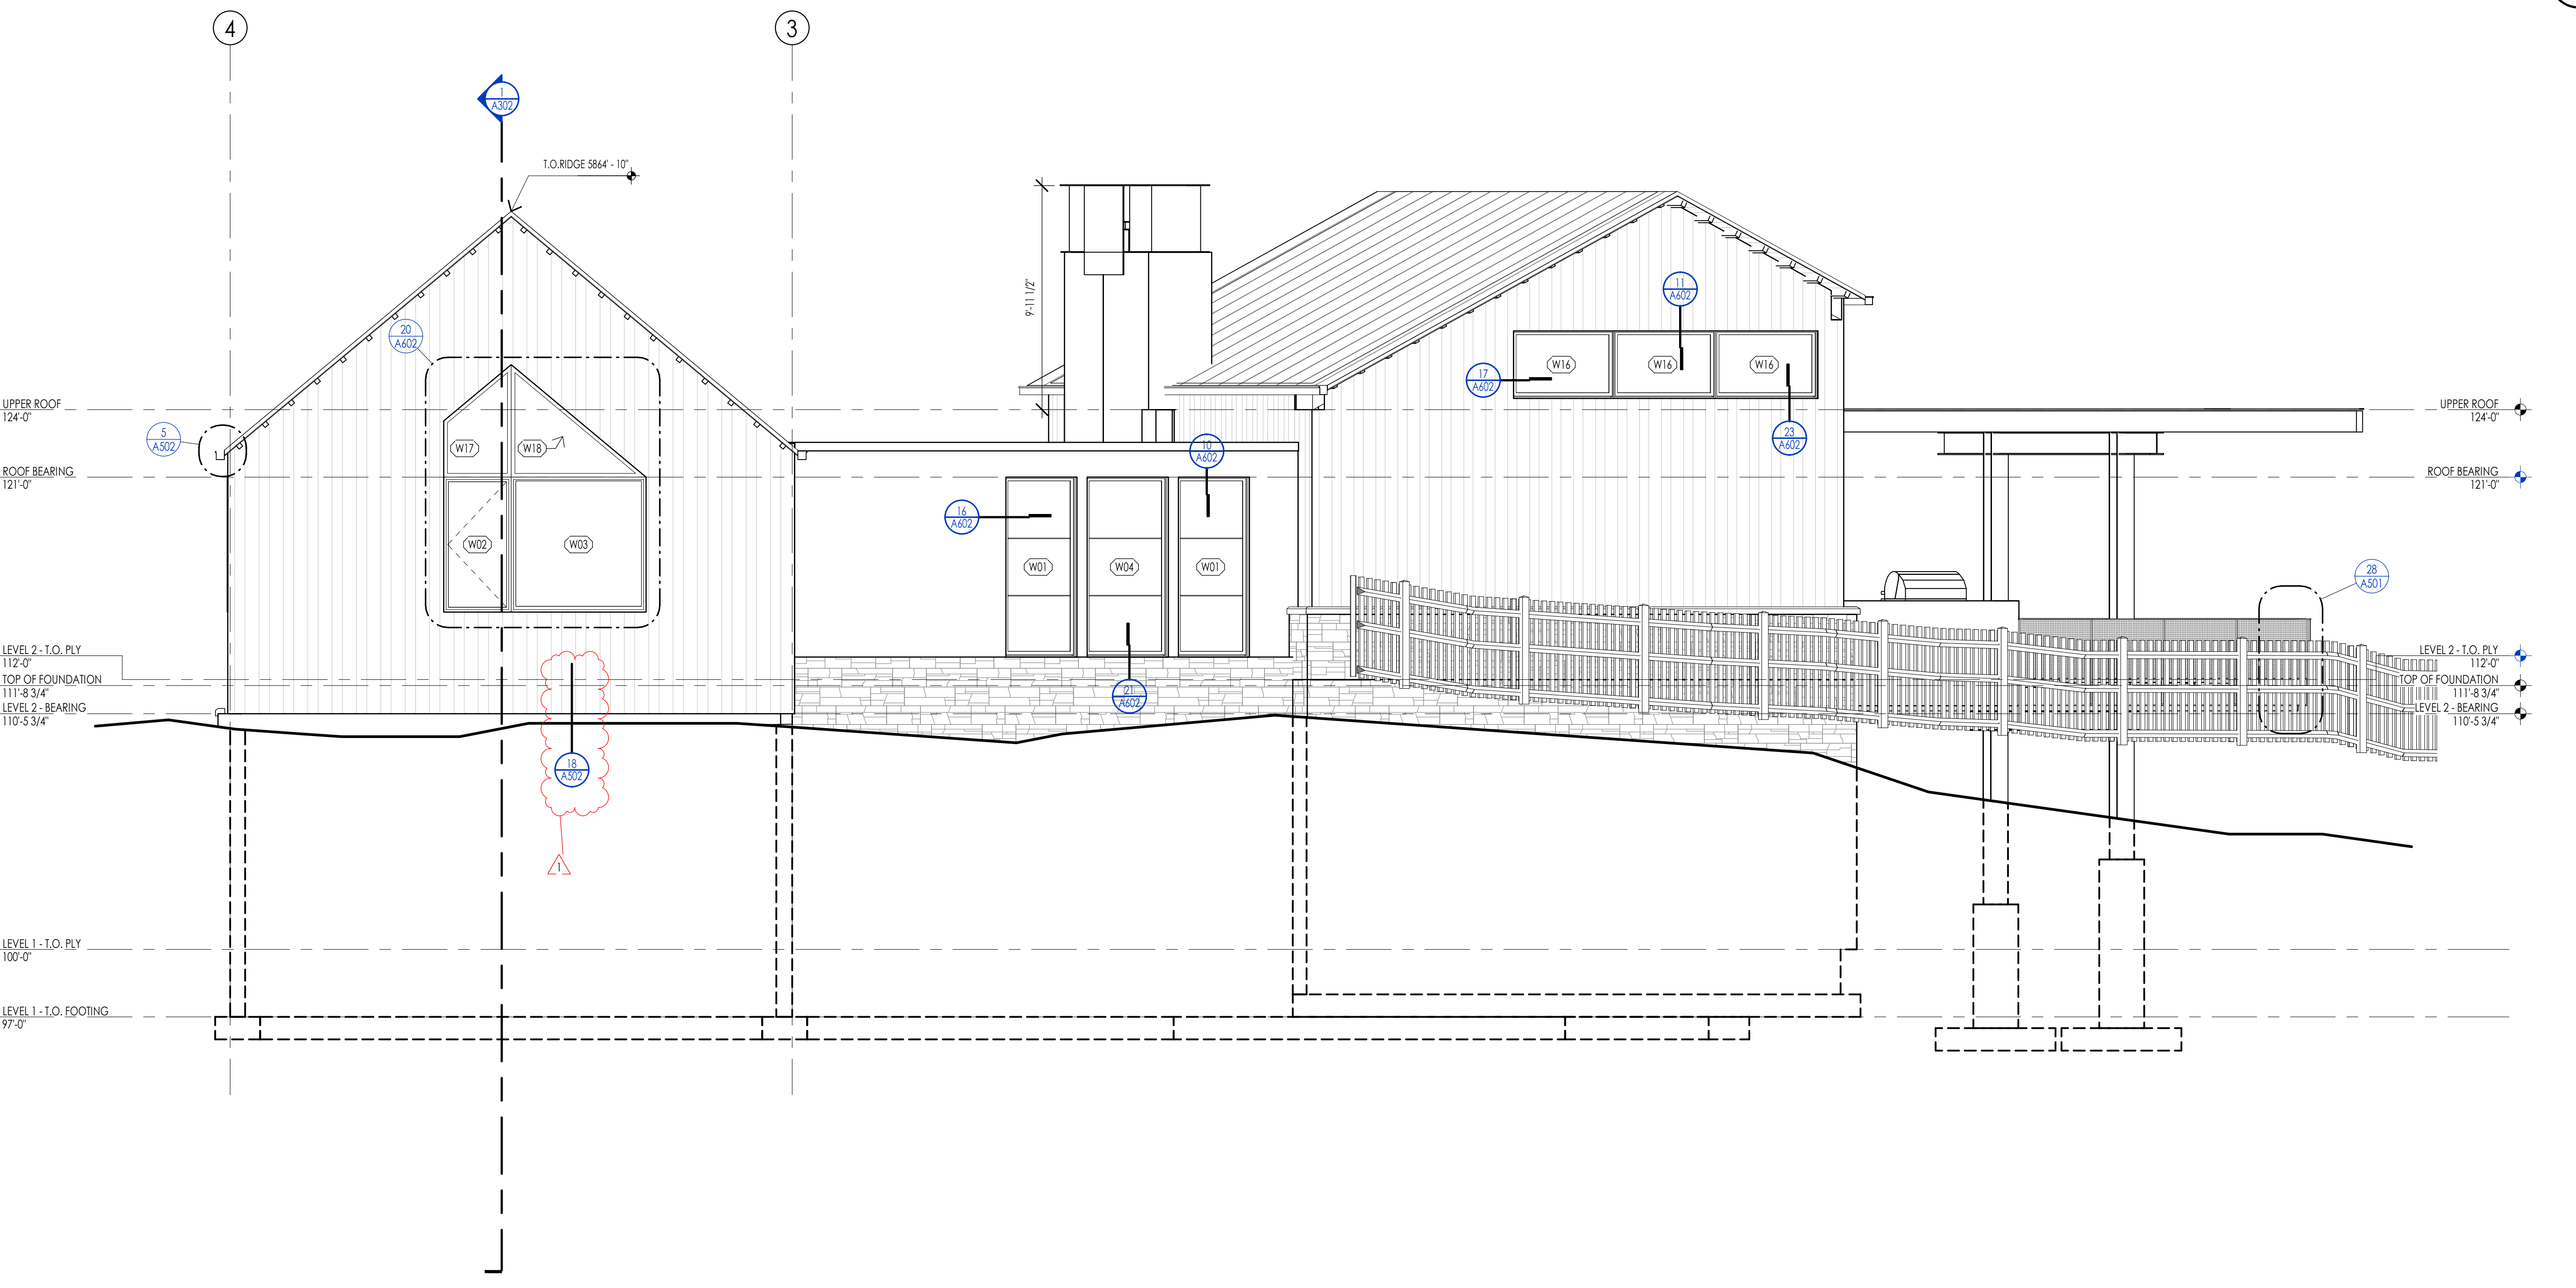

NORTH ELEVATION
1/4" = 1'-0"




Think
Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Sandwich, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkaoc.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated or commercially reproduced in whole or in part without the sole and express written permission from THINK ARCHITECTURE, INC.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

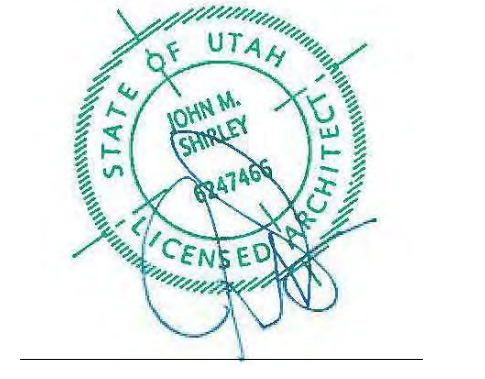


WARM SPRINGS RESIDENCE #35
190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30
REVISIONS:
1 04-27-2023 PER CITY COMMENTS

SHEET TITLE:
EXTERIOR ELEVATIONS

SHEET NUMBER:
A201




© 2021 THINK ARCHITECTURE, INC.

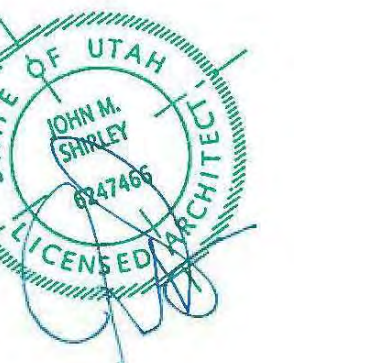


ELEVATION/ SECTION MATERIAL LEGEND	
HATCH PATTERN	DESCRIPTION
	STANDING SEAM ROOFING SYSTEM
	SINGLE PLY ROOFING MEMBRANE SYSTEM
	2X10 CEDAR CHANNEL LAP VERTICAL SIDING SYSTEM WITH SQUARE EDGES
	EXTERIOR STONE VENEER
	EXTERIOR METAL PANEL WALL SYSTEM

NOTE: REFER TO MATERIAL SPECIFICATIONS DOCUMENT FOR DETAILED INFORMATION REGARDING EACH FINISH MATERIAL.

ELEVATION/ SECTION KEYNOTES

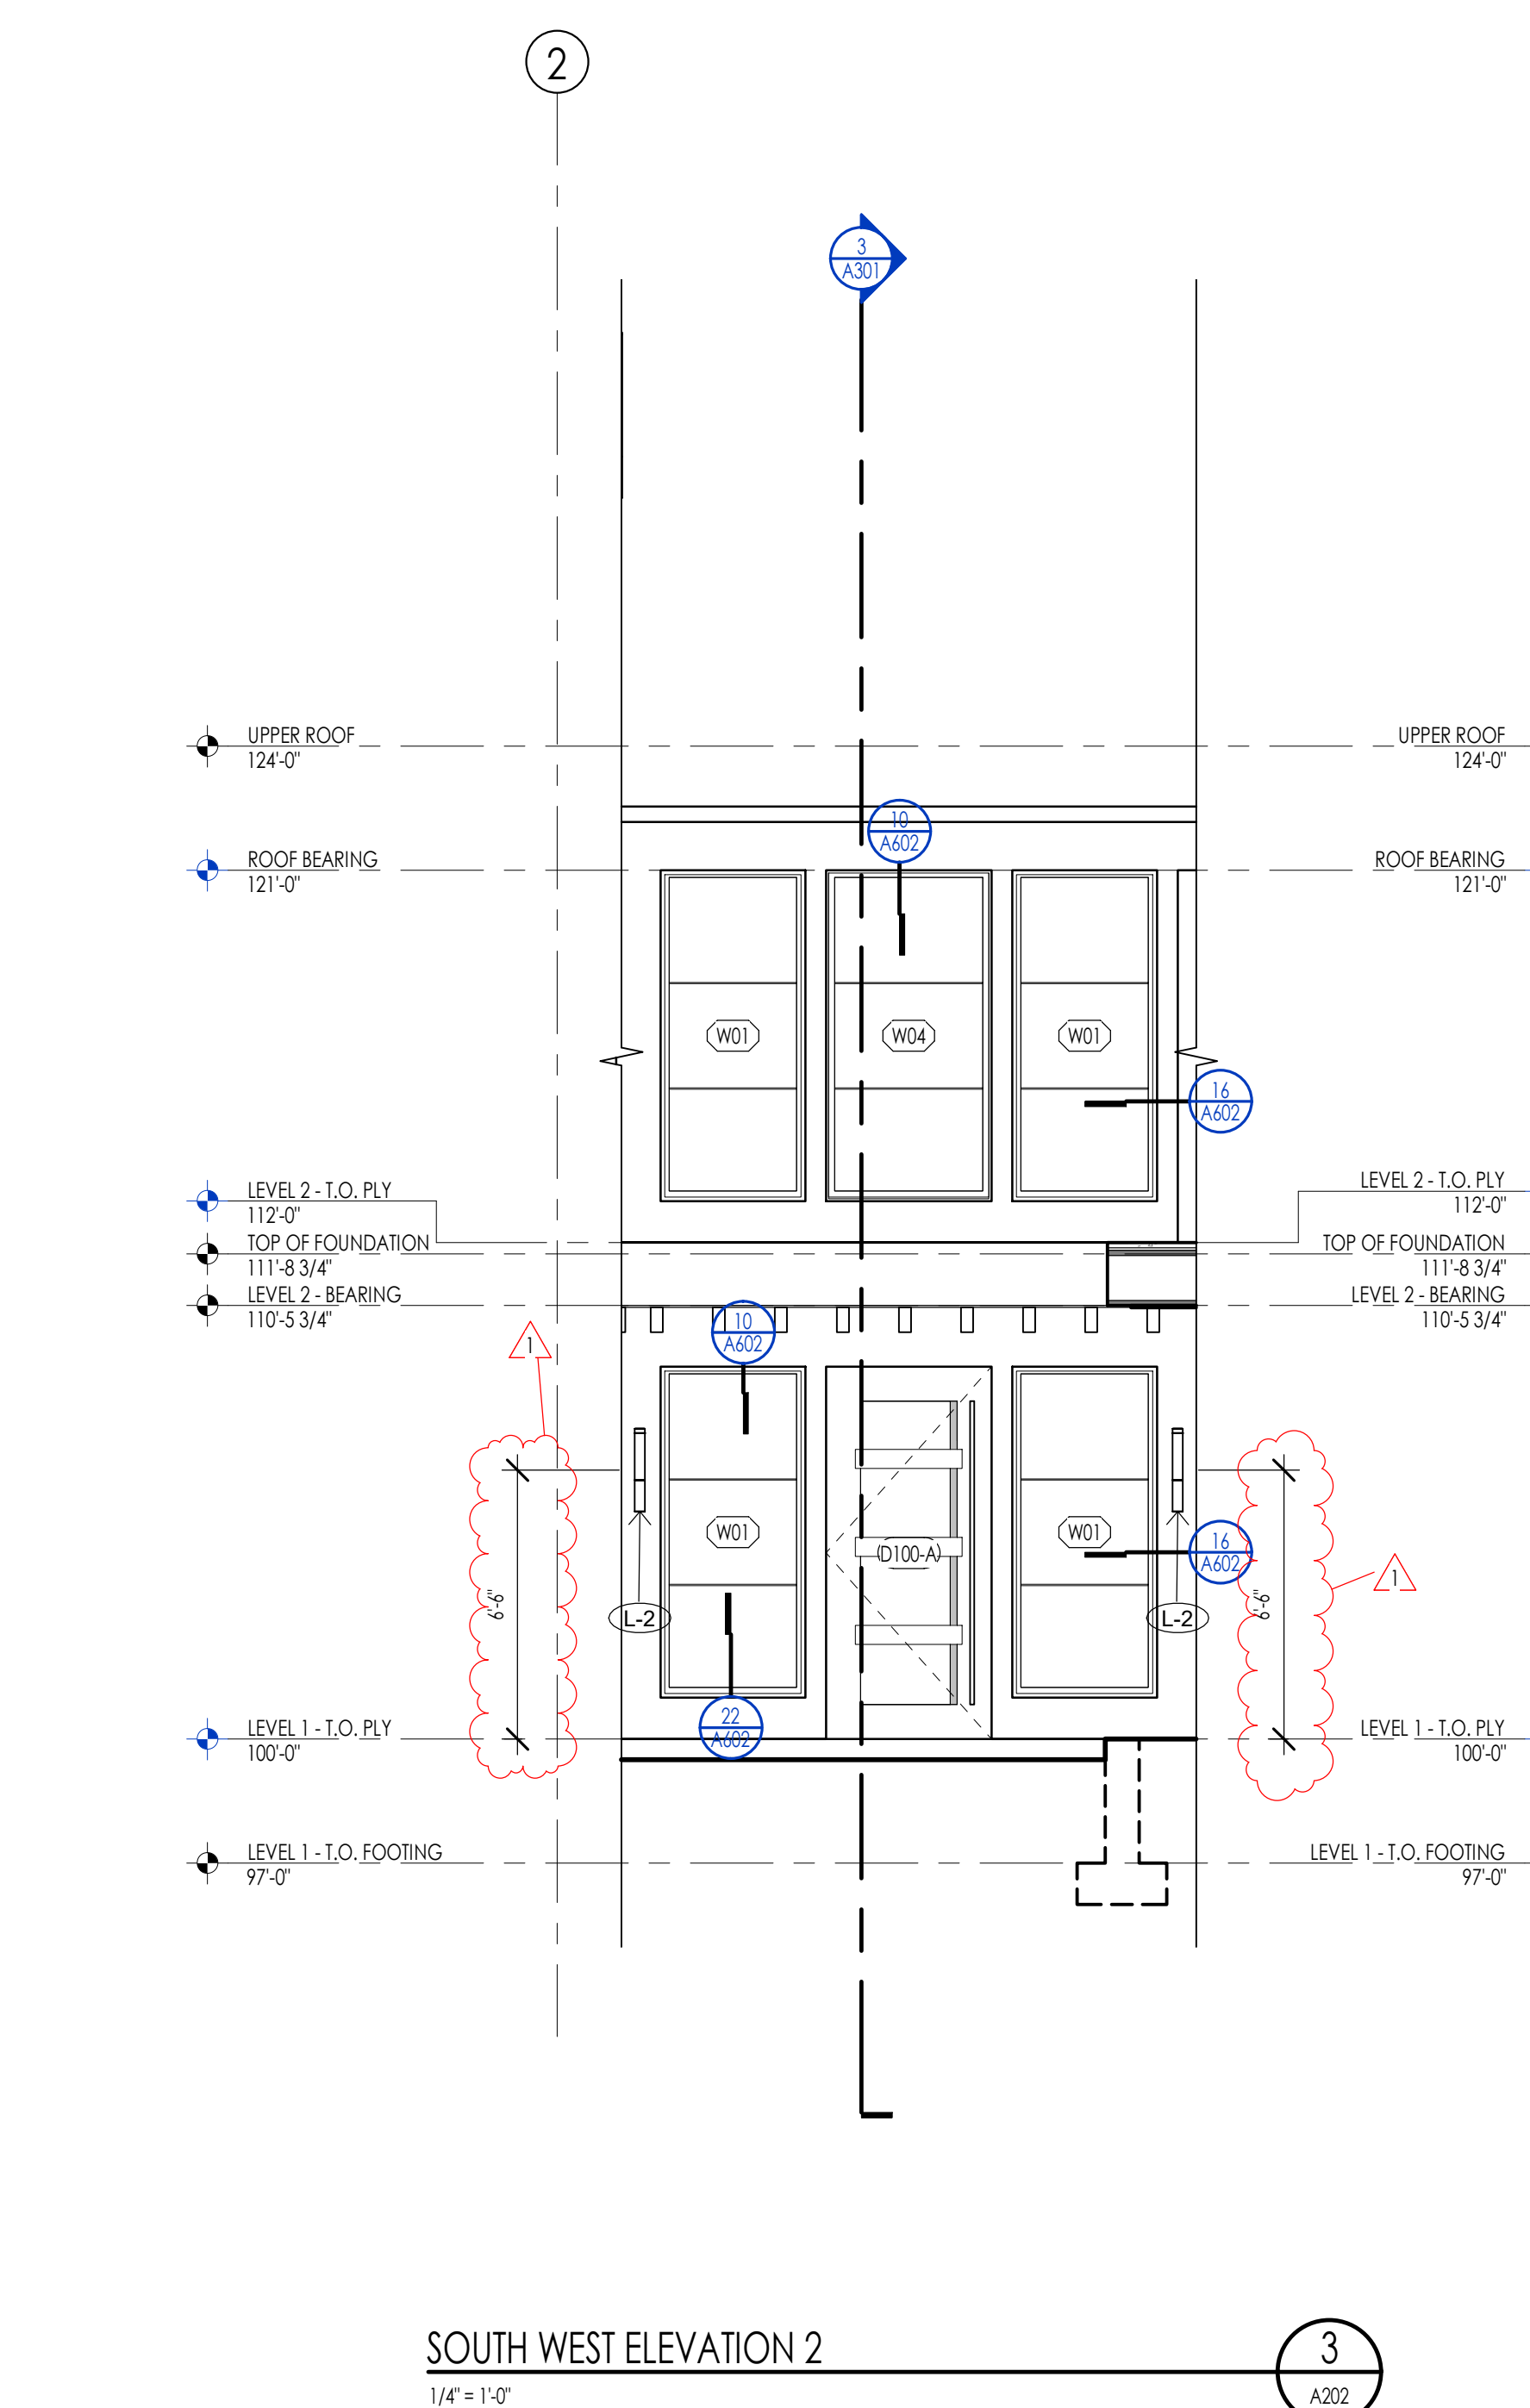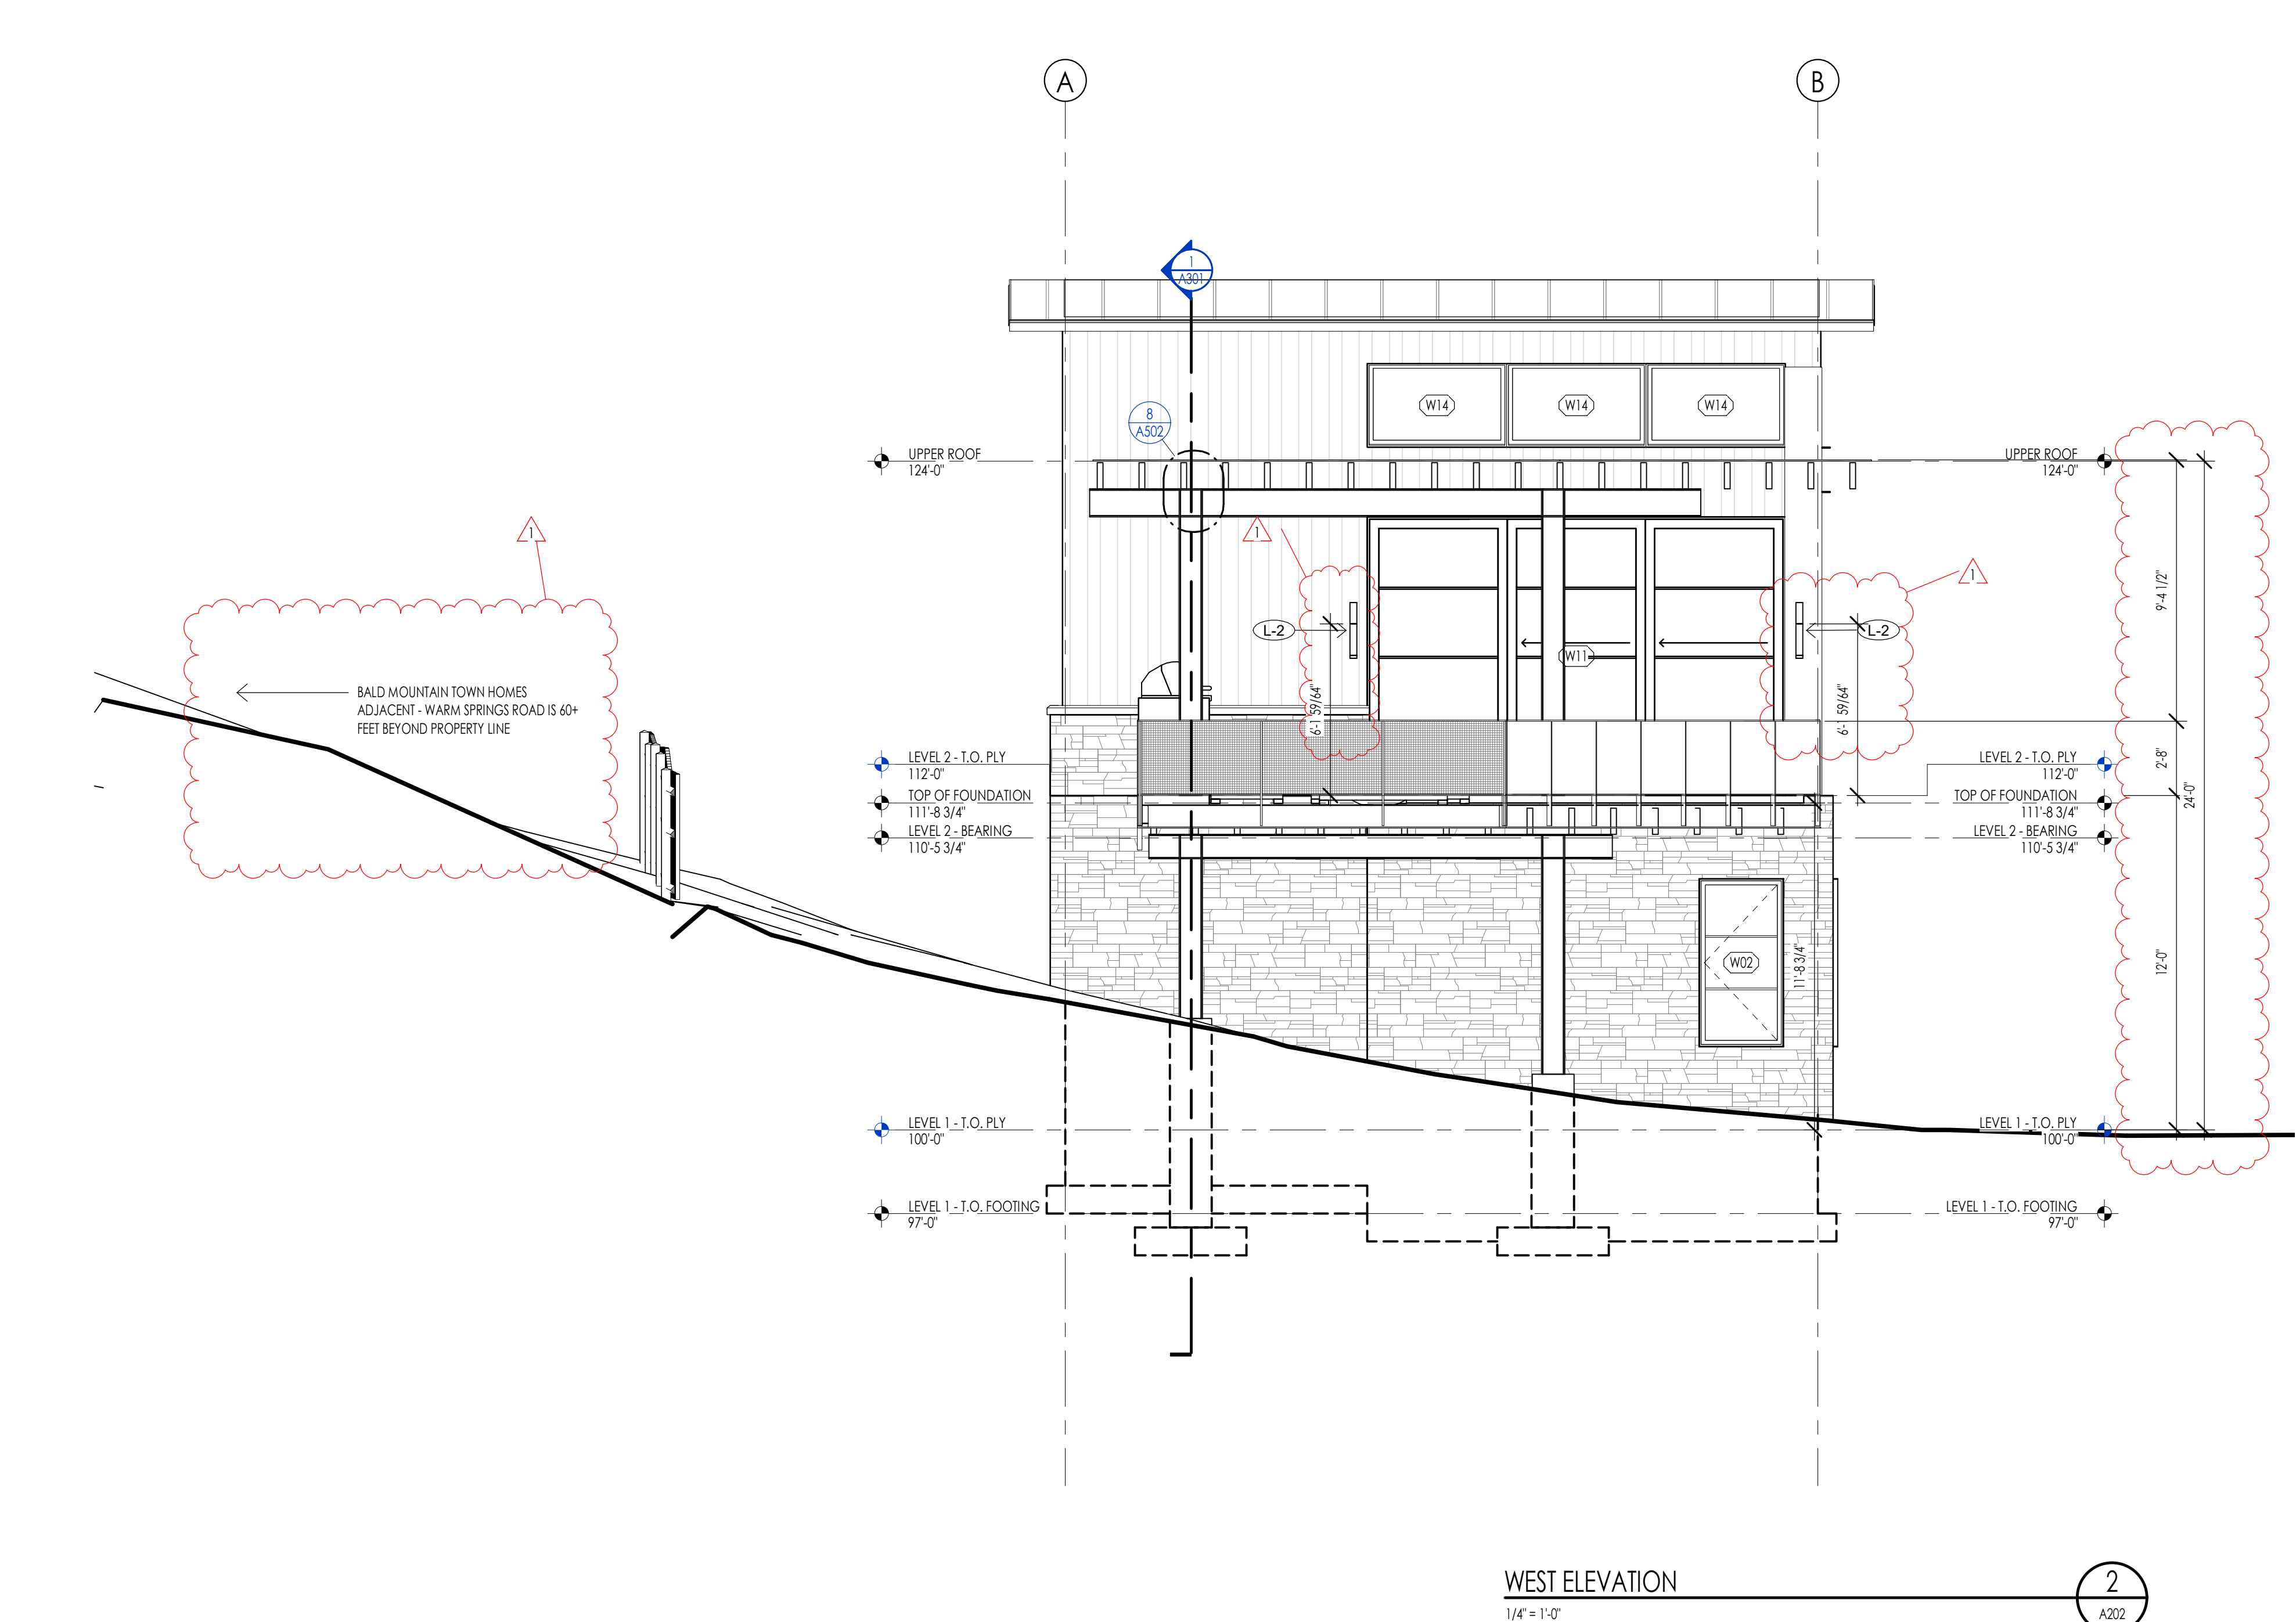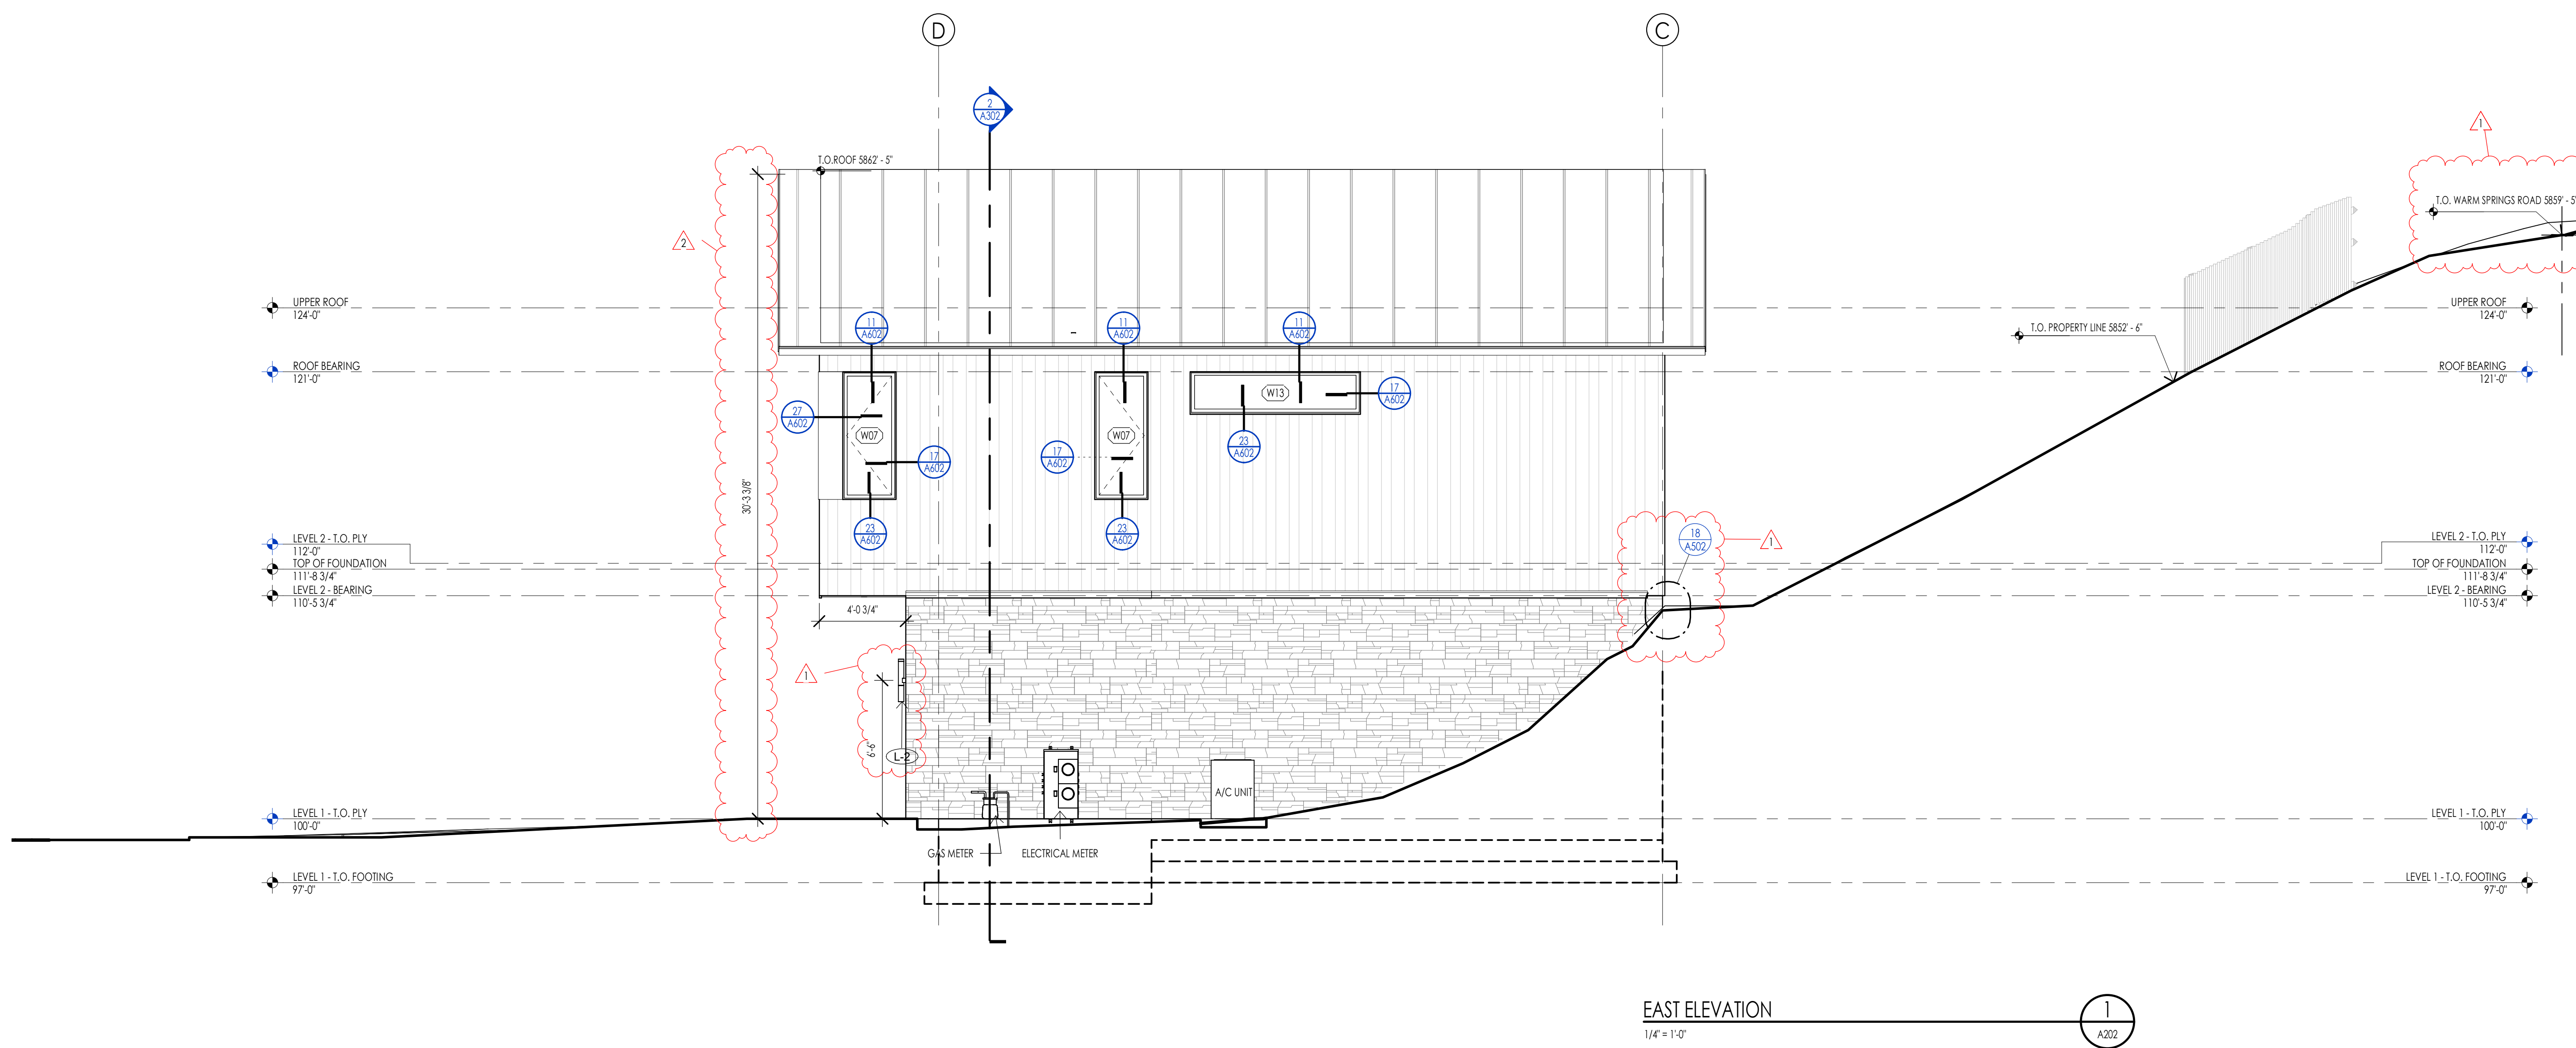


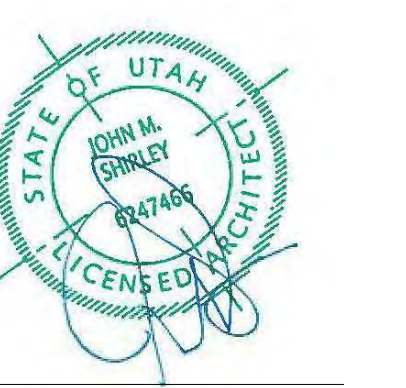


ELEVATION/ SECTION MATERIAL LEGEND	
HATCH PATTERN	DESCRIPTION
	STANDING SEAM ROOFING SYSTEM
	SINGLE PLY ROOFING MEMBRANE SYSTEM
	2X10 CEDAR CHANNEL LAP VERTICAL SIDING SYSTEM WITH SQUARE EDGES
	EXTERIOR STONE VENEER
	EXTERIOR METAL PANEL WALL SYSTEM

NOTE: REFER TO MATERIAL SPECIFICATIONS DOCUMENT FOR DETAILED INFORMATION REGARDING EACH FINISH MATERIAL.


ELEVATION/ SECTION KEYNOTES

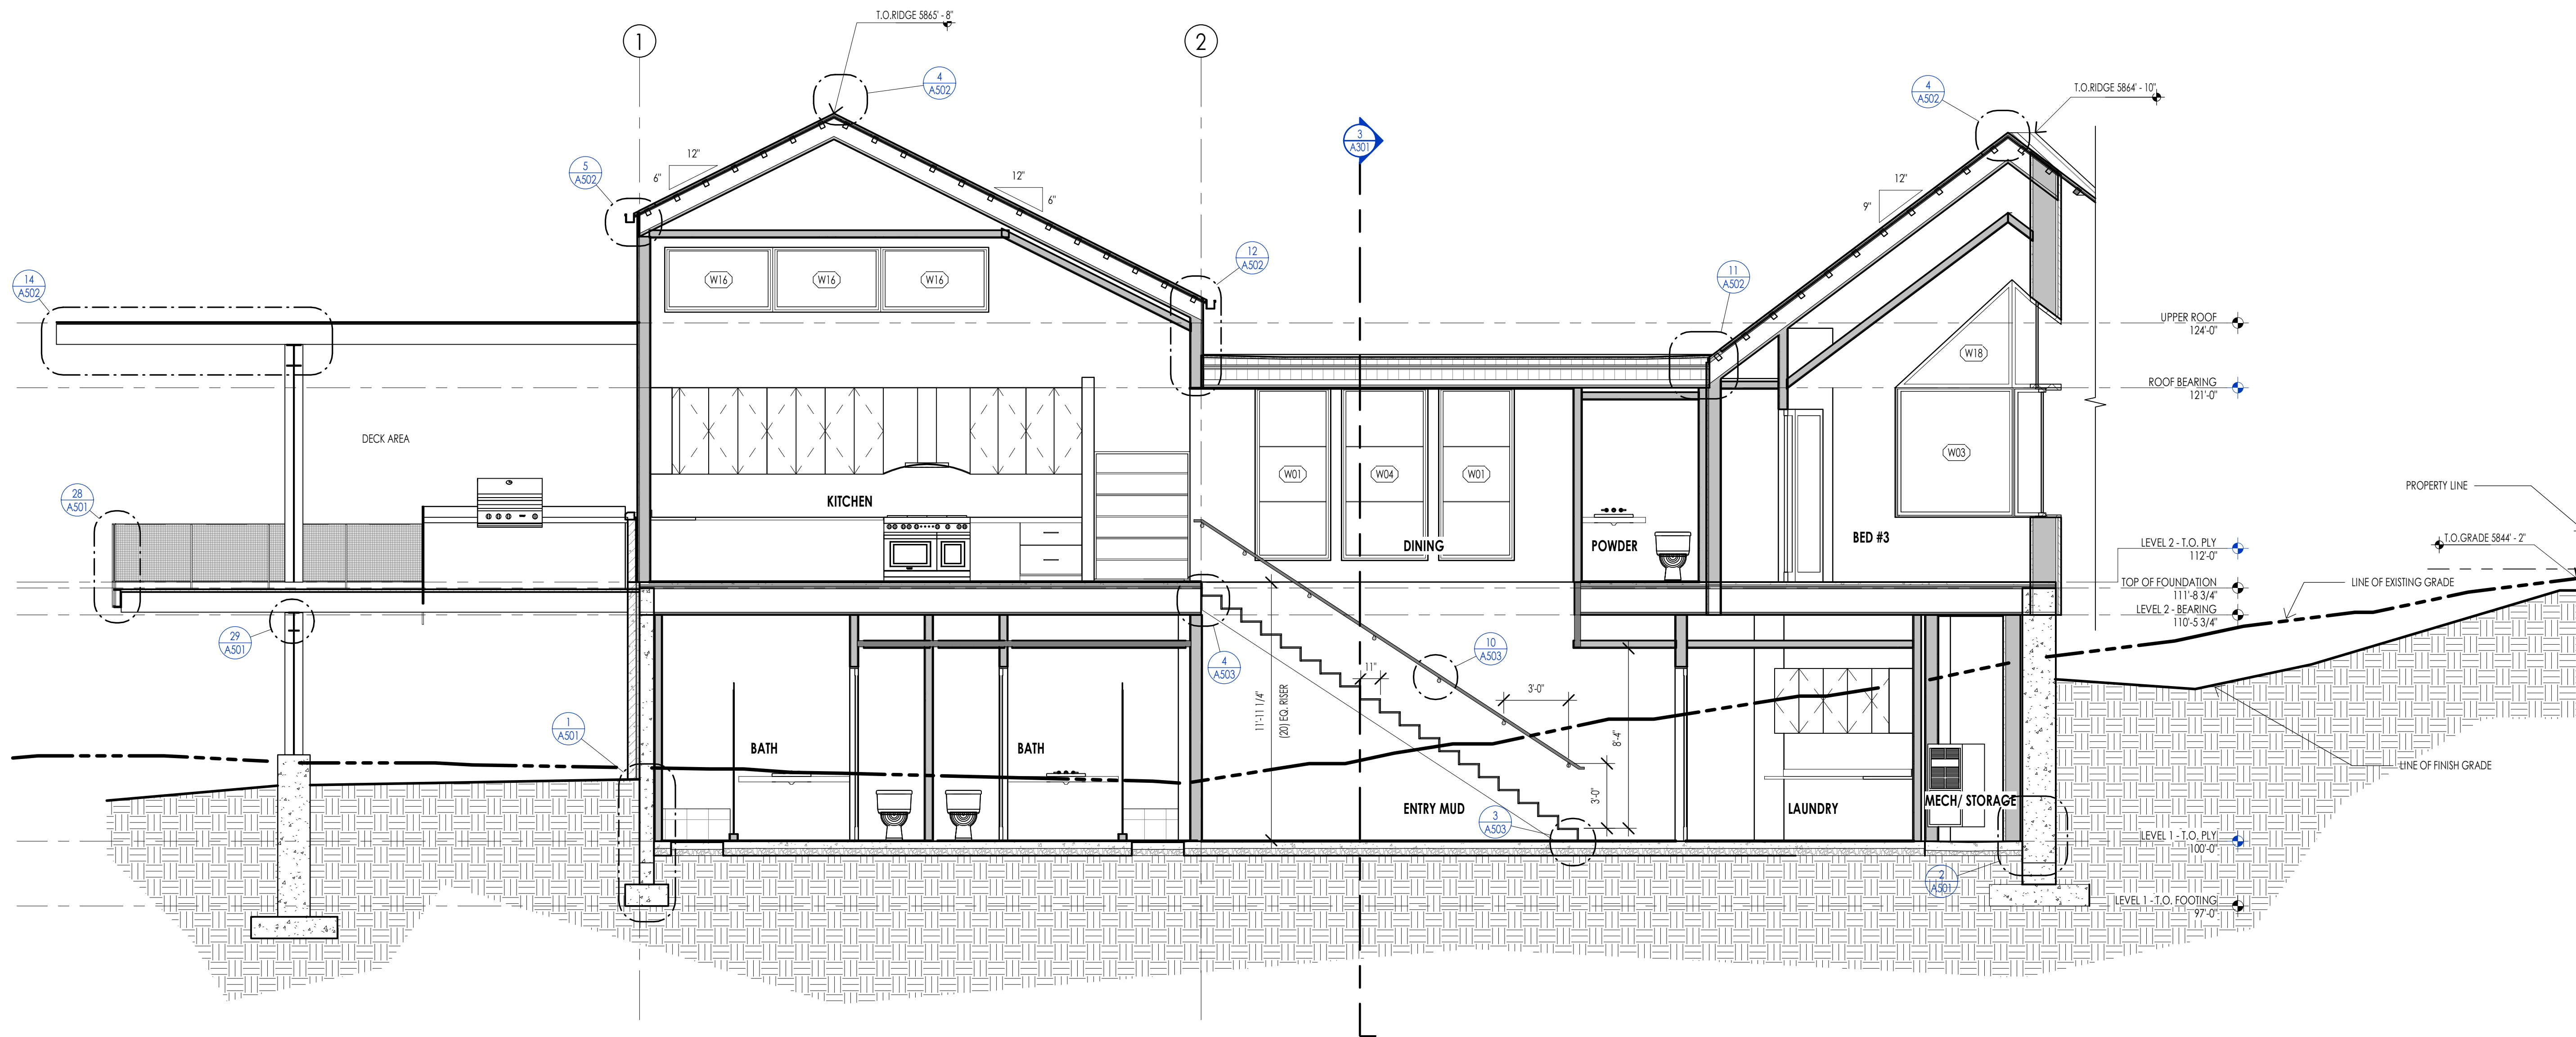

Section 1
1/4" = 1'-0" (A301)

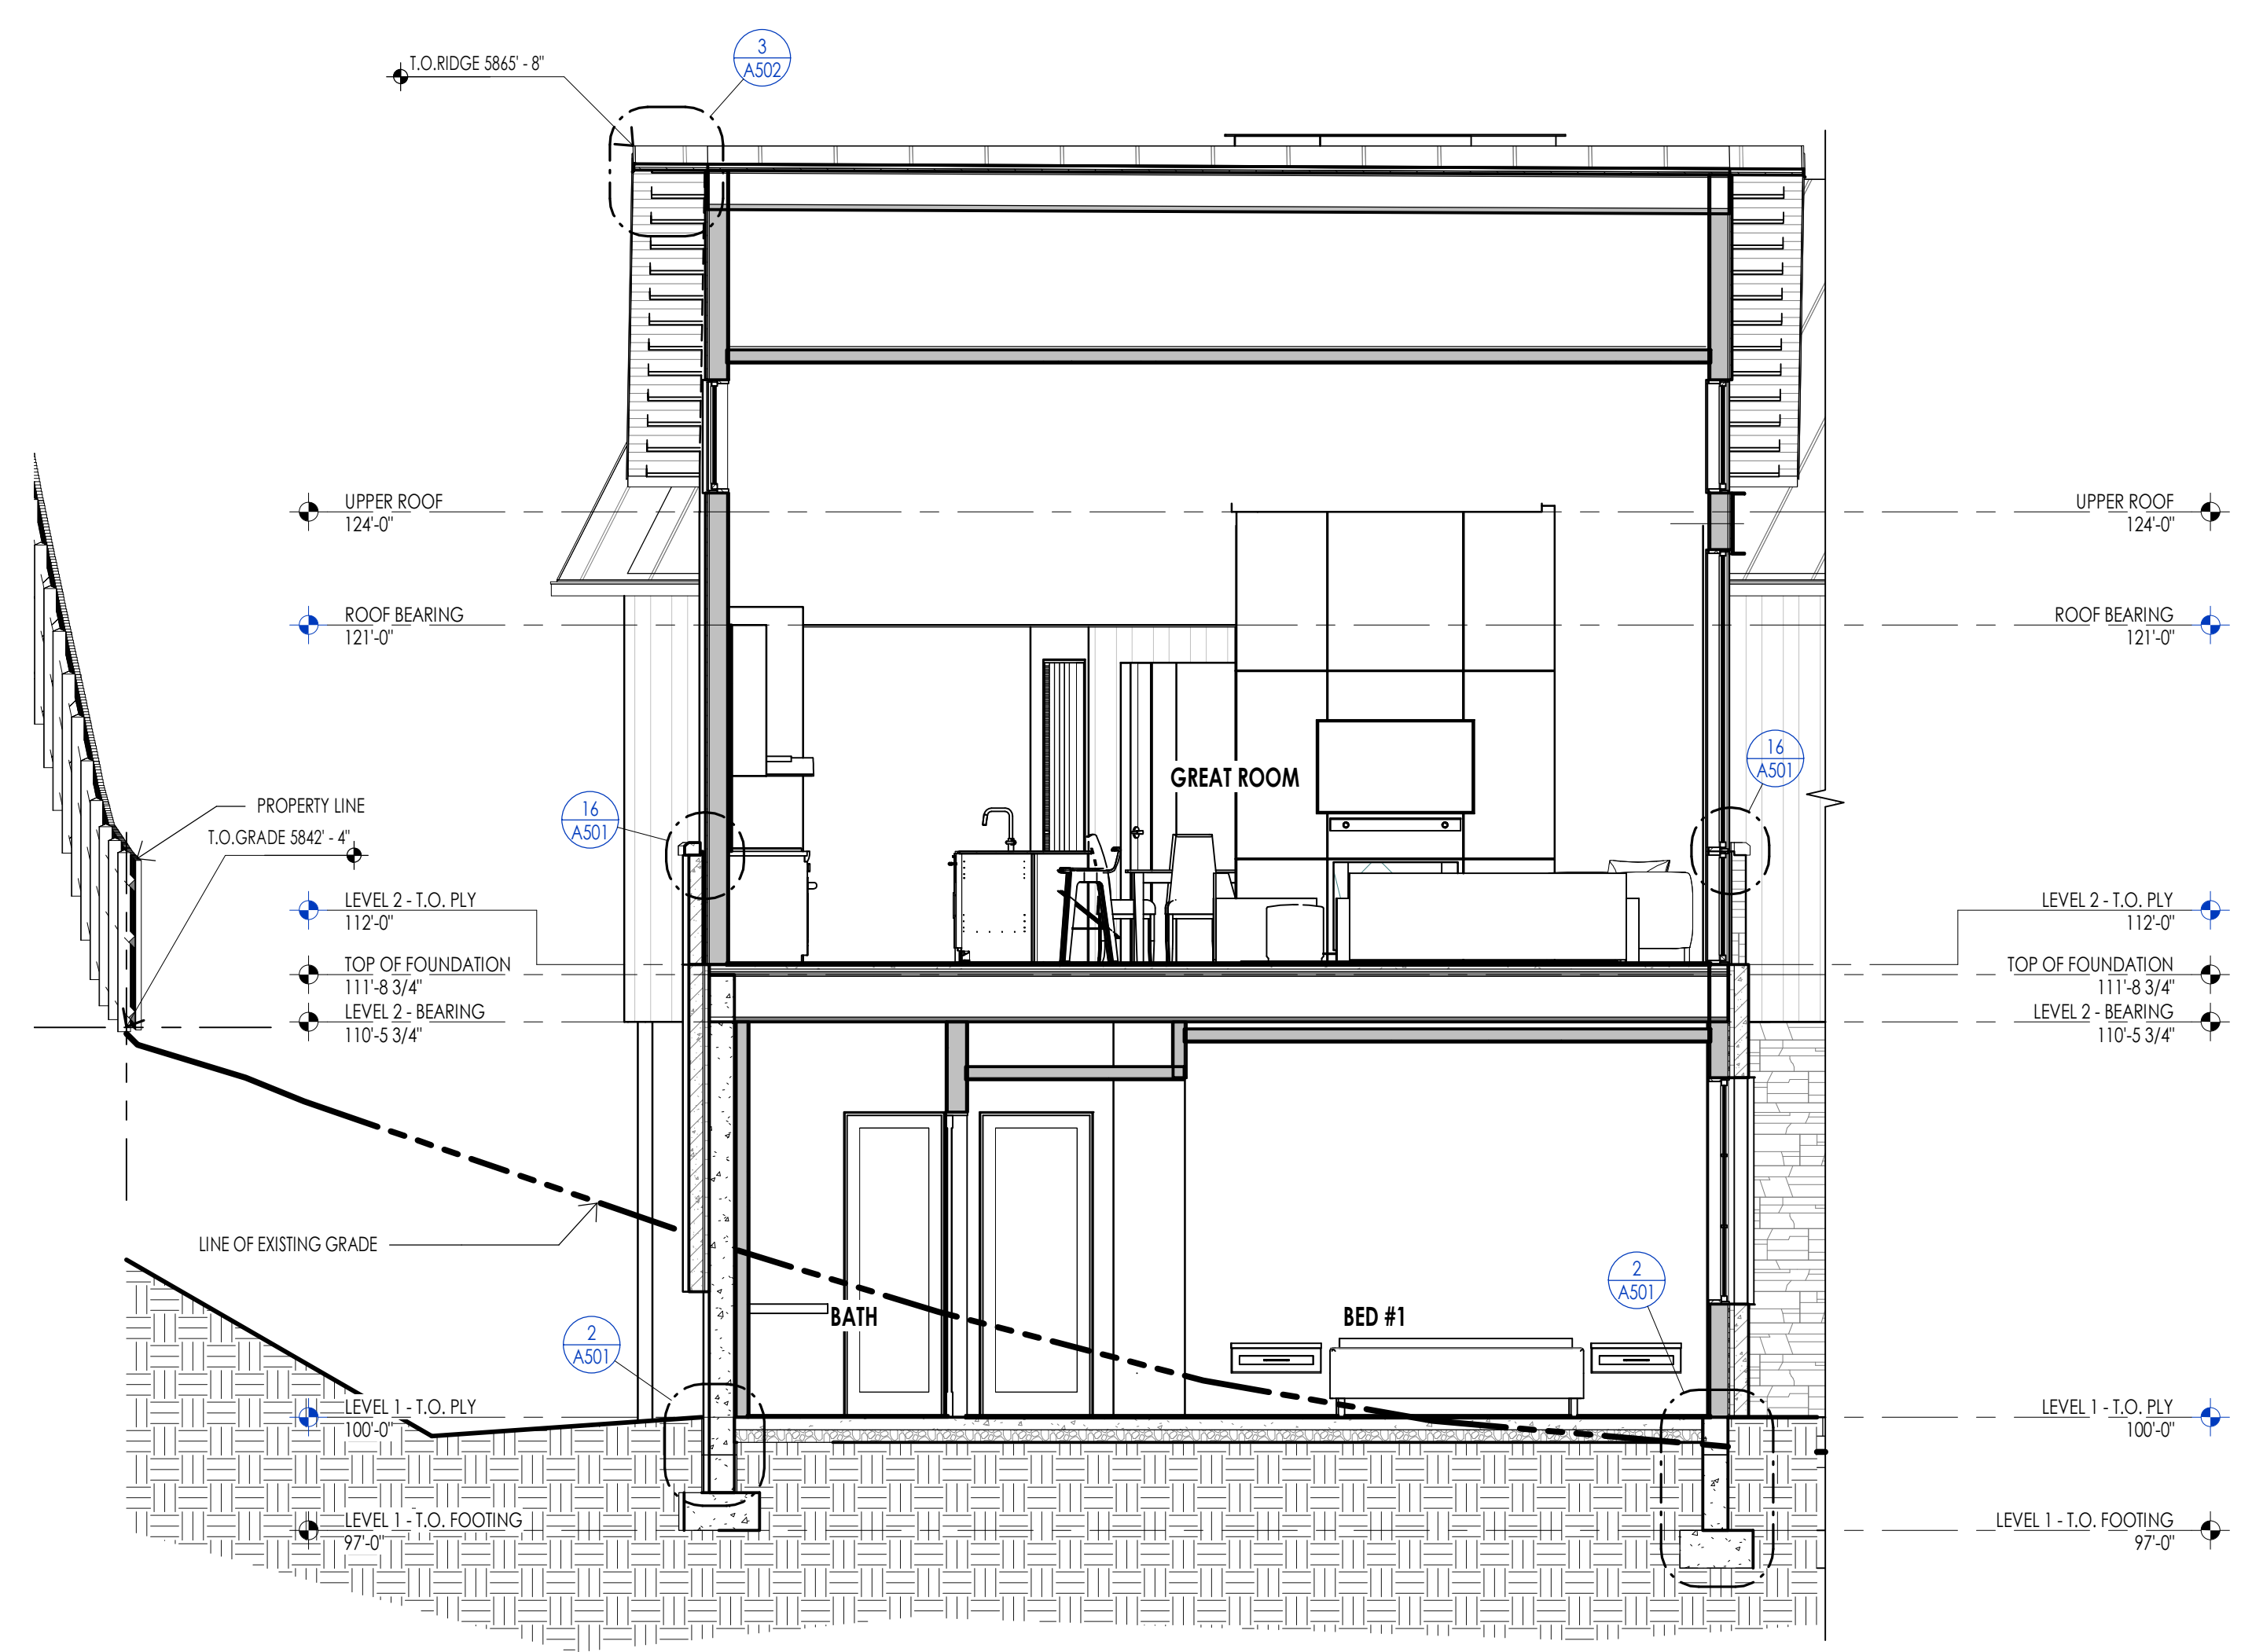

Section 2
1/4" = 1'-0" (A301)

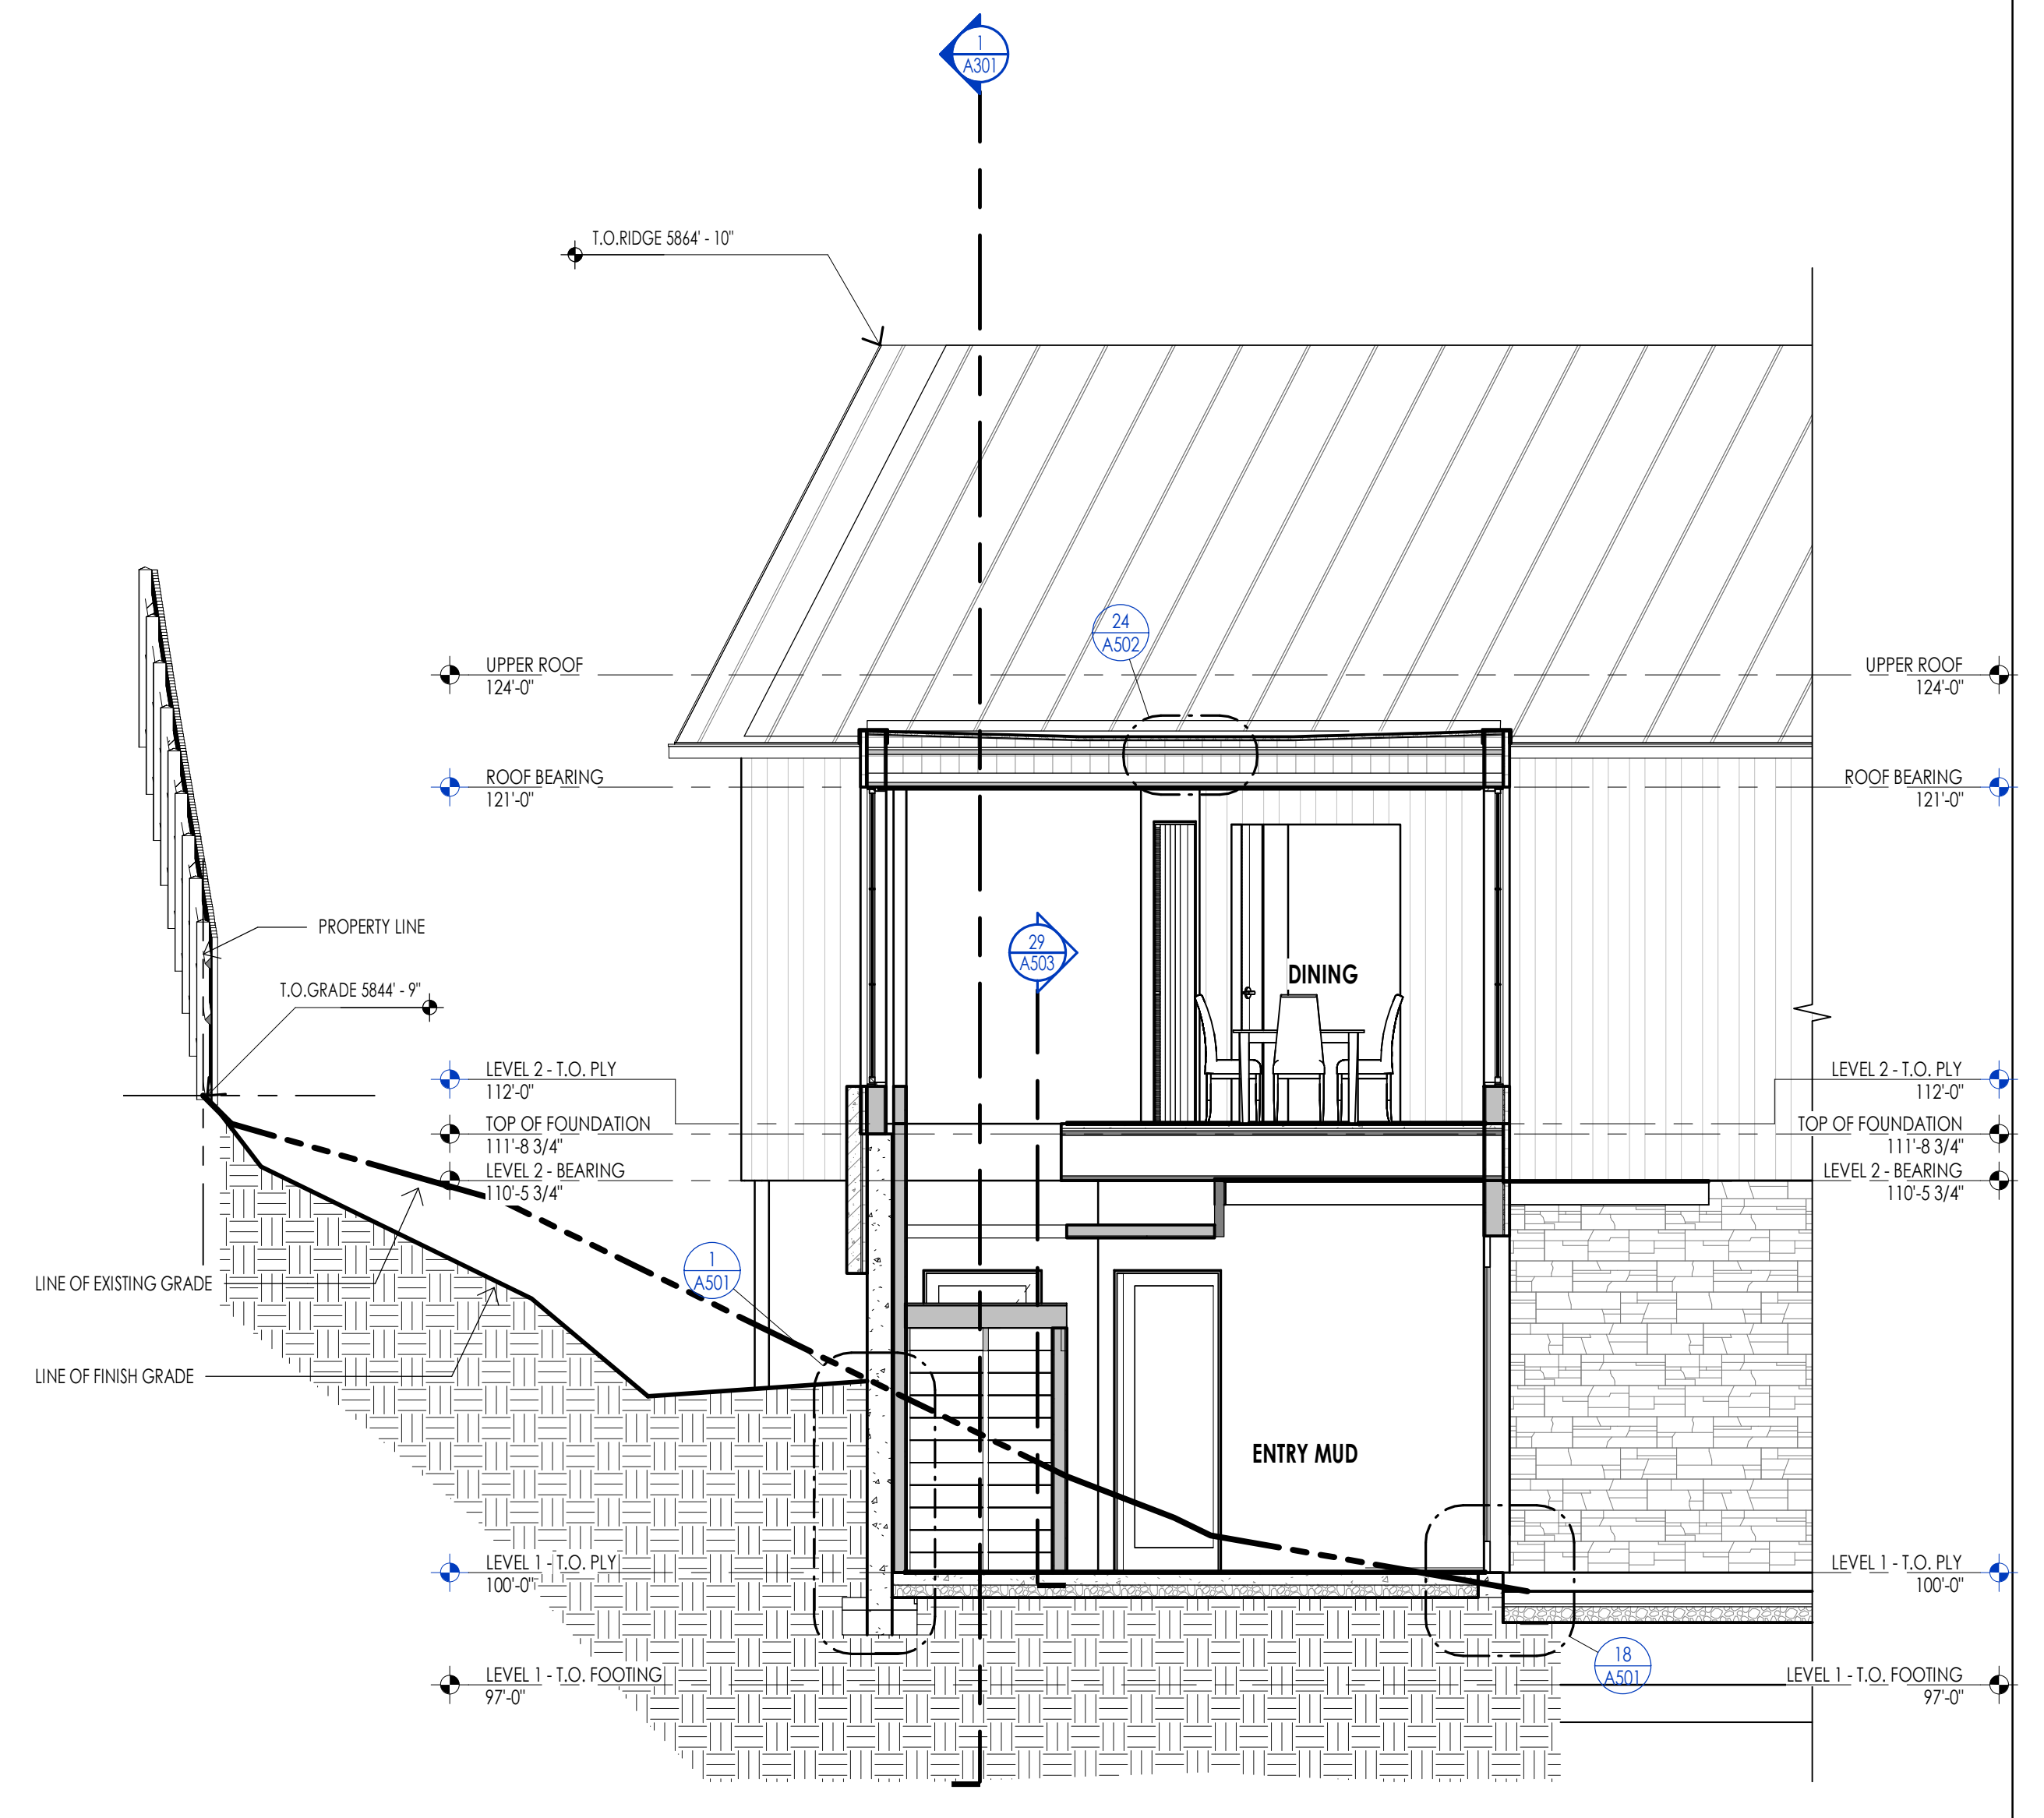

Section 3
1/4" = 1'-0" (A301)

WARM SPRINGS RESIDENCE #35


190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30
REVISIONS:
1 04-27-2023 PER CITY COMMENTS

SHEET TITLE:
BUILDING SECTIONS


SHEET NUMBER:
A301

© 2021 THINK ARCHITECTURE, INC.

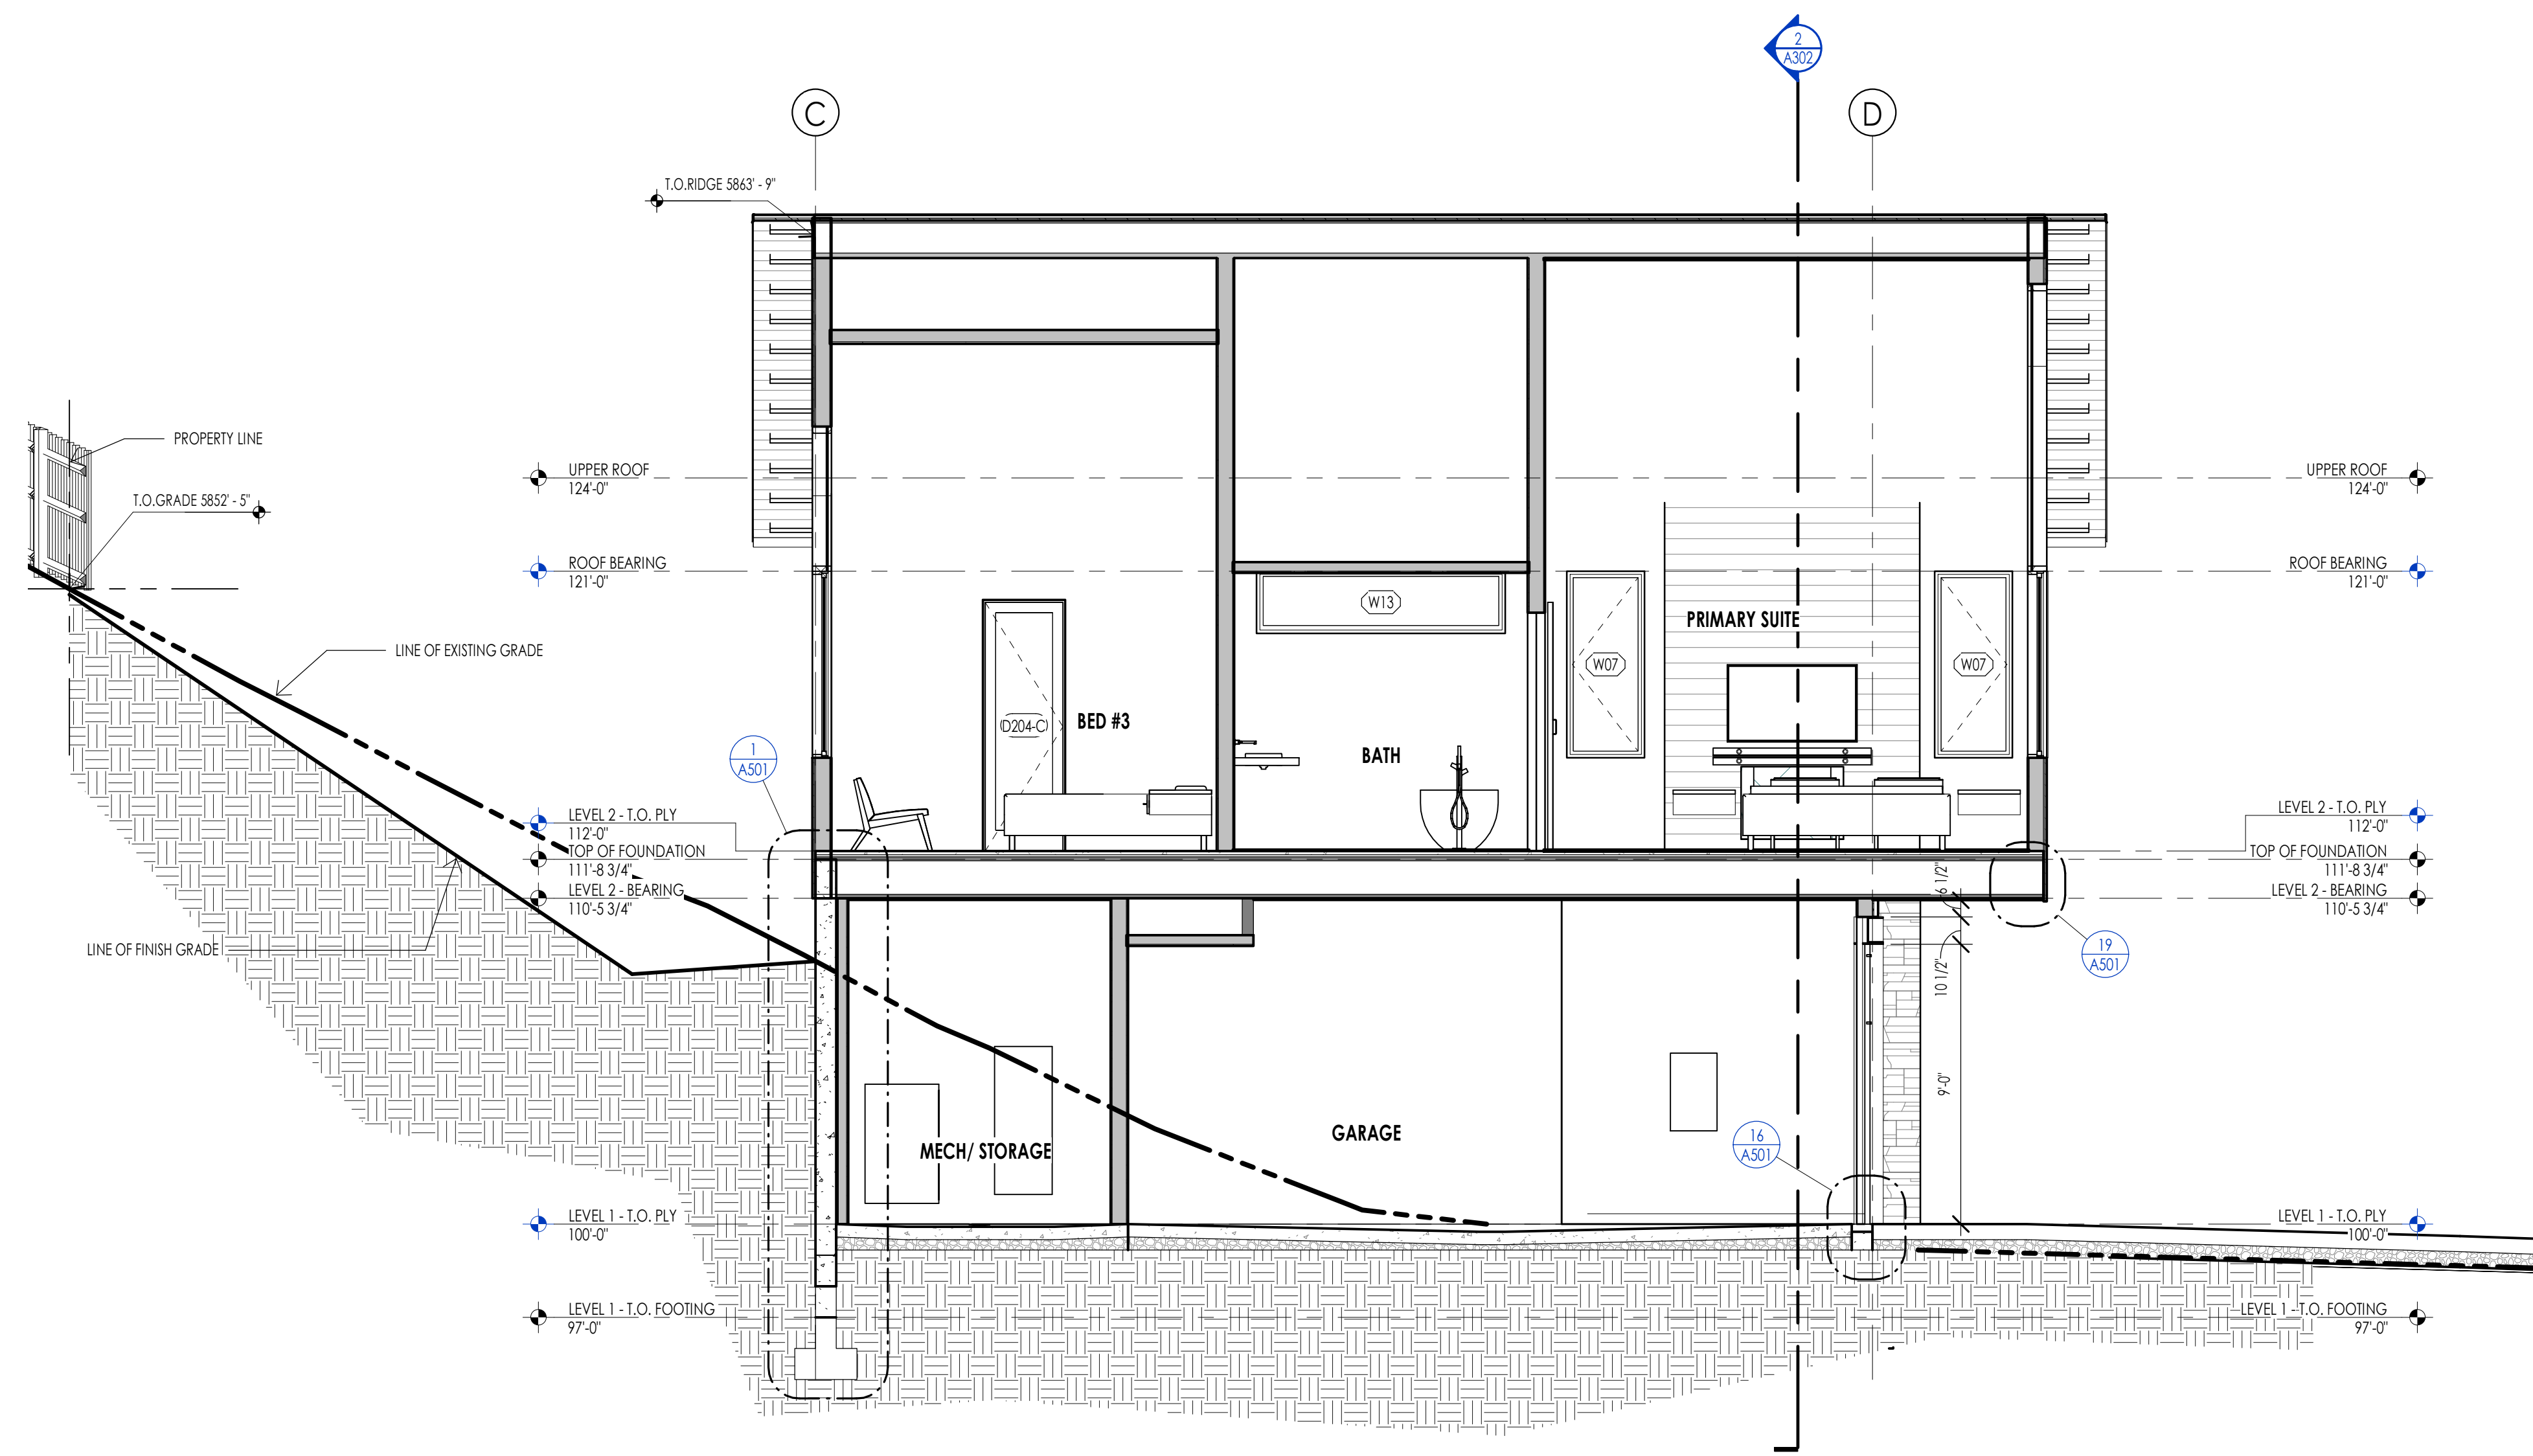

Section 4
1/4" = 1'-0"

1
A302

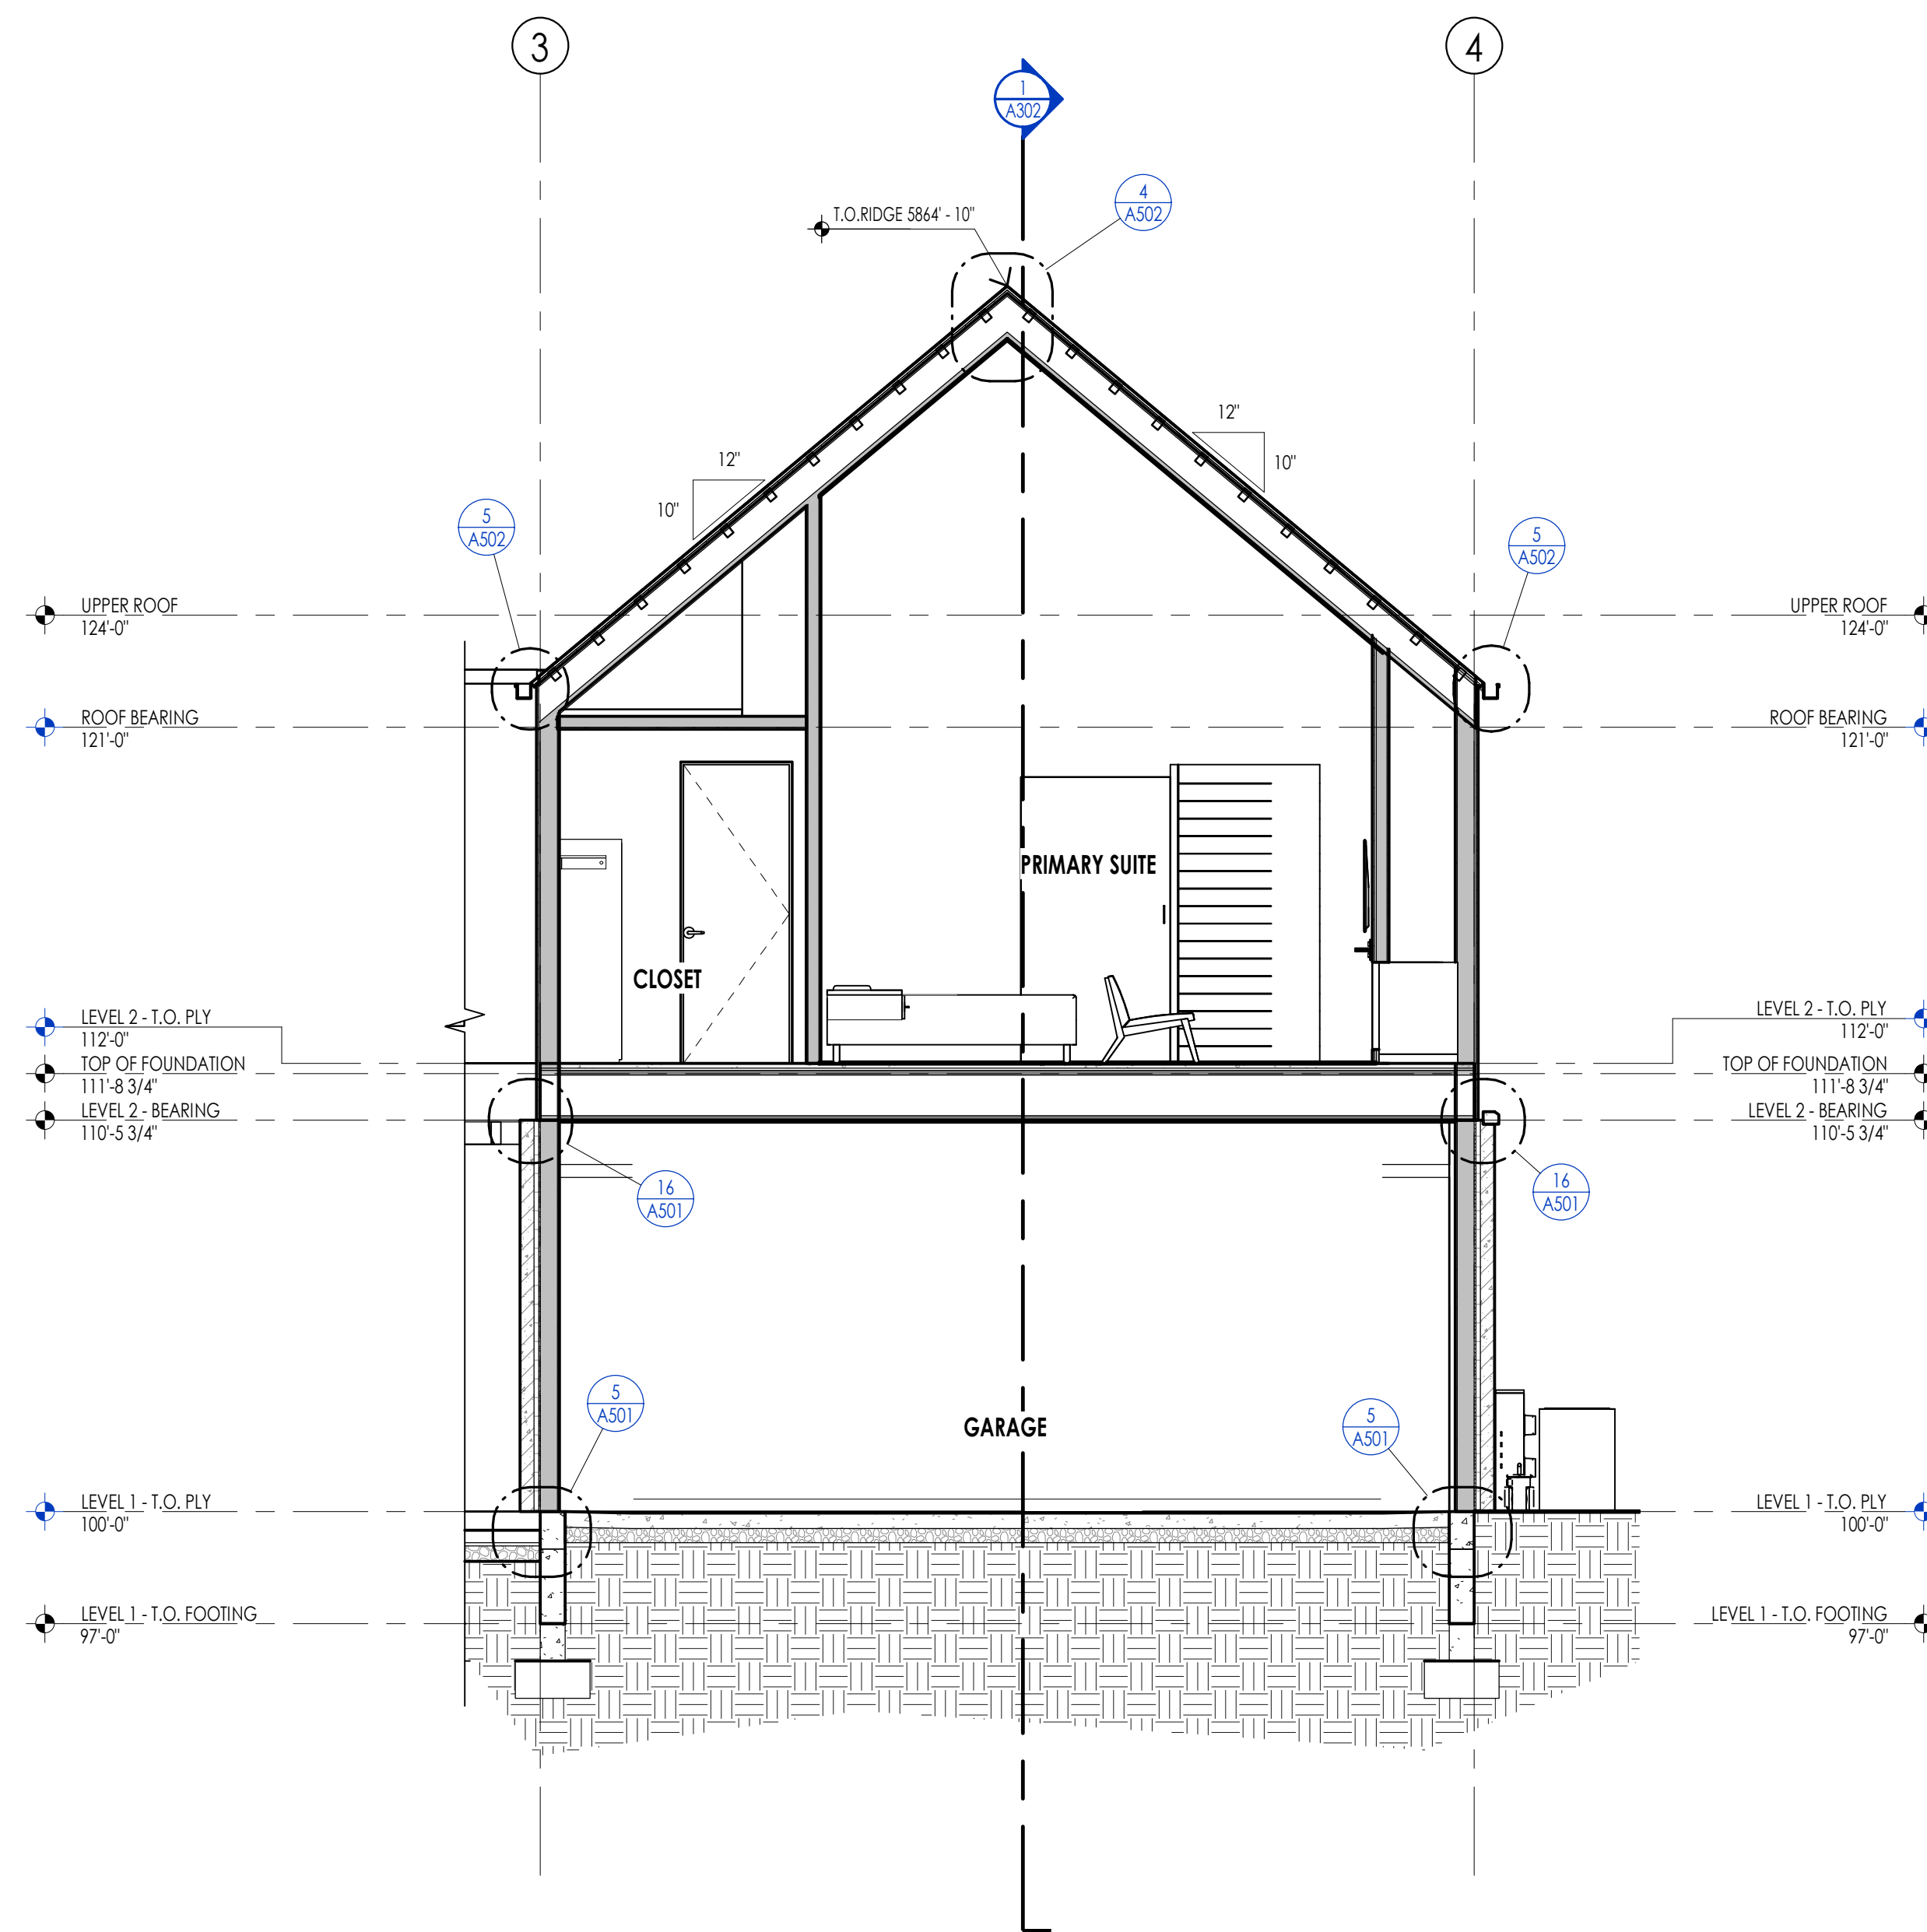

Section 5
1/4" = 1'-0"

2
A302

ELEVATION/ SECTION MATERIAL LEGEND	
HATCH PATTERN	DESCRIPTION
	STANDING SEAM ROOFING SYSTEM
	SINGLE PLY ROOFING MEMBRANE SYSTEM
	2X10 CEDAR CHANNEL LAP VERTICAL SIDING SYSTEM WITH SQUARE EDGES
	EXTERIOR STONE VENEER
	EXTERIOR METAL PANEL WALL SYSTEM

NOTE: REFER TO MATERIAL SPECIFICATIONS DOCUMENT FOR DETAILED INFORMATION REGARDING EACH FINISH MATERIAL.

ELEVATION/ SECTION KEYNOTES

PERMIT SET

BUILDING SECTIONS

SHEET NUMBER:
A302

PROJECT NO. 22023
DATE: 2023.06.30

REVISIONS:
1 04-27-2023 PER CITY COMMENTS




Think
Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management


7927 So. Highpoint Parkway, Suite 300
Scary, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkarc.com

The designs shown and described herein including all technical drawings, graphic representations & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced in whole or in part without the sole and express written permission from THINK Architecture, Inc.


These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

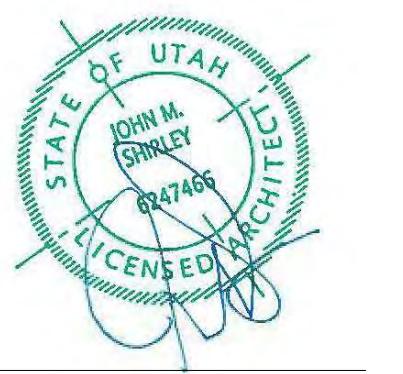



WARM SPRINGS RESIDENCE #35
190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

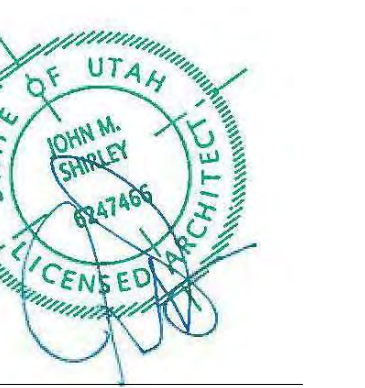


GREAT ROOM INTERIOR VIEW

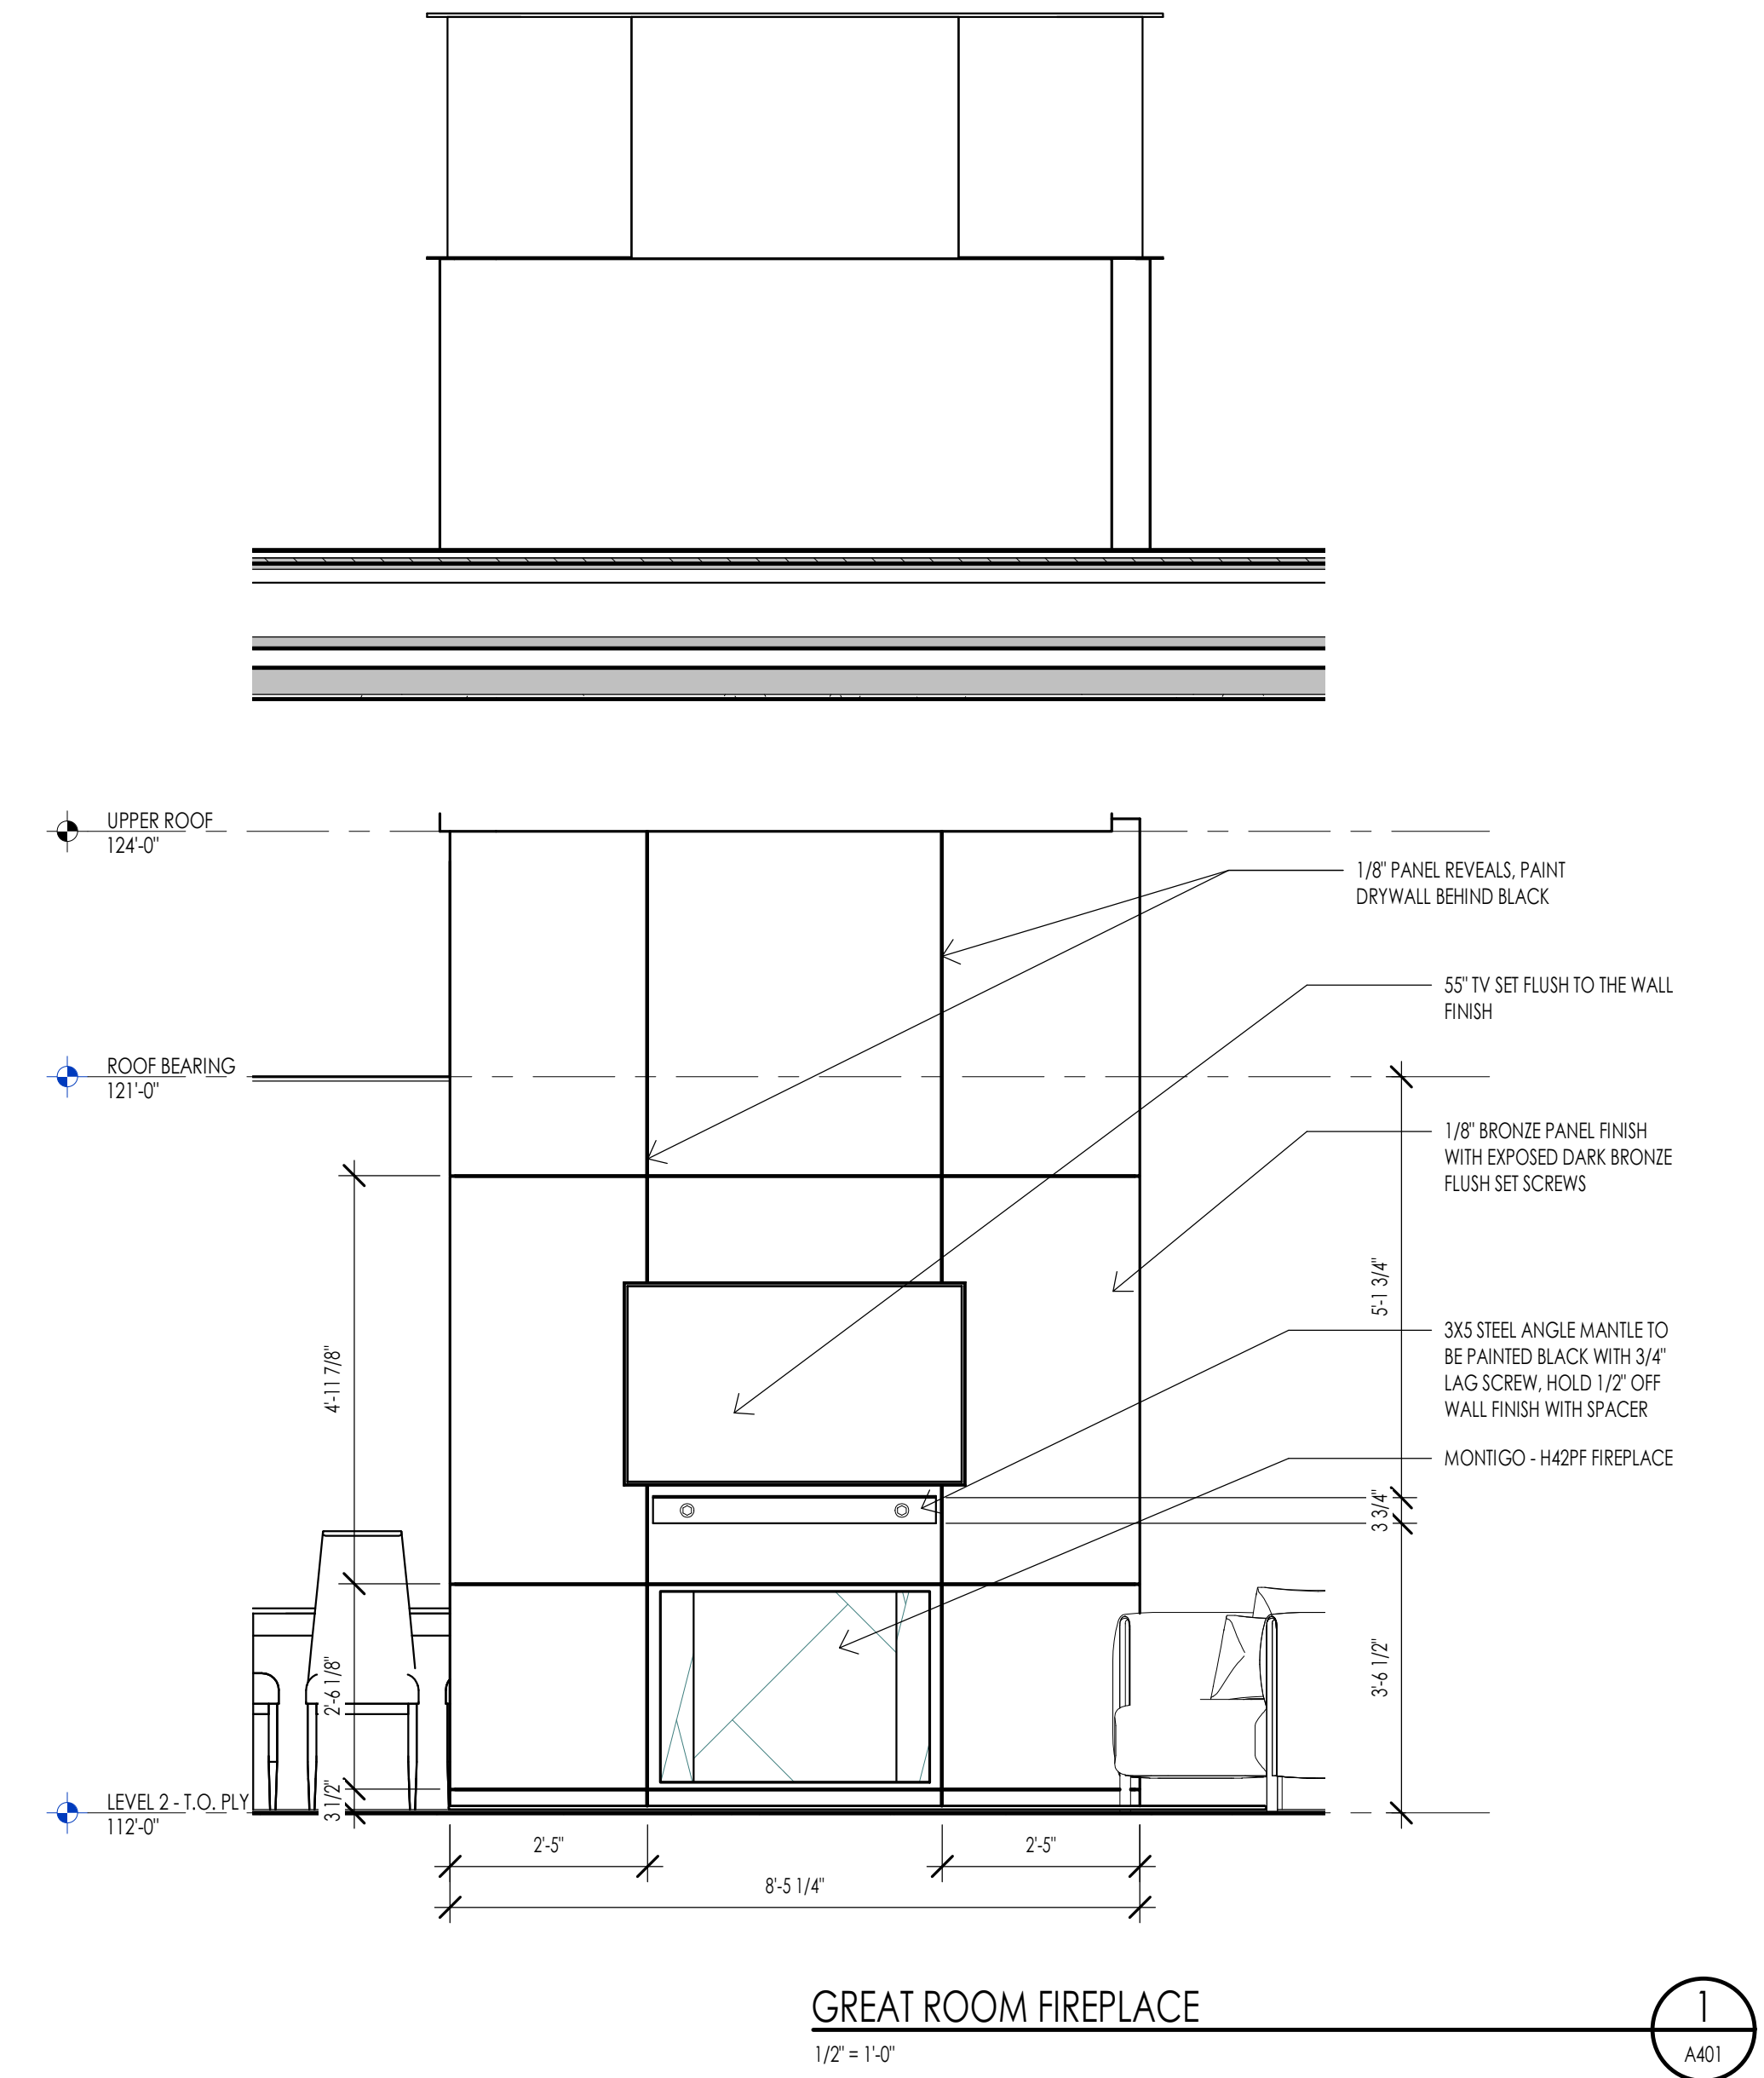

OUTDOOR LIVING VIEW

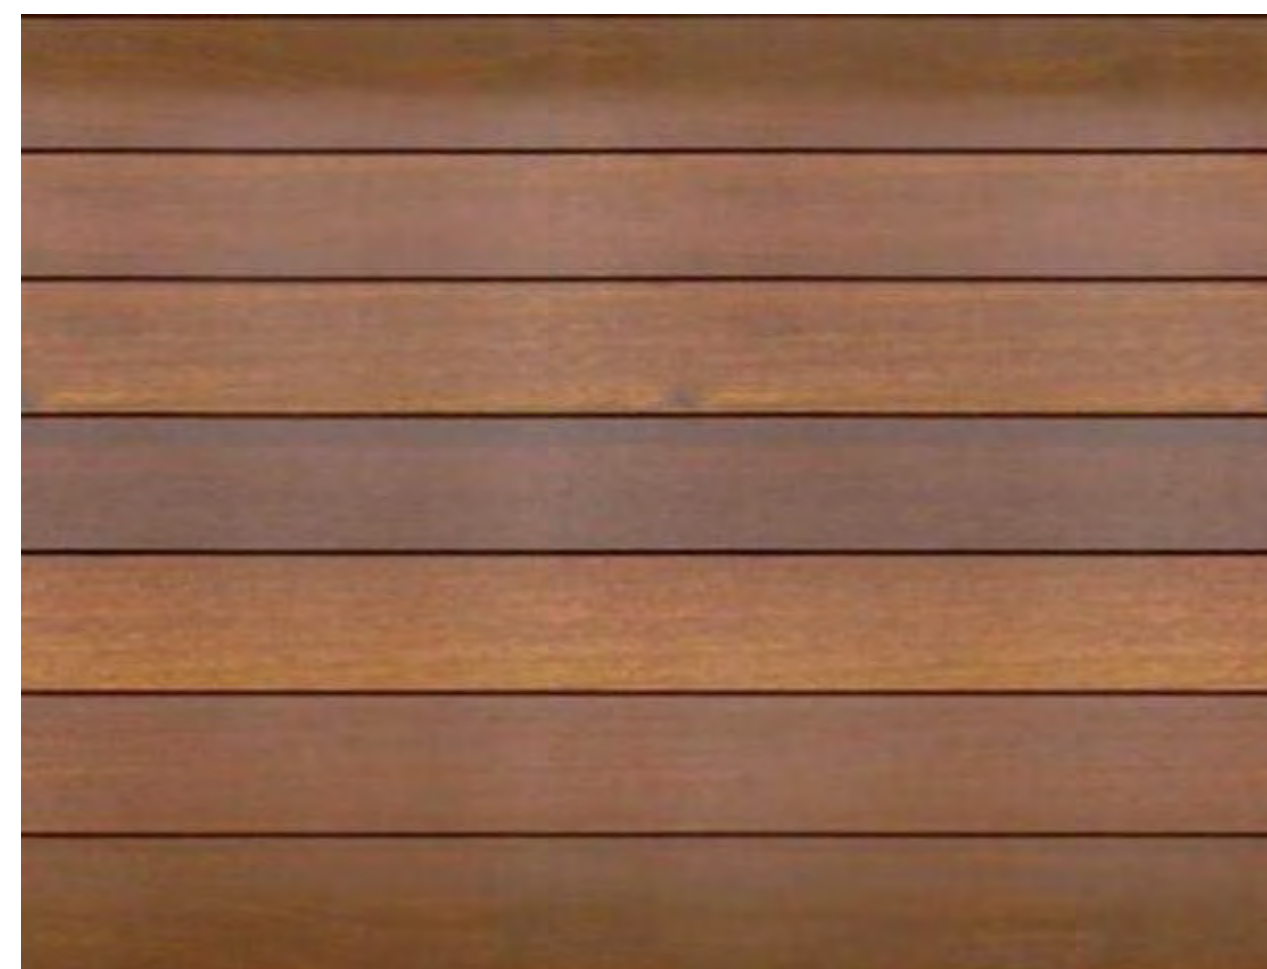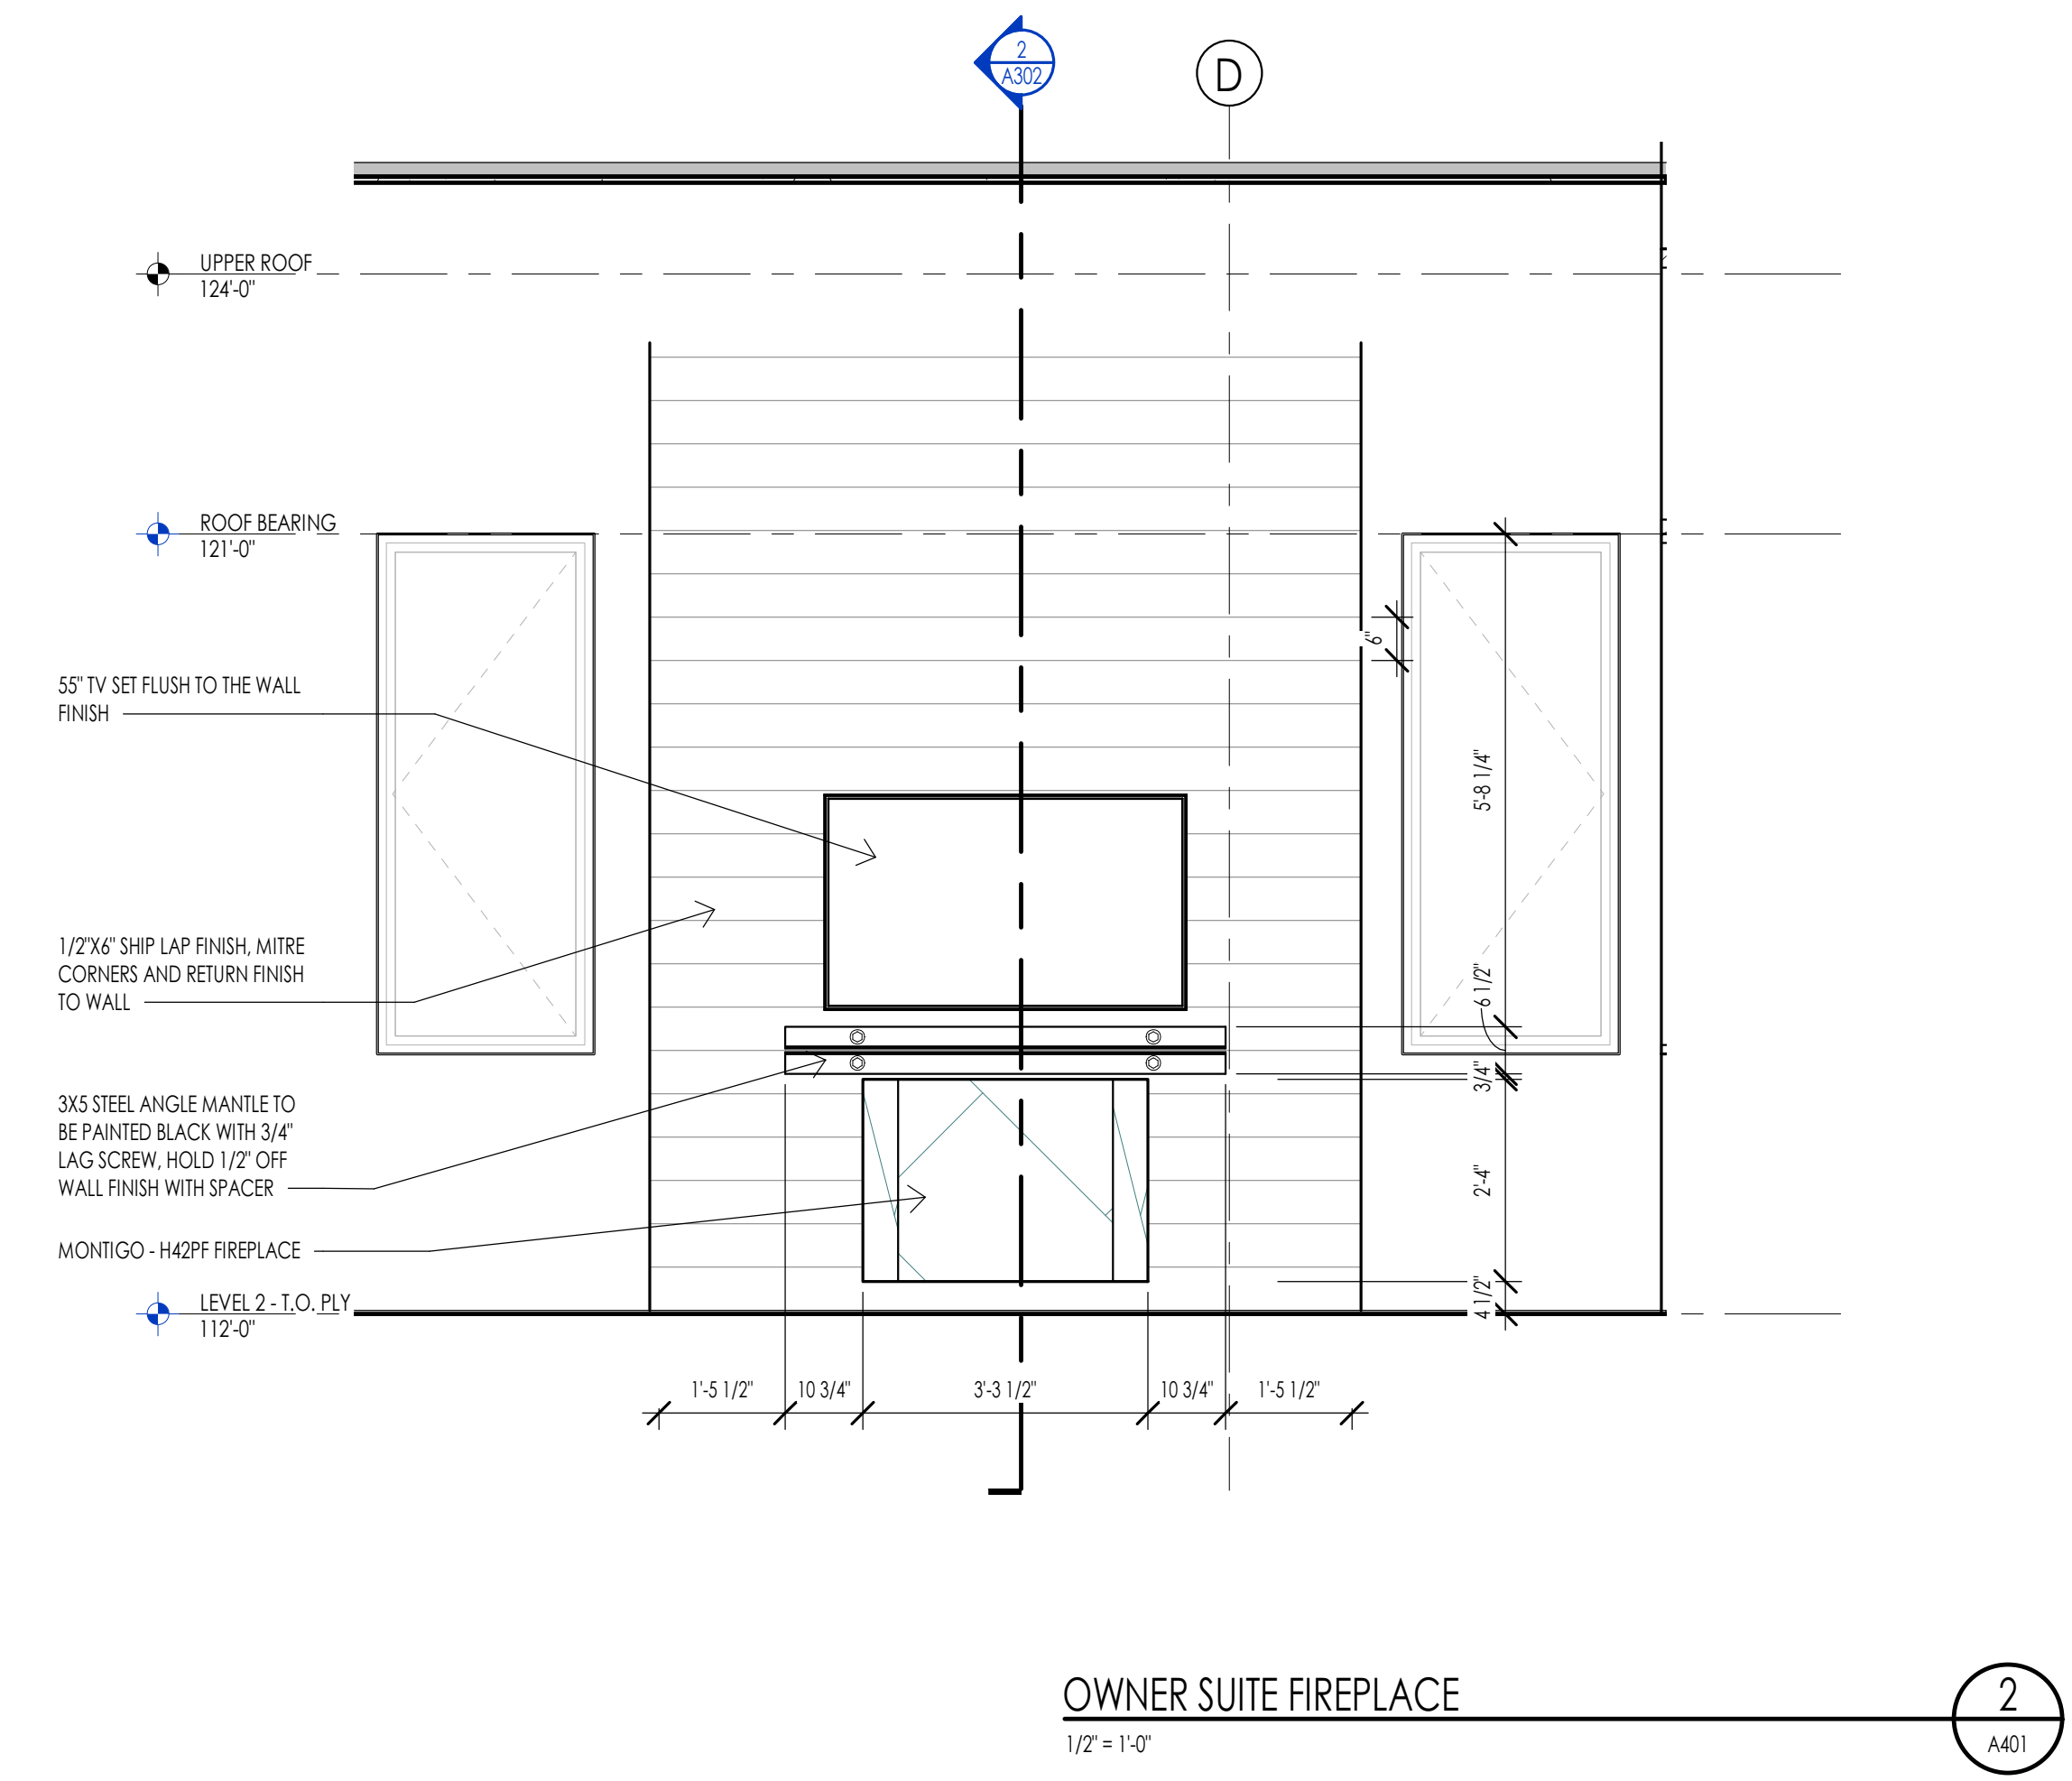

INTERIOR WOOD SLAT FINISH

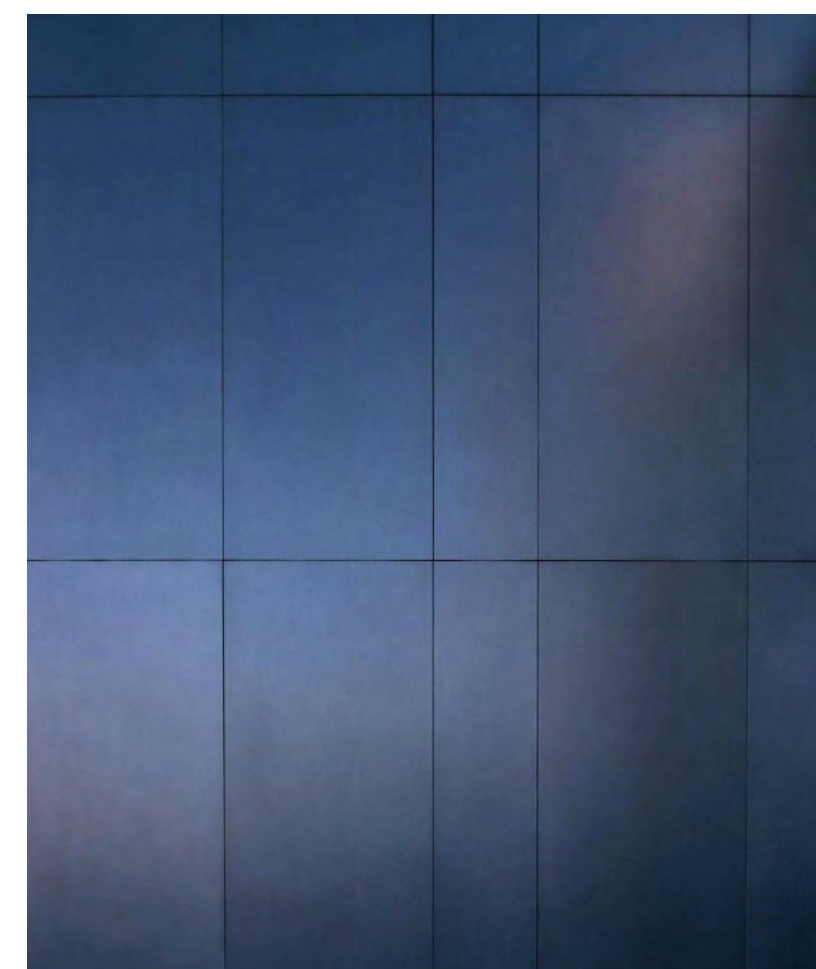

STEEL FIREPLACE SURROUND

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340


PROJECT NO. 22023
DATE: 2023.06.30
REVISIONS:

SHEET TITLE:
FIREPLACE ELEVATIONS


SHEET NUMBER:
A401

© 2023 THINK ARCHITECTURE, INC.


PERMIT SET

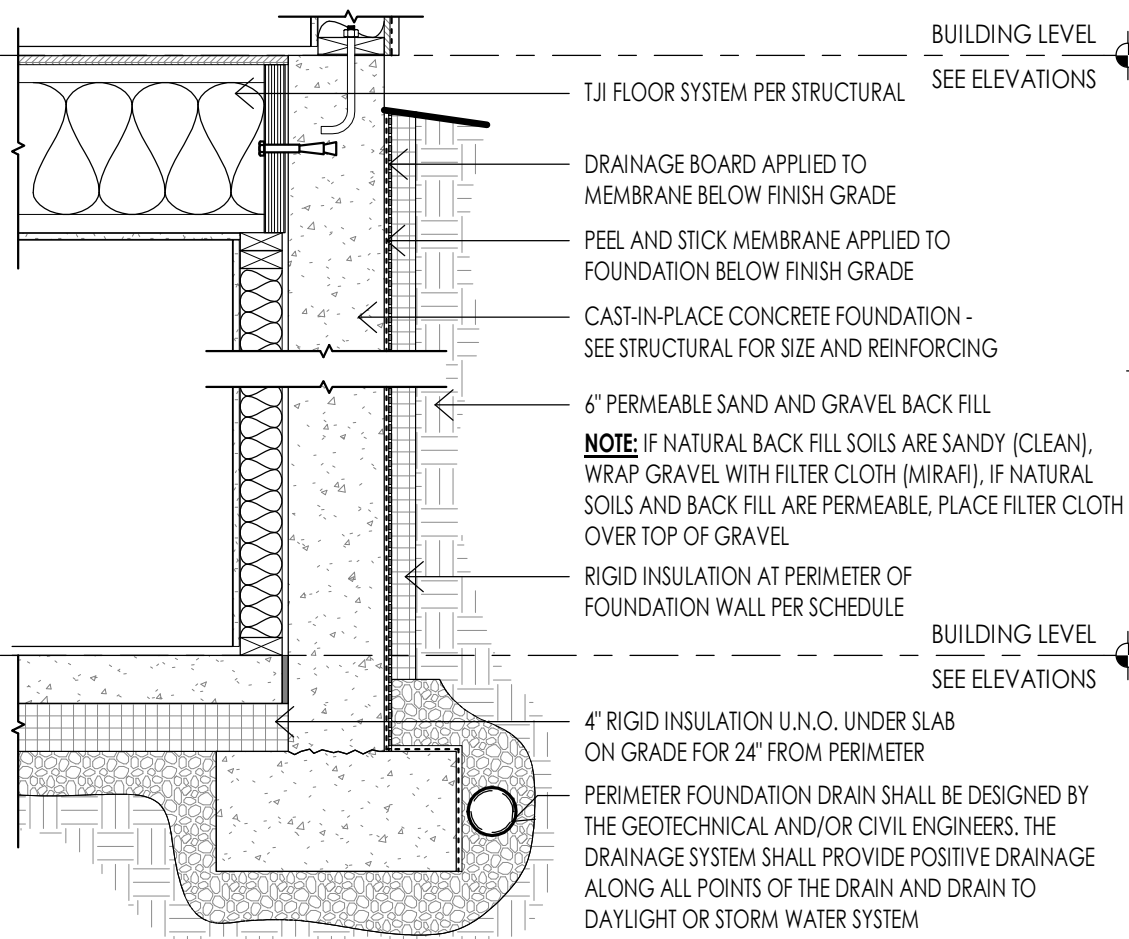


CONCRETE - TYPICAL FOUNDATION WATERPROOFING 1
3/4" = 1'-0"

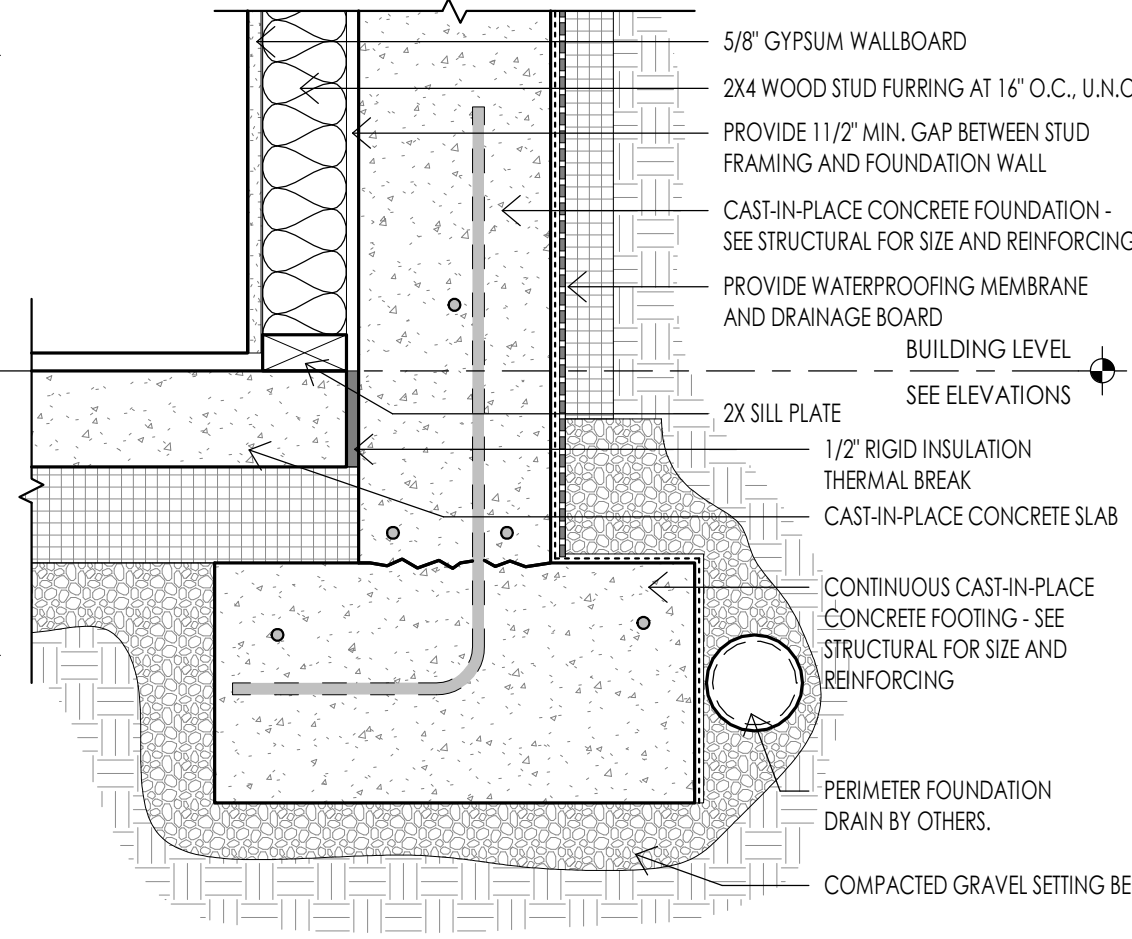


CONCRETE - TYPICAL FOUNDATION FURR OUT WALL 2
1 1/2" = 1'-0"

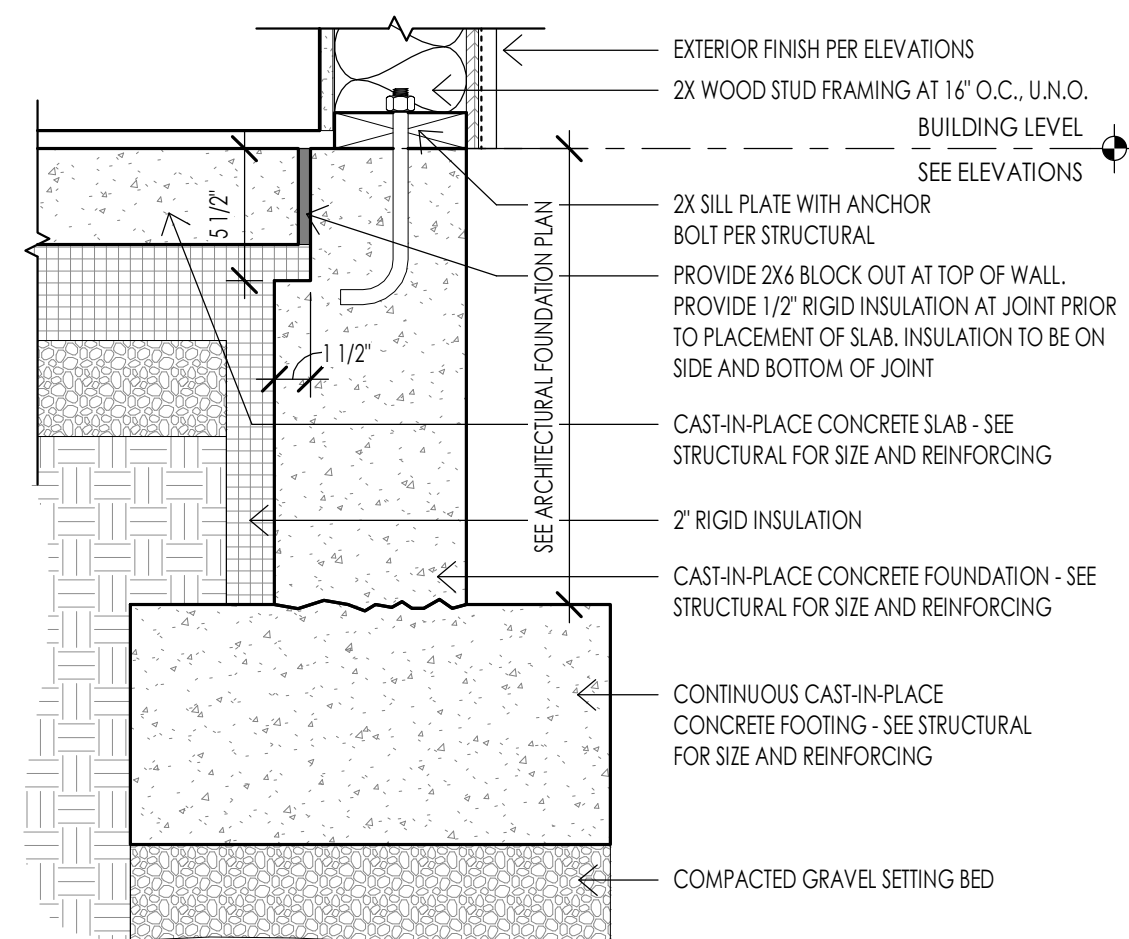


CONCRETE - FOUNDATION DETAIL AT WALKOUT 3
1 1/2" = 1'-0"

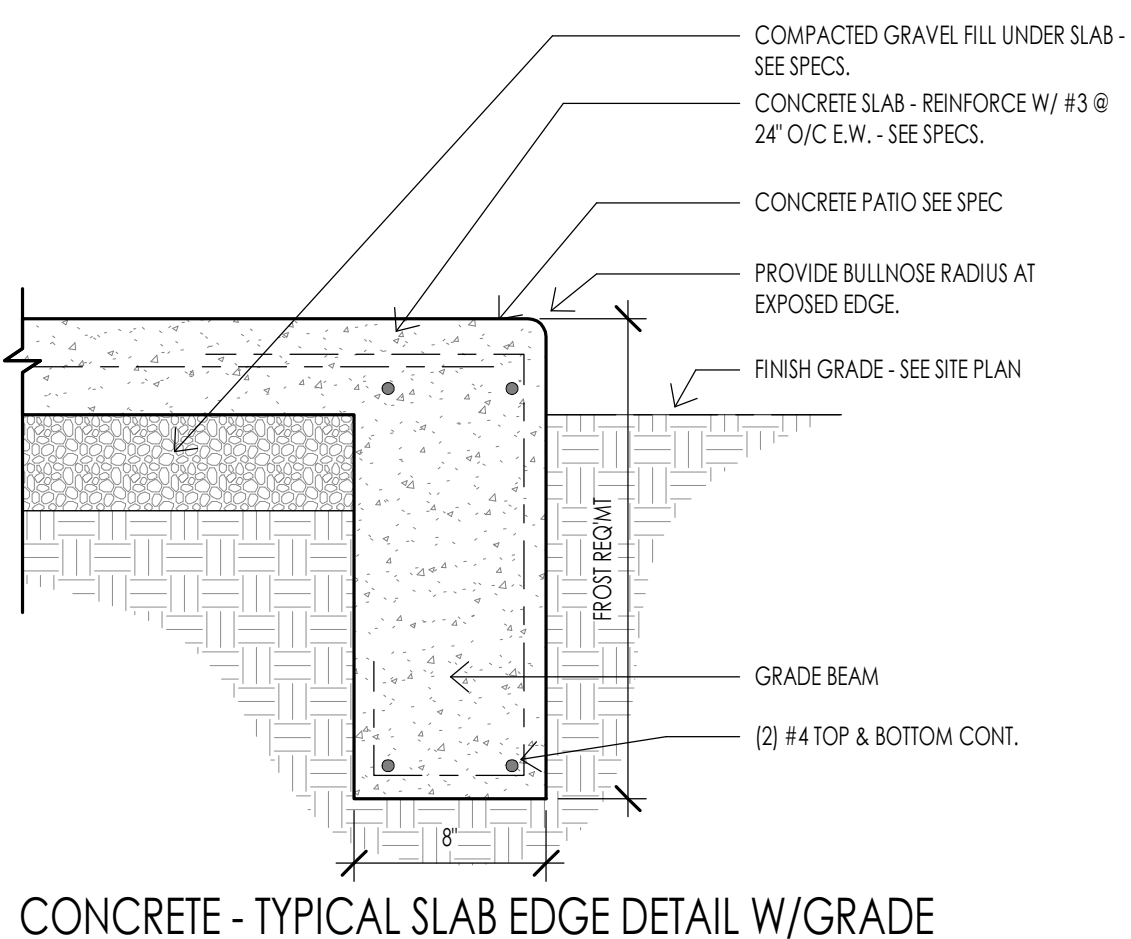


CONCRETE - TYPICAL SLAB EDGE DETAIL W/GRADE BEAM 4
1 1/2" = 1'-0"

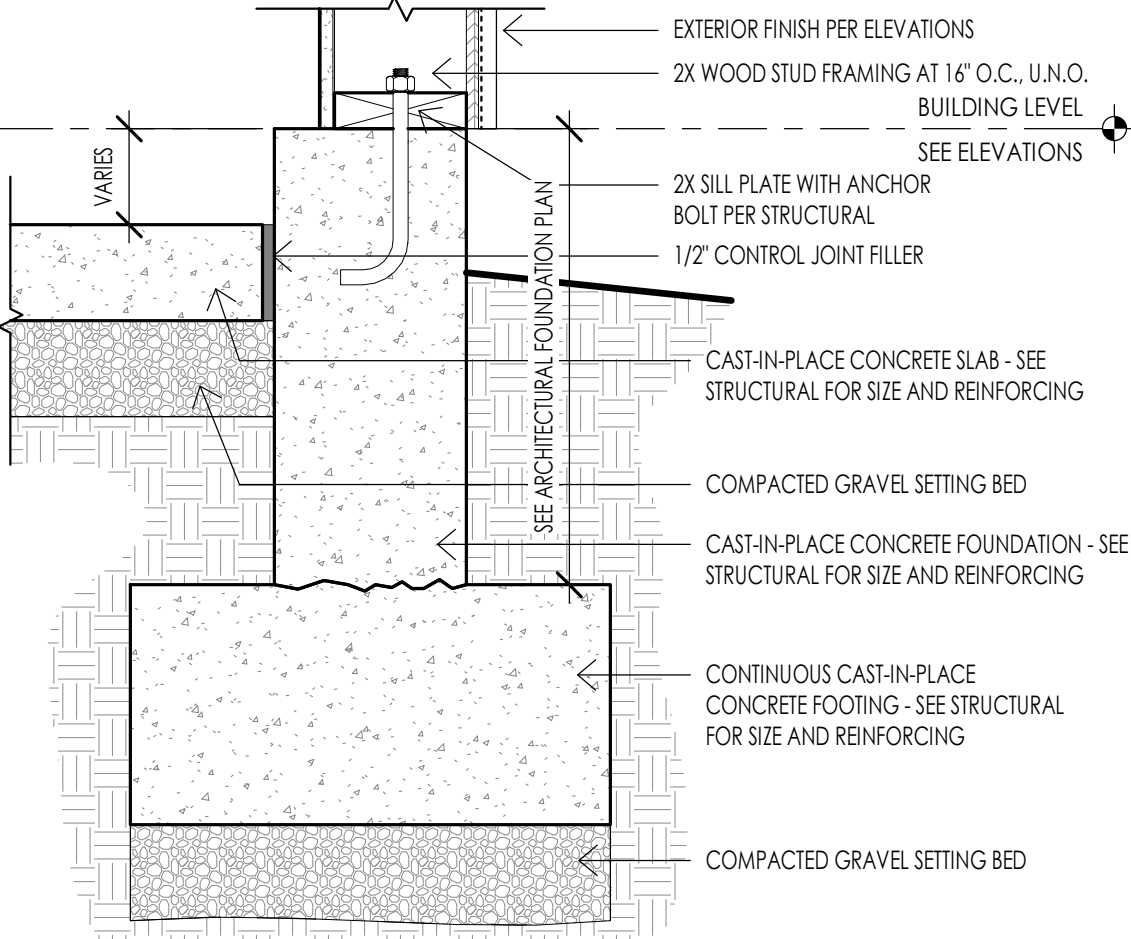


CONCRETE - FOUNDATION DETAIL AT GARAGE 5
1 1/2" = 1'-0"

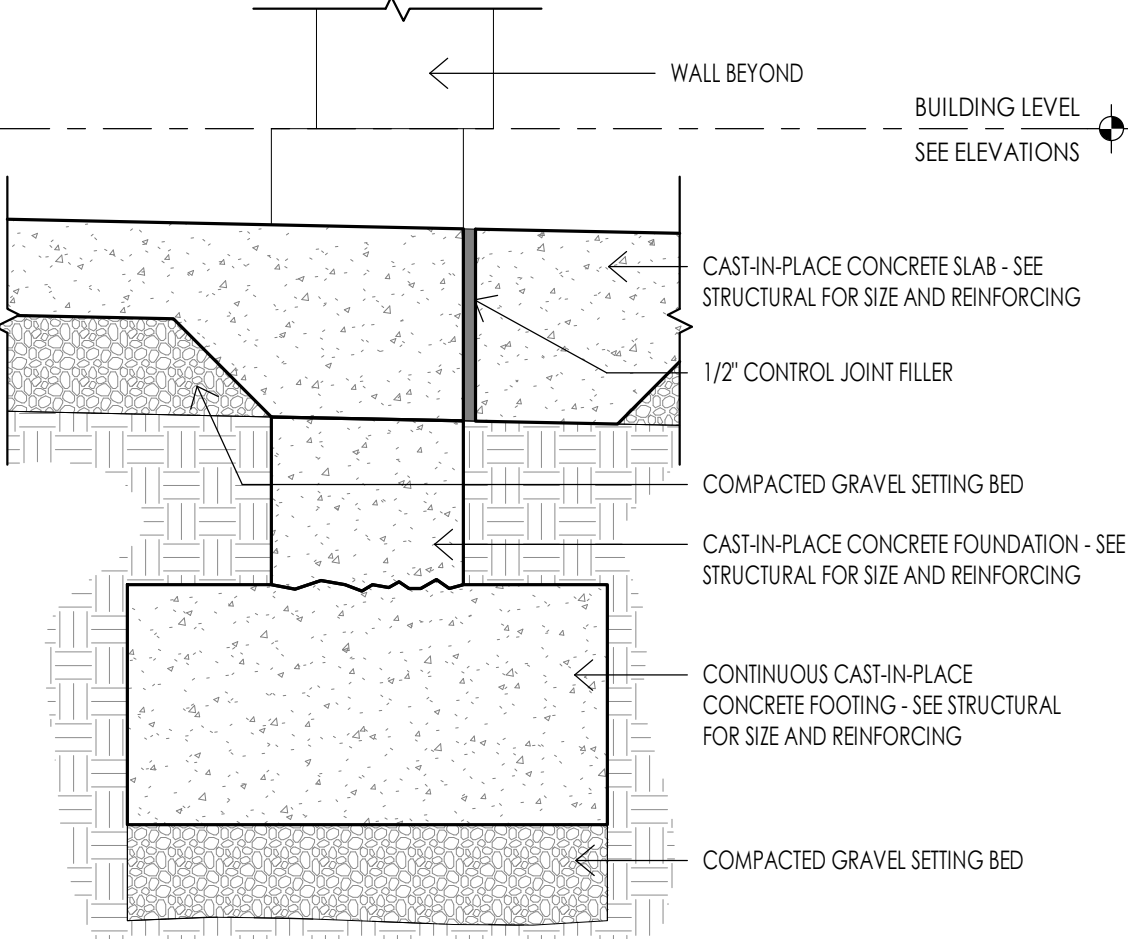


CONCRETE - FOUNDATION DETAIL AT GARAGE DOOR 6
1 1/2" = 1'-0"

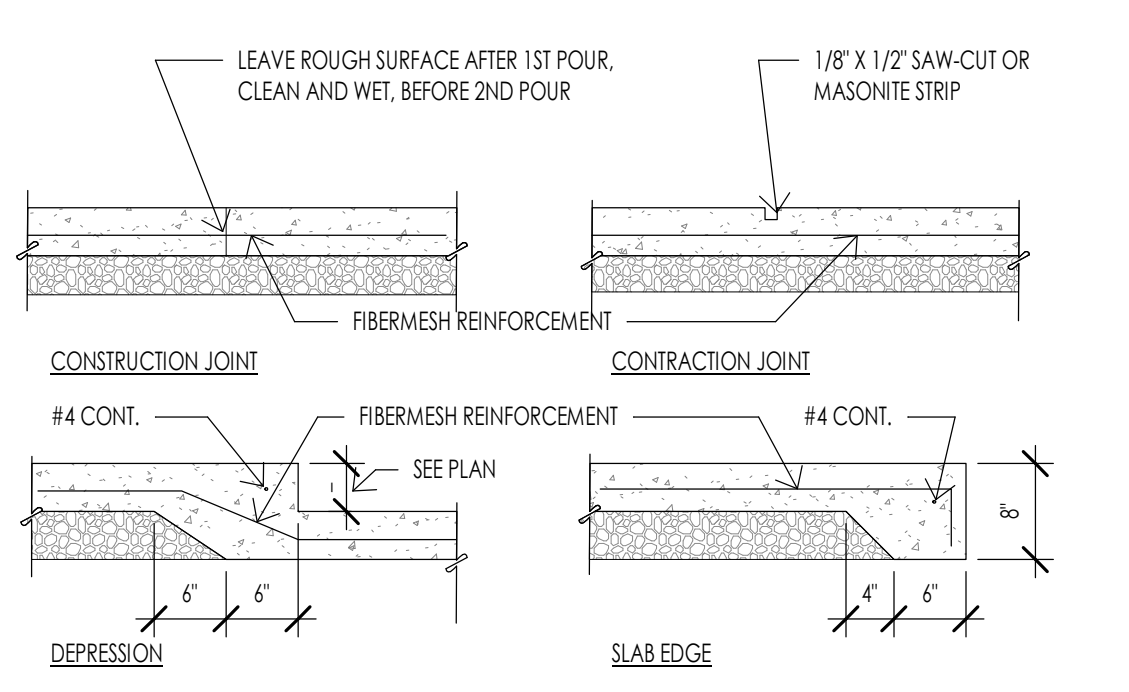


CONCRETE - TYPICAL SLAB DETAILS 7
3/4" = 1'-0"

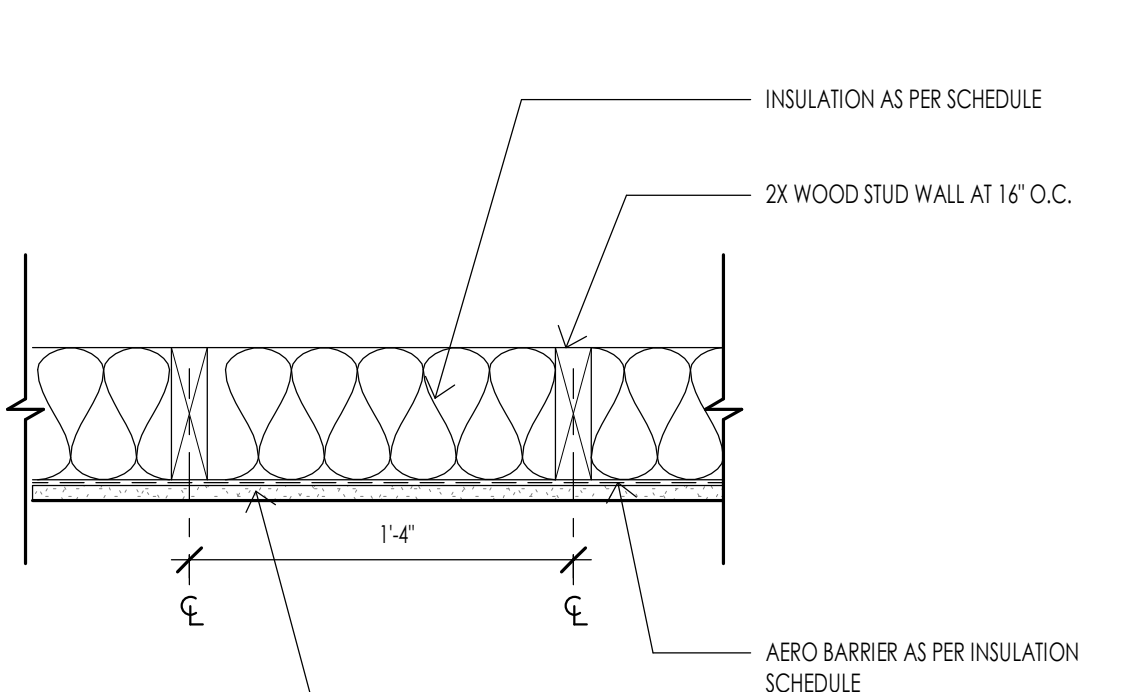


FRAMING - FURR OUT WALL ASSEMBLY 8
1 1/2" = 1'-0"

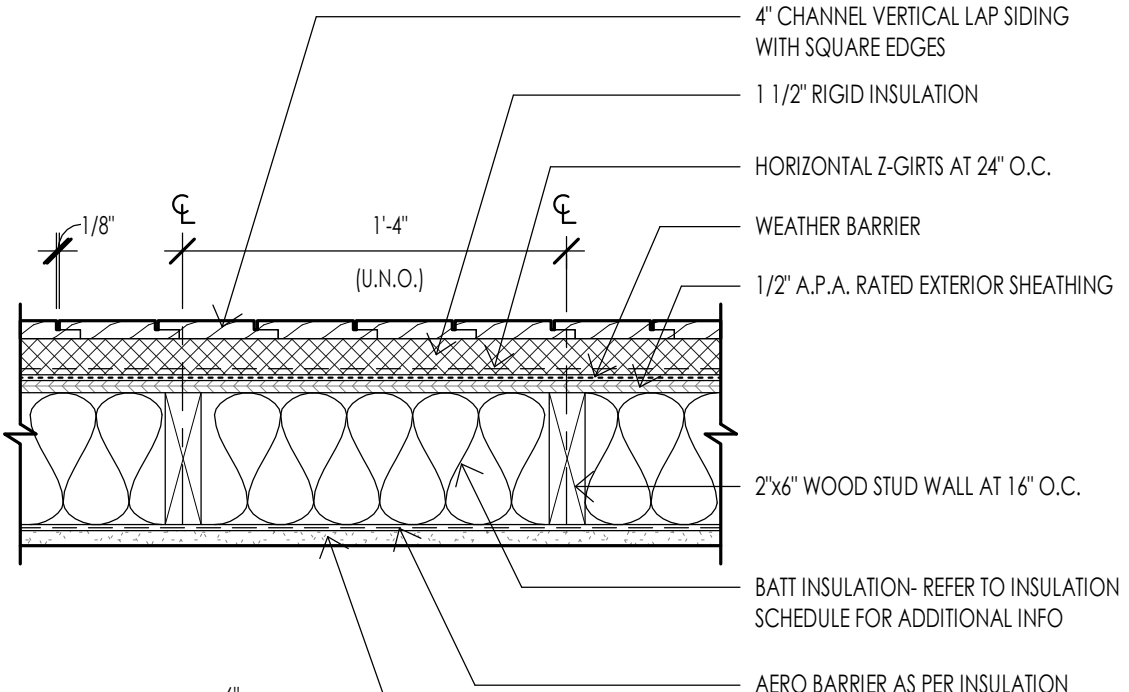


FRAMING - WOOD SIDING WALL ASSEMBLY 9
1 1/2" = 1'-0"

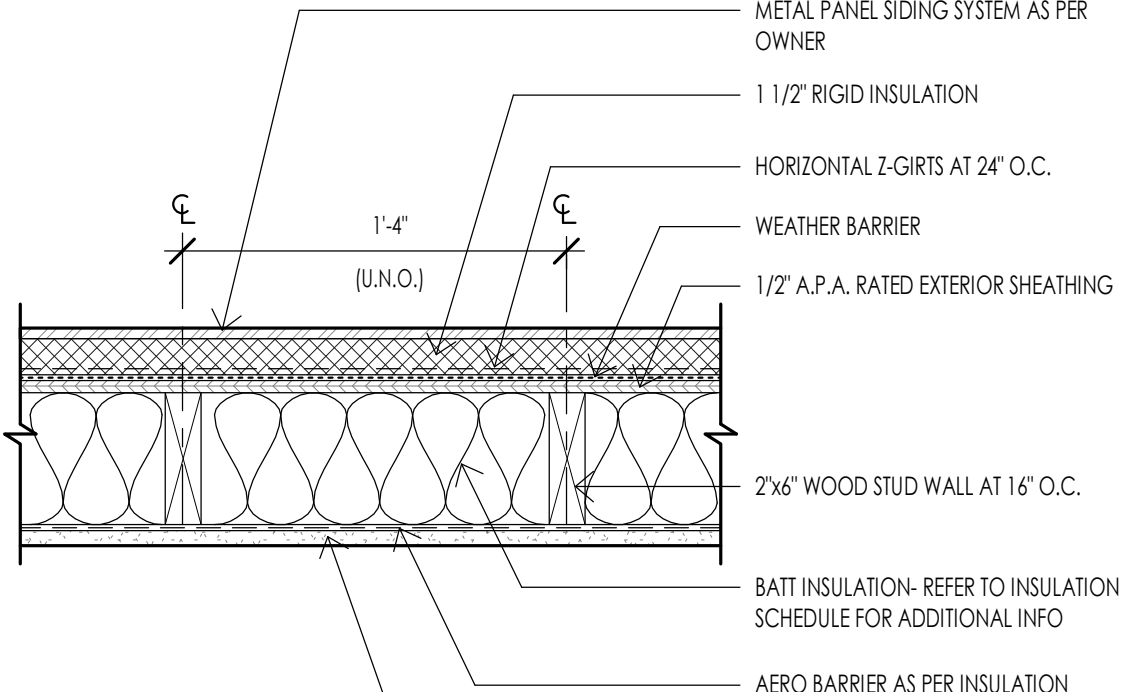


FRAMING - METAL PANEL WALL ASSEMBLY 10
1 1/2" = 1'-0"

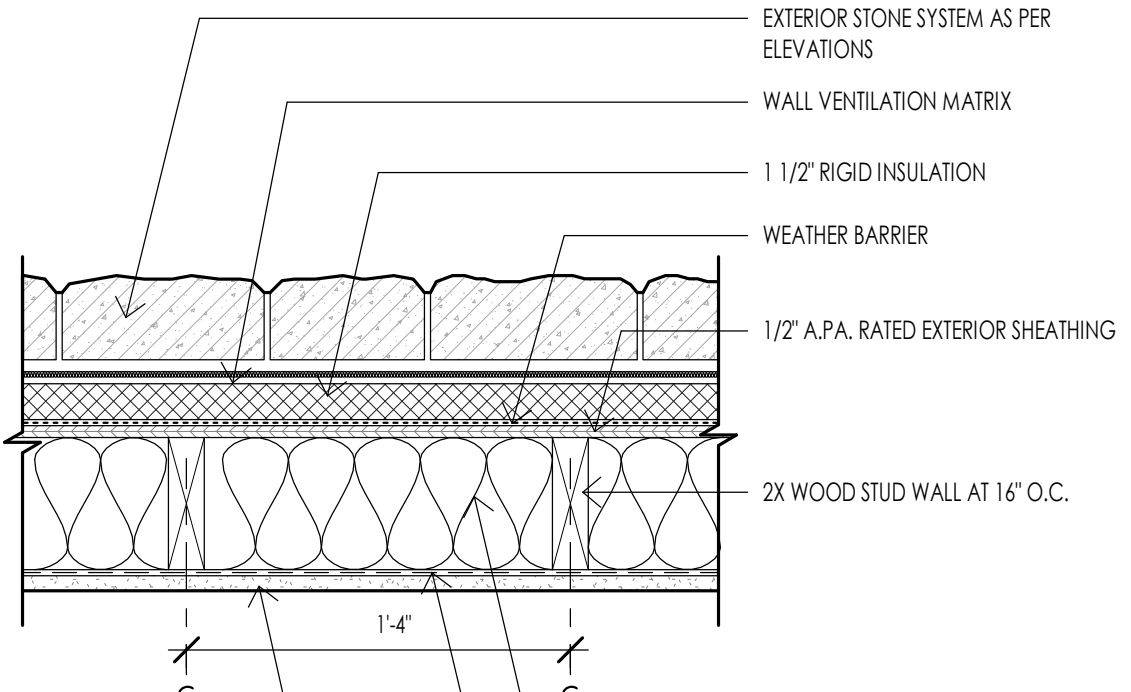


FRAMING - STONE MASONRY WALL ASSEMBLY 11
1 1/2" = 1'-0"

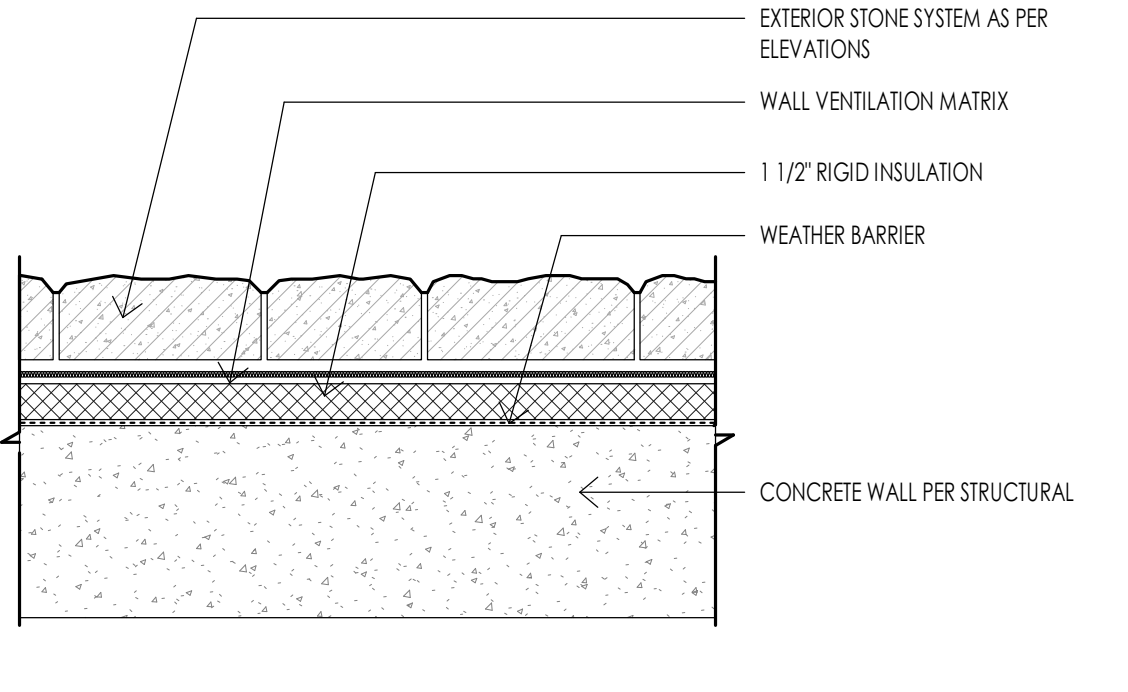


FRAMING - CONCRETE WALL W STONE ASSEMBLY 12
1 1/2" = 1'-0"

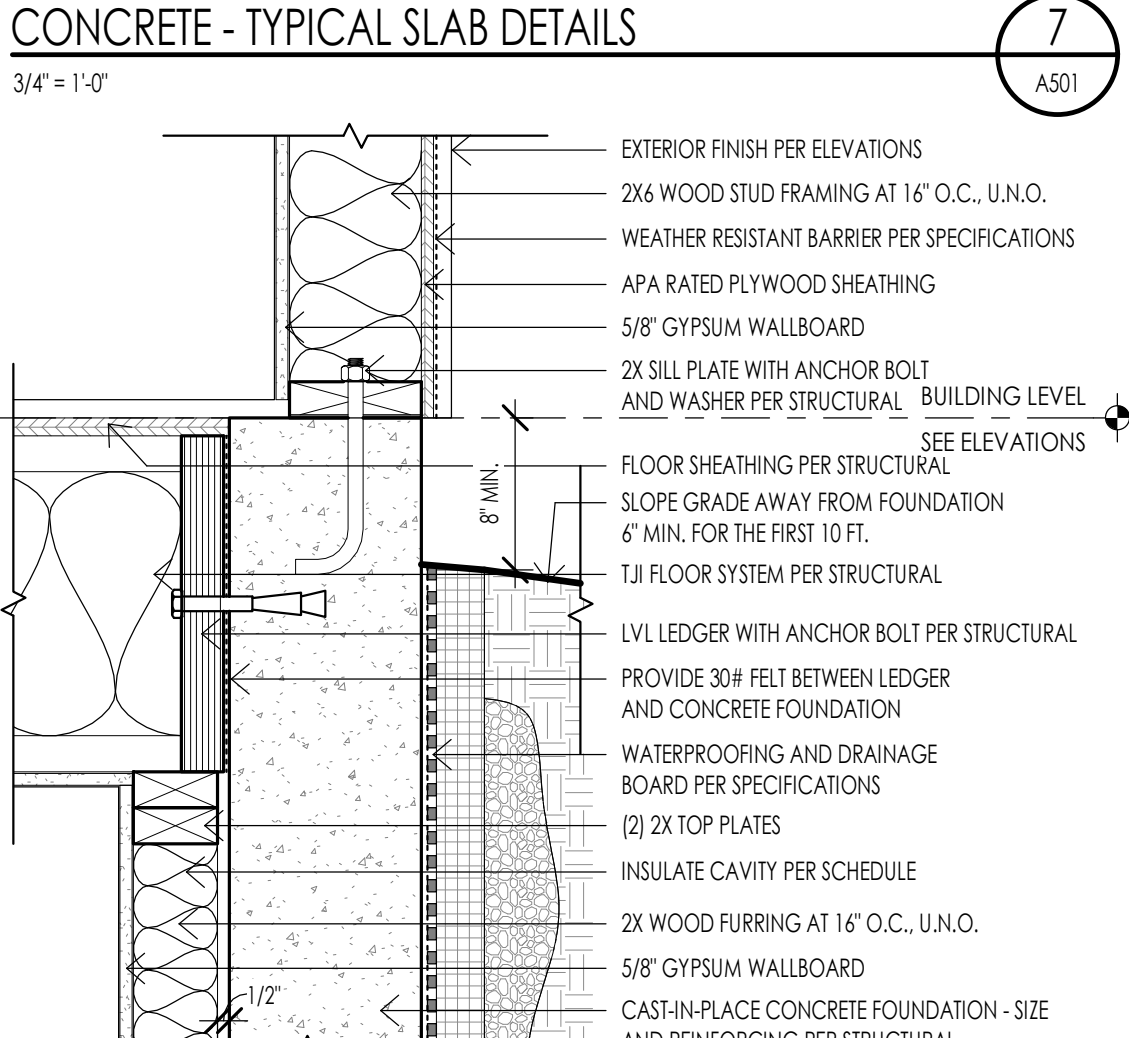


TYPICAL FLOOR DETAIL AT FOUNDATION 13
1 1/2" = 1'-0"

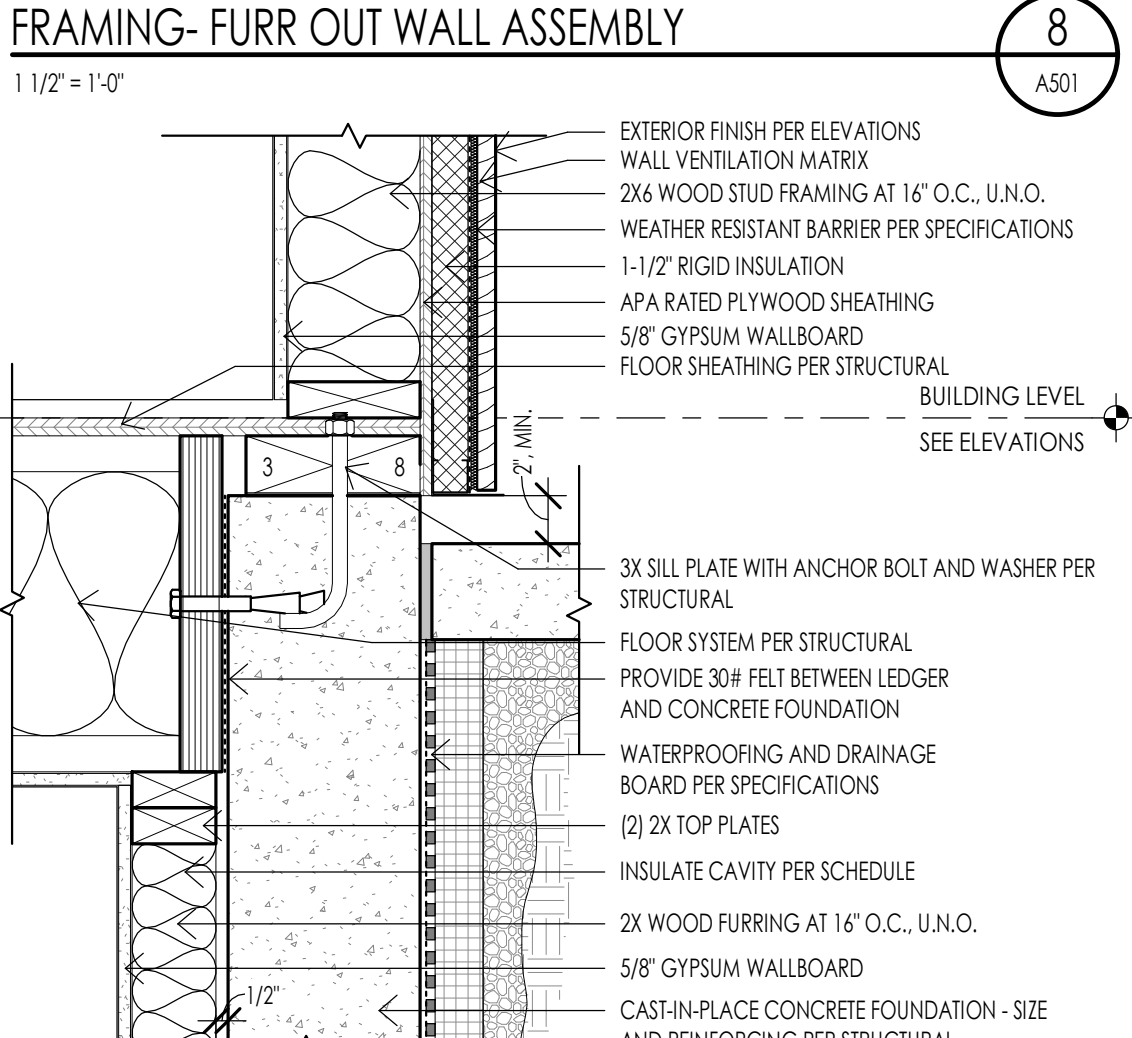


FLOOR DETAIL AT FOUNDATION/PATIO 14
1 1/2" = 1'-0"

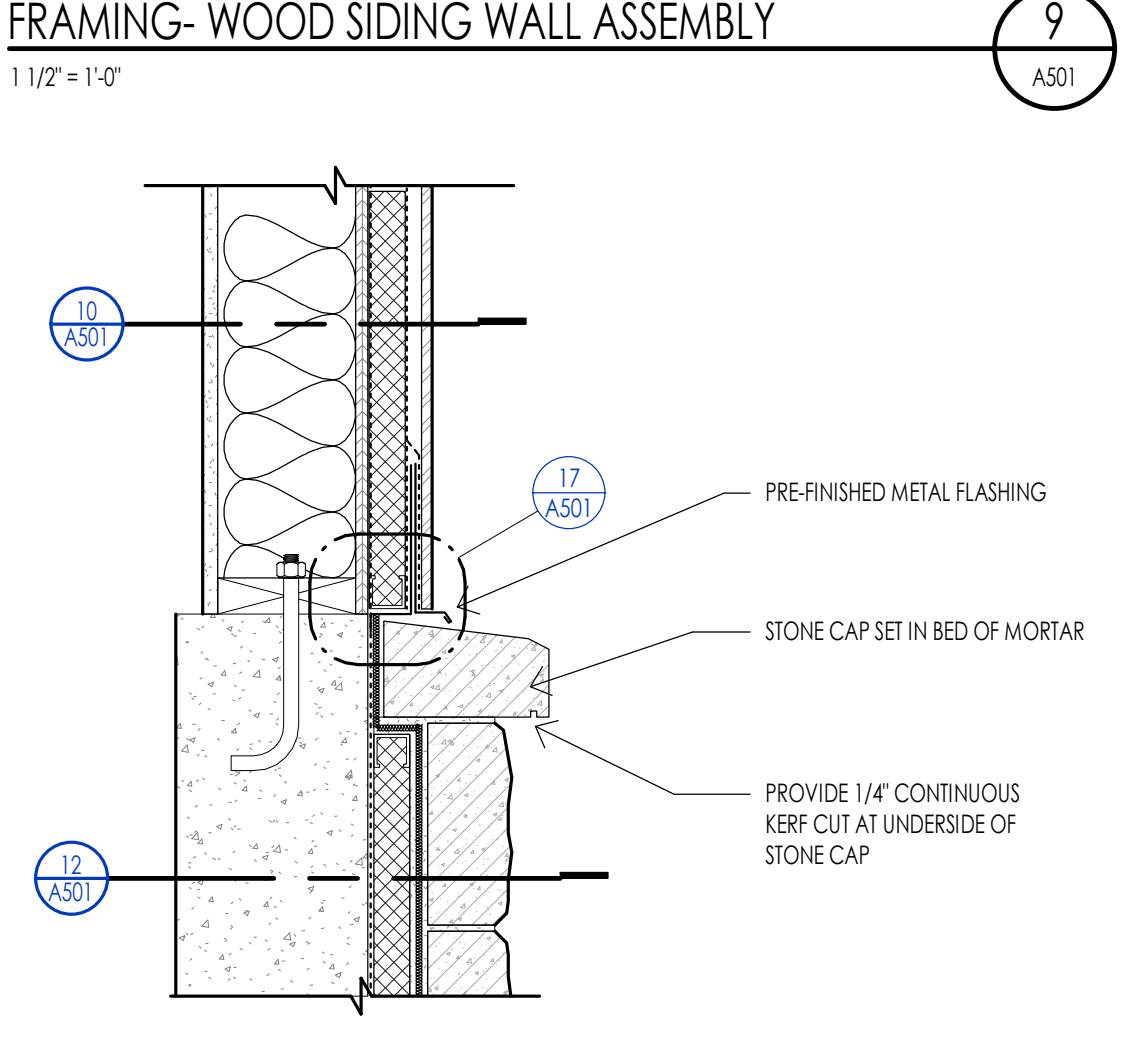


MASONRY - STONE WALL TO METAL PANEL WALL 15
1 1/2" = 1'-0"

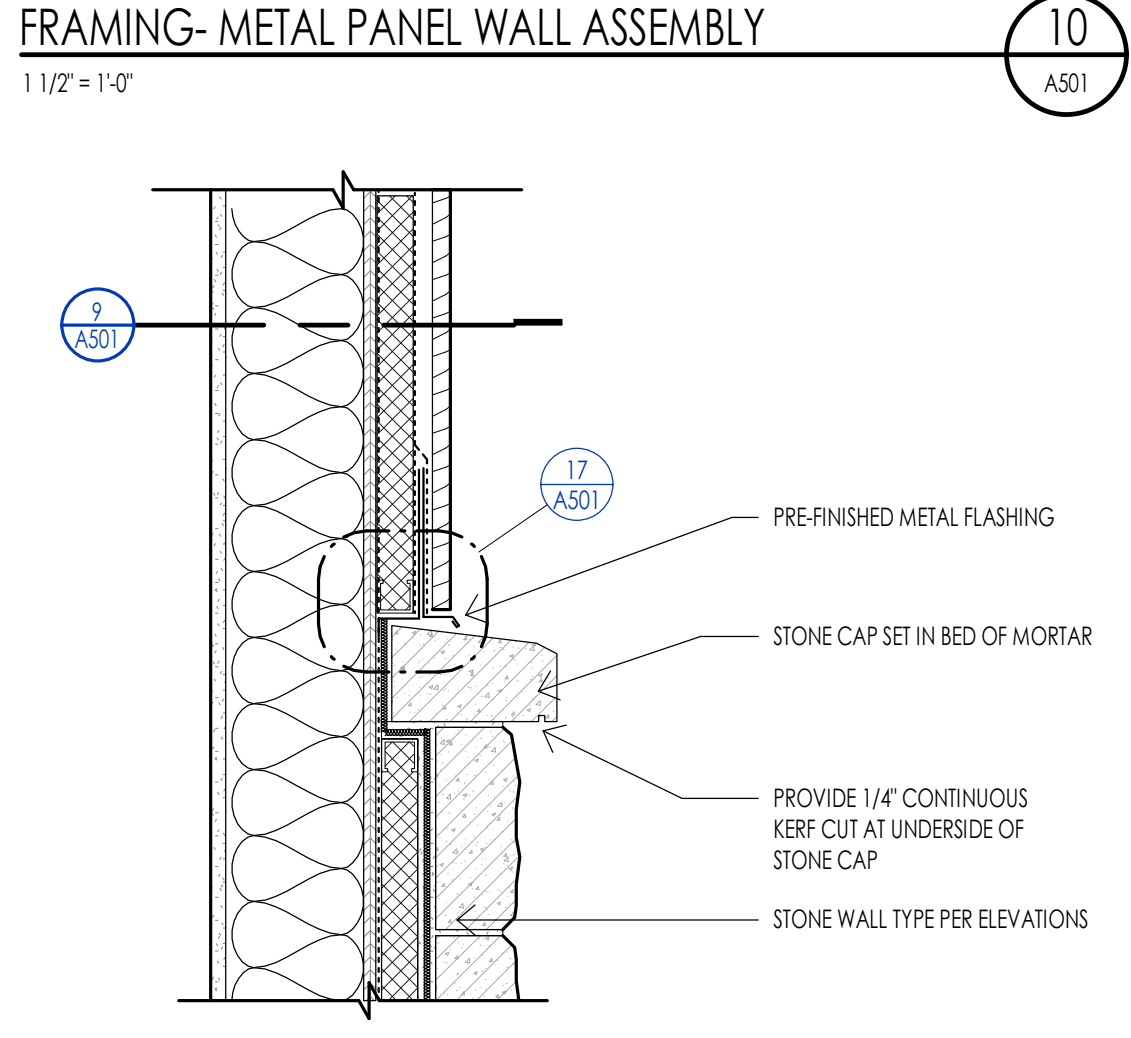


MASONRY - TRANSITION STONE WALL TO SIDING 16
1 1/2" = 1'-0"

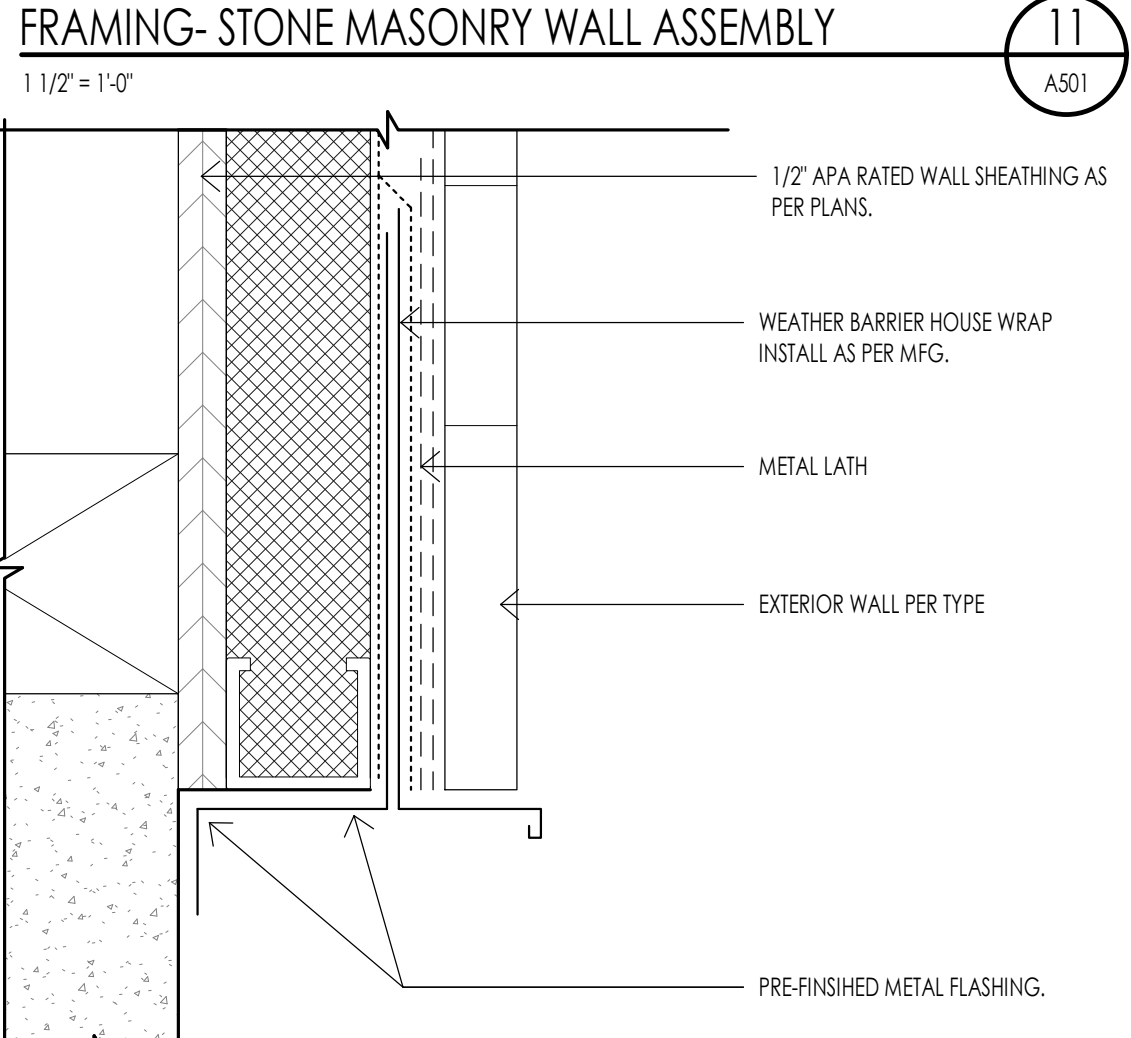


MASONRY - WOOD SIDING BASE FLASHING 17
6" = 1'-0"

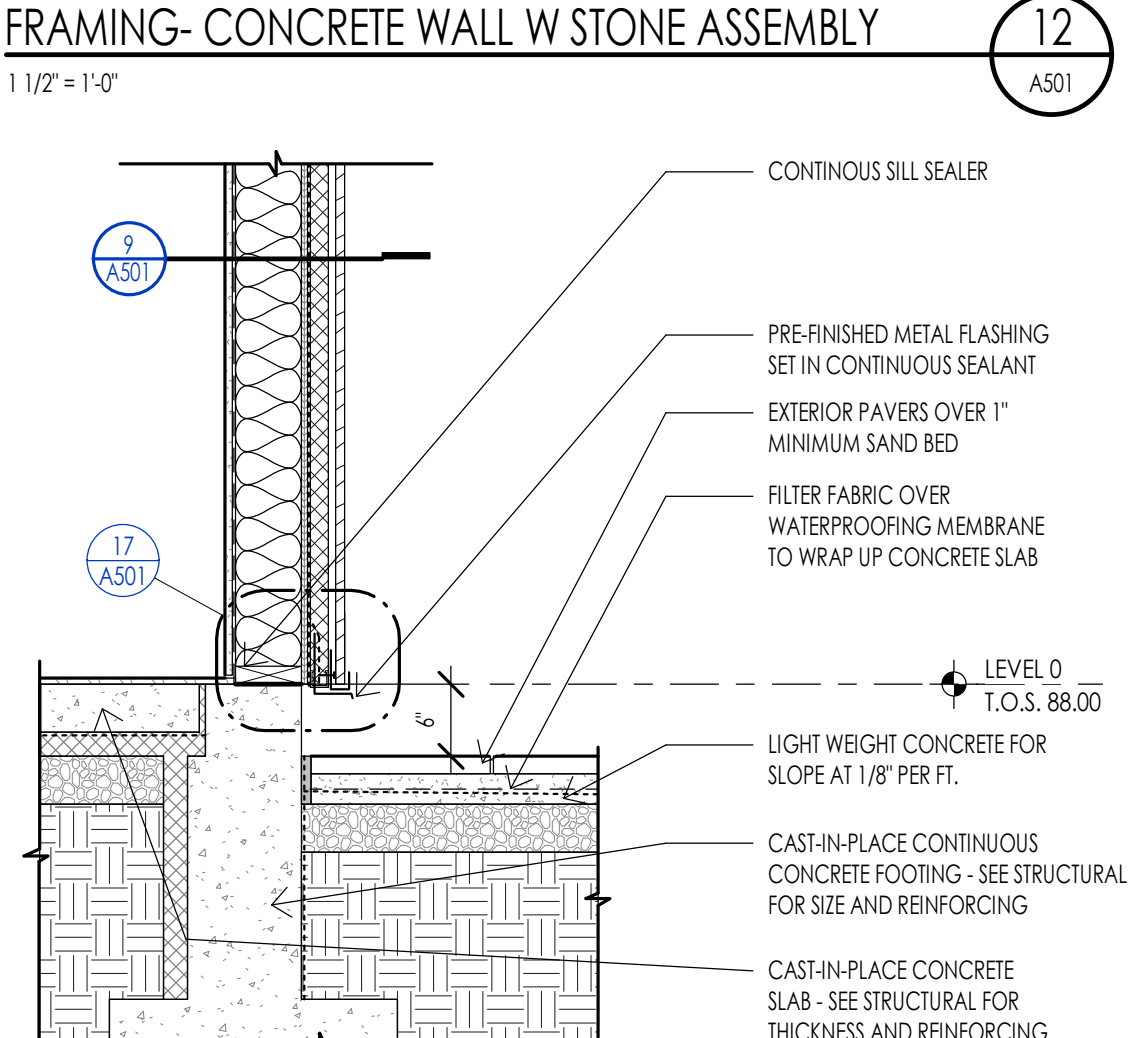


CONCRETE - FOUNDATION AT PAVERS 18
3/4" = 1'-0"

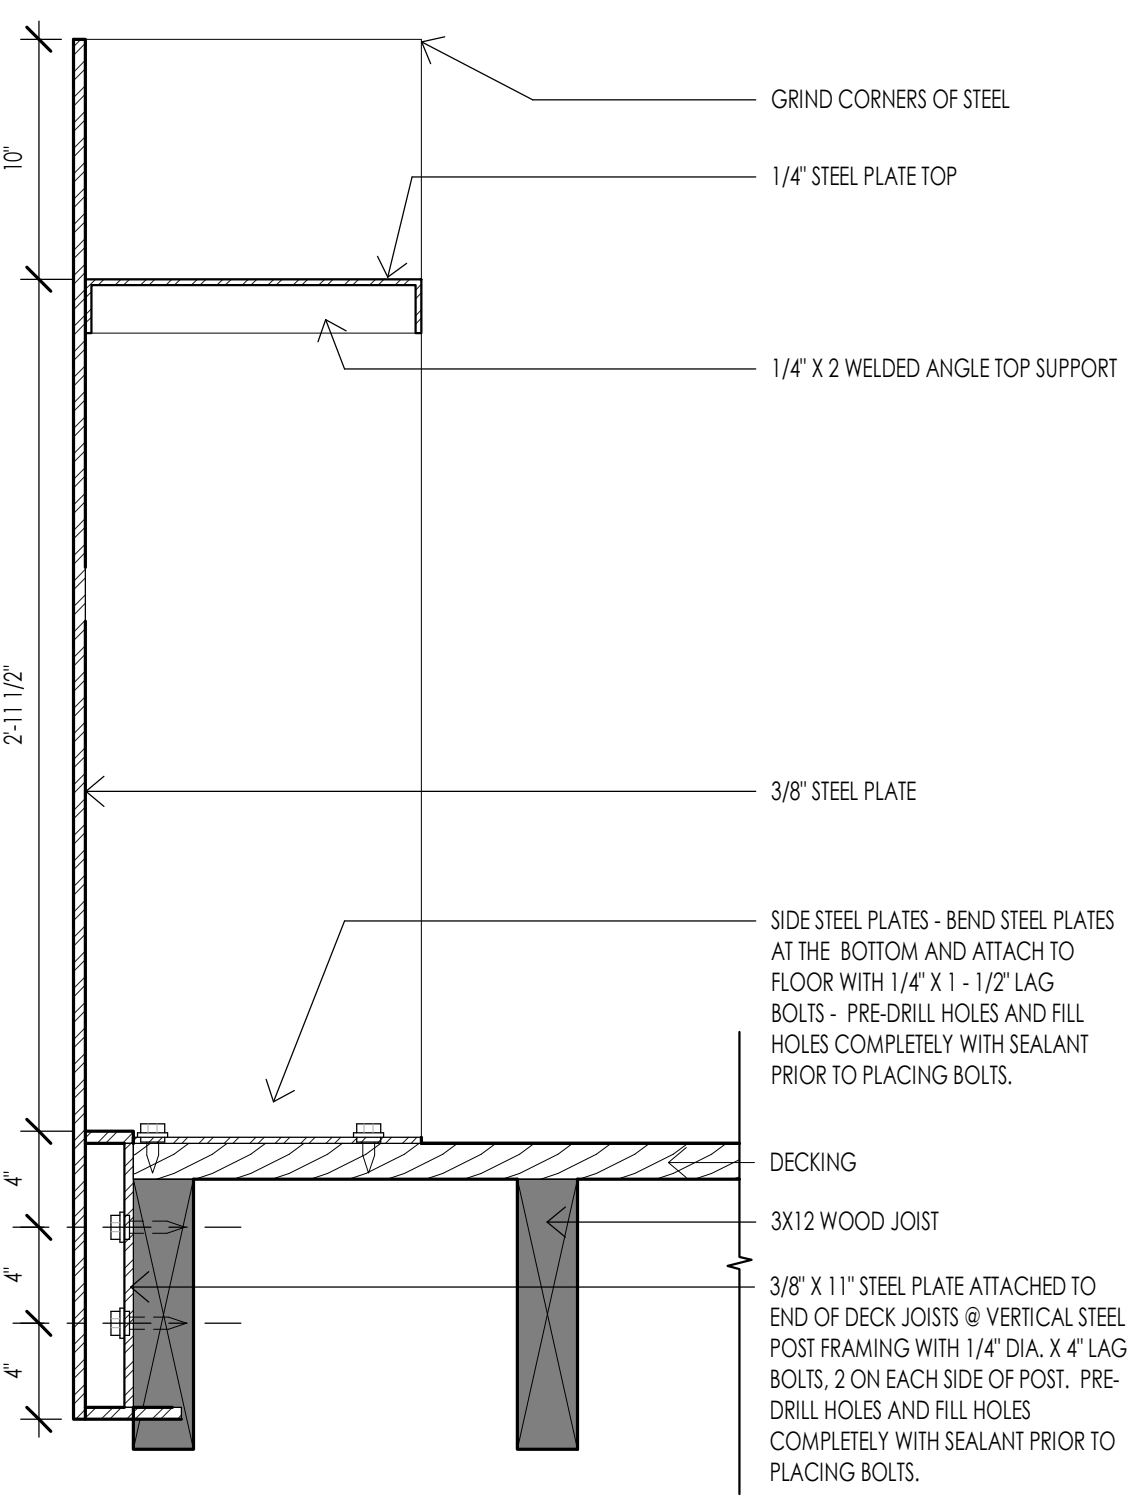


DECK - BBQ SECTION DETAIL 25
1 1/2" = 1'-0"

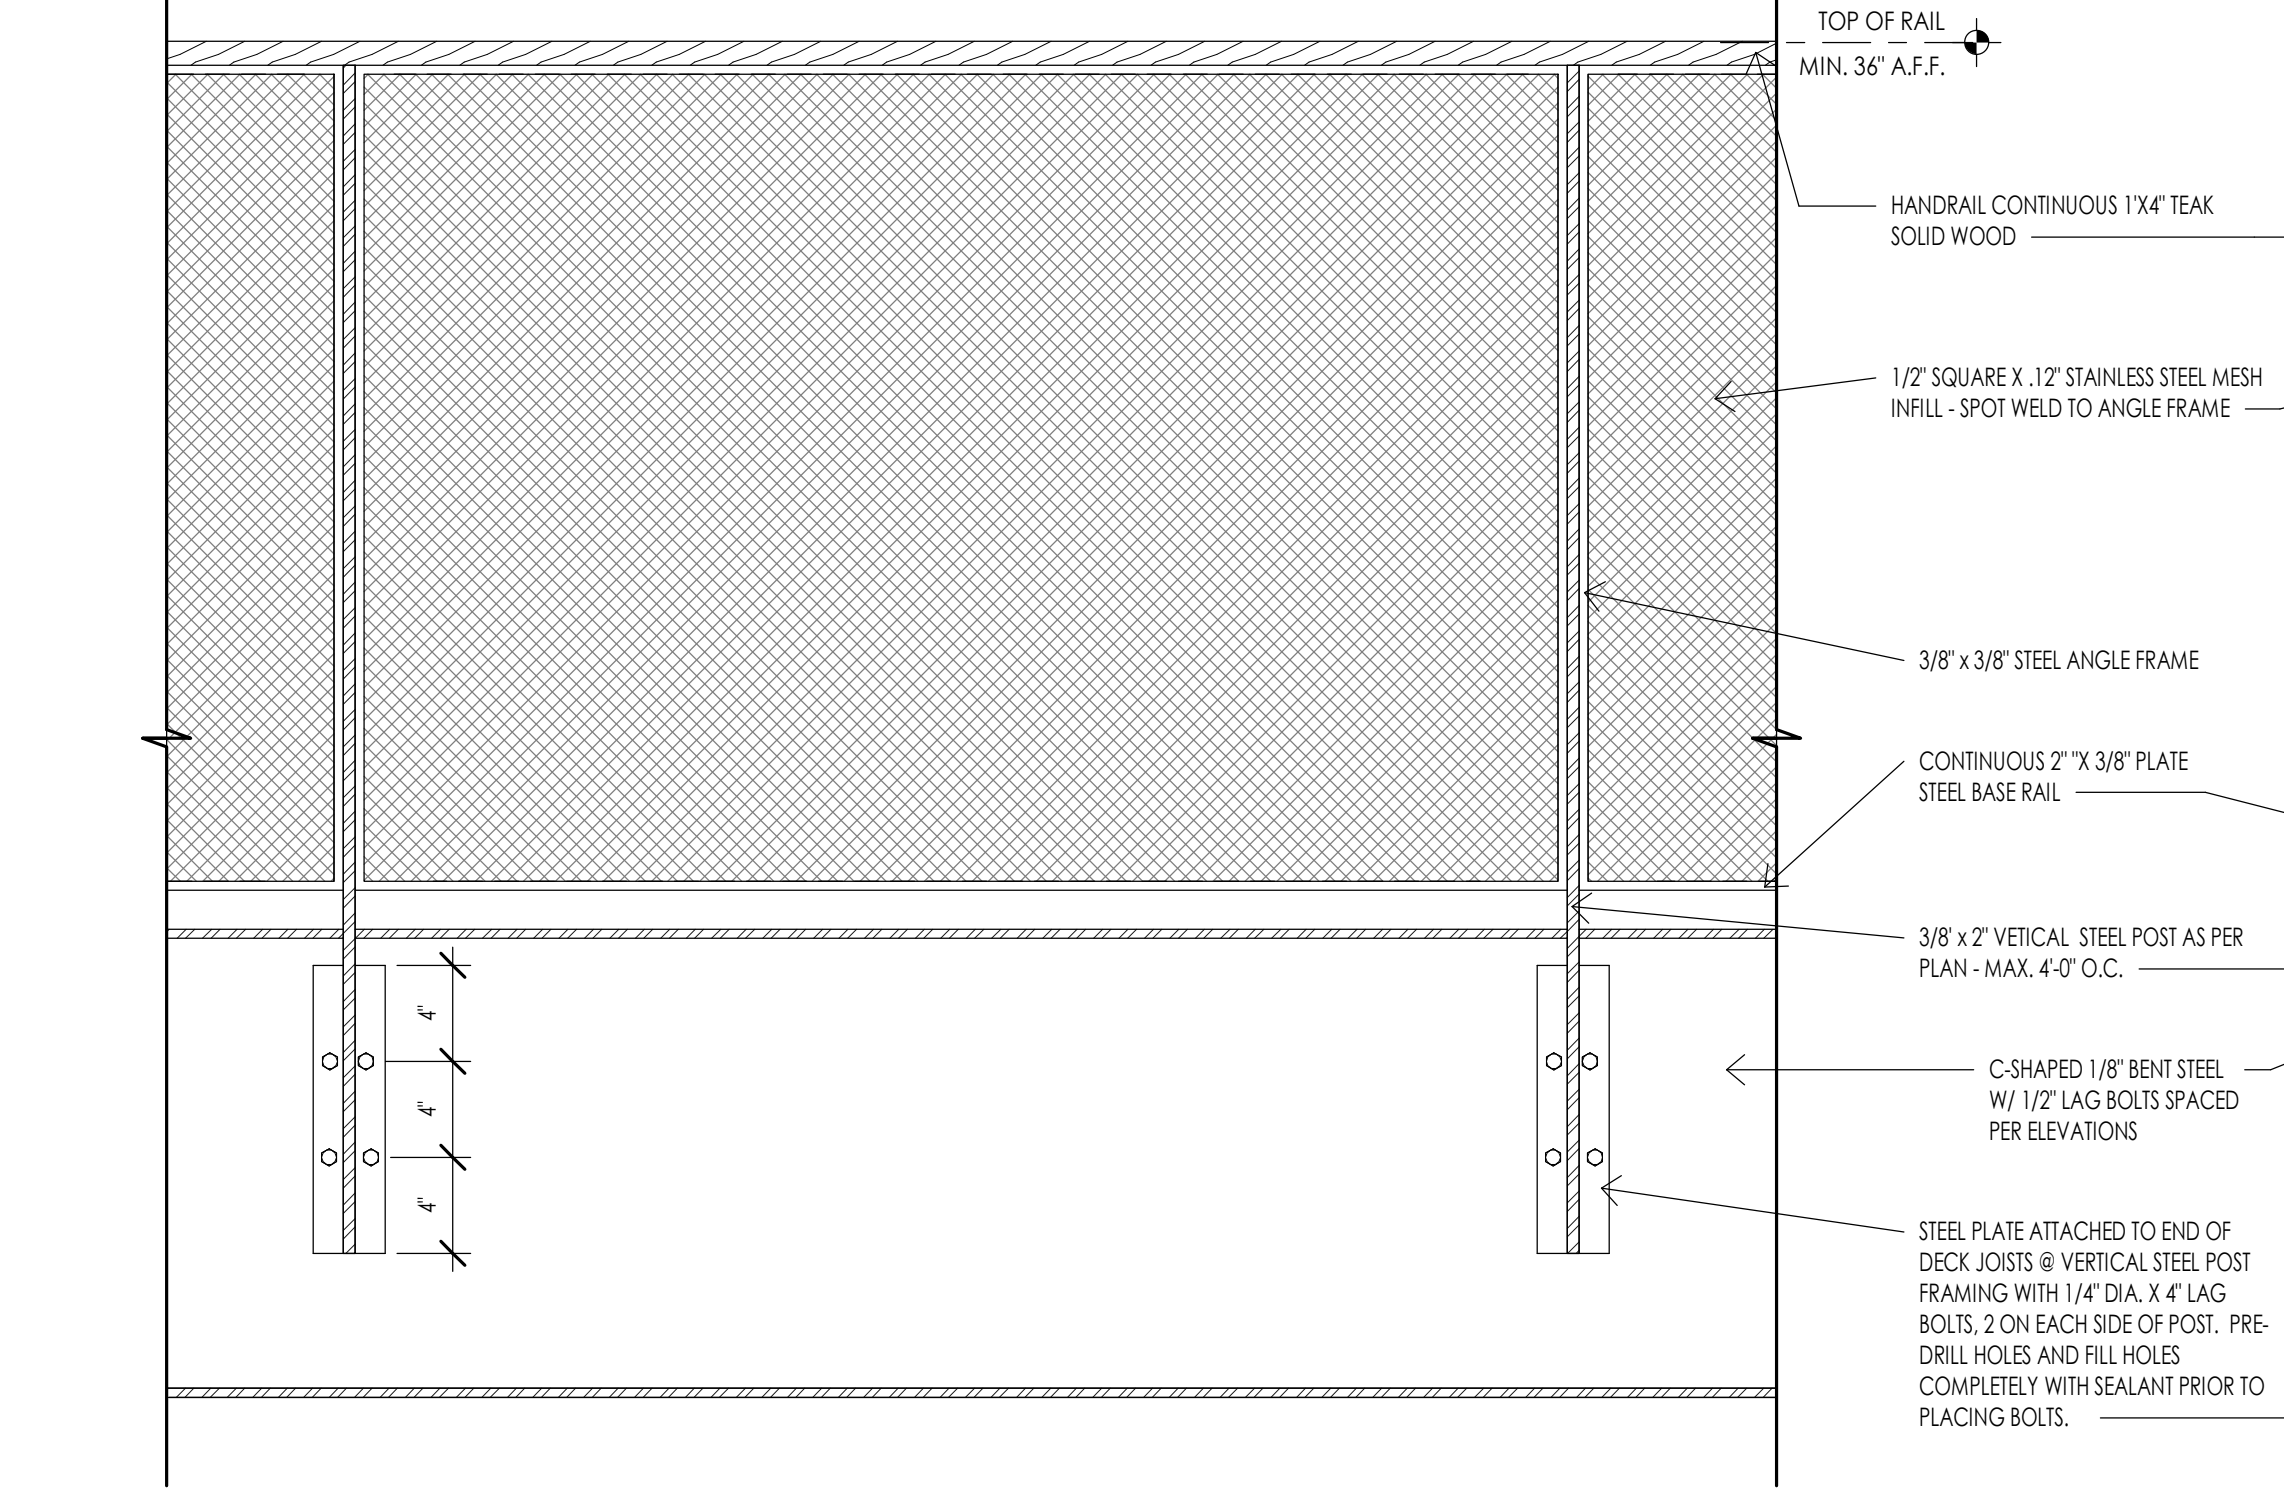


DECK - GUARDRAIL DETAIL 28
1 1/2" = 1'-0"

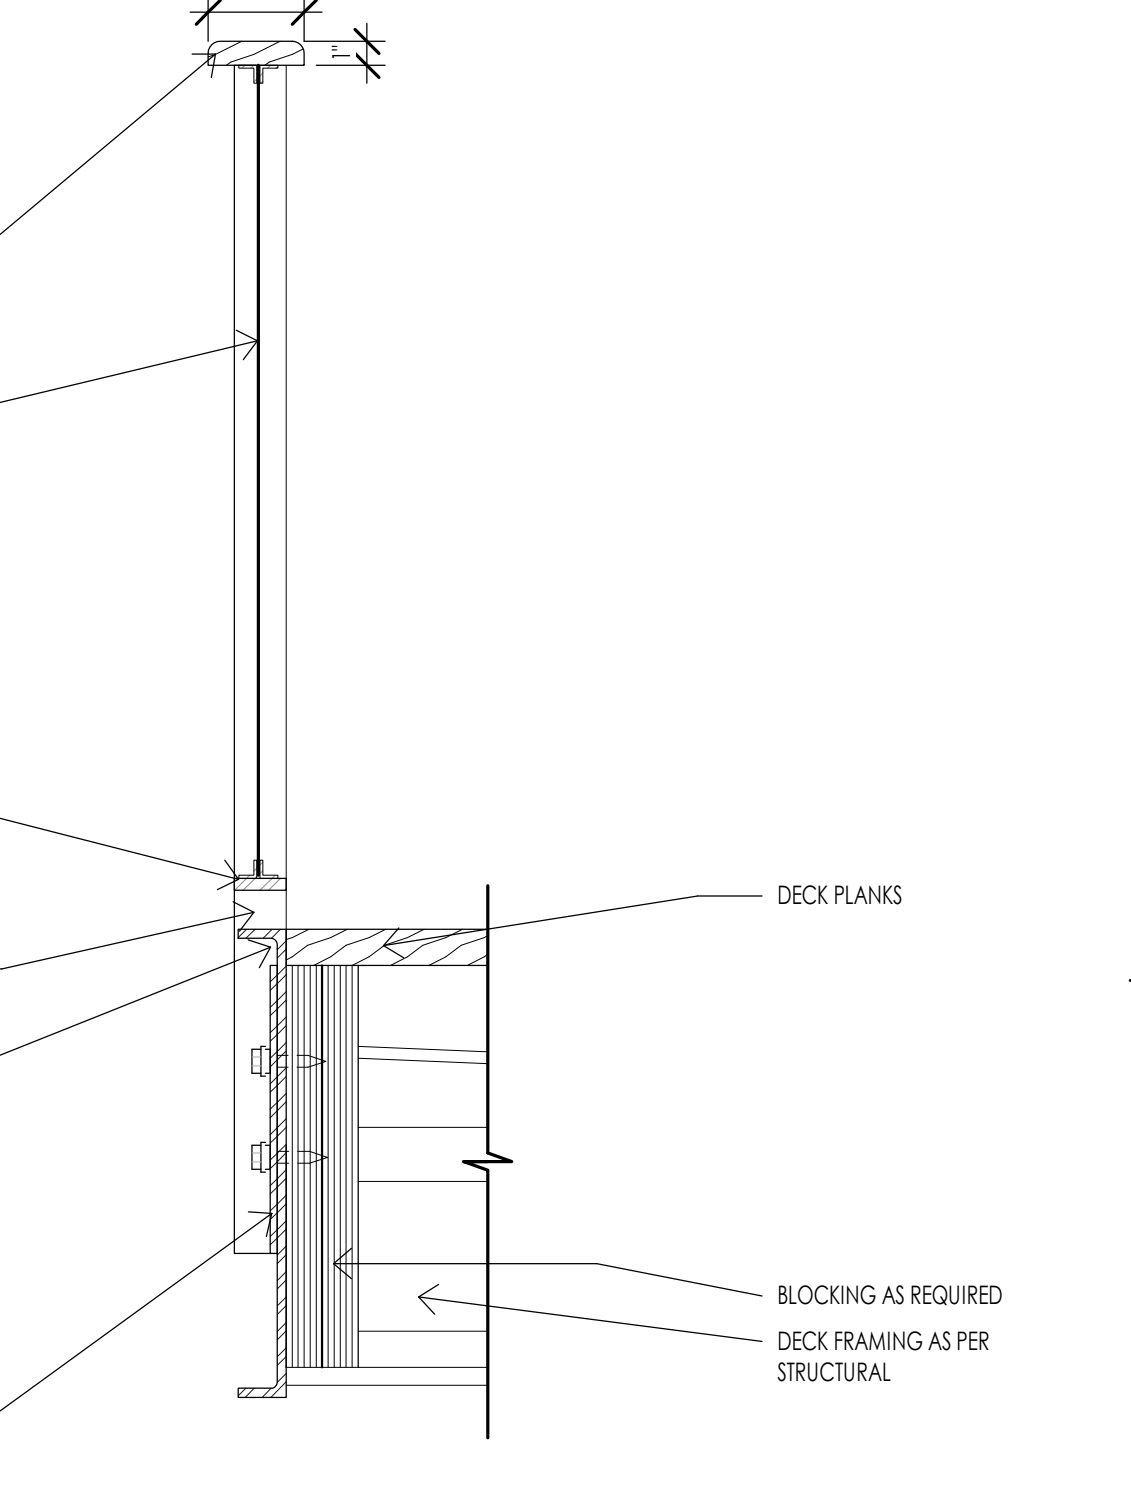


DECK - STEEL BEAM TO JOIST DETAIL 29
1" = 1'-0"

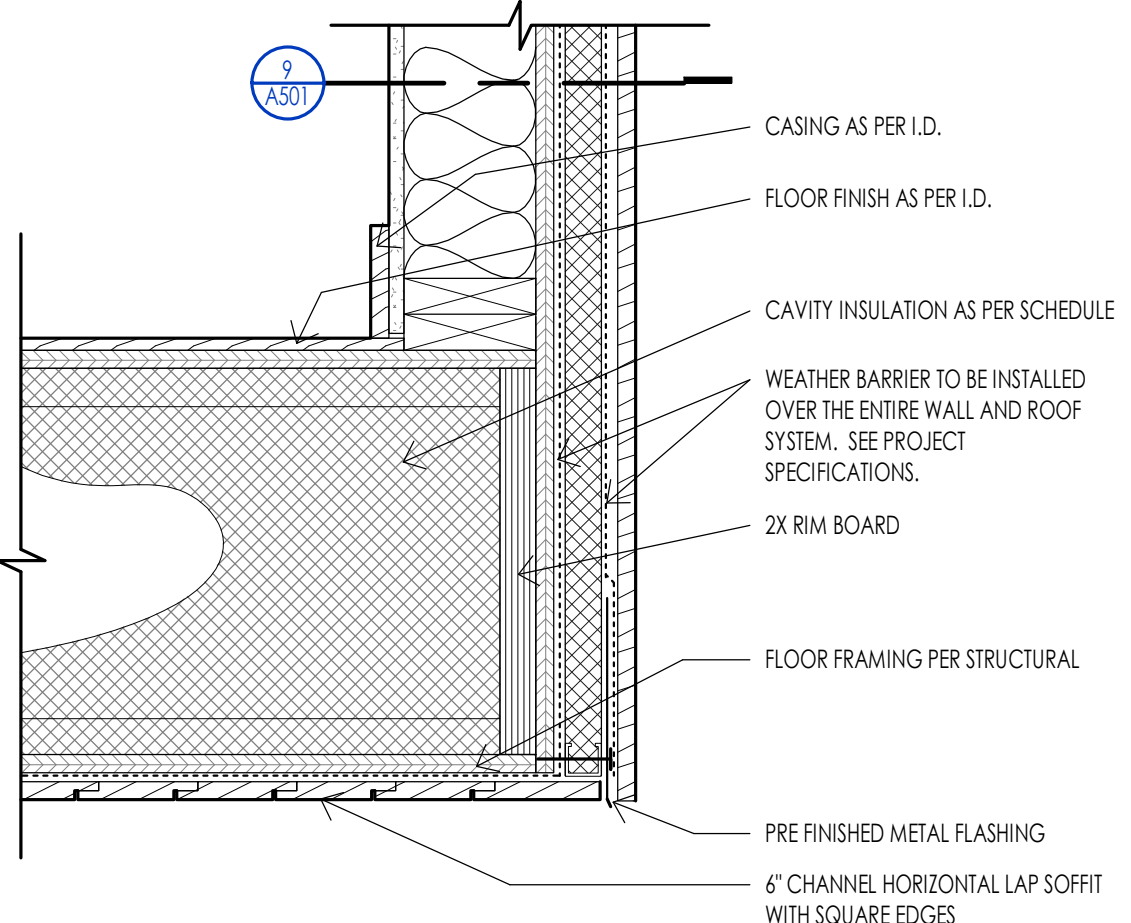



FRAMING - VERTICAL SIDING AT CANTILEVERED FLOOR 19
1 1/2" = 1'-0"

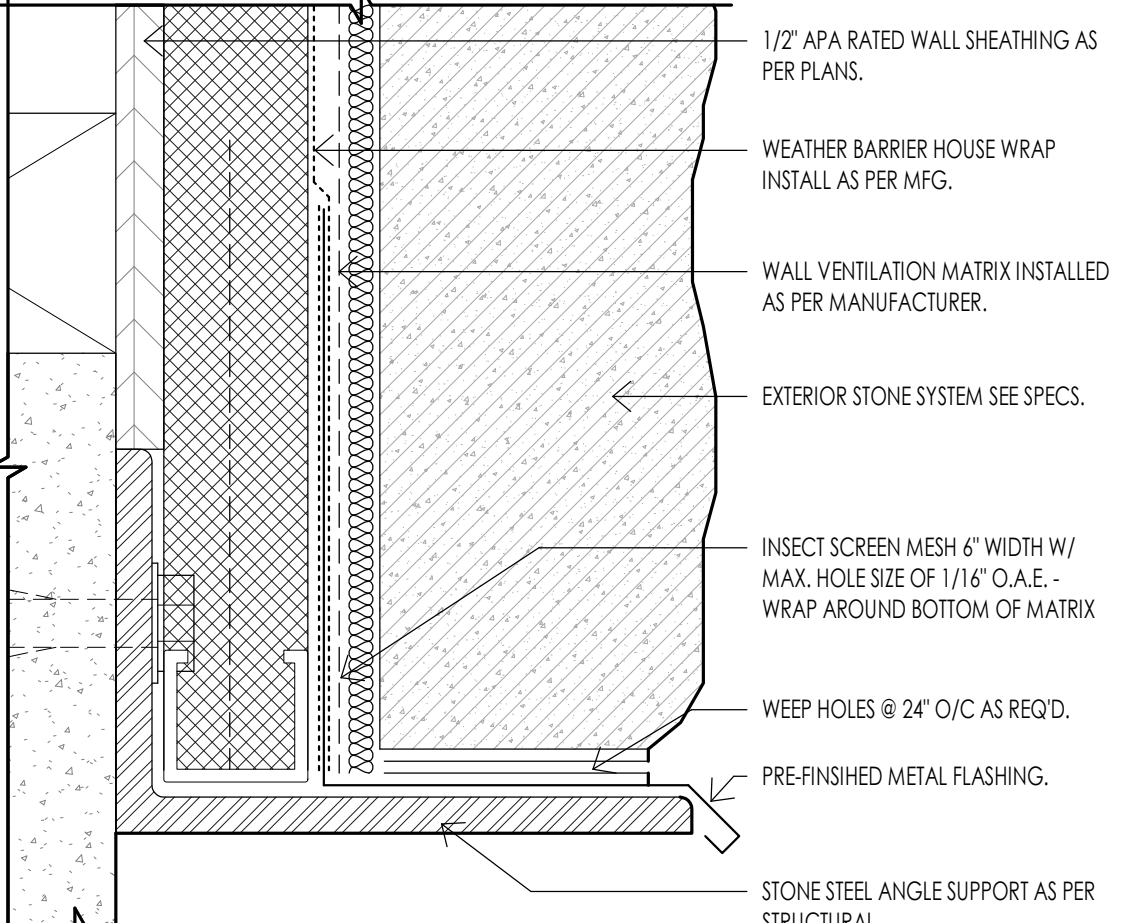


MASONRY - STONE BASE FLASHING 24
6" = 1'-0"

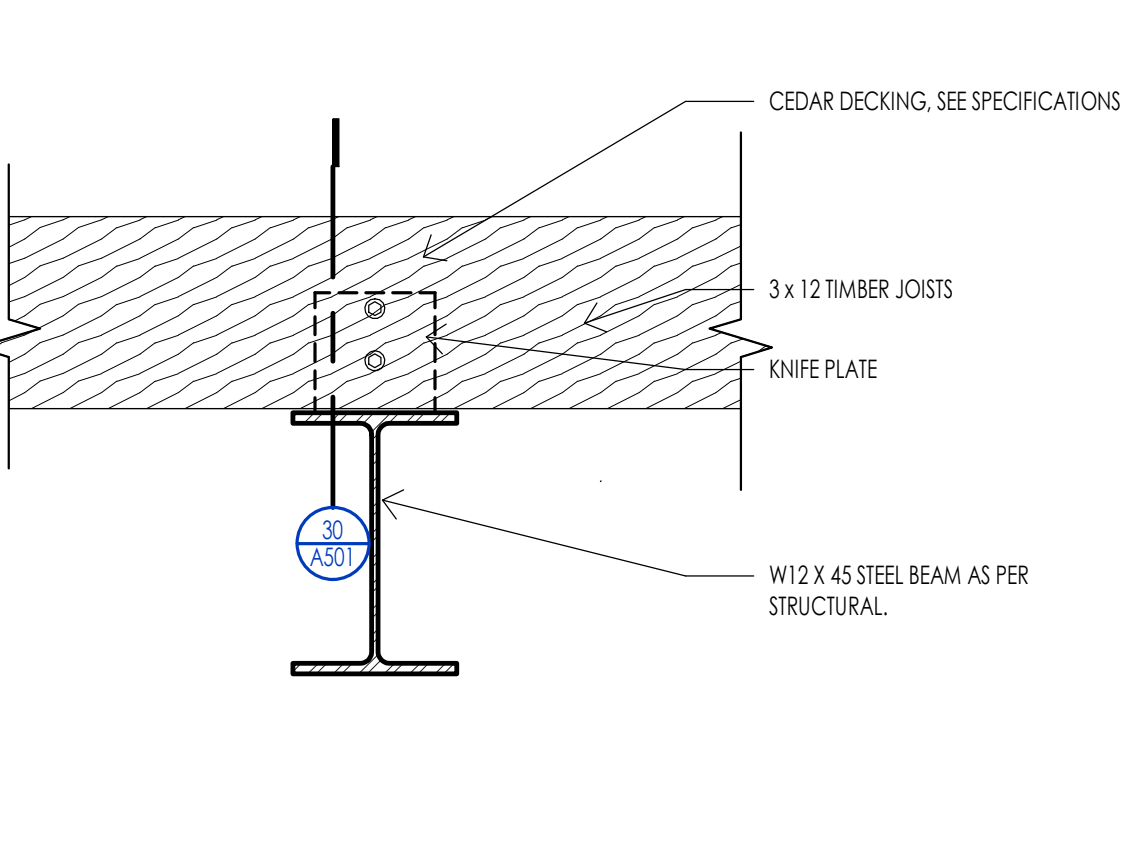


DECK - TYPICAL TIMBER CONNECTION 30
3" = 1'-0"

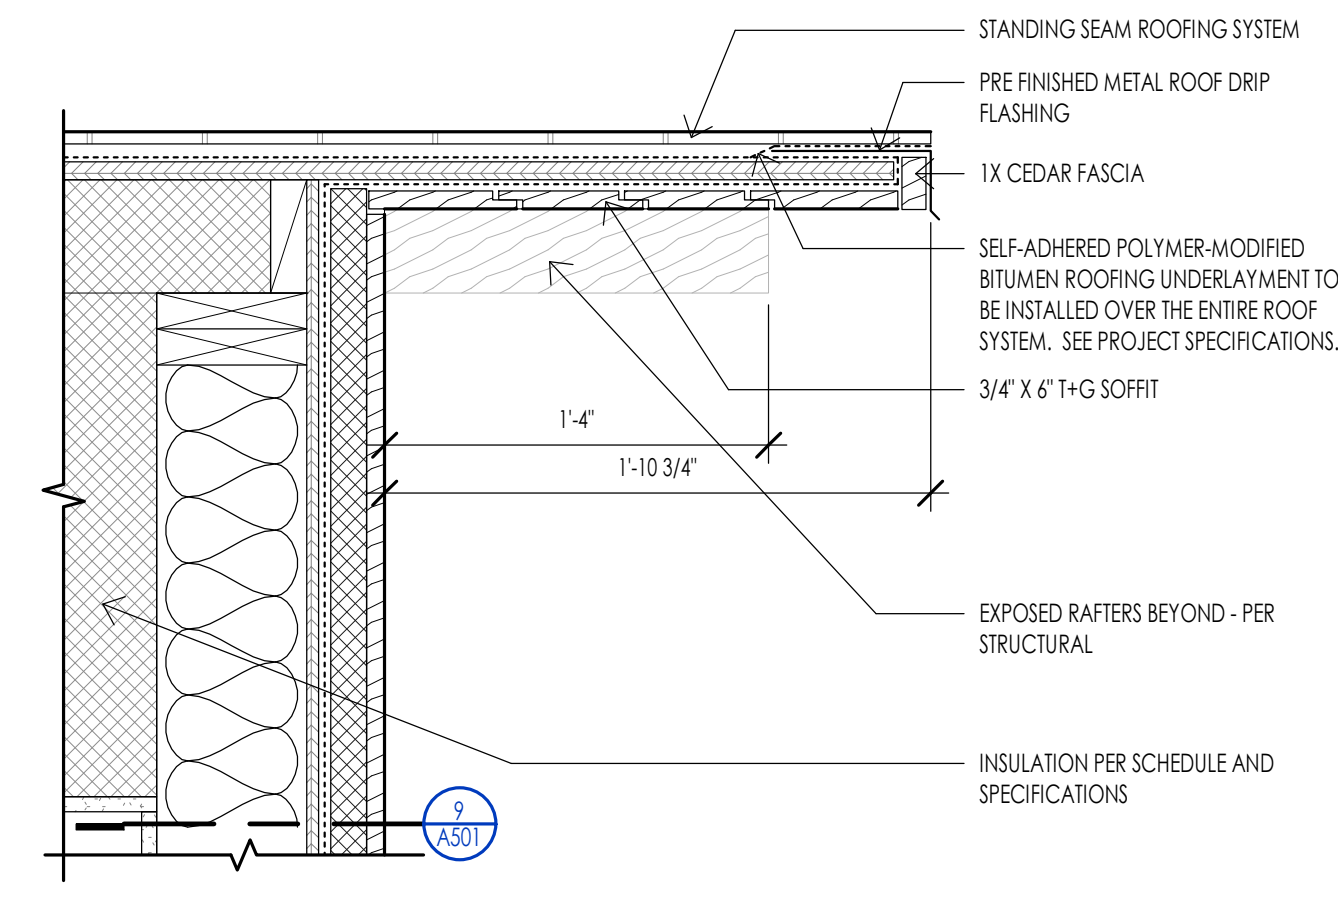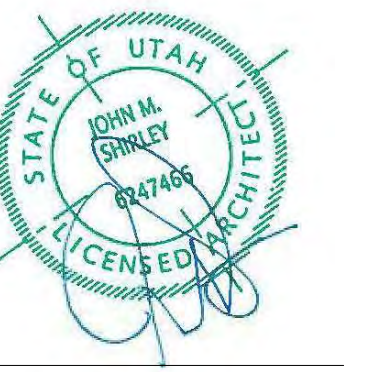


ROOF - RAKE DETAIL
1 1/2" = 1'-0"

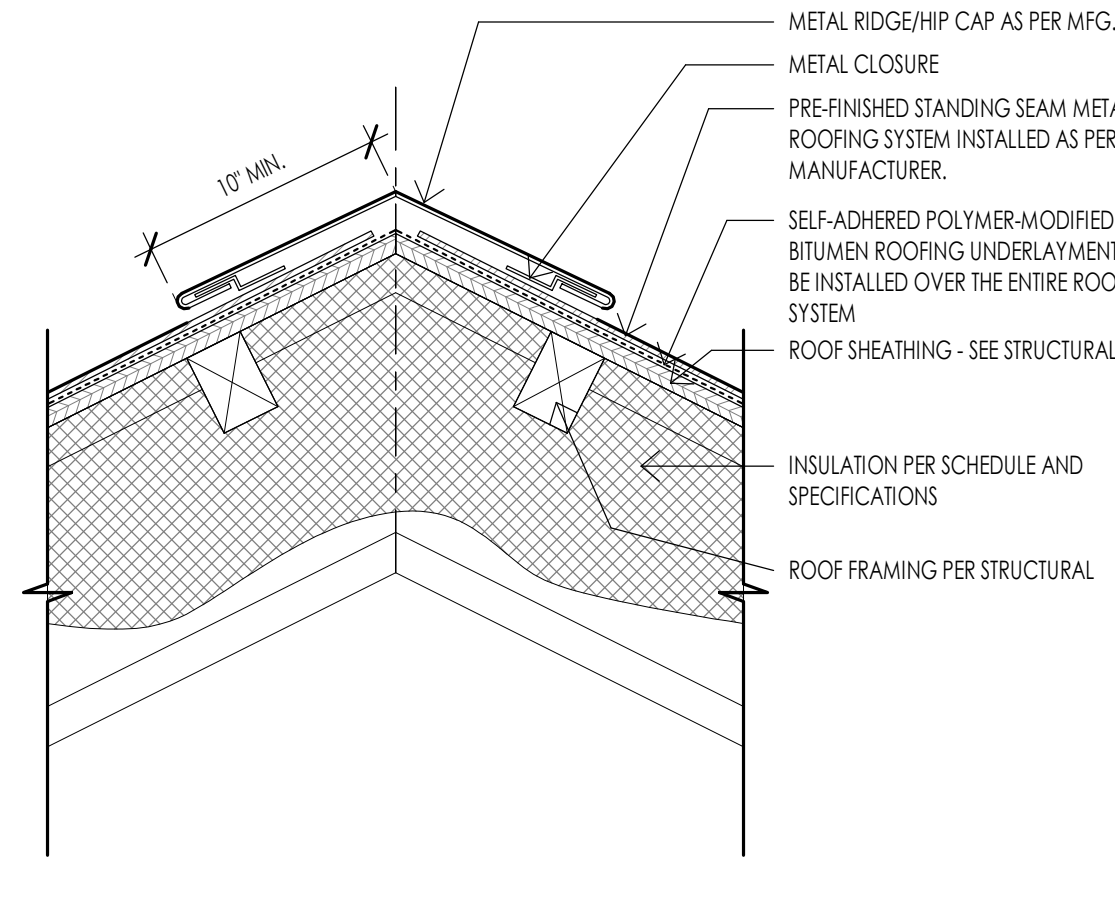


ROOF - STANDING SEAM RIDGE
1 1/2" = 1'-0"

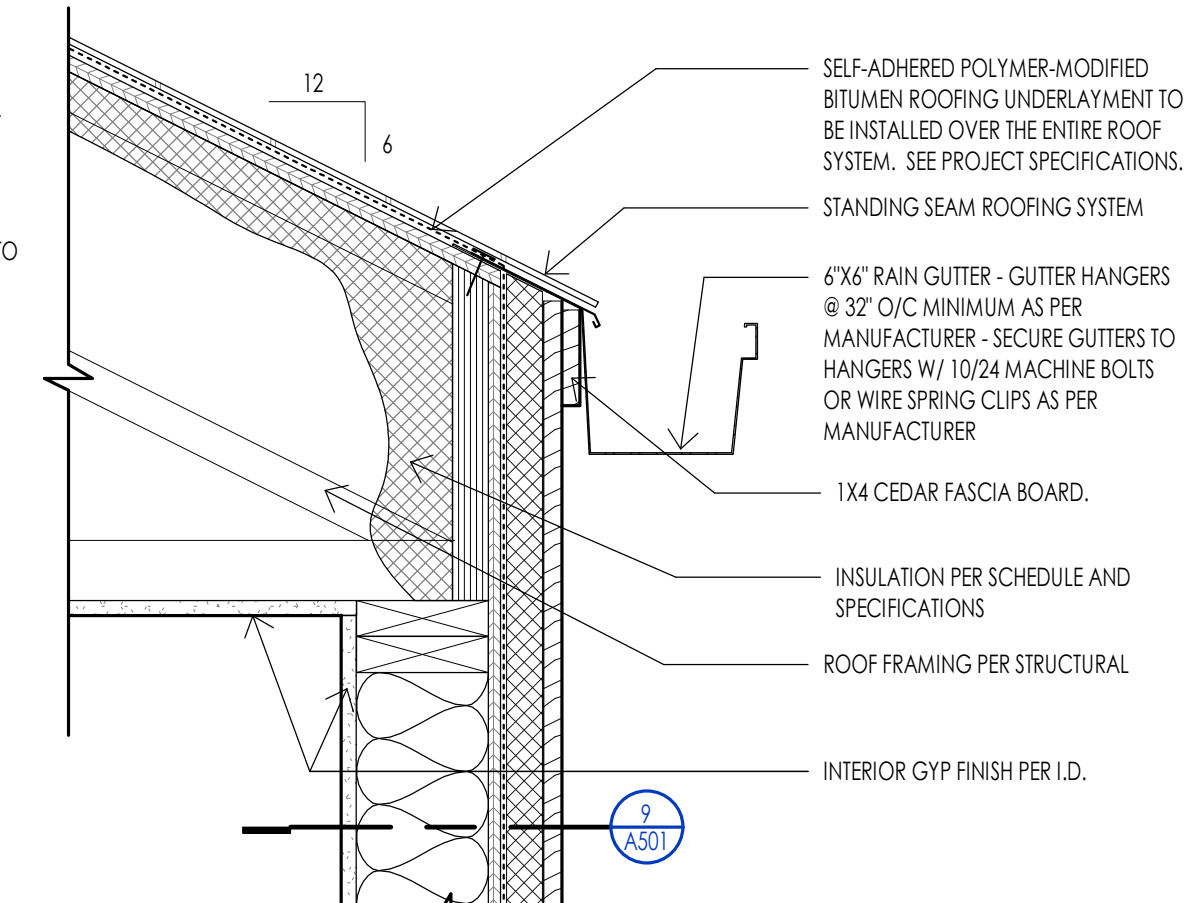


ROOF - 6/12 EAVE DETAIL AT SIDING
1 1/2" = 1'-0"

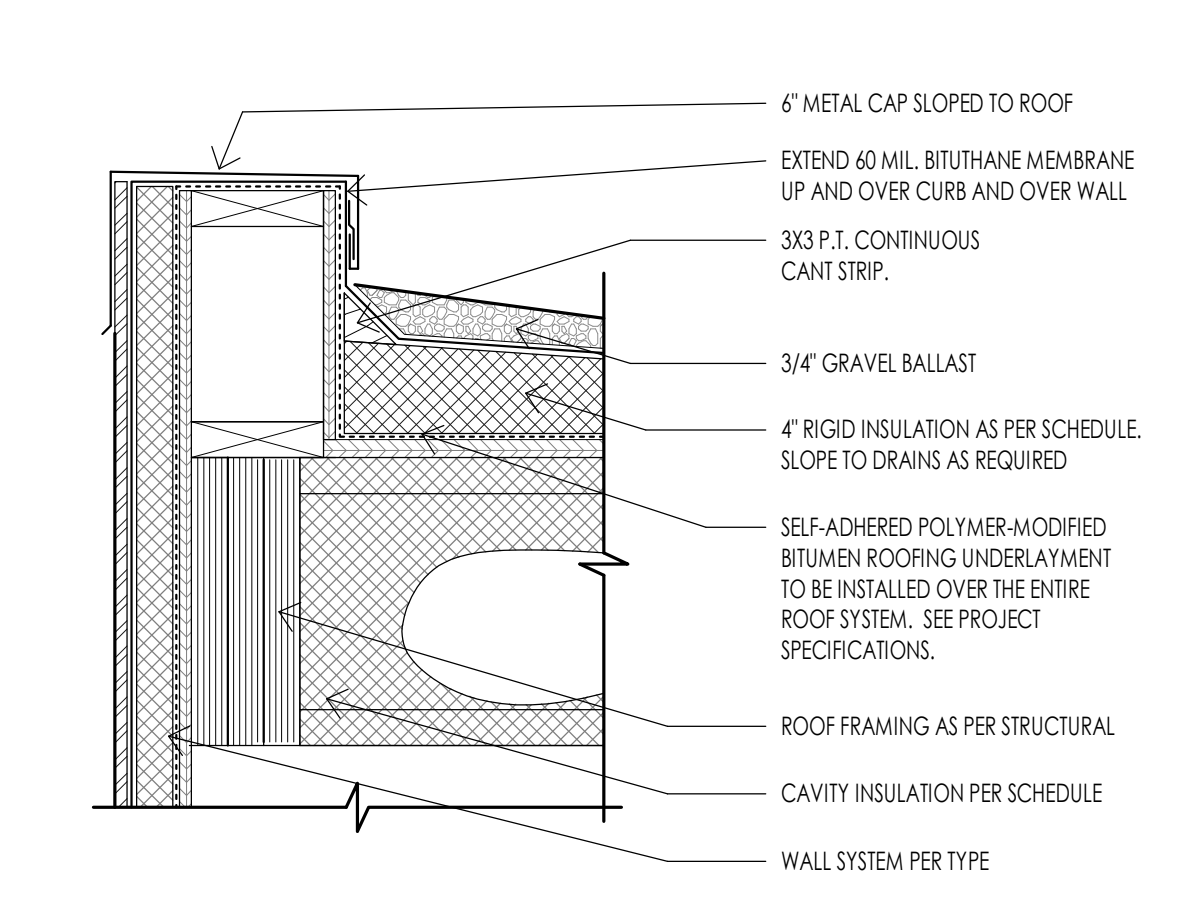


ROOF - METAL SIDING PARAPET TO ROOF
1 1/2" = 1'-0"

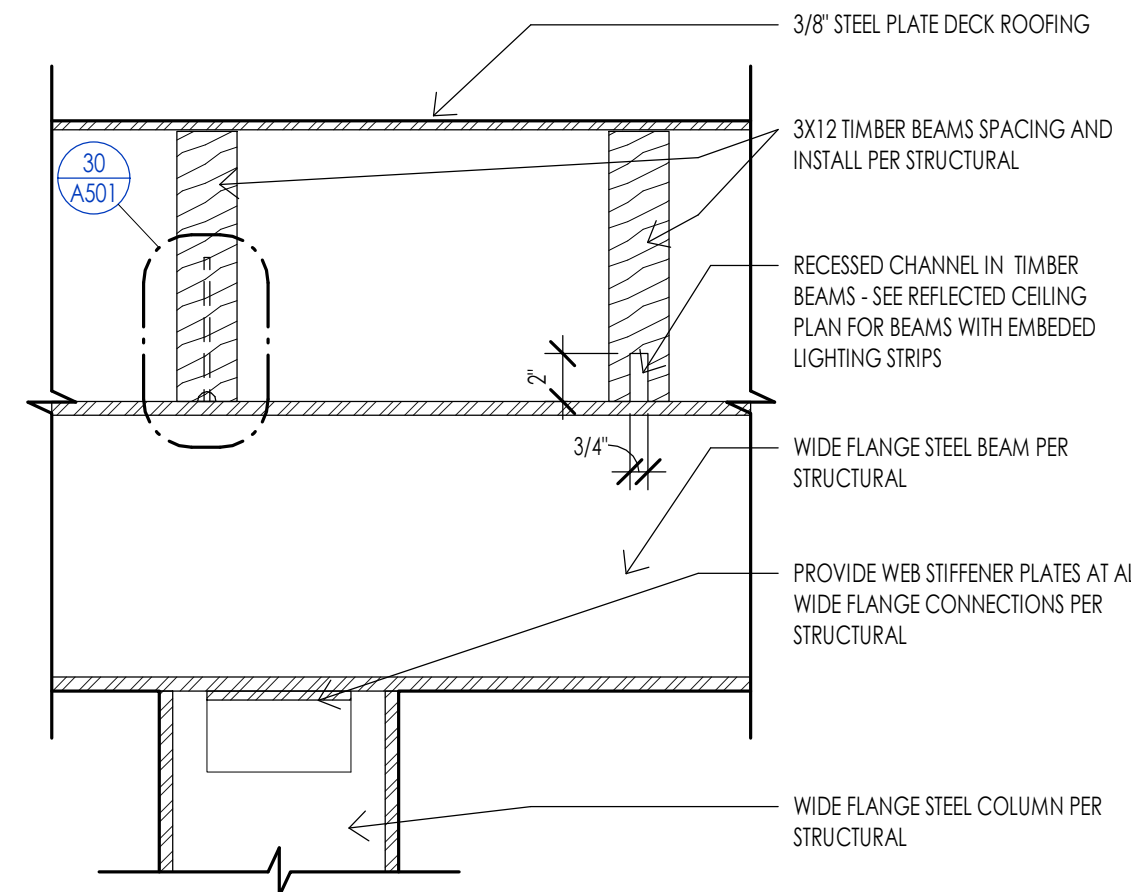


ROOF - DECK AWNING DETAIL
1 1/2" = 1'-0"

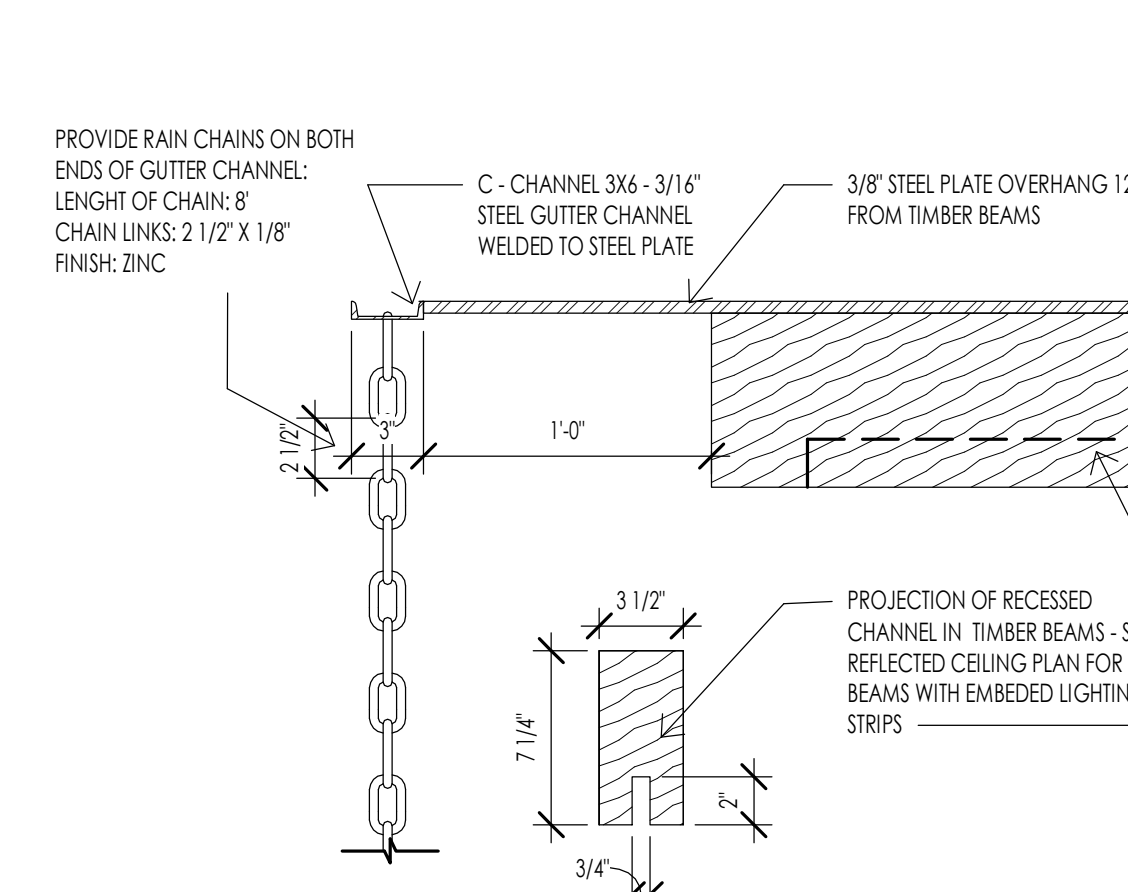


ROOF - ENTRY CANOPY DETAIL
1 1/2" = 1'-0"

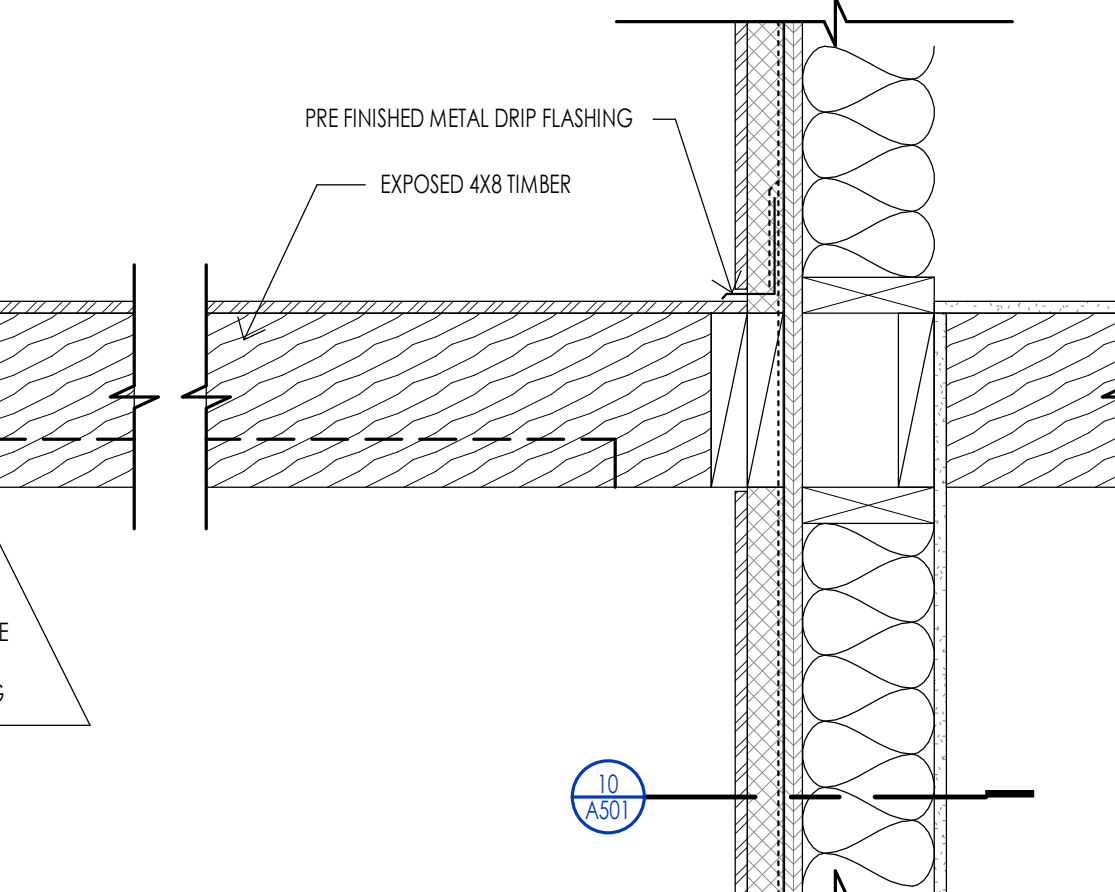


ROOF - STANDING SEAM TRANSITION TO FLAT ROOF
1 1/2" = 1'-0"

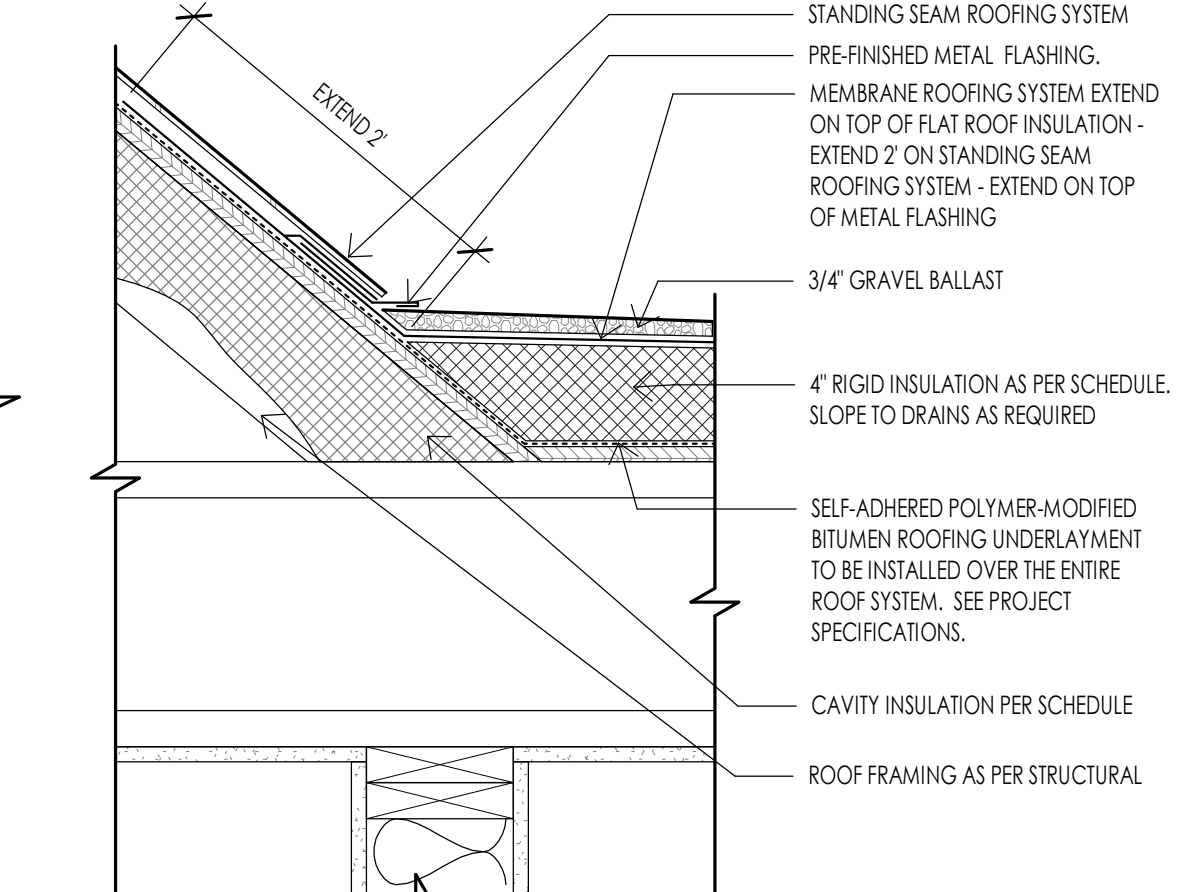

ROOF - STANDING SEAM TRANSITION
1 1/2" = 1'-0"

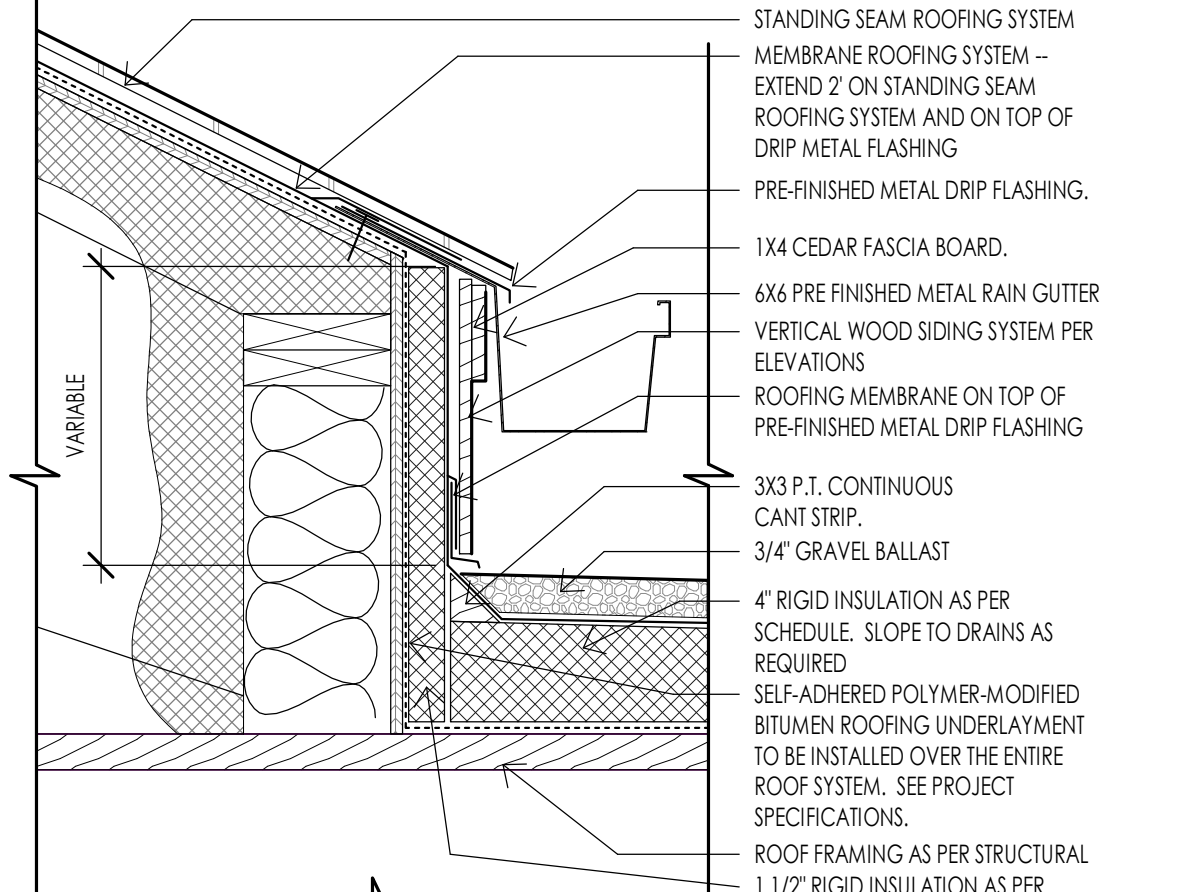

ROOF - DECK AWNING SECTION
1 1/2" = 1'-0"

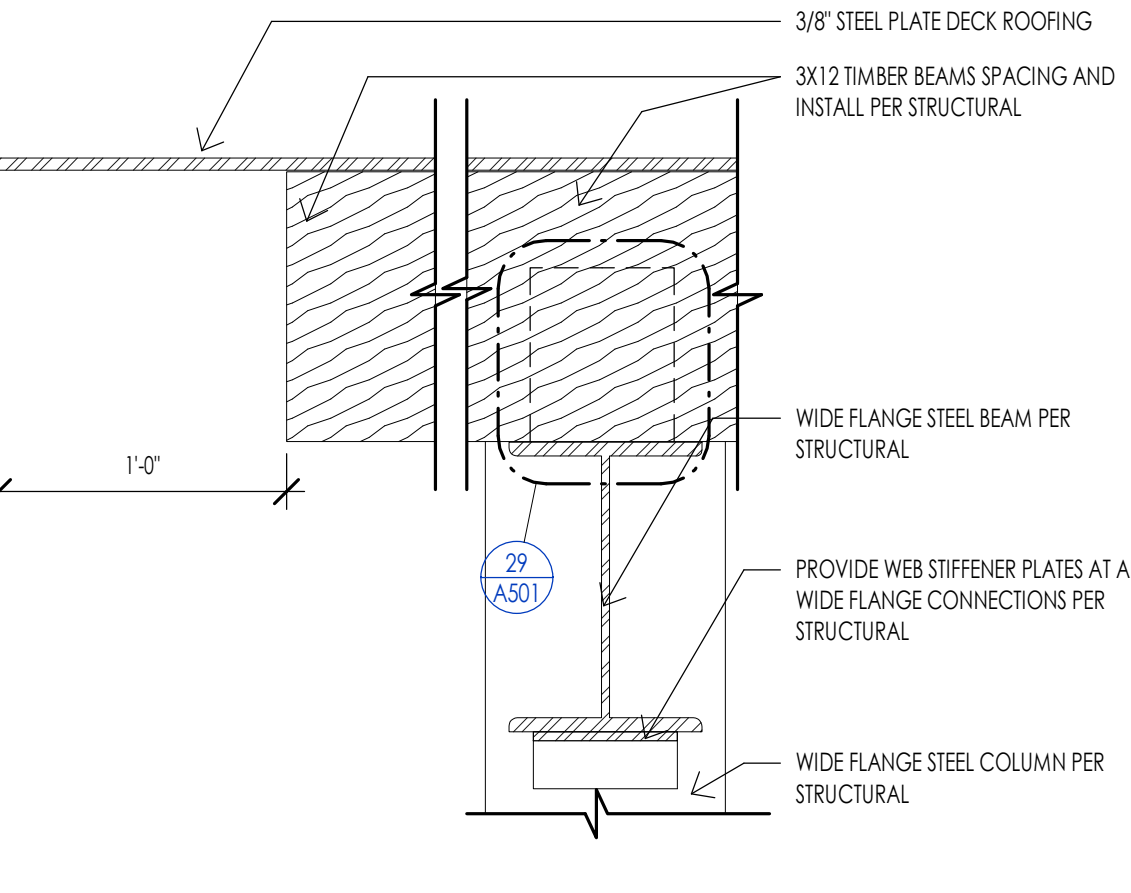


ROOF - DECK AWNING SECTION
1 1/2" = 1'-0"




ROOF - ENLARGED DRAIN DETAIL
1 1/2" = 1'-0"



ROOF - CHIMNEY TYPICAL FRAMING
1" = 1'-0"

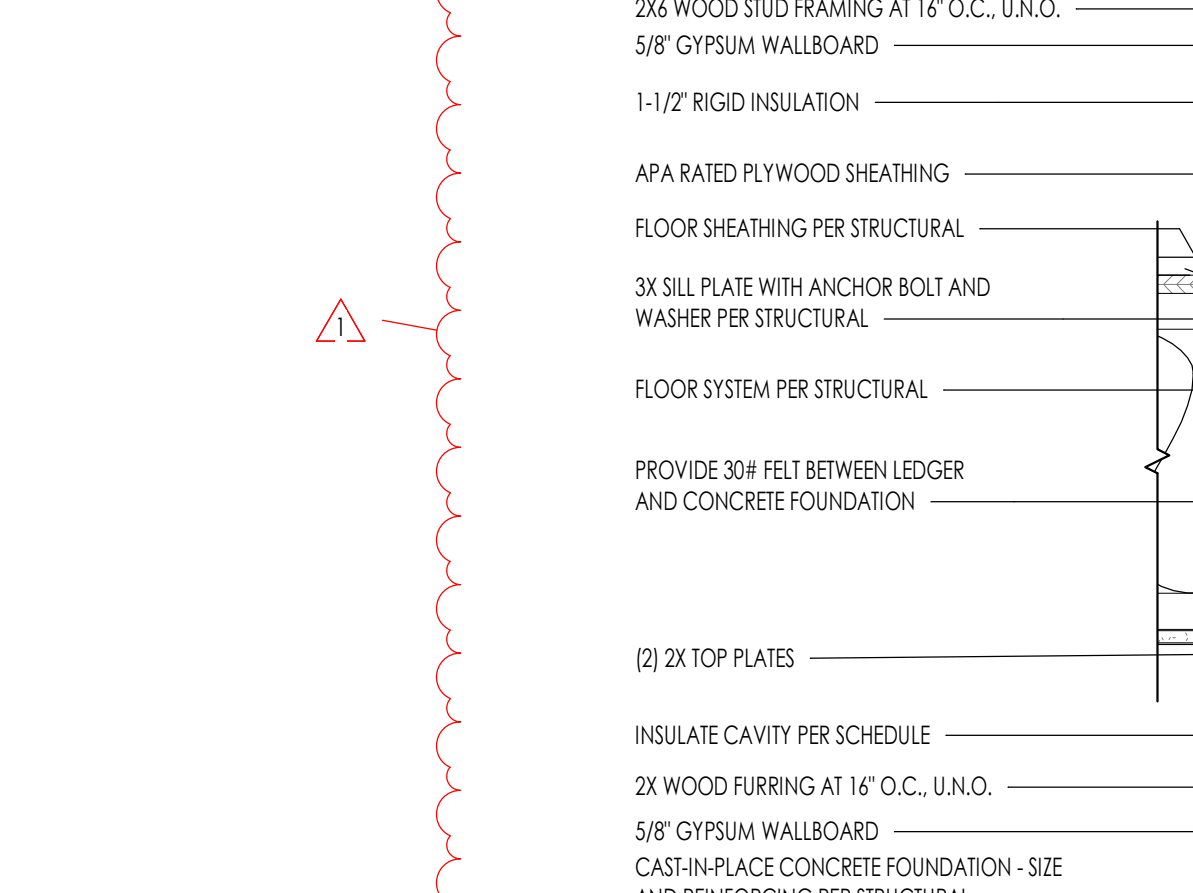


ROOF - OPEN SIDE CHIMNEY CAP DETAIL
1" = 1'-0"

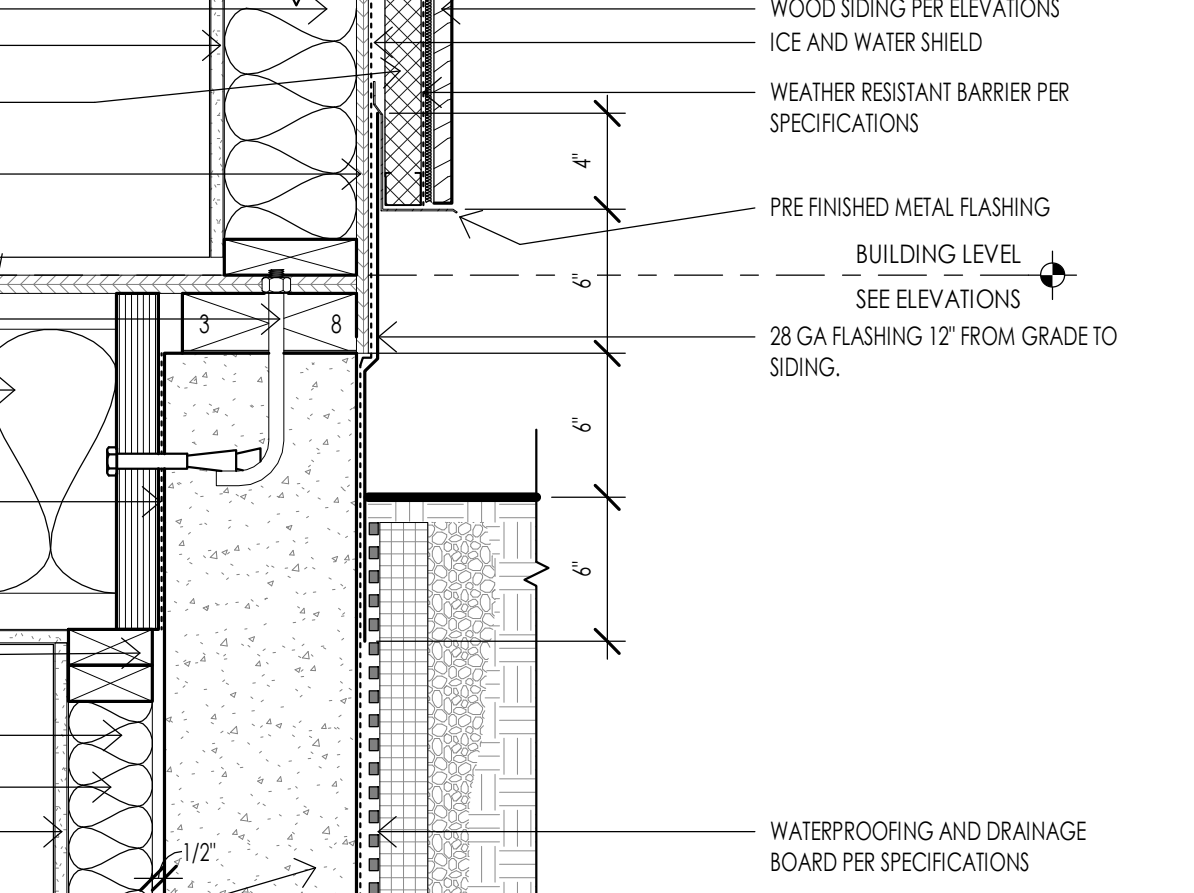


FRAMING - FLASHING DETAIL - SIDING AT GRADE
1 1/2" = 1'-0"




ROOF - DRAIN DETAIL
1 1/2" = 1'-0"

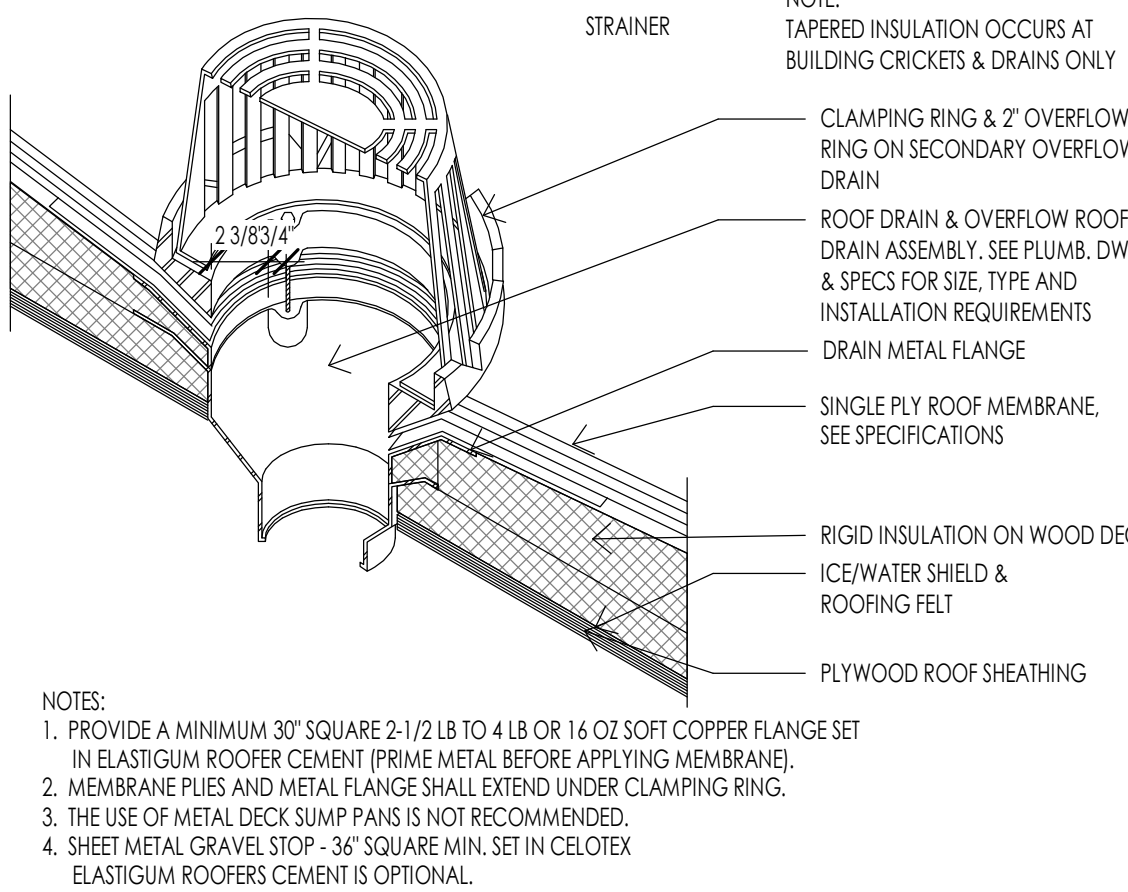


ROOF - DRAIN SECTION
1" = 1'-0"

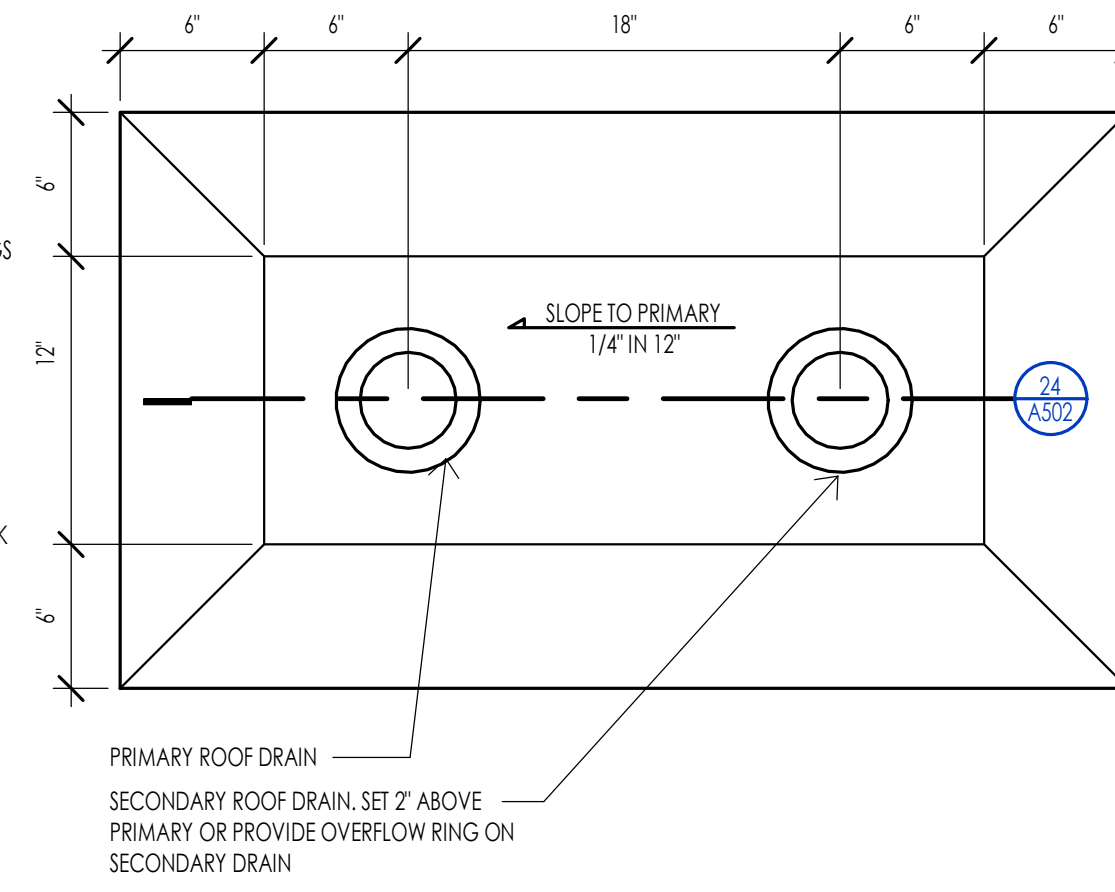

ROOF - ENLARGED DRAIN DETAIL
1 1/2" = 1'-0"

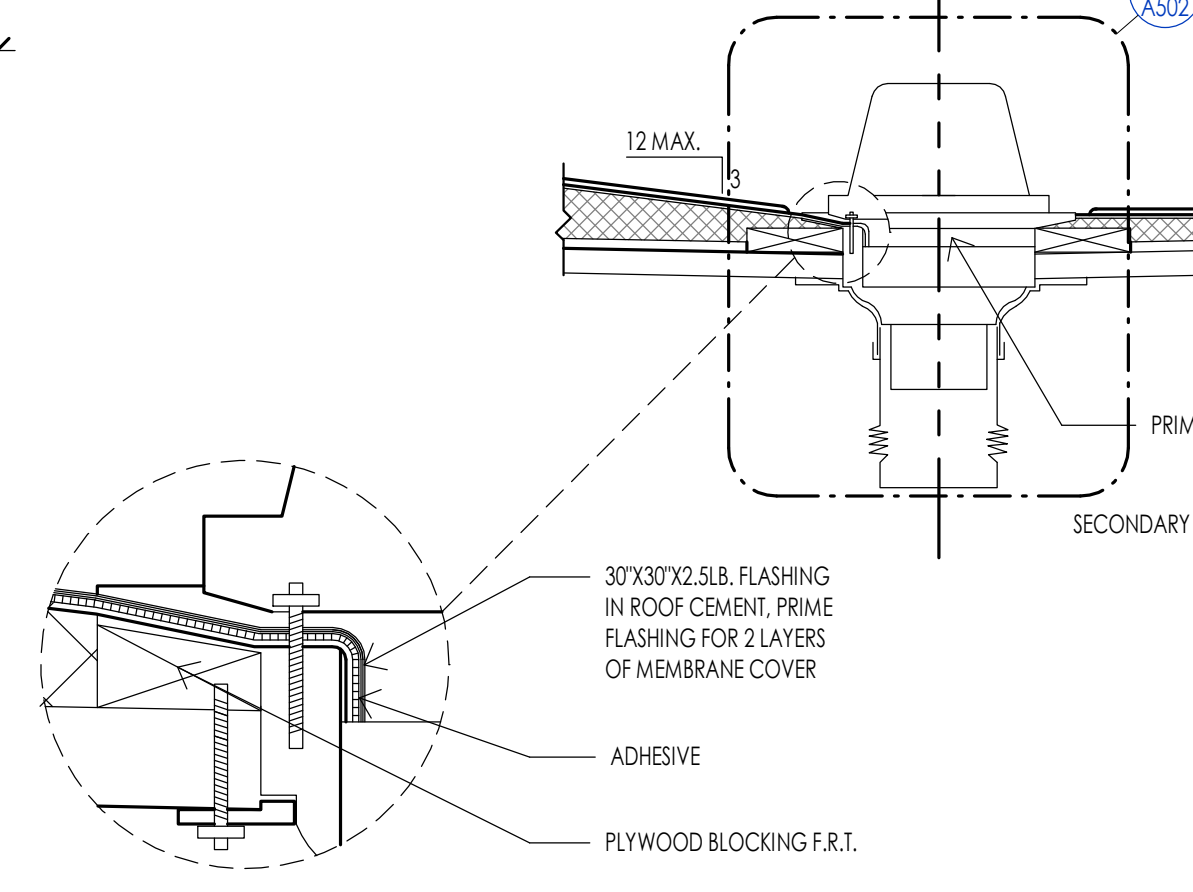


ROOF - DRAIN SECTION
1" = 1'-0"

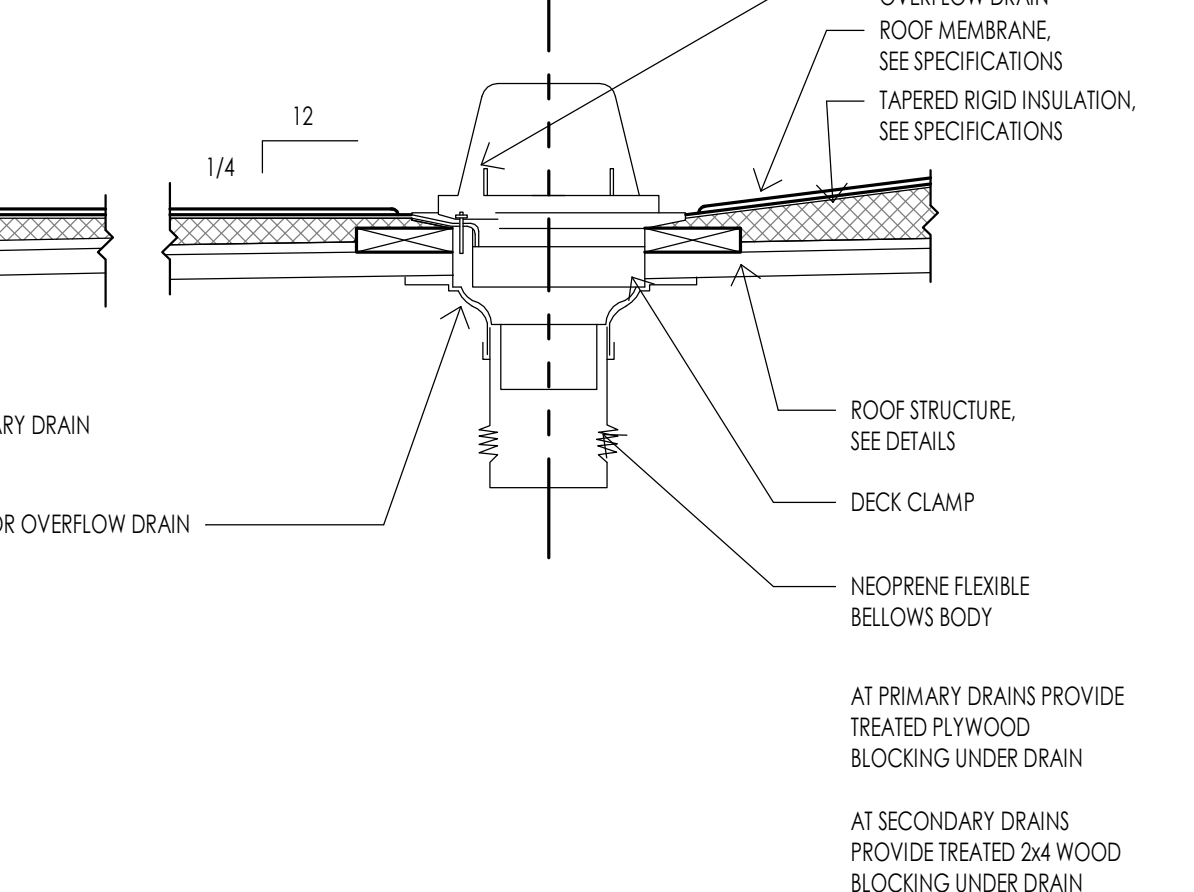


ROOF - DRAIN SECTION
1" = 1'-0"




ROOF - DRAIN DETAIL
1 1/2" = 1'-0"

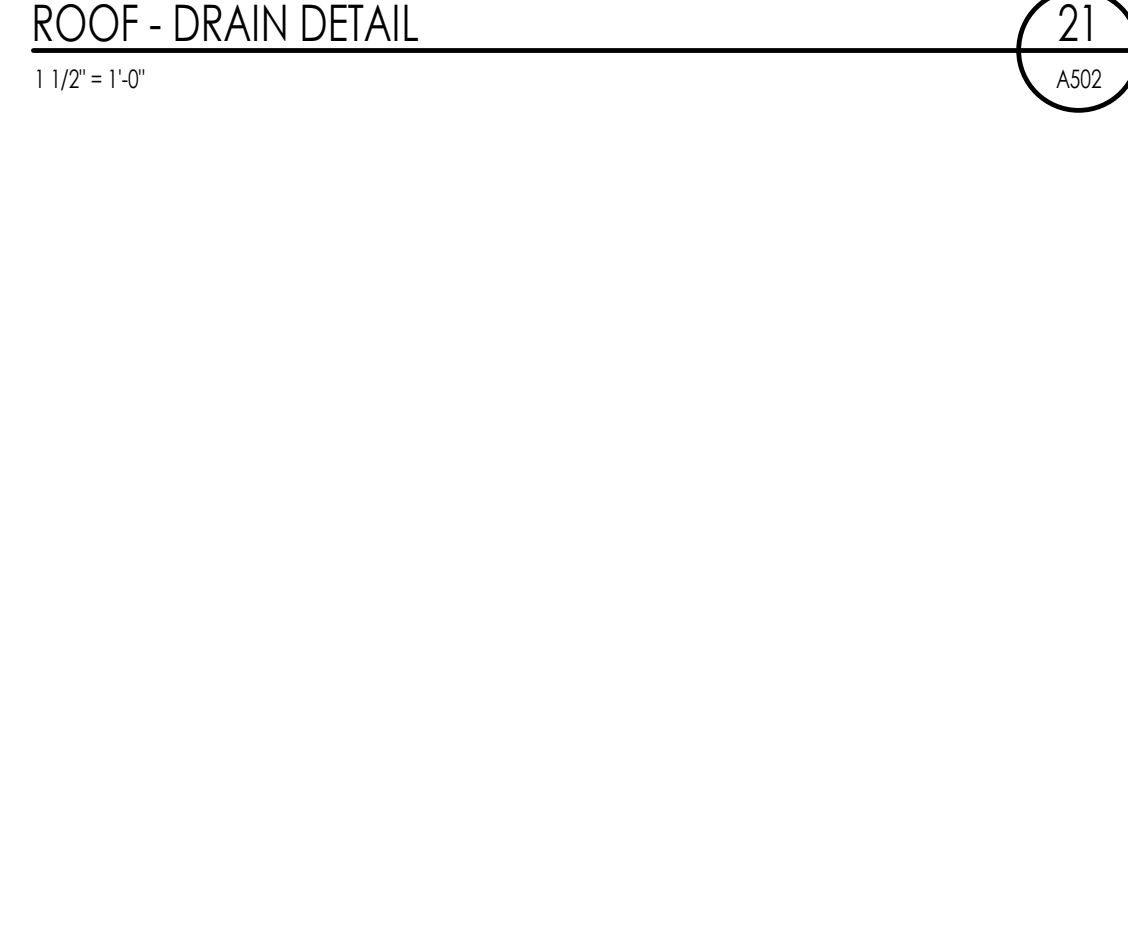


ROOF - ENLARGED DRAIN DETAIL
1 1/2" = 1'-0"

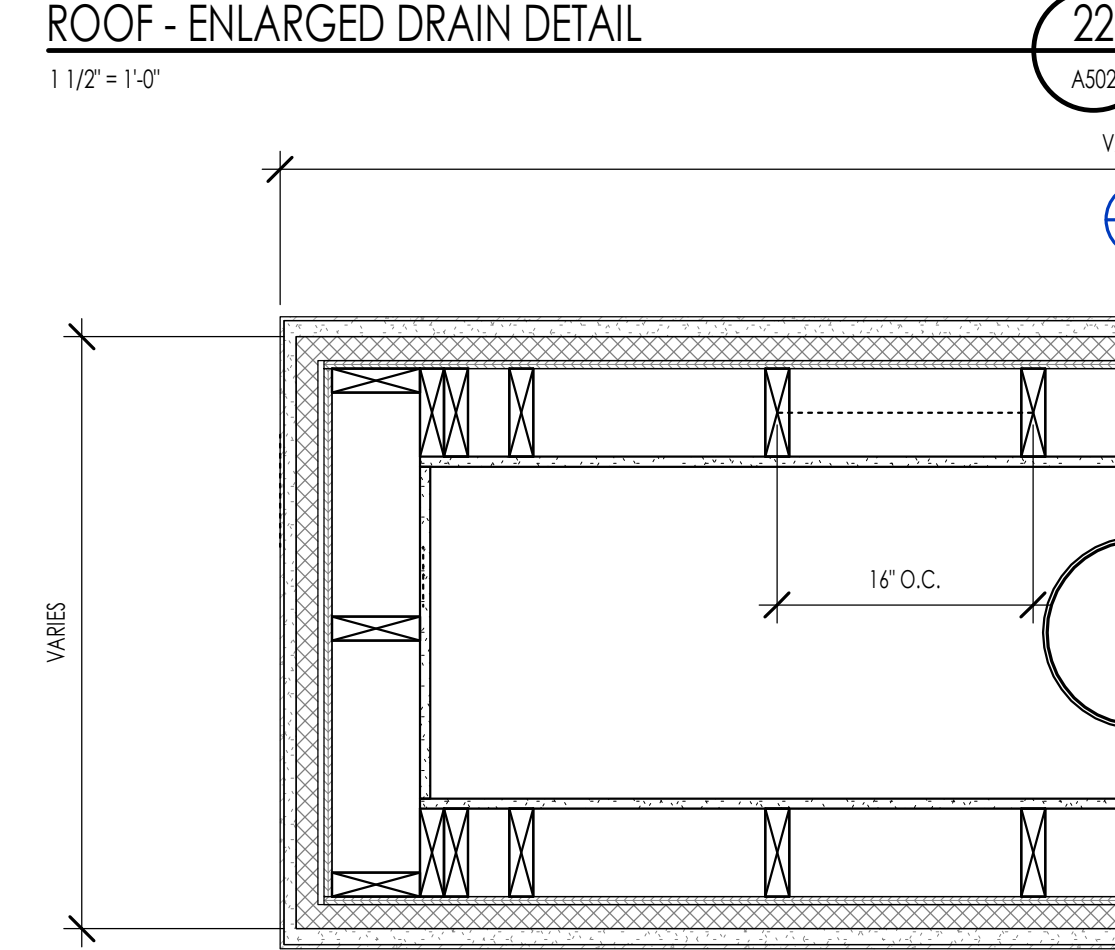

ROOF - CHIMNEY TYPICAL FRAMING
1" = 1'-0"

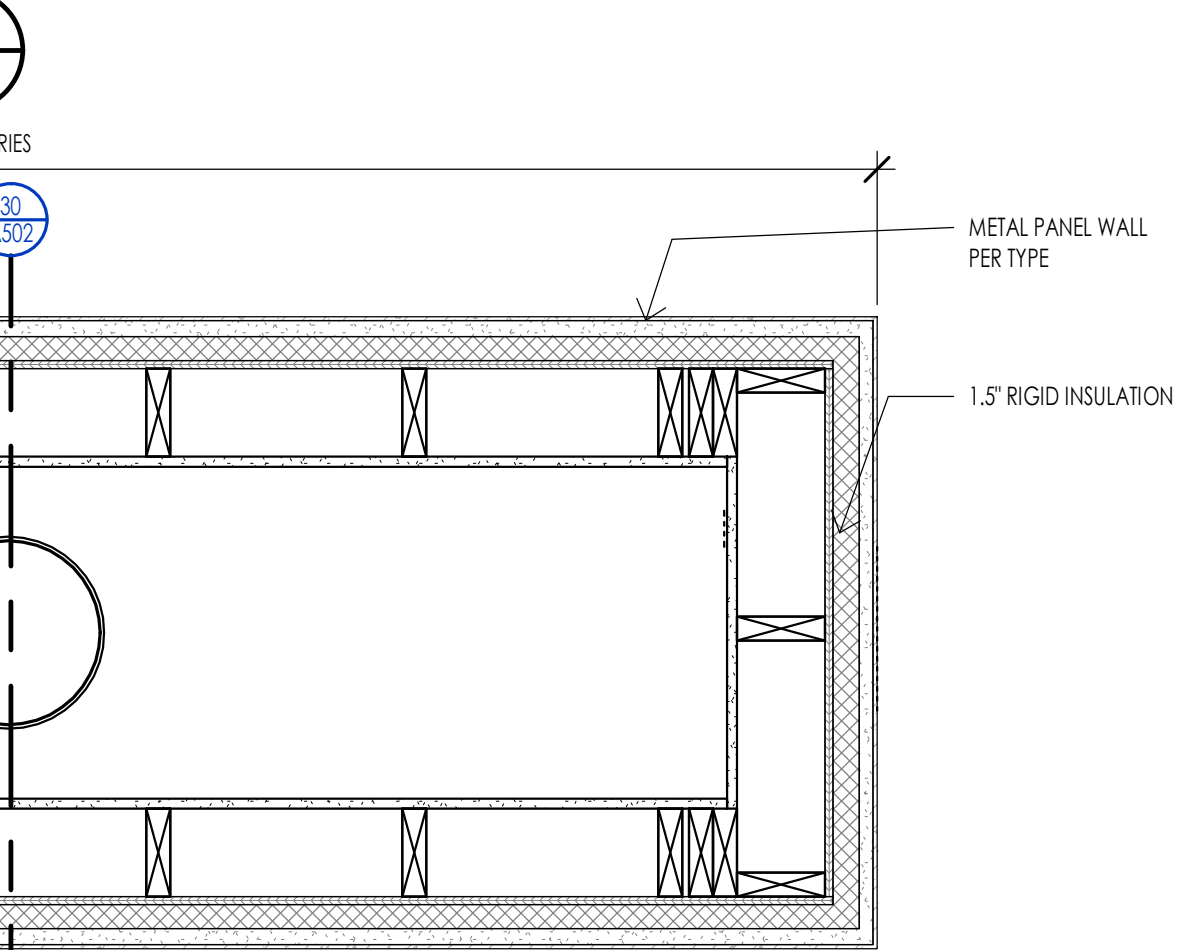

ROOF - OPEN SIDE CHIMNEY CAP DETAIL
1" = 1'-0"

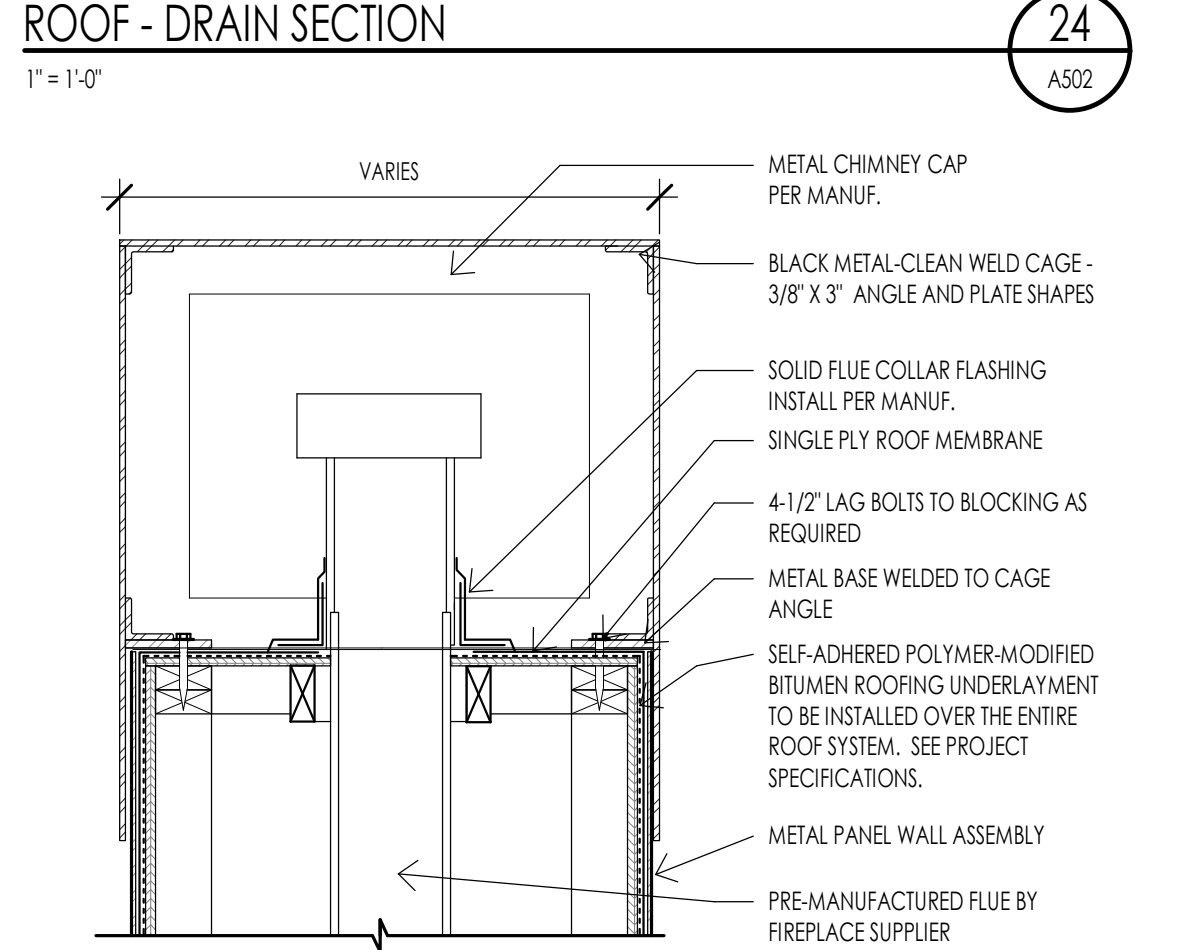





ROOF - OPEN SIDE CHIMNEY CAP DETAIL
1" = 1'-0"



STAIR PLAN GENERAL NOTES

- STAIR CONSTRUCTION SHALL MEET THE FOLLOWING REQUIREMENTS. SEE I.R.C. SECTION R311.5.
 - THE MINIMUM STAIRWAY WIDTH SHALL NOT BE LESS THAN 36 INCHES CLEAR WIDTH. HANDRAILS MAY PROJECT INTO THE REQUIRED WIDTH A DISTANCE OF 4 1/2 INCHES FROM EACH SIDE OF A STAIRWAY. (I.R.C. R311.7.1) FOR ADDITIONAL WIDTH REQUIREMENTS OR FOR SPIRAL, CURVED, WINDING STAIRS, ETC. REQUIREMENTS SEE I.R.C. SECTION R311.7.10.1
 - THE MAXIMUM STAIR RISER HEIGHT SHALL NOT EXCEED 7 3/4 INCHES AND THE MINIMUM STAIR TREAD DEPTH SHALL BE 10 INCHES. THE TREAD DEPTH SHALL BE MEASURED HORIZONTALLY BETWEEN THE VERTICAL PLANES OF THE FOREMOST PROJECTION OF ADJACENT TREADS. THE GREATEST RISER HEIGHT OR TREAD DEPTH SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8 INCH. (UTAH STATE AMENDMENT (REPLACES R311.7.5 AND ALLOWS FOR 8" MAX RISERS AND 9" MIN. TREADS))
 - LANDINGS: EVERY LANDING SHALL HAVE A WIDTH DIMENSION OF NOT LESS THAN THE STAIRWAY SERVED. EVERY LANDING SHALL HAVE A MINIMUM DEPTH DIMENSION OF 36 INCHES MEASURED IN THE DIRECTION OF TRAVEL. FOR LANDINGS WITH ADJOINING DOORS SEE I.R.C. SECTION R311.7.6 FOR SOME EXCEPTIONS/OPTIONS.
 - ENCLOSED ACCESSIBLE SPACE UNDER STAIRS SHALL HAVE WALLS, UNDER STAIR SURFACE AND ANY SOFFITS PROTECTED ON THE ENCLOSED SIDE WITH 1/2 INCH GYPSUM BOARD. (I.R.C. R302.7)
 - HEADROOM: EVERY STAIRWAY SHALL HAVE A MINIMUM HEADROOM CLEARANCE IN ALL PARTS OF THE STAIR OF NOT LESS THAN 6 FEET 8 INCHES. SUCH CLEARANCES SHALL BE MEASURED VERTICALLY FROM THE SLOPED PLANE ADJOINING THE TREAD NOSING OR FROM THE FLOOR SURFACE OF THE LANDING. (I.R.C. R311.7.2)
- HEADROOM: EVERY STAIRWAY SHALL HAVE A MINIMUM HEADROOM CLEARANCE IN ALL PARTS OF THE STAIR OF NOT LESS THAN 6 FEET 8 INCHES. SUCH CLEARANCES SHALL BE MEASURED VERTICALLY FROM THE SLOPED PLANE ADJOINING THE TREAD NOSING OR FROM THE FLOOR SURFACE OF THE LANDING. (I.R.C. R311.7.2)
 - HANDRAILS SHALL BE MOUNTED A MINIMUM OF 34 INCHES AND A MAXIMUM OF 38 INCHES ABOVE THE NOSING OF THE TREAD AND SHALL BE PROVIDED ON AT LEAST ONE SIDE OF STAIRWAYS. ALL REQUIRED HANDRAILS SHALL BE CONTINUOUS THE FULL LENGTH OF THE STAIRS WITH FOUR OR MORE RISERS FROM A POINT DIRECTLY ABOVE THE TOP RISER OF THE FLIGHT TO A POINT DIRECTLY ABOVE THE LOWEST RISER. BARS SHALL BE RETURNED OR SHALL TERMINATE IN NEVEL FLOORS, VOLUTES, TURNOUT OR STARTING EASING SHALL BE ALLOWED OVER THE LOWEST TREAD.
 - THE HAND GRIP PORTION OF HANDRAILS SHALL HAVE A CIRCULAR CROSS SECTION OF 1 1/4 INCHES MINIMUM TO 2 5/8 INCHES MAXIMUM. OTHER HANDRAIL SHAPES THAT HAVE AN EQUIVALENT GRASPING SURFACE ARE PERMISSIBLE. SEE BUILDING CODE. EDGES SHALL HAVE A MINIMUM RADIUS OF 0.031 INCH. R311.7.8.3.
 - HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE OF NOT LESS THAN 1 1/2 INCHES BETWEEN THE WALL AND THE HANDRAIL.
- GUARD RAILS SHALL MEET THE FOLLOWING REQUIREMENTS. SEE I.R.C. SECTION R312.
 - GUARDRAILS ARE REQUIRED AT ALL PORCHES, BALCONIES OR RAISED FLOOR SURFACES LOCATED MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW AND SHALL BE NOT LESS THAN 36 INCHES IN HEIGHT. OPEN SIDES OF STAIRS WITH A TOTAL RISE OF MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW SHALL HAVE GUARDS NOT LESS THAN 34 INCHES IN HEIGHT MEASURED VERTICALLY FROM THE NOSING OF THE TREAD.
 - REQUIRED GUARDS ON OPEN SIDES OF STAIRWAYS, RAISED FLOOR AREAS, BALCONIES, ETC. SHALL HAVE INTERMEDIATE RAILS OR ORNAMENTAL CLOSURES THAT DO NOT ALLOW PASSAGE OF A SPHERE 4 INCHES IN DIAMETER.
 - THE TRIANGLE OPENINGS FORMED BY THE RISER, TREAD AND BOTTOM RAIL OF A GUARD AT THE OPEN SIDE OF A STAIRWAY ARE PERMITTED TO BE OF SUCH A SIZE THAT A SPHERE 6 INCHES IN DIAMETER CANNOT PASS THROUGH.
 - THE GUARDS AT SIDES OF STAIRS SHALL HAVE GUARD SUCH THAT A 4-3/8" SPHERE CANNOT PASS THROUGH IT.

STAIR PLAN KEYNOTES

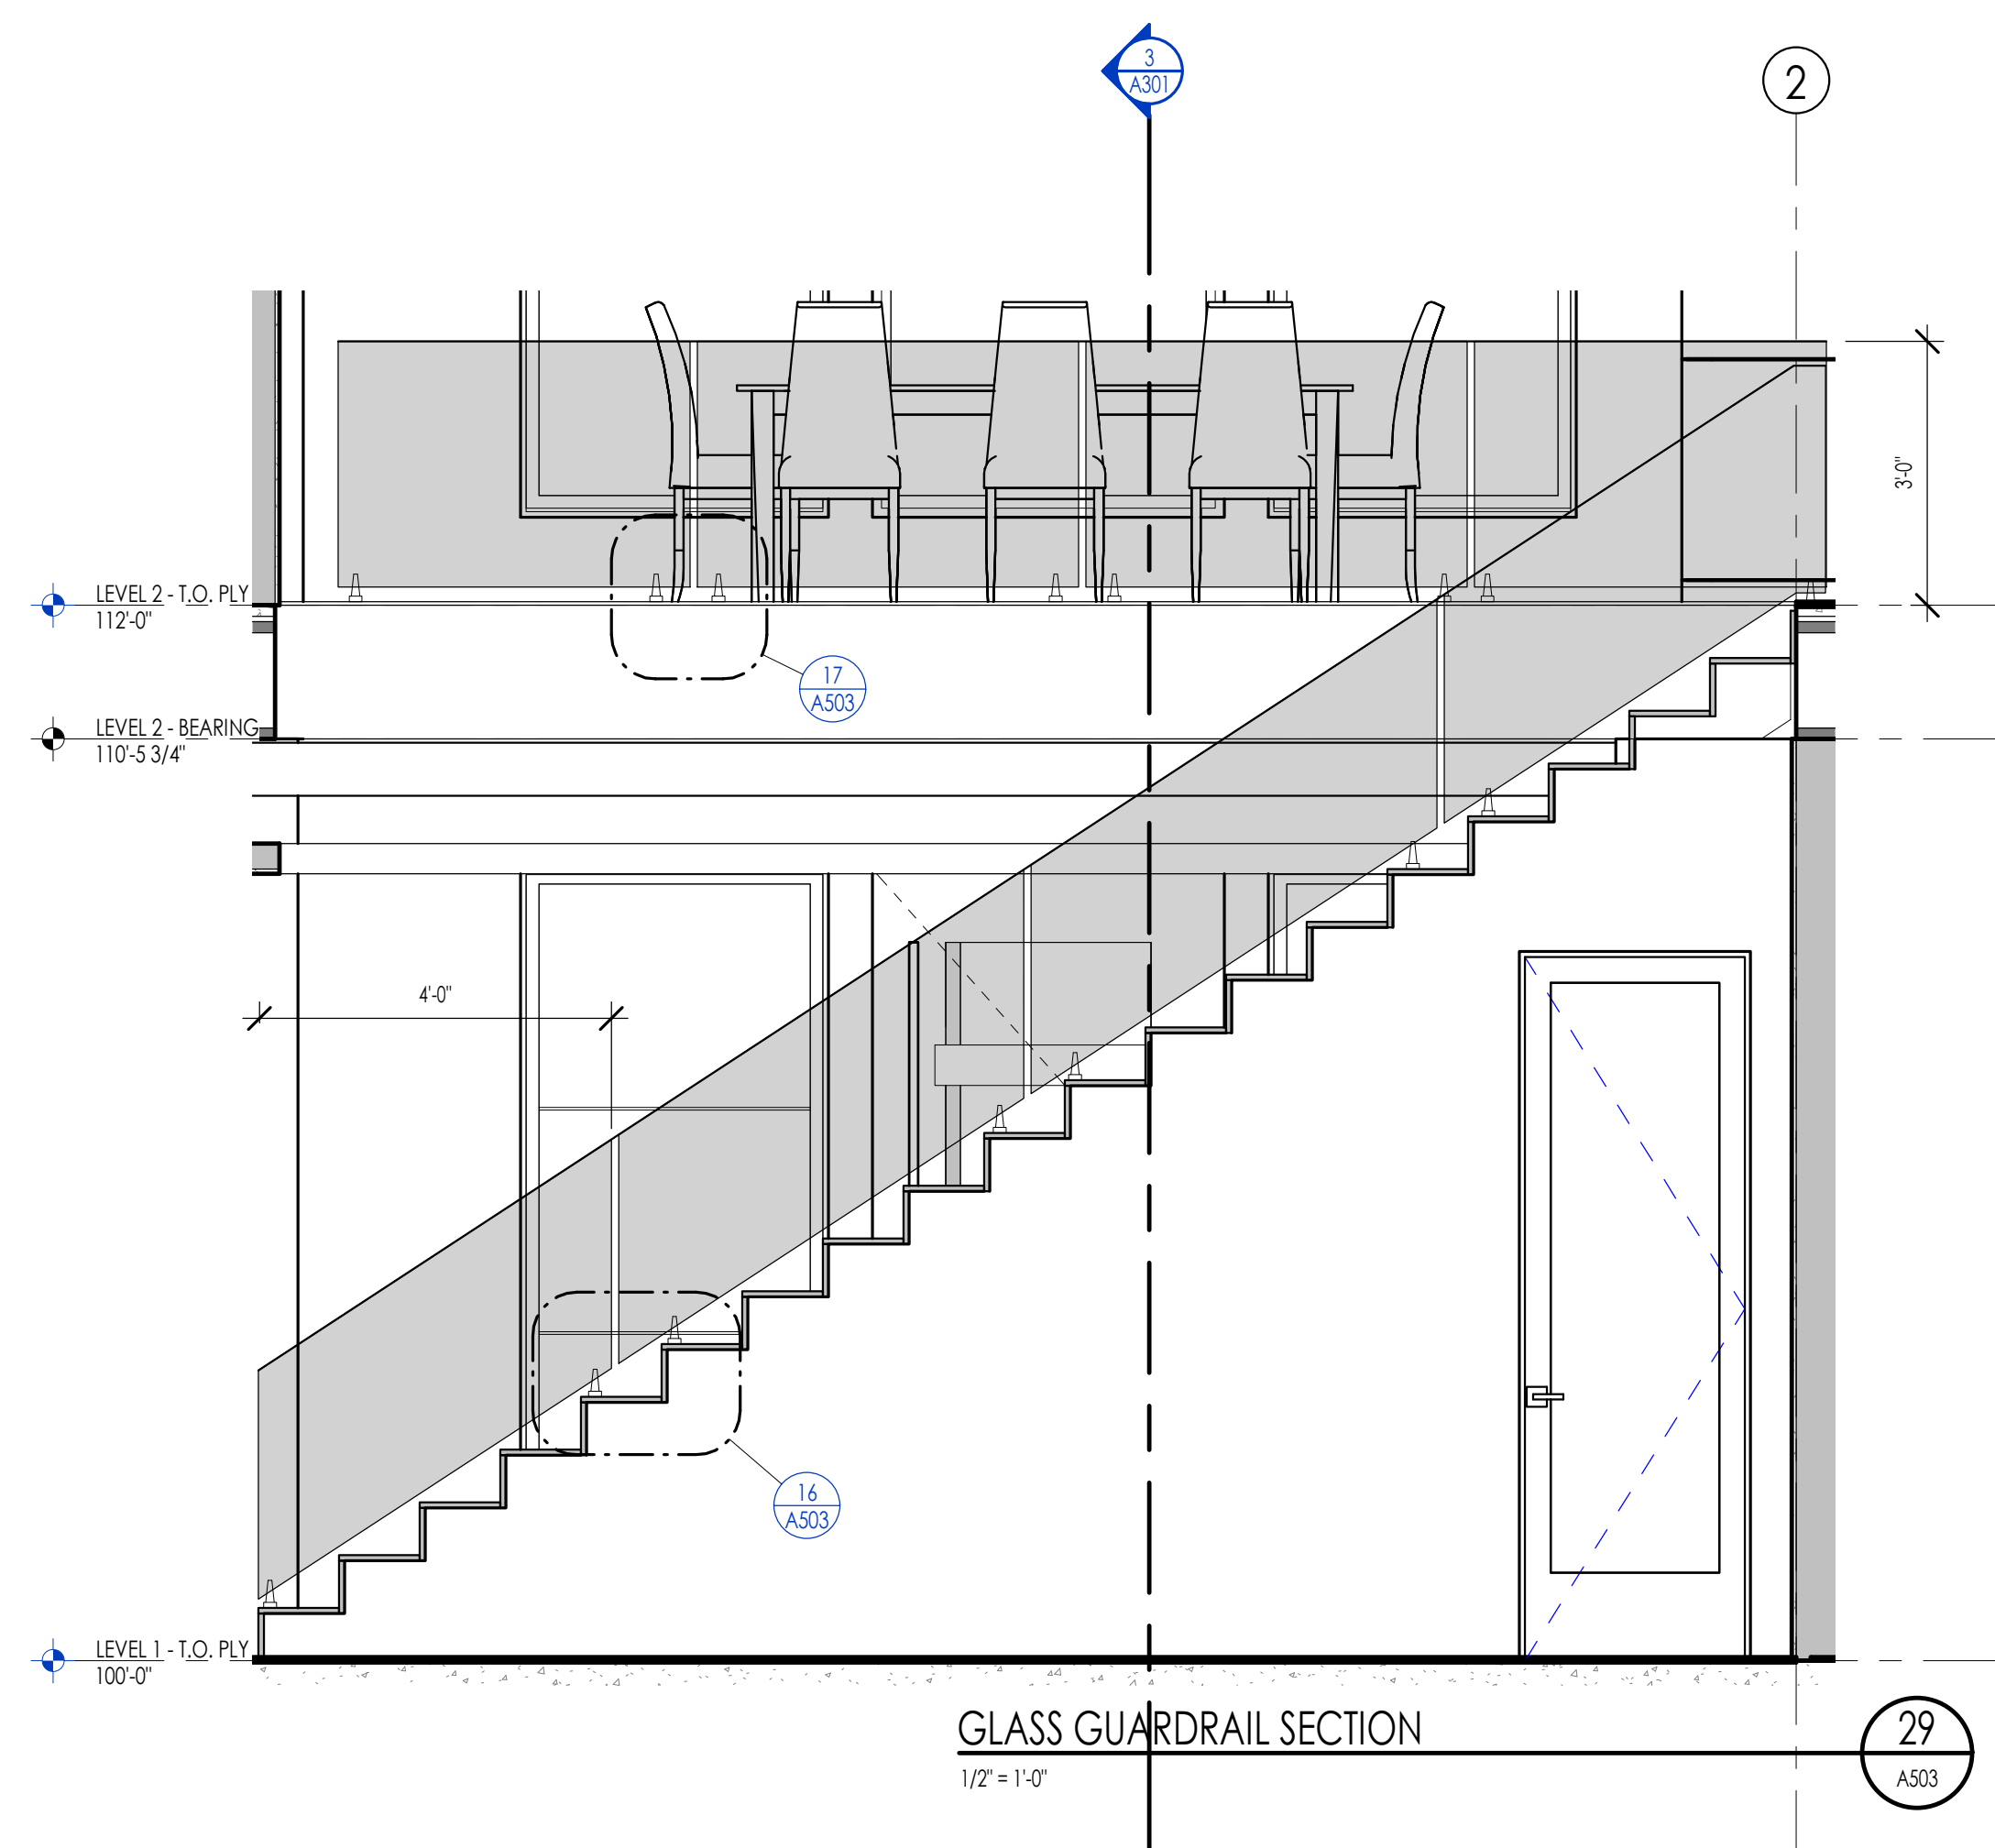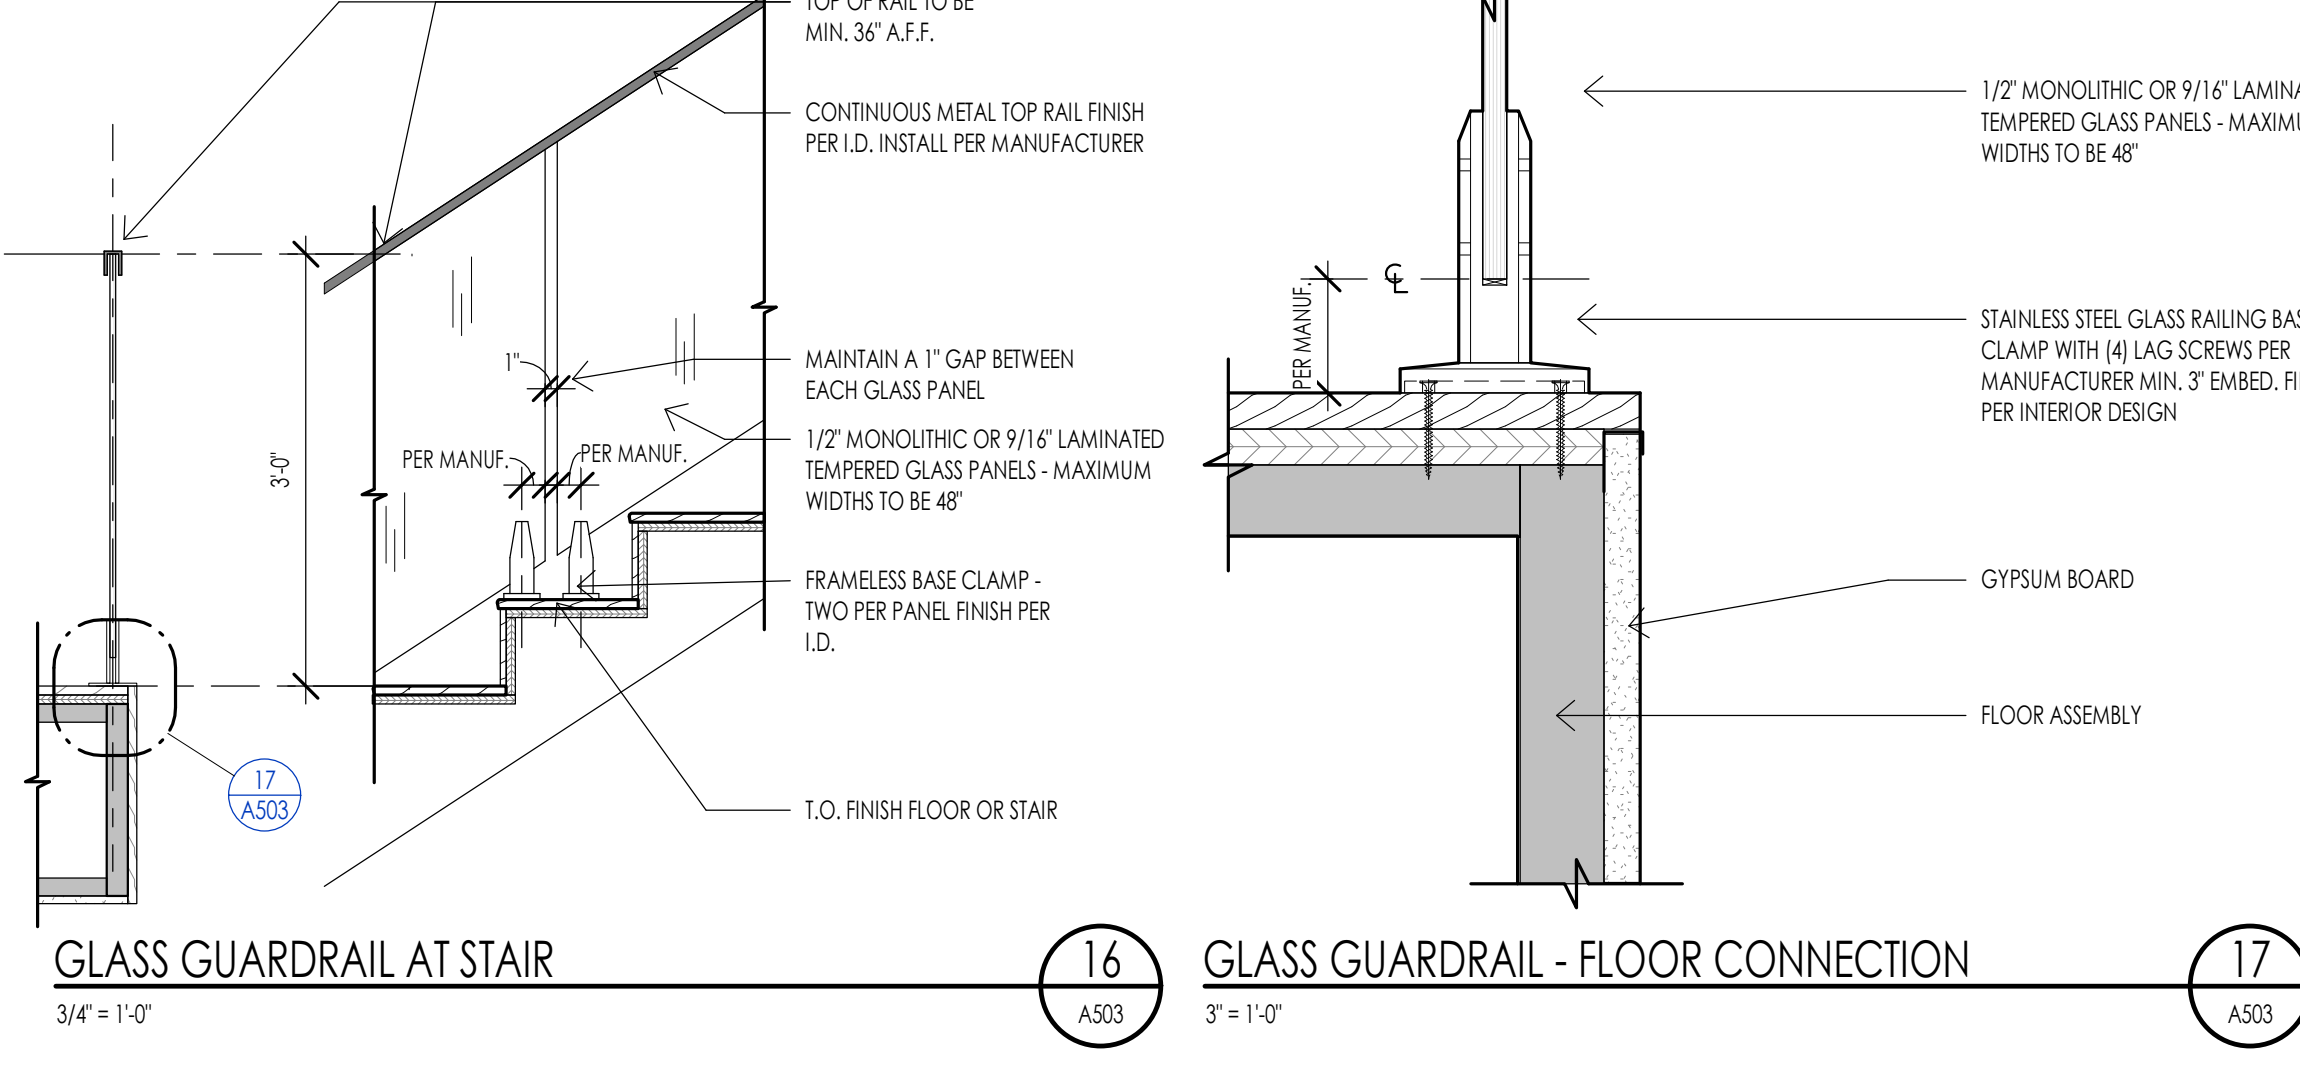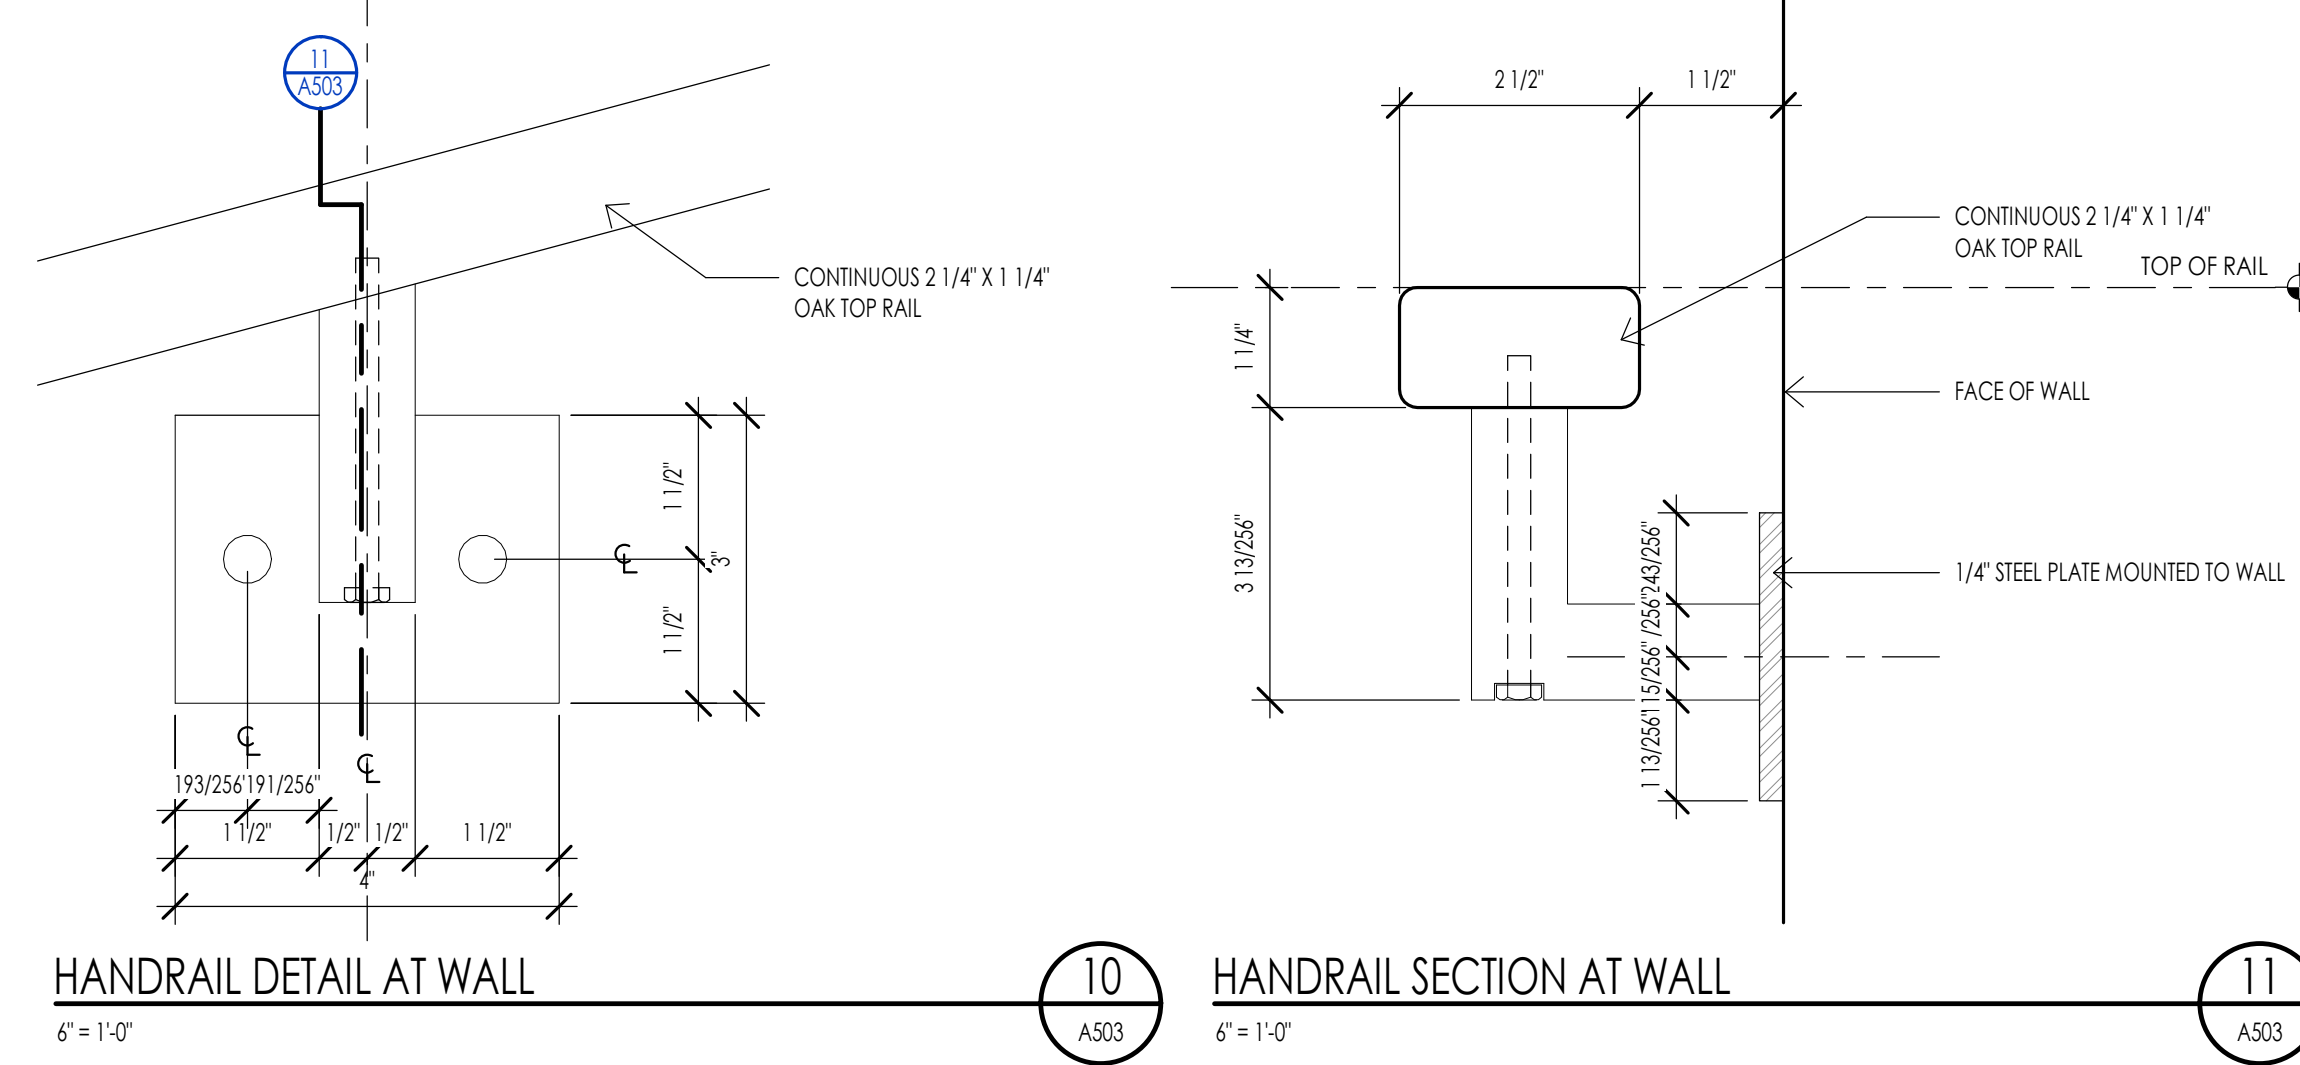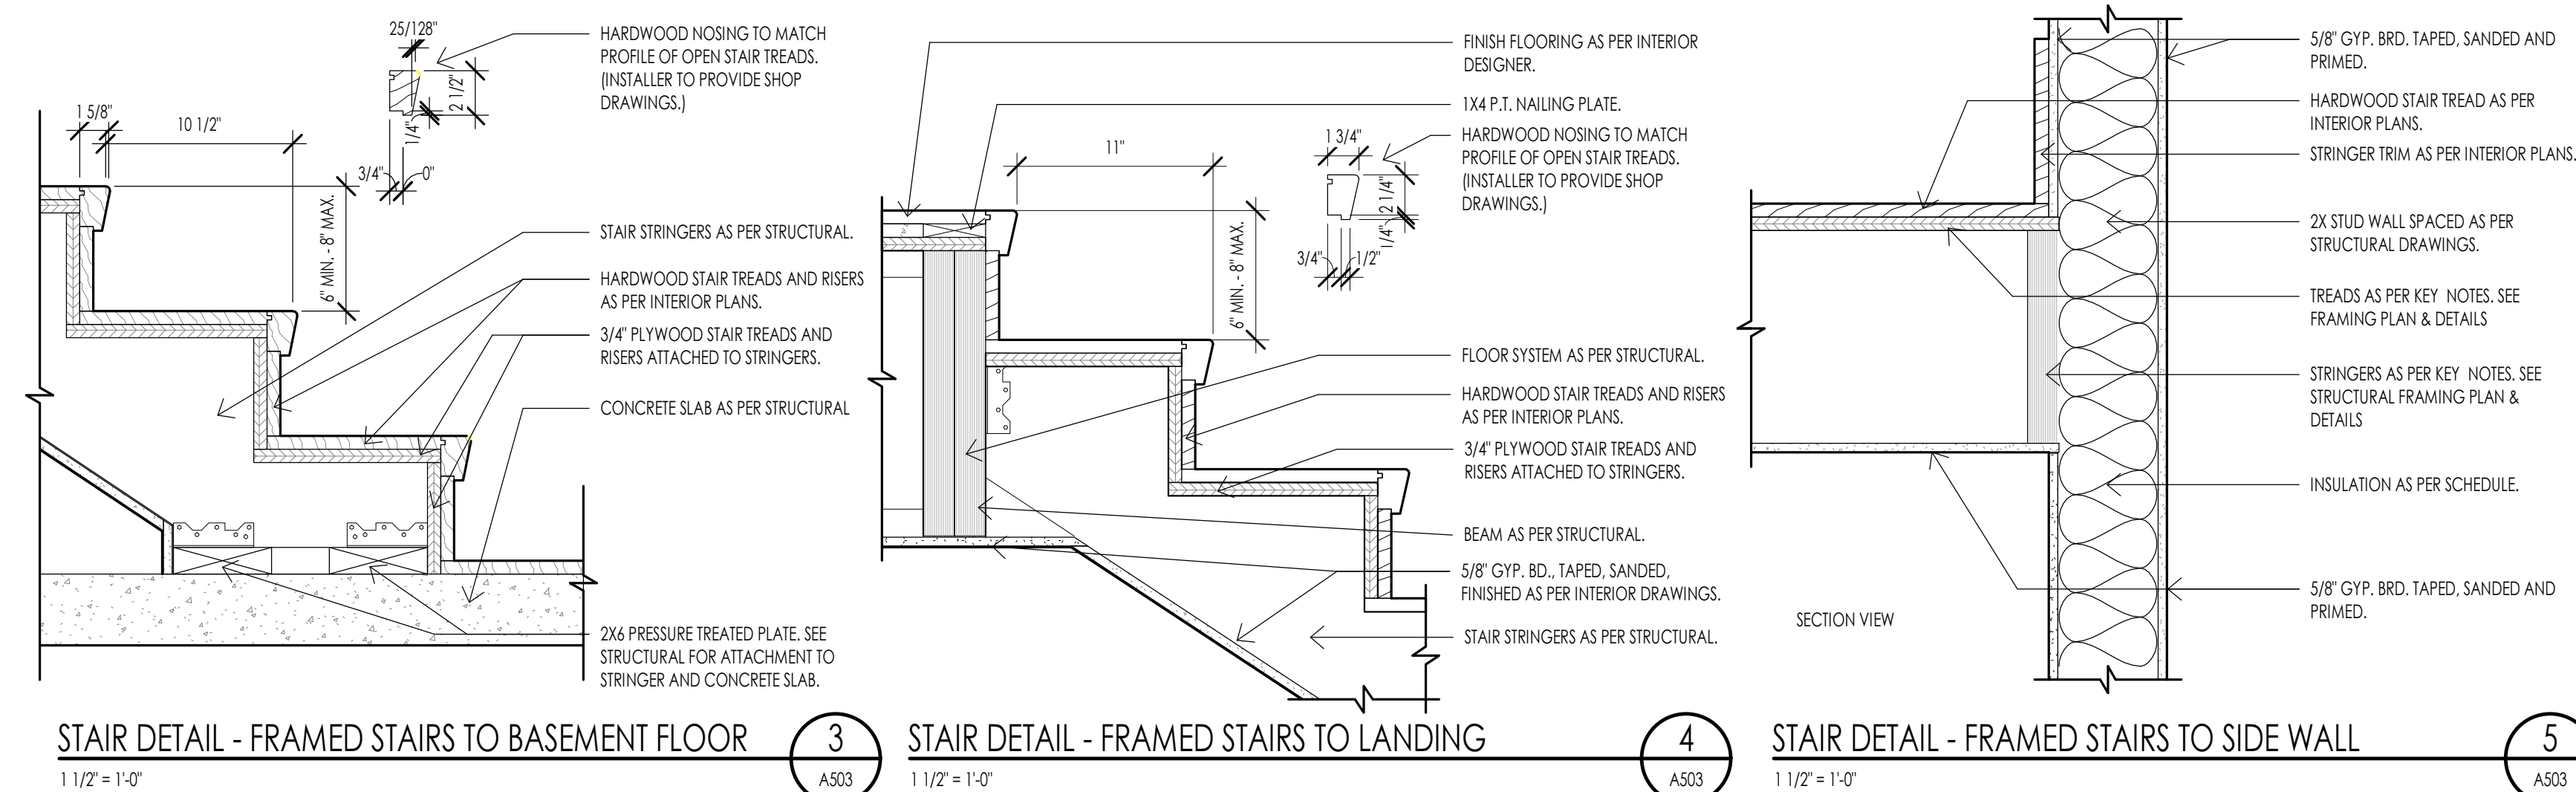

DOOR SCHEDULE


MARK	DOOR					FRAME					FIRE RATING	HARDWARE	REMARKS	
	SIZE	MATERIAL	TYPE	FINISH	HEAD	JAMB	SILL	MATERIAL	TYPE	FINISH				
														WIDTH
D103A	4'-0"	9'-0"	2"		D4	AS PER I.D.	19/A601	20/A601		F2	AS PER I.D.	NON-RATED	H10	
D101A	2'-10"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601		F1	AS PER I.D.	NON-RATED	H8	
D101B	3'-0"	8'-0"	2"		D3	AS PER I.D.	22/A601	23/A601	24/A601	METAL	F3	AS PER I.D.	20 MIN	H4
D101C	2'-4"	8'-0"	1 3/4"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H5
D102A	2'-10"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D102B	2'-4"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H5
D103A	2'-4"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D103B	2'-4"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D103C	2'-0"	7'-0"	1/4"	GLASS	D4					FRAMELESS				
D104A	2'-4"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D104B	2'-4"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D104C	2'-0"	7'-0"	1/4"	GLASS	D4					FRAMELESS				
D105A	3'-0"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H5
D106A	28'-0"	9'-0"	2"	METAL	D7		30/A601	28/A601						GARAGE DOOR
D107A	3'-0"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601	24/A601		F1	AS PER I.D.	NON-RATED	H1
D202A	2'-4"	8'-0"	2 1/4"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D203A	2'-10"	8'-0"	2 1/4"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D203B	2'-10"	8'-0"	2 1/4"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H5
D203C	4'-0"	8'-0"	1 3/4"		D5	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H4
D203D	2'-4"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D203E	2'-0"	7'-0"	1/4"	GLASS	D4					FRAMELESS				
D204A	2'-10"	8'-0"	2 1/4"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D204B	6'-0"	8'-0"	2"		D2	AS PER I.D.	22/A601	23/A601			F2	AS PER I.D.	H5	
D204C	2'-4"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D204D	2'-4"	8'-0"	2"		D1	AS PER I.D.	22/A601	23/A601			F1	AS PER I.D.	NON-RATED	H8
D204E	2'-0"	7'-0"	1/4"	GLASS	D4					FRAMELESS				

DOOR SCHEDULE GENERAL NOTES


- SEE SHEET A601 FOR DOOR AND FRAME TYPES.
- CONTRACTOR SHALL FIELD VERIFY ALL DOOR OPENINGS PRIOR TO ORDERING ALL DOORS.
- CONTRACTOR SHALL SUBMIT COMPLETE DOOR AND HARDWARE SHOP DRAWINGS AND SUBMITTALS FOR APPROVAL FOR EACH BUILDING PRIOR TO ORDERING AND TAKING RECEIPT OF DOOR ORDER. ARCHITECT SHALL REVIEW ALL DOORS FOR COMPLIANCE SPECIFICATIONS AND BUILDING CODE.
- ALL DOORS REQUIRED TO BE RATED SHALL HAVE APPROPRIATE U.L. RATING AS INDICATED IN DOOR SCHEDULE AND SPECIFICATION. ALL DOORS SHALL HAVE LABEL ON DOOR AND FRAME FOR INSPECTION ON SITE, AND SHALL NOT BE REMOVED.
- ALL DOORS SHALL BE INSTALLED SO AS NOT TO HAVE MORE THAN 1/2" THRESHOLD AT EACH DOOR.
- SEE SPECS FOR HARDWARE SCHEDULE.
- REFER TO INTERIOR DESIGNER FOR CORRECT DOOR STYLES, SPECIES, AND FINISHES.
- OPENINGS BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED WITH SOLID WOOD DOOR NOT LESS THAN 1 3/8 INCHES THICK, SOLID HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8 INCHES THICK, OR 20 MINUTE FIRE RATED DOORS. SEE I.R.C. SECTION R202.5.1.

HARDWARE GROUPS


- H1 MECHANICAL ROOM**
 - 2 PAIR SPRING HINGES
 - 1 SMOKE SEAL
 - 1 PASSAGE SET
- H2 OVERHEAD GARAGE DOORS**
 - GARAGE ENTRY PROVIDED BY OVERHEAD DOOR MANUFACTURER
- H3 SECONDARY ENTRY DOOR**
 - 3 PAIR SPRING HINGES
 - 1 SMOKE SEAL
 - 1 LOCKSET
 - 1 DEADBOLT
 - 1 THRESHOLD
- H4 GARAGE HOUSE**
 - 3 PAIR HINGES
 - 1 WEATHER STRIP
 - 1 LOCKSET
 - 1 DEADBOLT
- H5 INTERIOR DOOR**
 - 3 PAIR HINGES
 - 1 PASSAGE SET
- H6 INTERIOR BARN DOOR**
- H7 INTERIOR DOUBLE BARN DOOR**
- H8 INTERIOR DOOR**
 - 3 PAIR HINGES
 - 1 PRIVACY SET
- H9 INTERIOR DOUBLE DOOR**
 - 6 PAIR HINGES
 - 2 KNOBS (SINGLE SIDE ONLY)
- H10 ENTRY DOOR**
 - 1 WEATHER STRIP
 - 1 THRESHOLD
 - 1 LOCKSET
 - 1 DEADBOLT
 - 1 PIVOT HINGE (TOP AND BOTTOM)
- H11 INTERIOR DOUBLE DOOR**
 - 6 PAIR HINGES
 - 2 PASSAGE SET
- H12 POCKET DOOR**

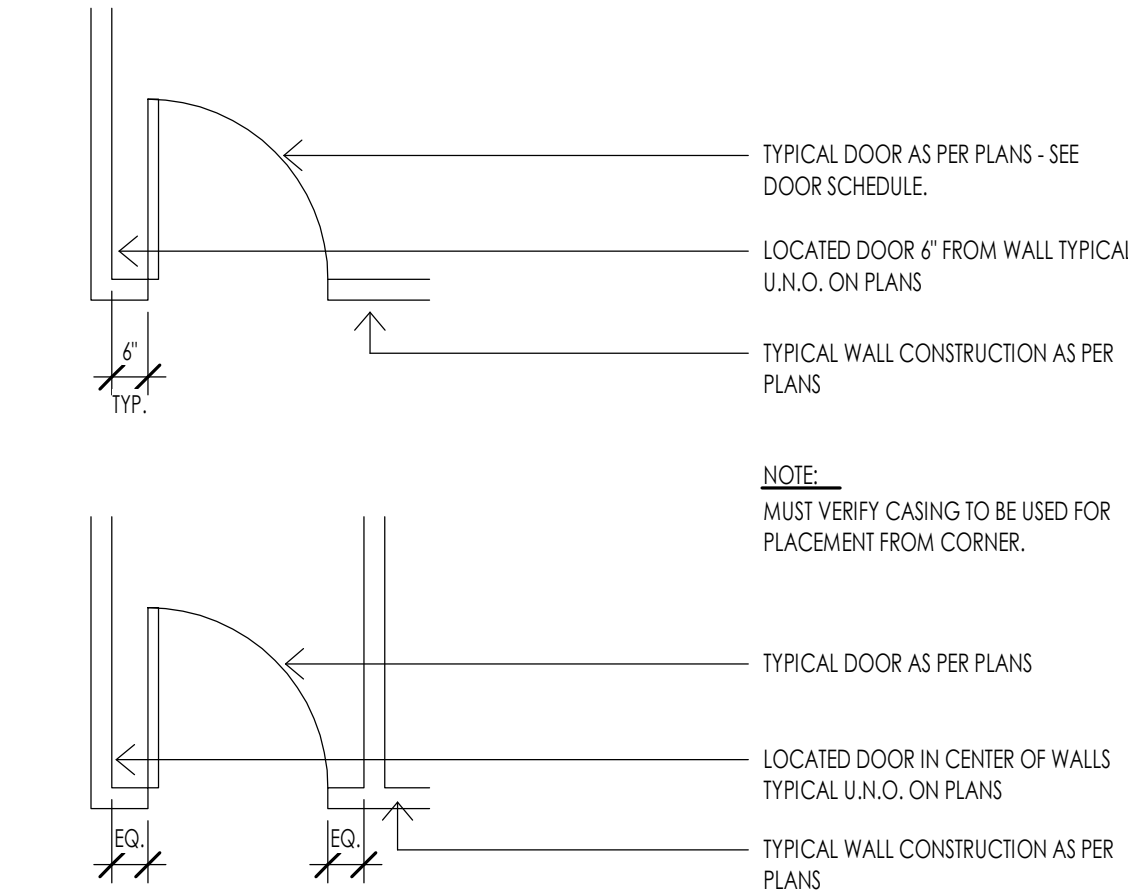


DOOR - TYPICAL PLACEMENT DETAIL
3/8" = 1'-0"

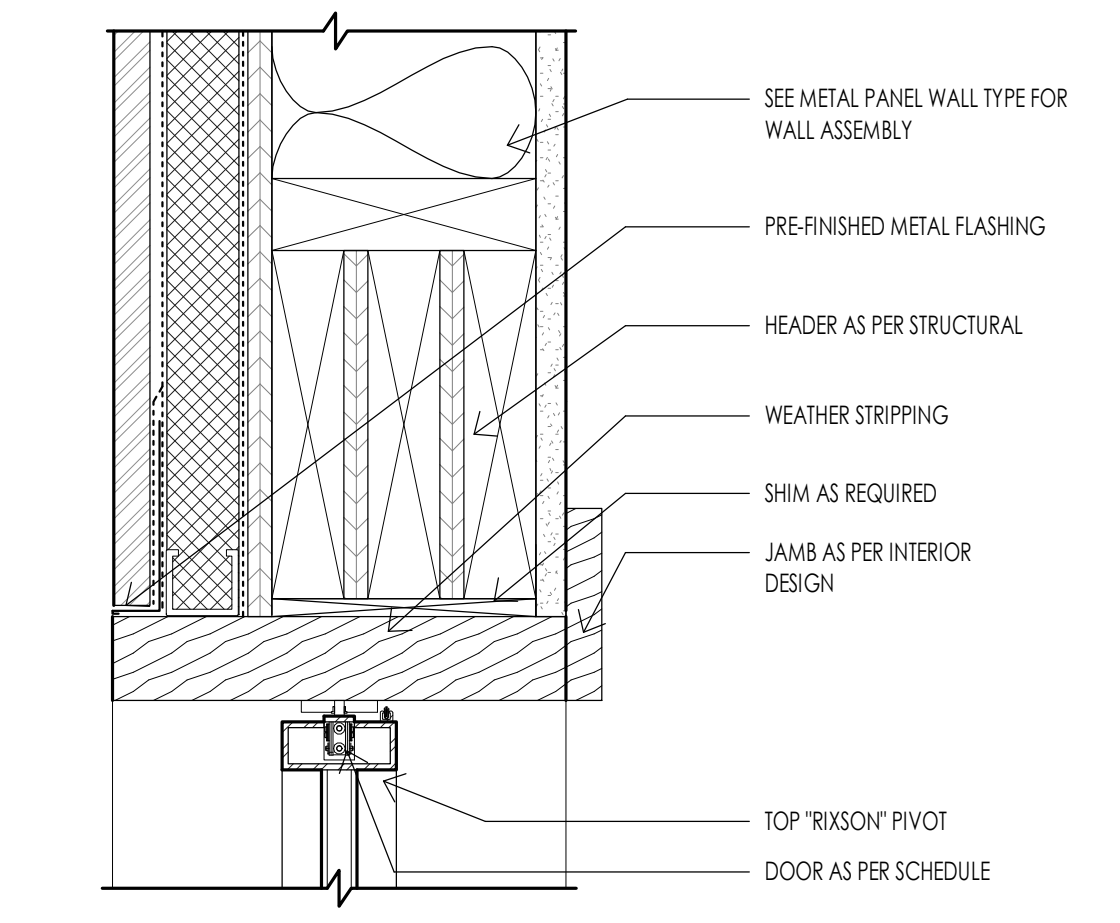

DOOR - PIVOT HEAD DETAIL
3" = 1'-0"

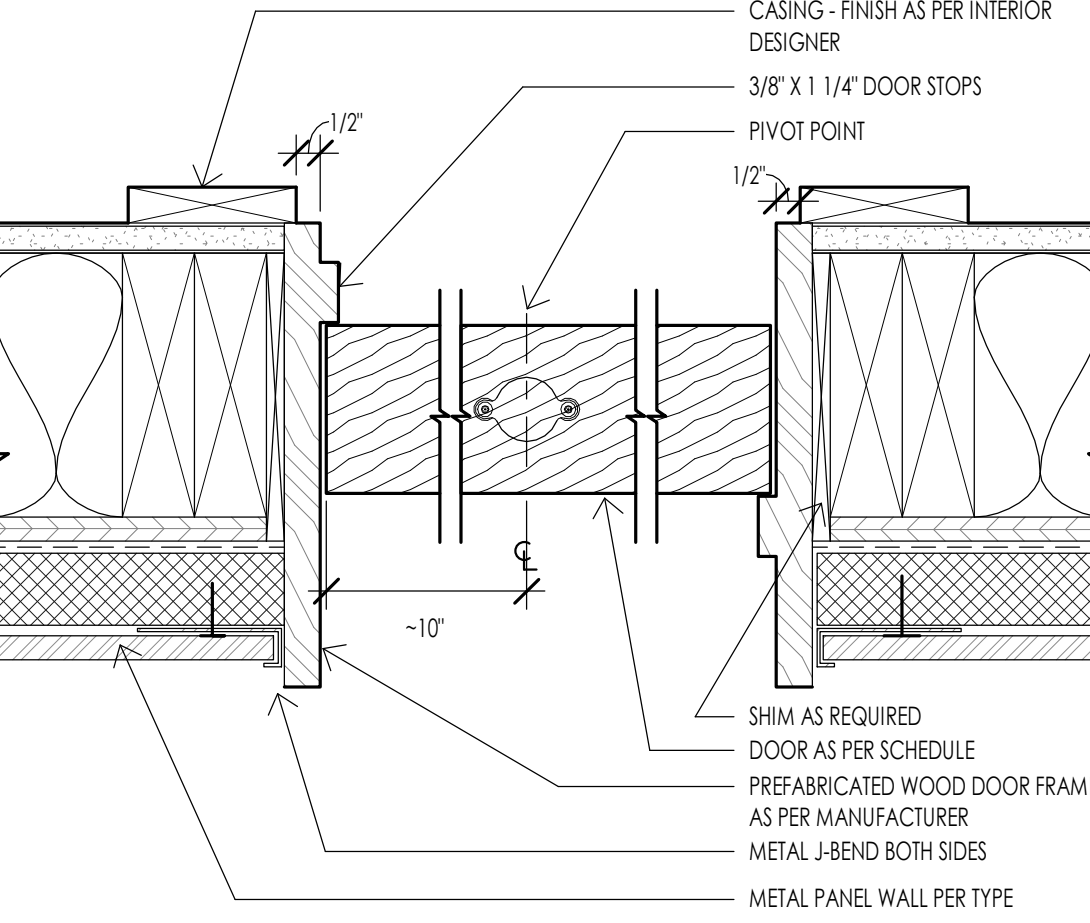


DOOR - PIVOT JAMB DETAIL WOOD DOOR
3" = 1'-0"

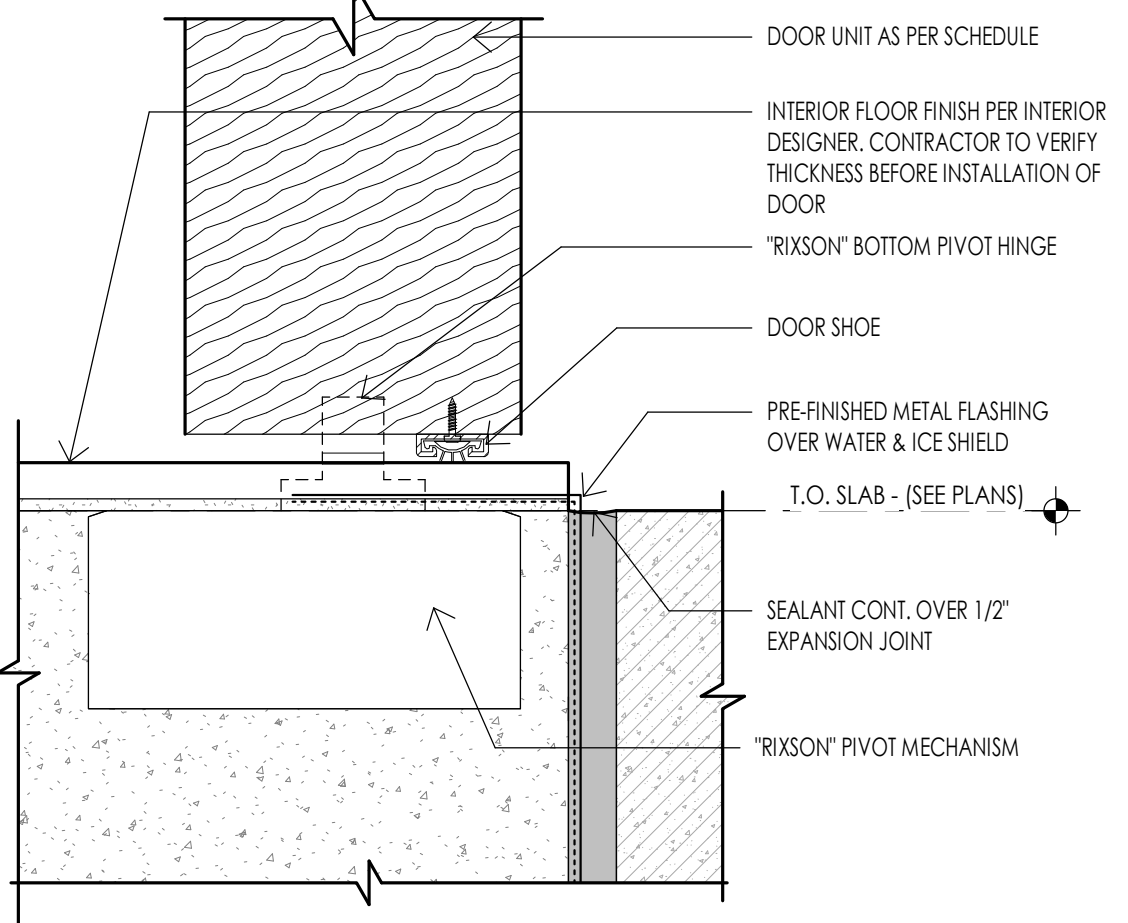


DOOR - PIVOT SILL DETAIL WOOD DOOR
6" = 1'-0"


DOOR TYPES

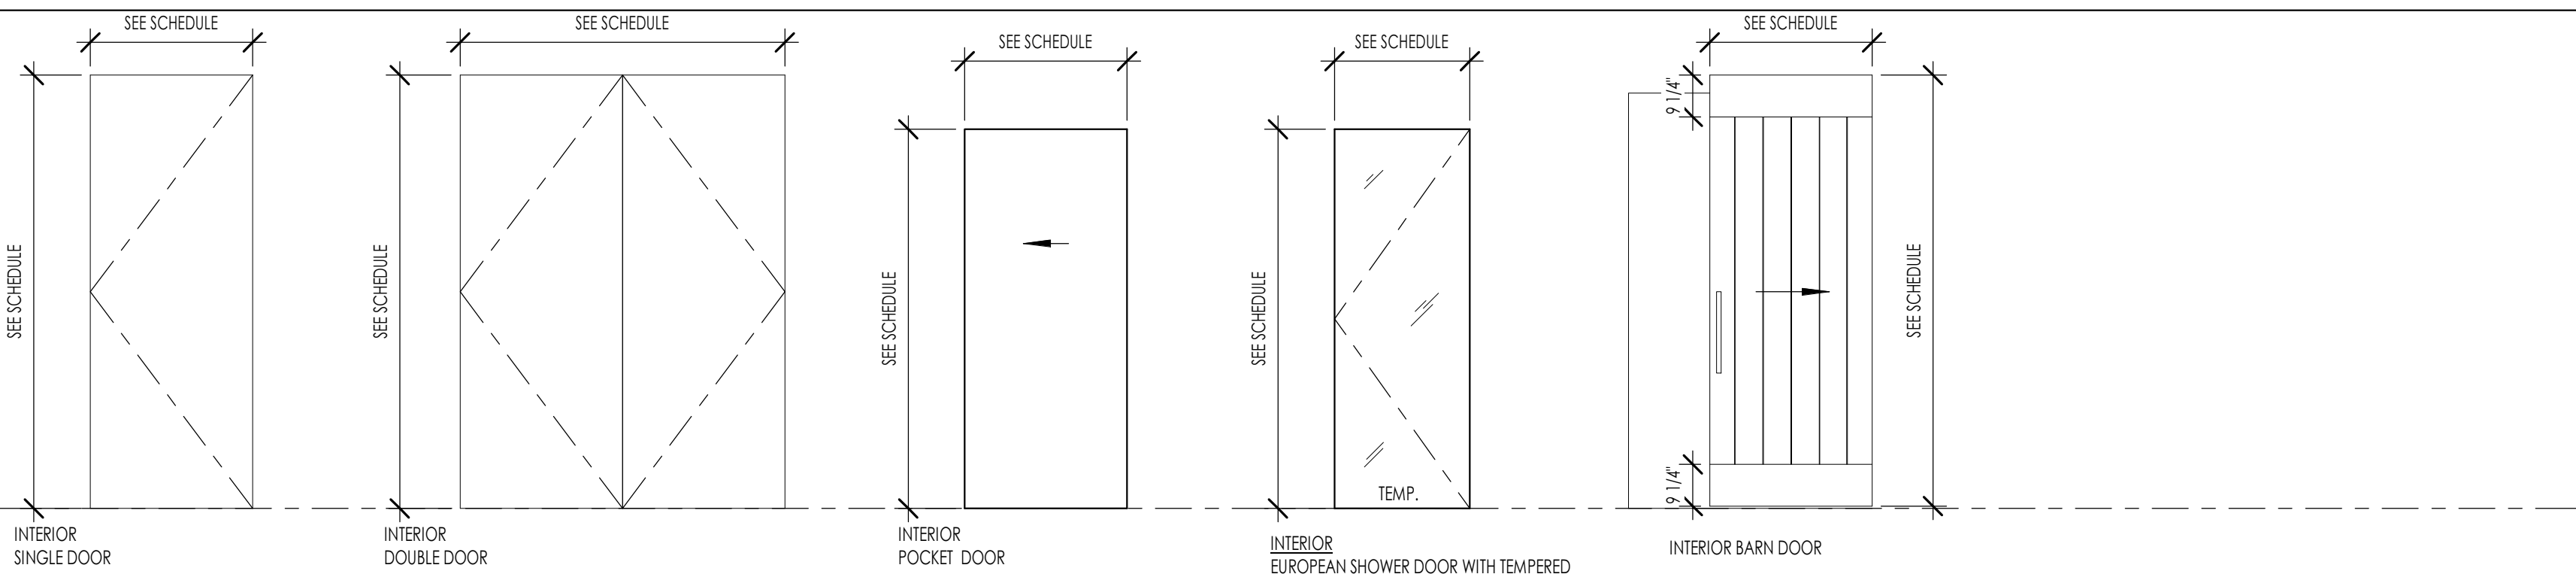

TYPE D1 **TYPE D2** **TYPE D3** **TYPE D4** **TYPE D5**

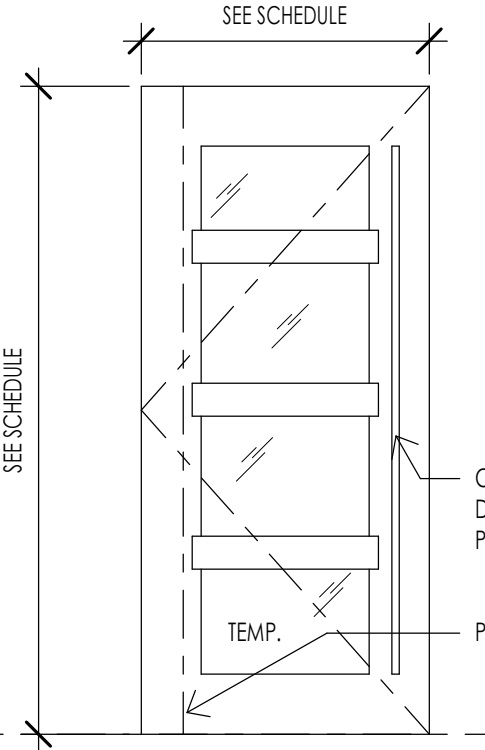


TYPE D6

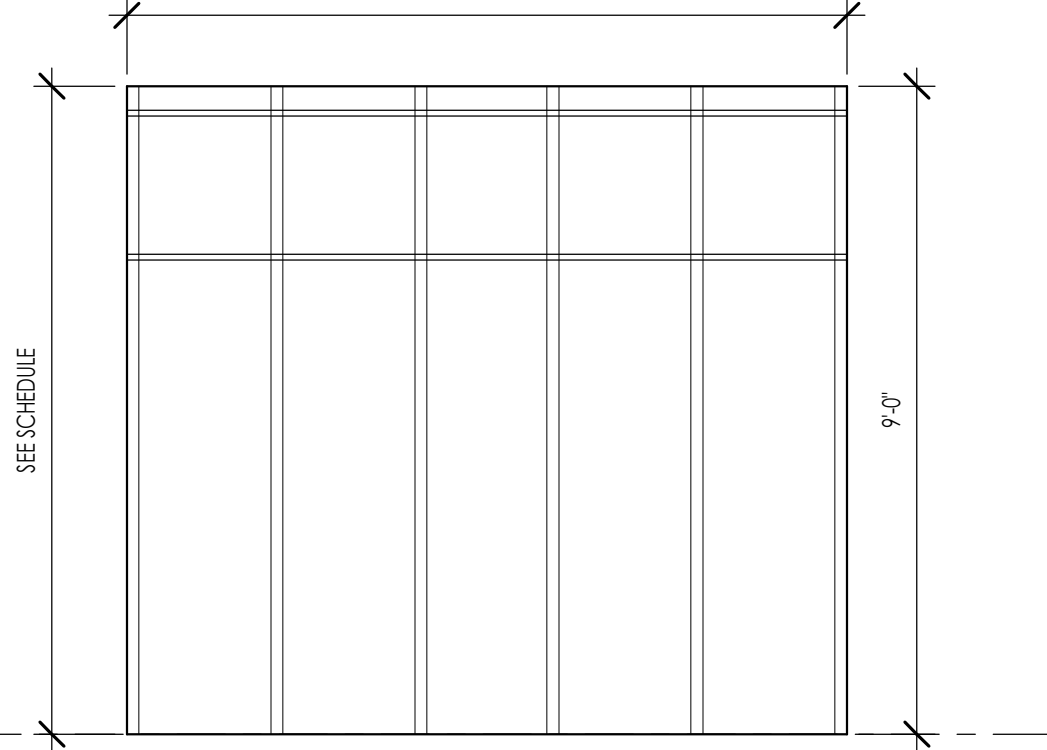


TYPE D7


FRAME TYPES

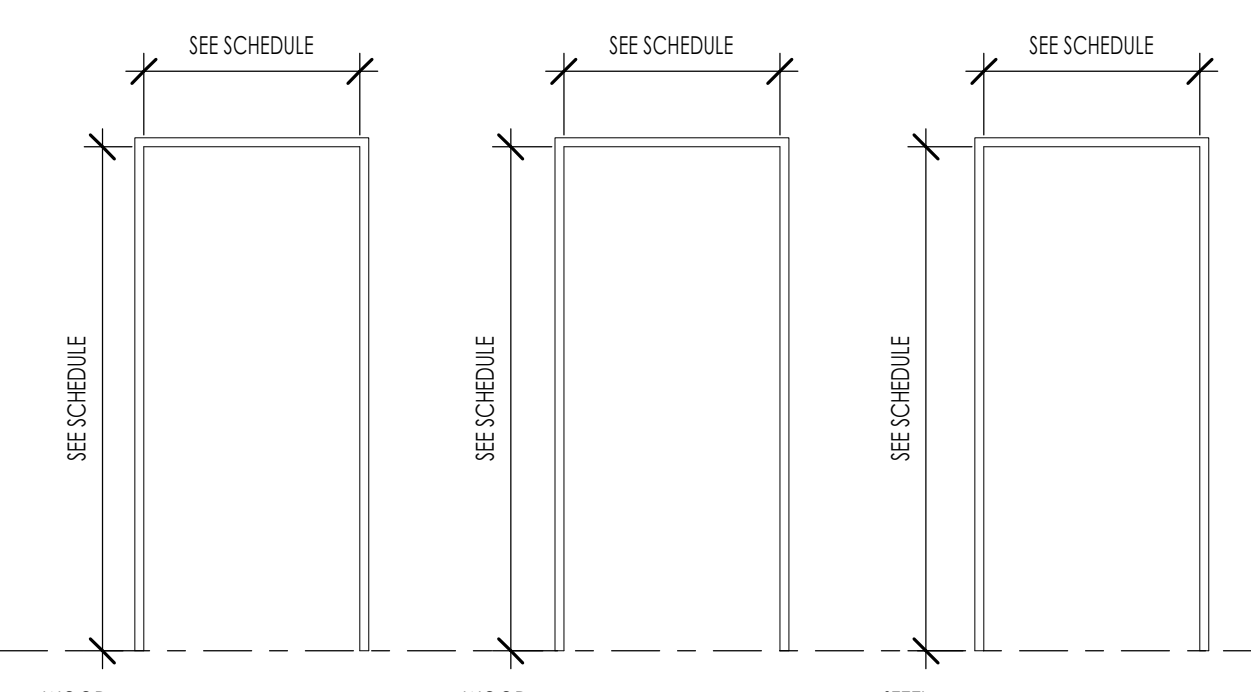


TYPE F1 **TYPE F2** **TYPE F3**

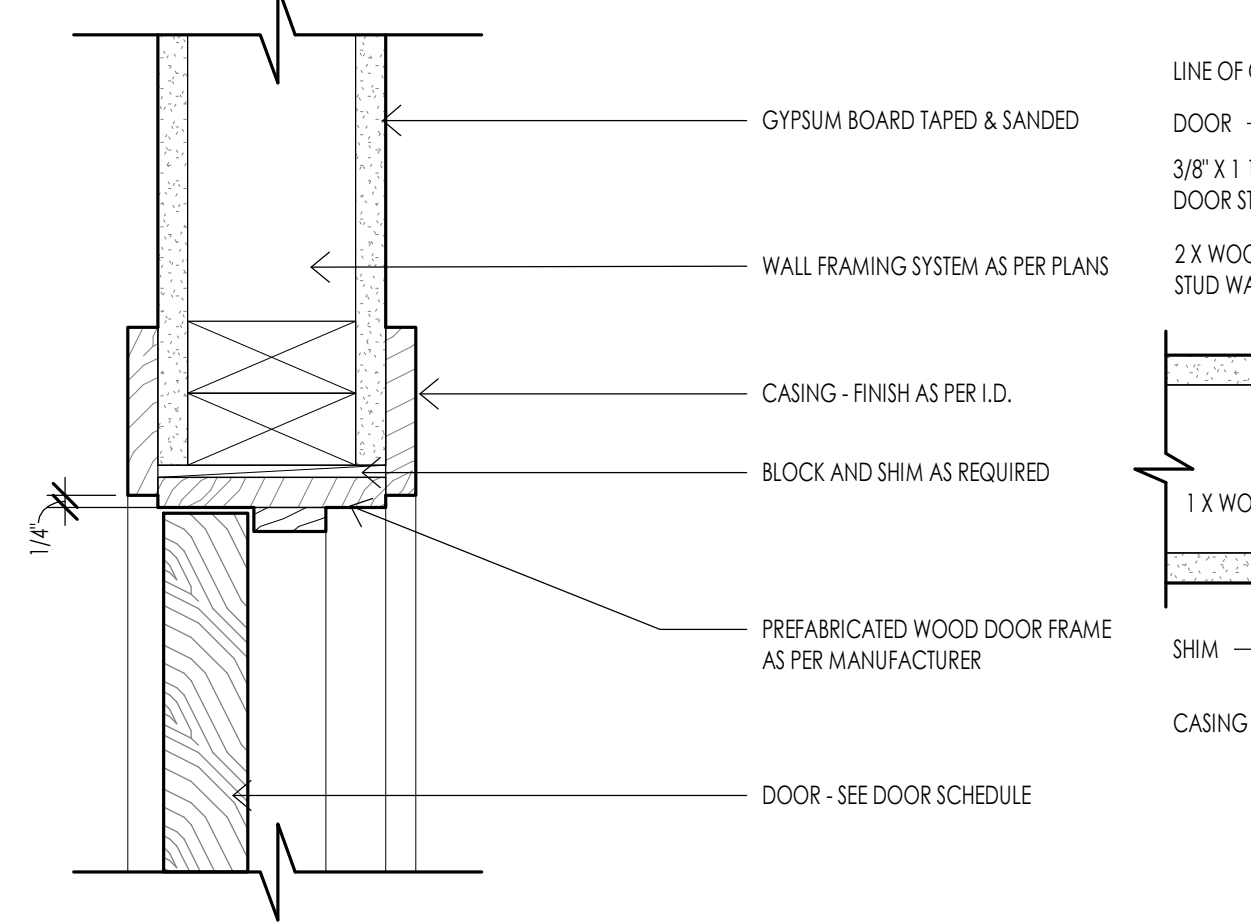


DOOR - TYPICAL INTERIOR HEAD
3" = 1'-0"

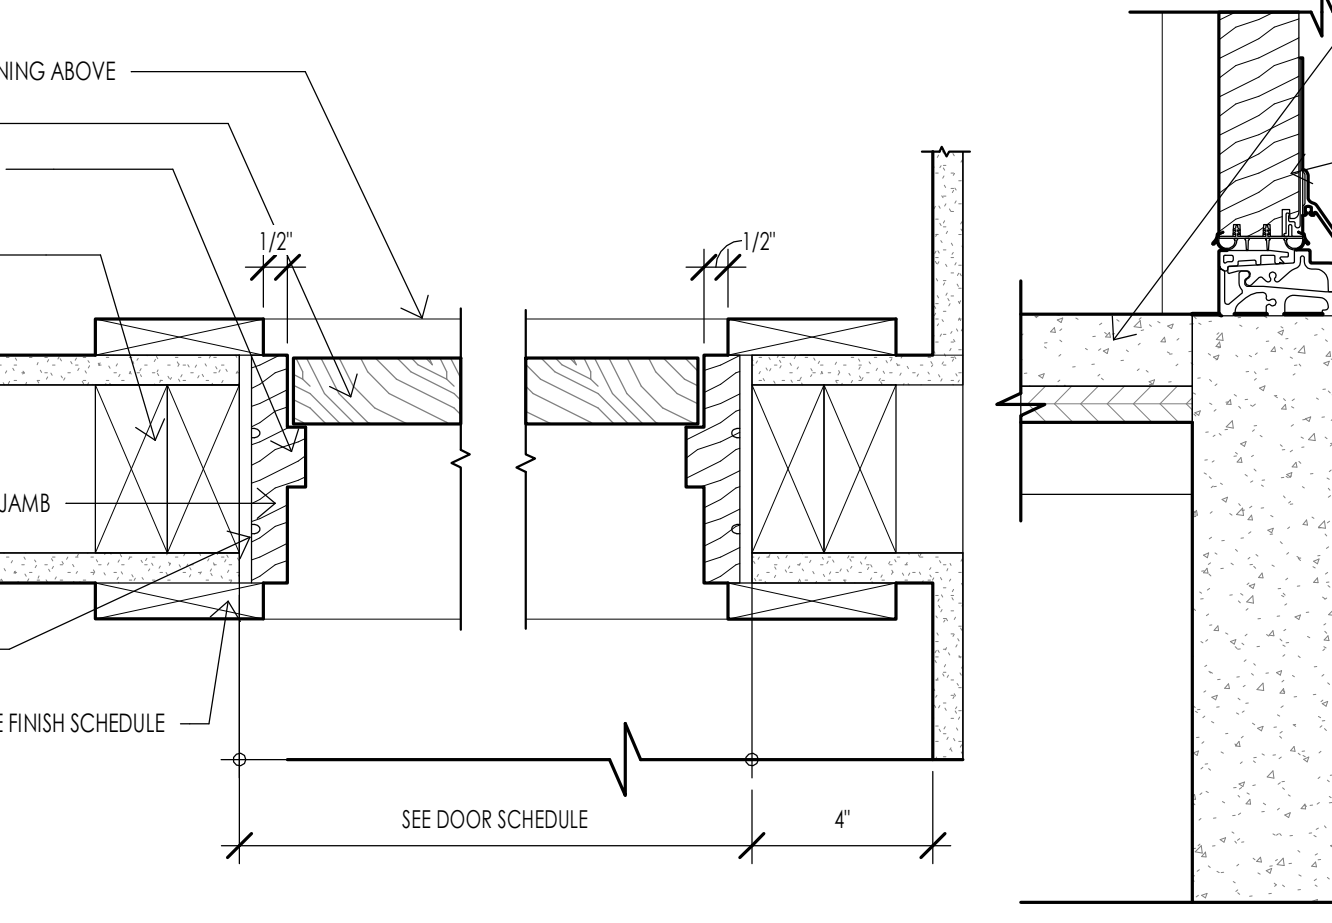


DOOR - INTERIOR TYPICAL JAMB DETAIL
3" = 1'-0"

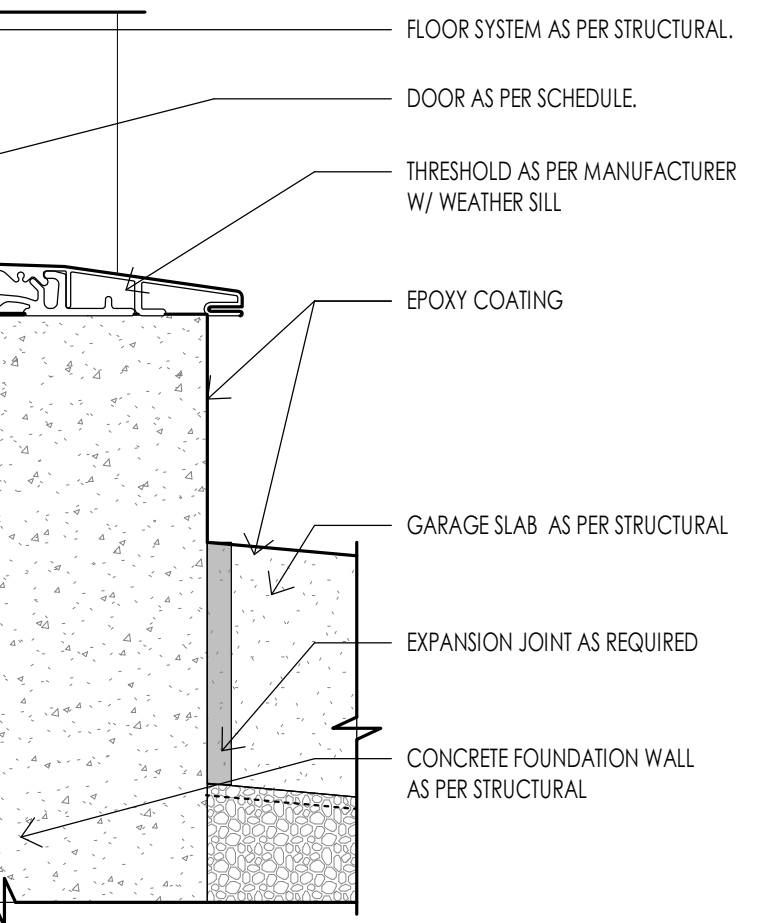

DOOR - THRESHOLD DETAIL @ GARAGE
3" = 1'-0"

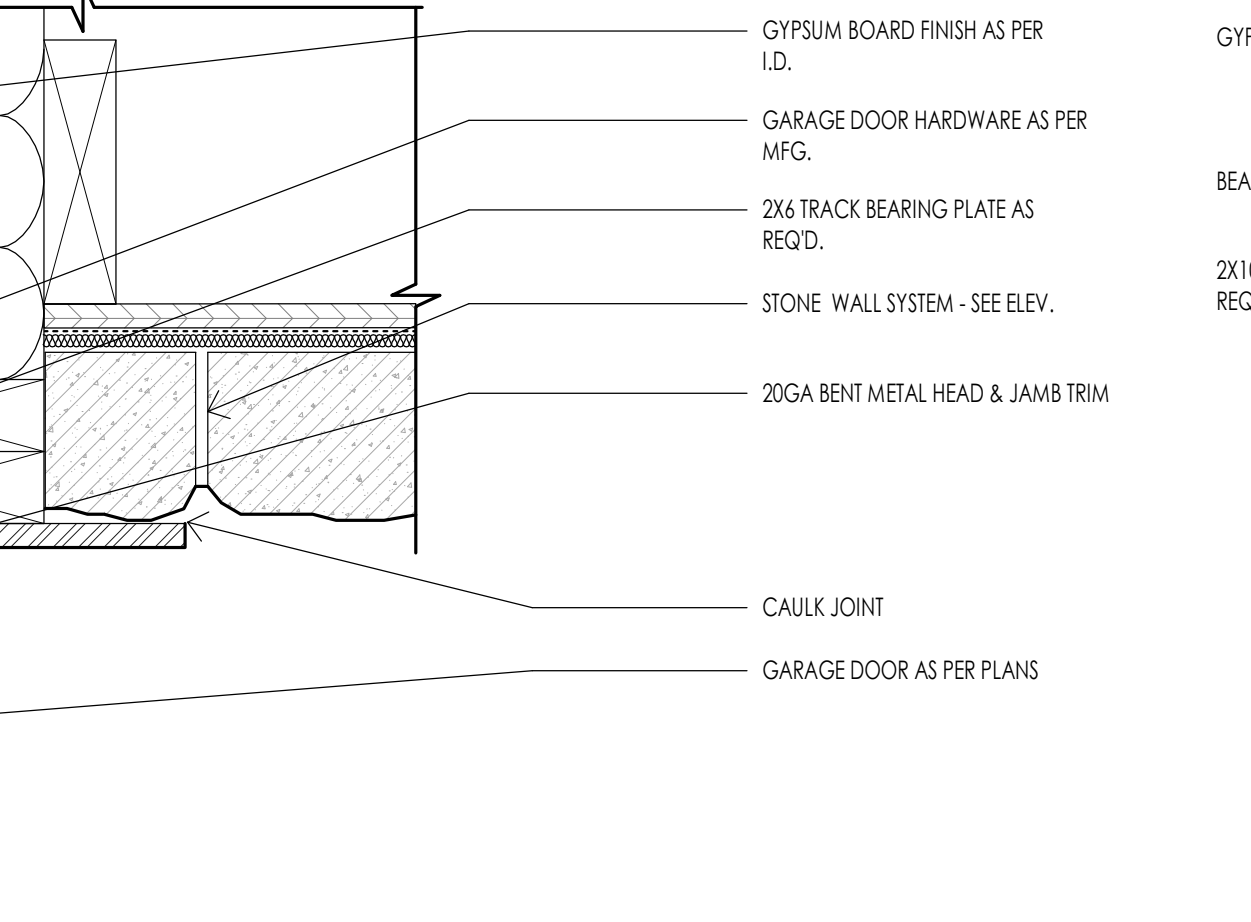

DOOR - GARAGE JAMB @ STONE
3" = 1'-0"

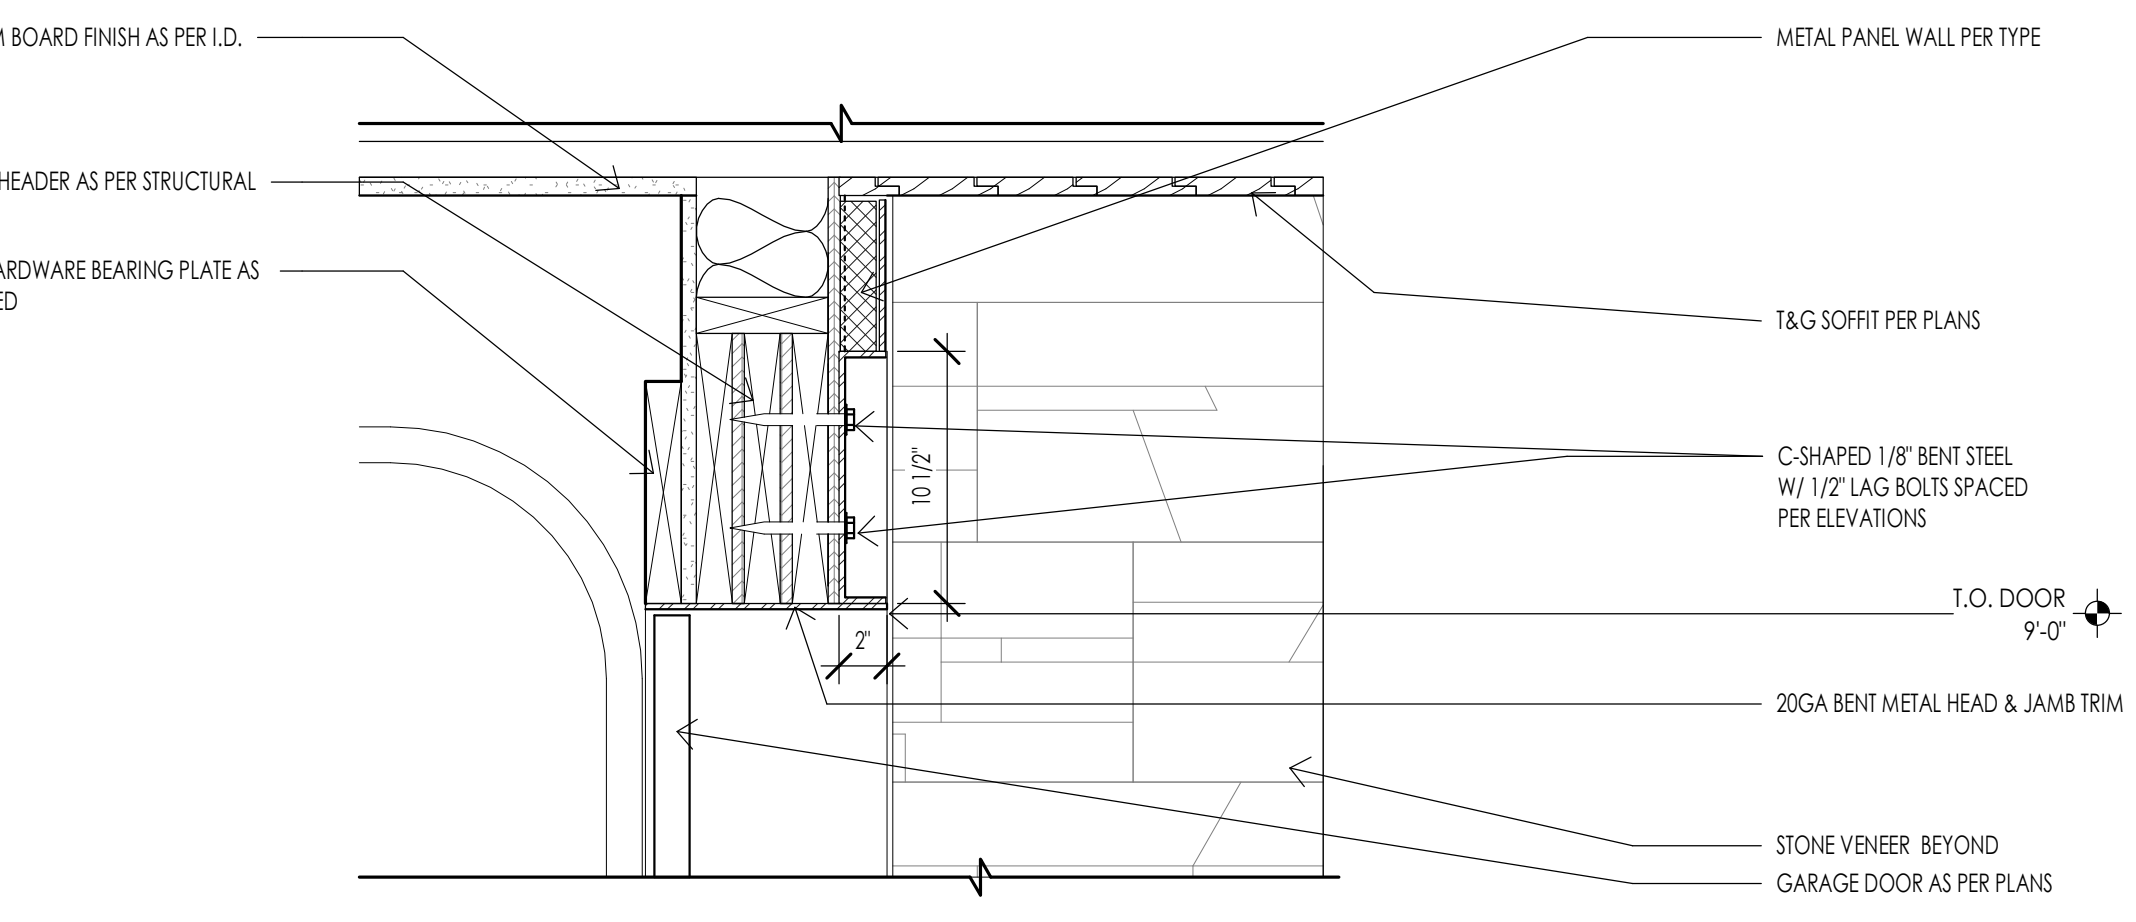


DOOR - GARAGE HEAD @ STONE
1 1/2" = 1'-0"



Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Sandwich, Utah 84094
ph: 801.269.0055
fax: 801.269.1425
www.thinkae2.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially exploited in whole or in part without the sole and express written permission from THINK Architecture, Inc.
These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

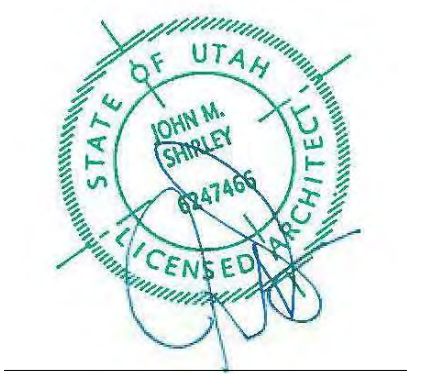

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30

SHEET TITLE:
DOOR SCHEDULE & ELEVATIONS



SHEET NUMBER:
A601

© 2021 THINK ARCHITECTURE, INC.

WINDOW SCHEDULE

MARK	UNIT SIZE		HEAD HEIGHT	OPERATION	MATERIAL	FINISH	DETAIL			GLAZING		COMMENTS
	WIDTH	HEIGHT					HEAD	JAMB	SILL	THICKNESS	TYPE	
W01	3'-6"	8'-0"	9'-0"	FIXED	ALUMINUM CLAD	AS PER I.D.	10/A602	16/A602	22/A602			
W02	3'-0"	6'-0"	9'-0"	CASEMENT	ALUMINUM CLAD	AS PER I.D.	VARIES	VARIES	VARIES			
W03	6'-0"	6'-0"	9'-0"	FIXED	ALUMINUM CLAD	AS PER I.D.	VARIES	VARIES	VARIES			
W04	4'-0"	8'-0"	9'-0"	FIXED	ALUMINUM CLAD	AS PER I.D.	10/A602	16/A602	VARIES			
W05	3'-0"	8'-0"	11'-0"	FIXED	ALUMINUM CLAD	AS PER I.D.	26/A602	VARIES	VARIES			
W06	3'-4"	9'-7"	9'-7"	FIXED-1 ANGLE ADJUSTABLE	ALUMINUM CLAD	AS PER I.D.	11/A602	VARIES	VARIES			
W07	2'-6"	6'-0"	9'-0"	CASEMENT	ALUMINUM CLAD	AS PER I.D.	11/A602	17/A602	23/A602			WINDOW - SEE SCHEDULE
W08	6'-0"	6'-0"	9'-0"	FIXED	ALUMINUM CLAD	AS PER I.D.	VARIES	VARIES	23/A602			STONE VENEER SEE ELEVATIONS AND SPECS.
W09	3'-4"	6'-0"	9'-0"	CASEMENT	ALUMINUM CLAD	AS PER I.D.	VARIES	17/A602	23/A602			
W10	3'-0"	3'-0"	3'-0"	FIXED	ALUMINUM CLAD	AS PER I.D.	VARIES	VARIES	21/A602			
W11	14'-10"	9'-11"	9'-11"	DOOR SLIDER TRIPLE	ALUMINUM CLAD	AS PER I.D.	11/A602	17/A602	PER MANUF.			
W12	8'-0"	6'-8"	6'-8"	FIXED-TRIANGLE ADJUSTABLE	ALUMINUM CLAD	AS PER I.D.	11/A602	VARIES	VARIES			
W13	8'-0"	2'-0"	9'-0"	FIXED	ALUMINUM CLAD	AS PER I.D.	11/A602	17/A602	23/A602			
W14	3'-0"	3'-0"	6'-4"	FIXED	ALUMINUM CLAD	AS PER I.D.	11/A602	VARIES	23/A602			
W15	3'-0"	3'-0"	6'-4"	FIXED	ALUMINUM CLAD	AS PER I.D.	11/A602	17/A602	26/A602			
W16	3'-0"	3'-0"	6'-4"	FIXED	ALUMINUM CLAD	AS PER I.D.	11/A602	17/A602	26/A602			
W17	3'-0"	5'-0"	5'-0"	FIXED-1 ANGLE ADJUSTABLE	ALUMINUM CLAD	AS PER I.D.	11/A602	VARIES	VARIES			
W18	6'-0"	5'-0"	5'-0"	FIXED-TRIANGLE ADJUSTABLE	ALUMINUM CLAD	AS PER I.D.	11/A602	VARIES	VARIES			

NOTE:
COORDINATE WITH DETAILS FOR ADDITIONAL INSTALLATION REQUIREMENT.

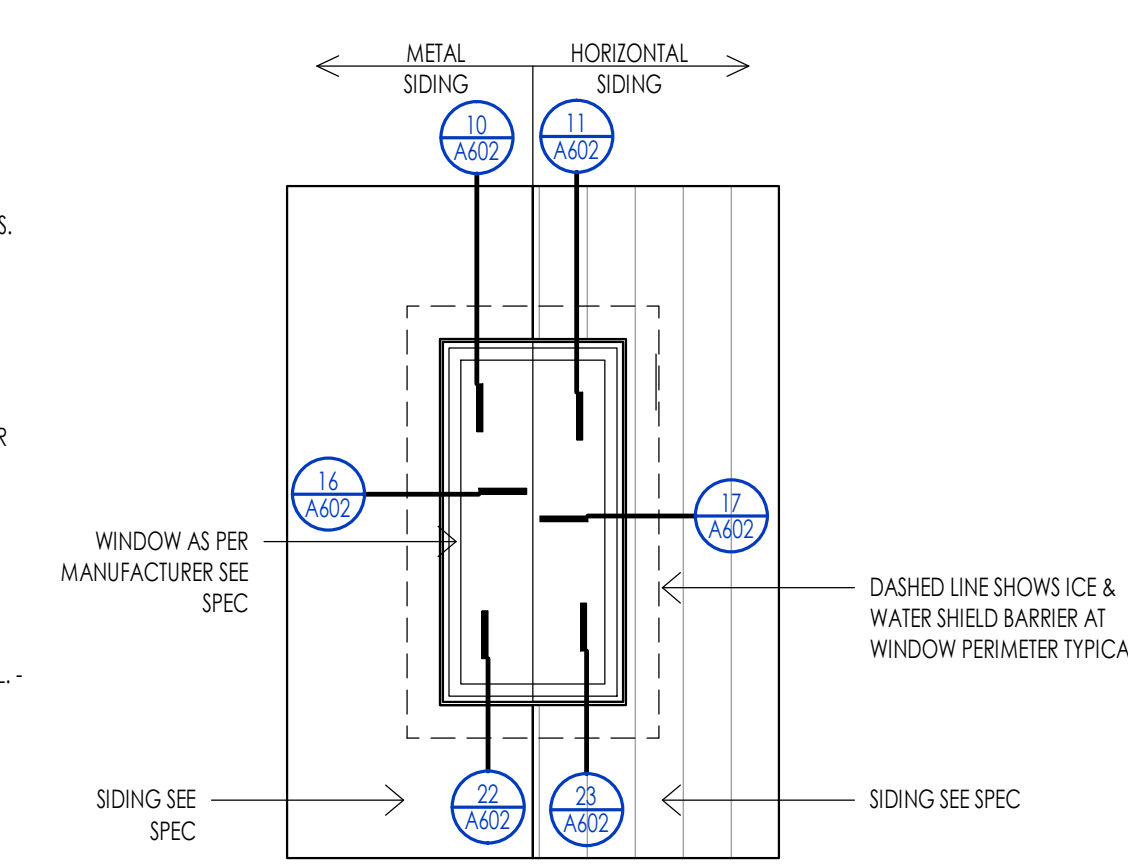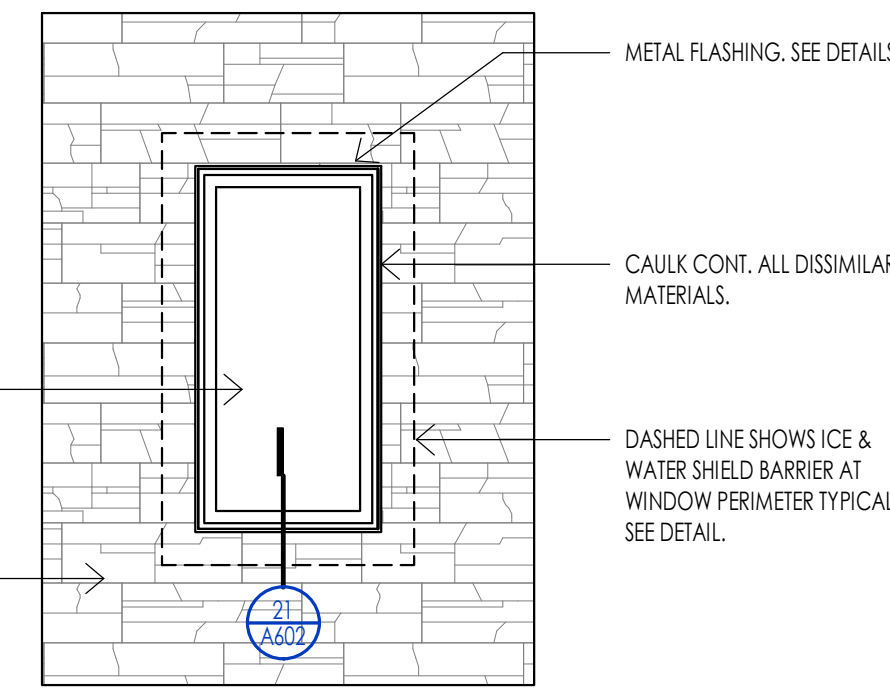

WINDOW LEGEND

SYMBOL	DESCRIPTION
T	TEMPERED GLAZING LOCATIONS.
→	DIRECTION OF OPERABLE WINDOW/DOOR.
E	WINDOW IS REQUIRED TO MEET EMERGENCY EGRESS.

WINDOW SPECIFICATIONS

APPROVED MANUFACTURERS: _____

MINIMUM U-VALUE: _____

SCREENS REQUIRED: _____

SCREEN COLOR: _____

TYPICAL JAMB WIDTH: _____

SDX WIDTH: _____

SDX TYPE: _____
















WINDOW GENERAL NOTES

- EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL MEET THE FOLLOWING REQUIREMENTS. SEE I.R.C. SECTION R310.
 - BASEMENTS WITH HABITABLE SPACES SHALL HAVE AT LEAST ONE OPERABLE EMERGENCY ESCAPE AND RESCUE WINDOW OR DOOR OR ACCESS TO AN ADJOINING BERGAM WITH AN EMERGENCY ESCAPE AND RESCUE WINDOW.
 - ALL EMERGENCY OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING AREA OF 5.7 SQUARE FEET. THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 20 INCHES. THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20 INCHES. EMERGENCY OPENINGS SHALL BE OPERATIONAL FROM THE INSIDE OF THE ROOM WITHOUT THE USE OF KEYS OR TOOLS. EXCEPT GROUND FLOOR, NET CLEAR AREA OF 5.0 SQUARE FEET. R310.1.1 TO R310.1.4.
 - WINDOW SHALL HAVE A SILL HEIGHT OF NOT MORE THAN 44 INCHES ABOVE THE FLOOR. OPENINGS WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GROUND ELEVATION SHALL BE PROVIDED WITH A WINDOW WELL. R310.2.2.
 - WINDOW WELLS REQUIRED FOR ESCAPE OR RESCUE SHALL HAVE HORIZONTAL DIMENSIONS THAT ALLOW THE DOOR OR WINDOW TO BE FULLY OPENED. THE HORIZONTAL DIMENSION FOR THE WINDOW WELL SHALL PROVIDE A MINIMUM NET CLEAR AREA OF 9 SQUARE FEET WITH A MINIMUM HORIZONTAL PROJECTION AND WIDTH OF 36 INCHES. R310.2.3.
 - WINDOW WELLS WITH A VERTICAL DEPTH GREATER THAN 44 INCHES BELOW THE ADJACENT GROUND LEVEL SHALL BE EQUIPPED WITH A PERMANENTLY AFFIXED LADDER OR STEPS USABLE WITH THE WINDOW IN THE FULLY OPENED POSITION. LADDERS OR RUNGS SHALL HAVE AN INSIDE WIDTH OF AT LEAST 12 INCHES. SHALL PROJECT AT LEAST 3 INCHES FROM THE WALL AND SHALL BE SPACED NOT MORE THAN 18 INCHES ON CENTER VERTICALLY FOR THE FULL HEIGHT OF THE WINDOW WELL. R310.2.3.1.
 - BARS, GRILLS, COVERS, SCREENS, ETC. SHALL BE PERMITTED TO BE PLACED OVER THE EMERGENCY EGRESS OPENING WINDOW WELL PROVIDED THE NET CLEAR OPENING SIZE IS NOT COMPROMISED AND THAT SUCH DEVICES SHALL BE RELEASED OR REMOVABLE FROM THE INSIDE WITHOUT THE USE OF A KEY, TOOL, OR FORCE GREATER THAN THAT WHICH IS REQUIRED FOR NORMAL OPERATION. R310.4.
- SAFETY GLAZING SHALL BE INSTALLED IN HAZARDOUS LOCATIONS AND SHALL MEET THE FOLLOWING REQUIREMENTS. SEE I.R.C. SECTION R308. FOR EXCEPTIONS SEE I.R.C. R308.4.
 - EACH PANE OF GLASS INSTALLED IN HAZARDOUS LOCATIONS SHALL BE PERMANENTLY IDENTIFIED BY MANUFACTURER DESIGNATING THE TYPE, THICKNESS, AND SAFETY GLAZING STANDARD. THE LABEL SHALL BE ACID ETCHED, SANDBLASTED, CERAMIC FRIED OR EMBOSSED ON GLASS AND BE VISIBLE WHEN THE UNIT IS GLAZED. FOR EXCEPTIONS SEE I.R.C. R308.1.
 - PROVIDE SAFETY GLAZING IN FIXED AND OPERABLE PANELS OF SWINGING, SLIDING AND FOLDING DOORS (R308.1.1). SAFETY GLAZING SHALL BE PROVIDED WHEN GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 40 INCHES ABOVE THE FLOOR OR WALKING SURFACE AND IS WITHIN 24 INCHES OF EITHER SIDE OF THE DOOR IN THE PLANE OF THE DOOR IN A CLOSED POSITION OR WHERE THE GLAZING IS ON A WALL PERPENDICULAR TO THE PLANE OF THE DOOR IN A CLOSED POSITION AND WITHIN 24 INCHES OF THE HINGE SIDE OF AN IN SWINGING DOOR. (I.R.C. R308.4.2)
 - PROVIDE SAFETY GLAZING WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 36 INCHES ABOVE THE PLANE OF THE ADJACENT WALKING SURFACE OF STAIRWAYS, LANDINGS BETWEEN FLIGHTS OF STAIRS AND RAMPS. (I.R.C. R308.4.6)
 - PROVIDE SAFETY GLAZING IN DOORS AND ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHUBS AND SHOWERS. GLAZING IN ANY PORTION OF A BUILDING WALL ENCLOSING THESE COMPARTMENTS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE A STANDING OR WALKING SURFACE. (I.R.C. R308.4.5)
 - PROVIDE SAFETY GLAZING IN RAILINGS REGARDLESS OF AN AREA OR HEIGHT. (I.R.C. R308.4.4)
 - PROVIDE SAFETY GLAZING IN WALLS AND FENCES ENCLOSING SWIMMING POOLS OR HOT TUBS WHERE THE BOTTOM EDGE OF THE POOL OR SPA GLASS IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE. (I.R.C. R308.4.5)
 - PROVIDE SAFETY GLAZING IN FIXED OR OPERABLE PANELS THAT MEETS ALL OF THE FOLLOWING CONDITIONS: AREAS GREATER THAN 9 SQUARE FEET; BOTTOM EDGE LESS THAN 18 INCHES ABOVE THE FLOOR; TOP EDGE GREATER THAN 36 INCHES ABOVE FLOOR; AND WITHIN 36 INCHES OF WALKING SURFACE. (I.R.C. R308.4.3)
- THE GENERAL CONTRACTOR AND WINDOW SUPPLIER ARE RESPONSIBLE TO FIELD MEASURE ALL WINDOW OPENINGS AND PROVIDE SHOP DRAWINGS BEFORE MANUFACTURING. SHOP DRAWINGS SHALL BE PROVIDED FOR EACH BUILDING INDIVIDUALLY AND SHALL NOT BE COMBINED WITH ANY OTHER BUILDING. THE WINDOW SUPPLIER SHALL BE RESPONSIBLE TO VERIFY ALL EMERGENCY EGRESS, LIGHT AND VENTILATION, AND TEMPERED GLASS LOCATION REQUIREMENTS PRIOR TO EACH SUBMITTAL.
- THE GENERAL CONTRACTOR AND WINDOW SUPPLIER ARE RESPONSIBLE TO VERIFY THAT EACH OF THE ABOVE LISTED REQUIREMENTS HAVE BEEN MET AND NOTE ANY DISCREPANCIES ON SUBMITTAL. REFER TO THE PROJECT SPECIFICATIONS FOR ADDITIONAL INFORMATION.

Think Architecture

Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Scary, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkaoc.com

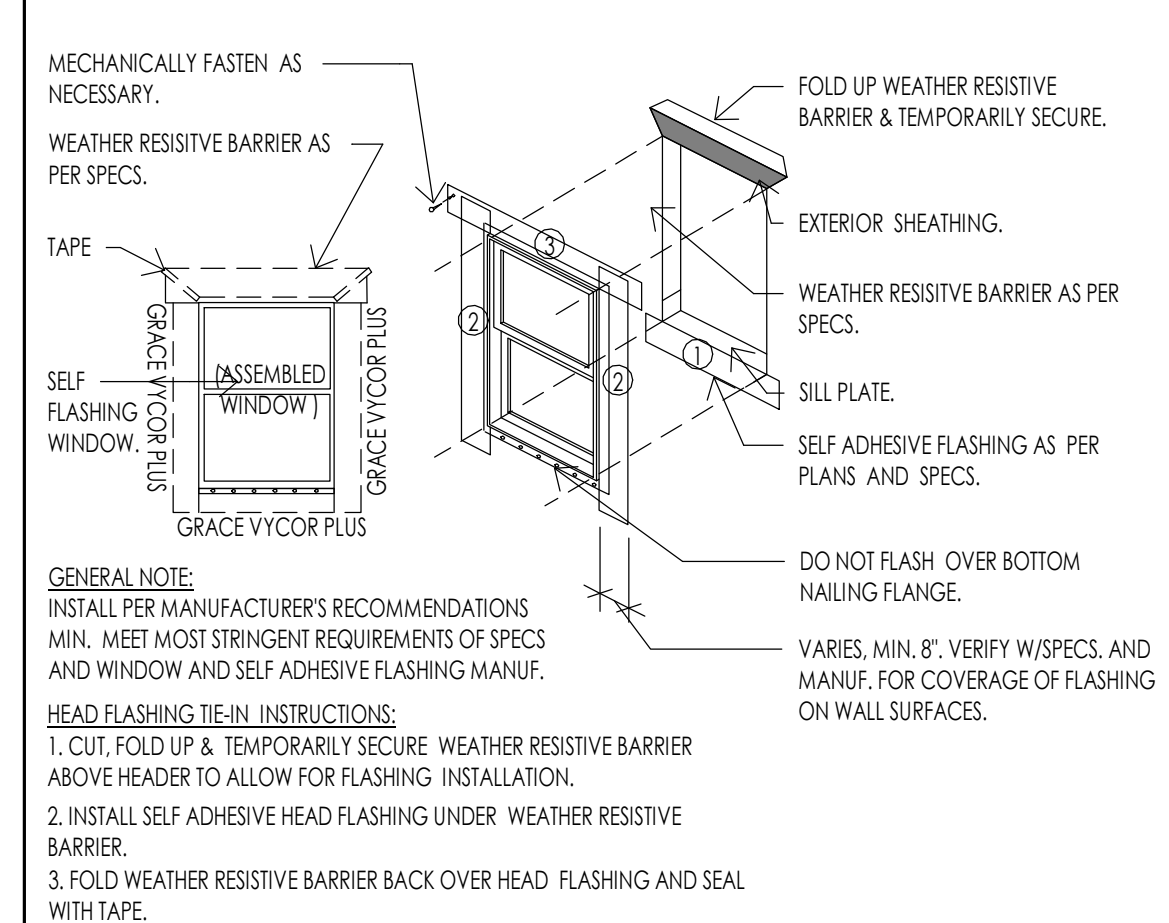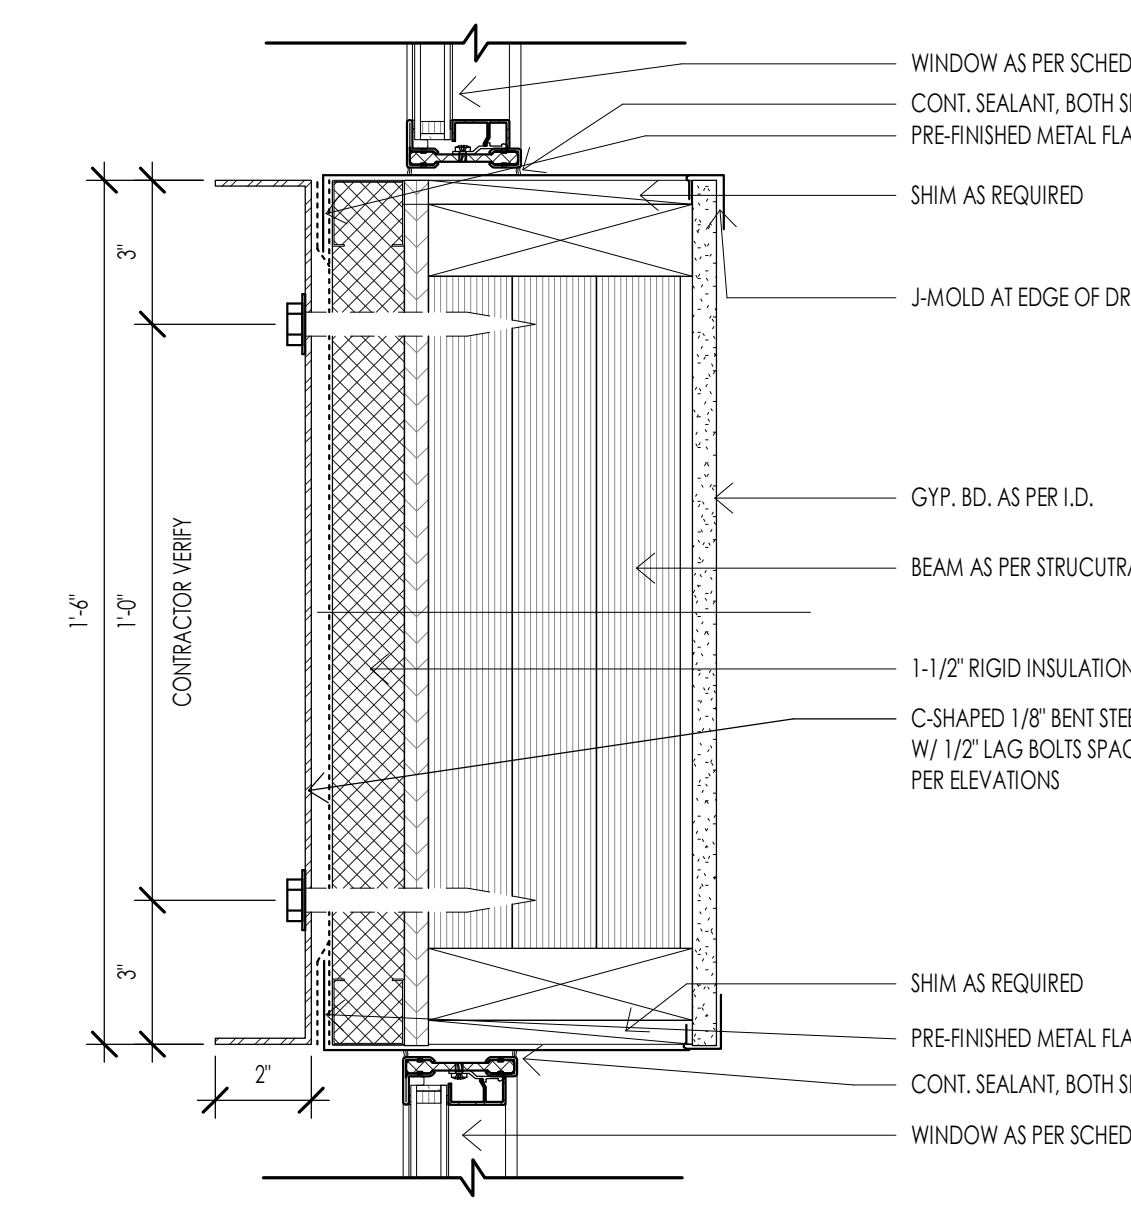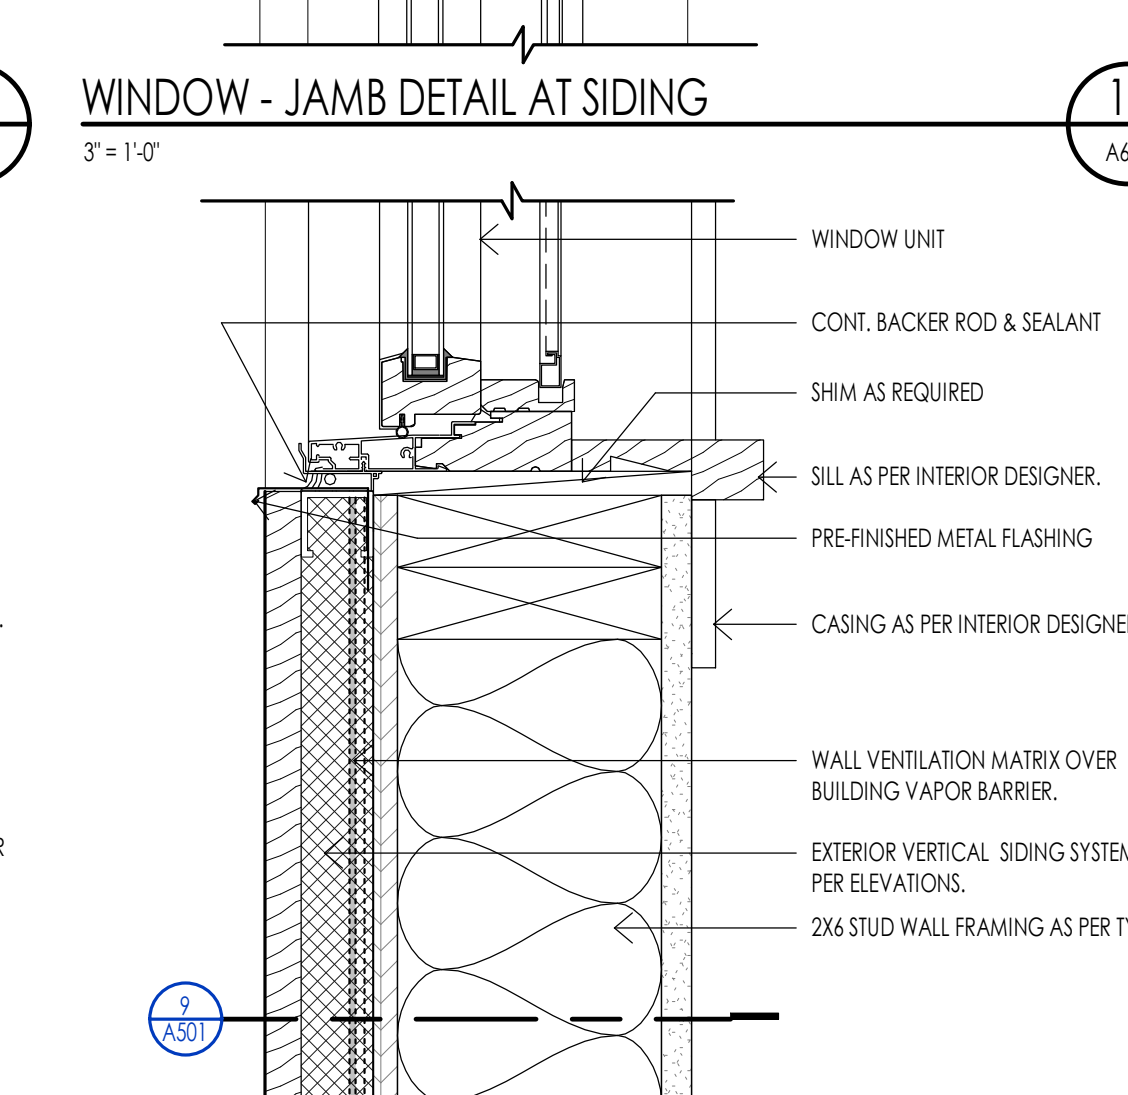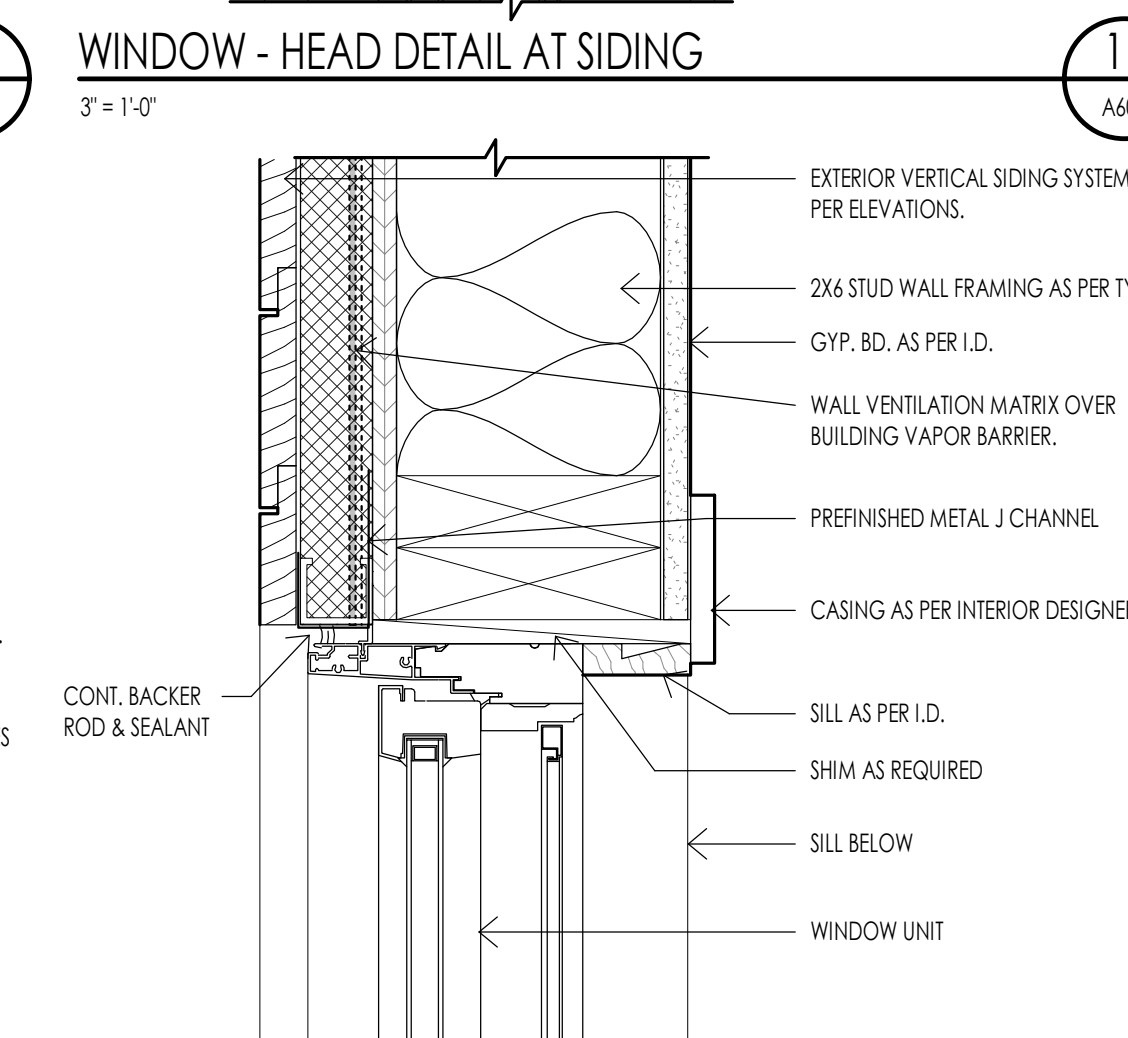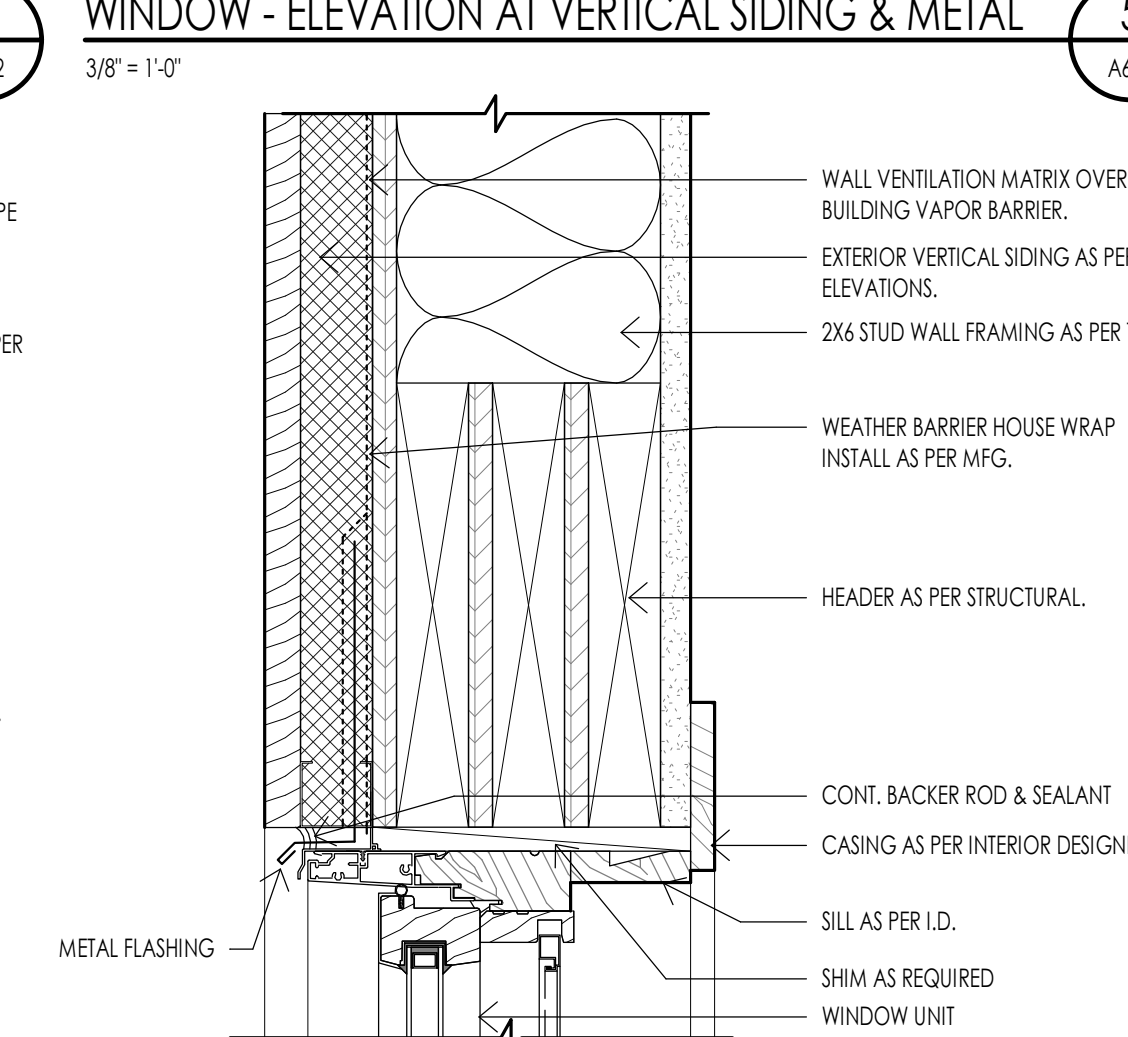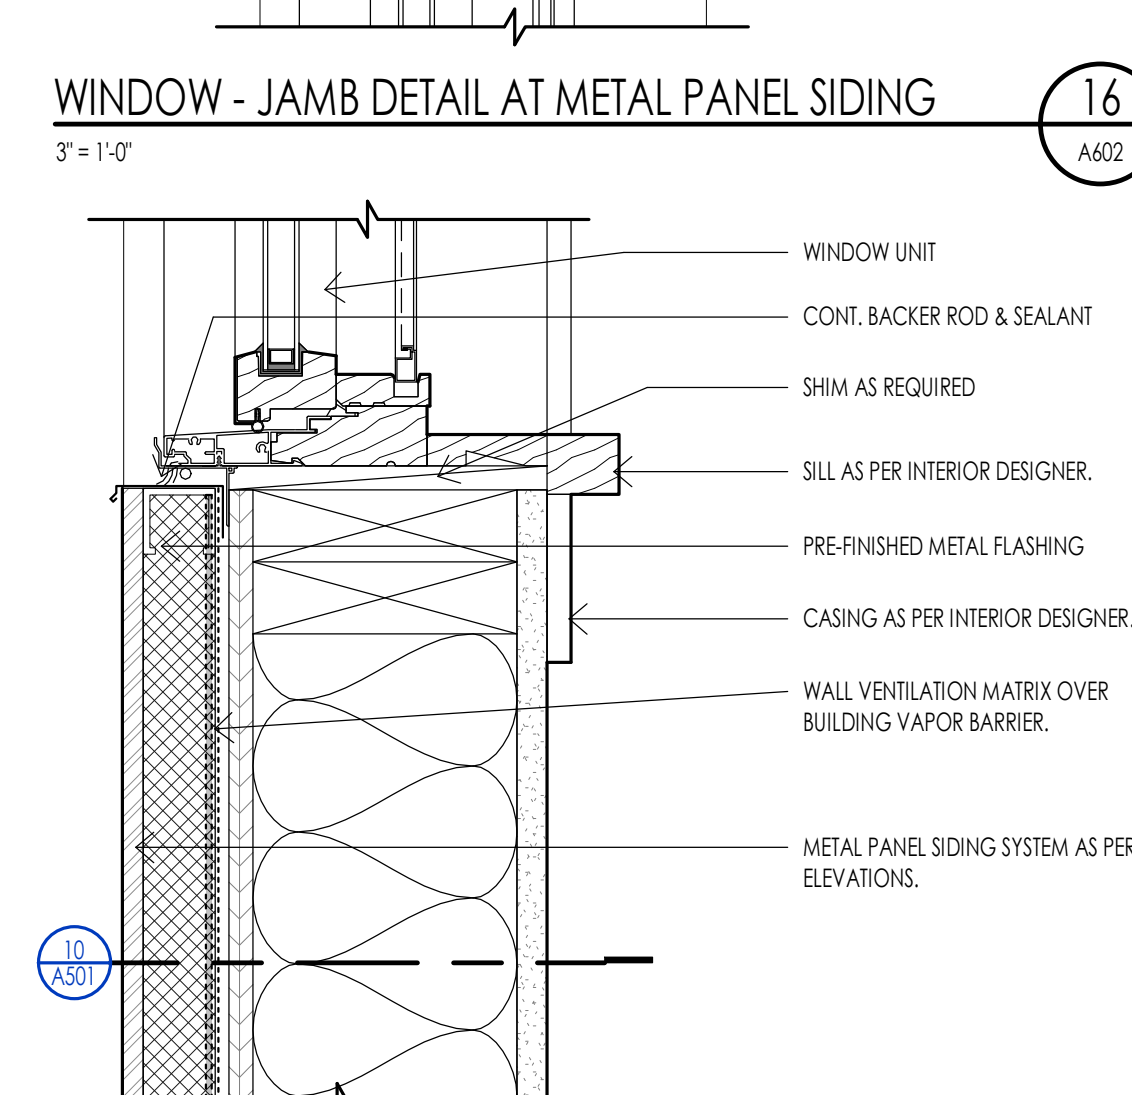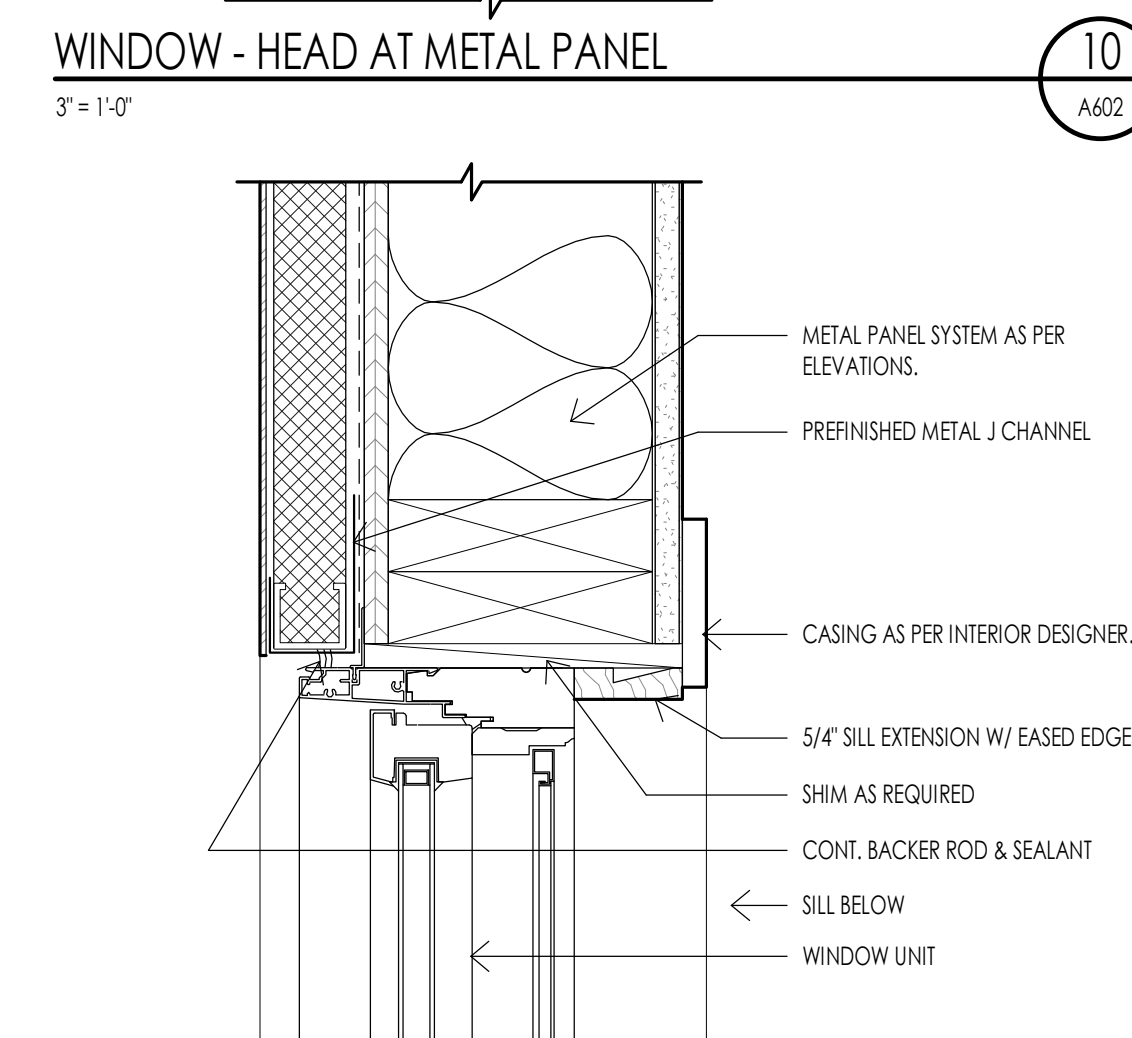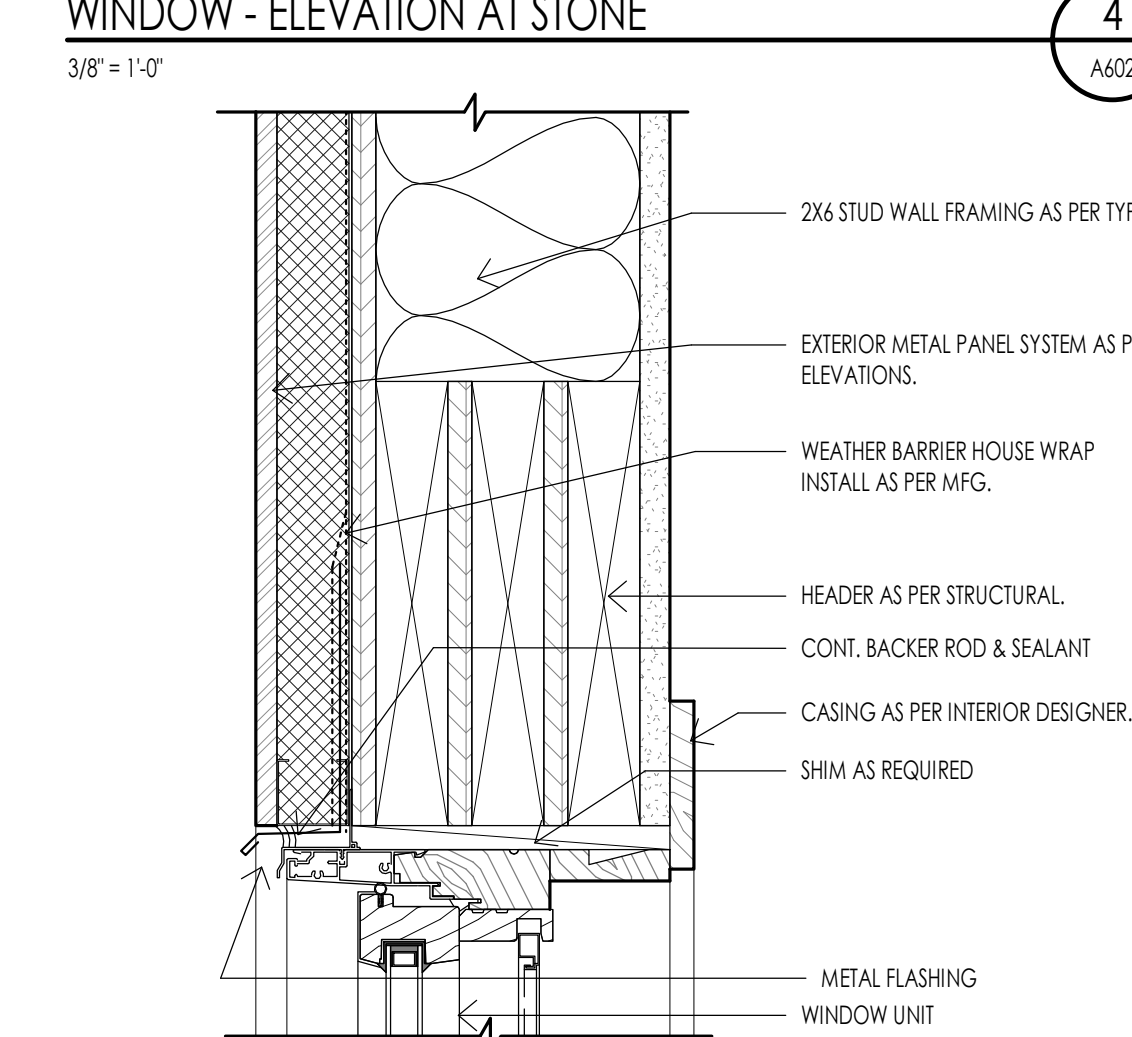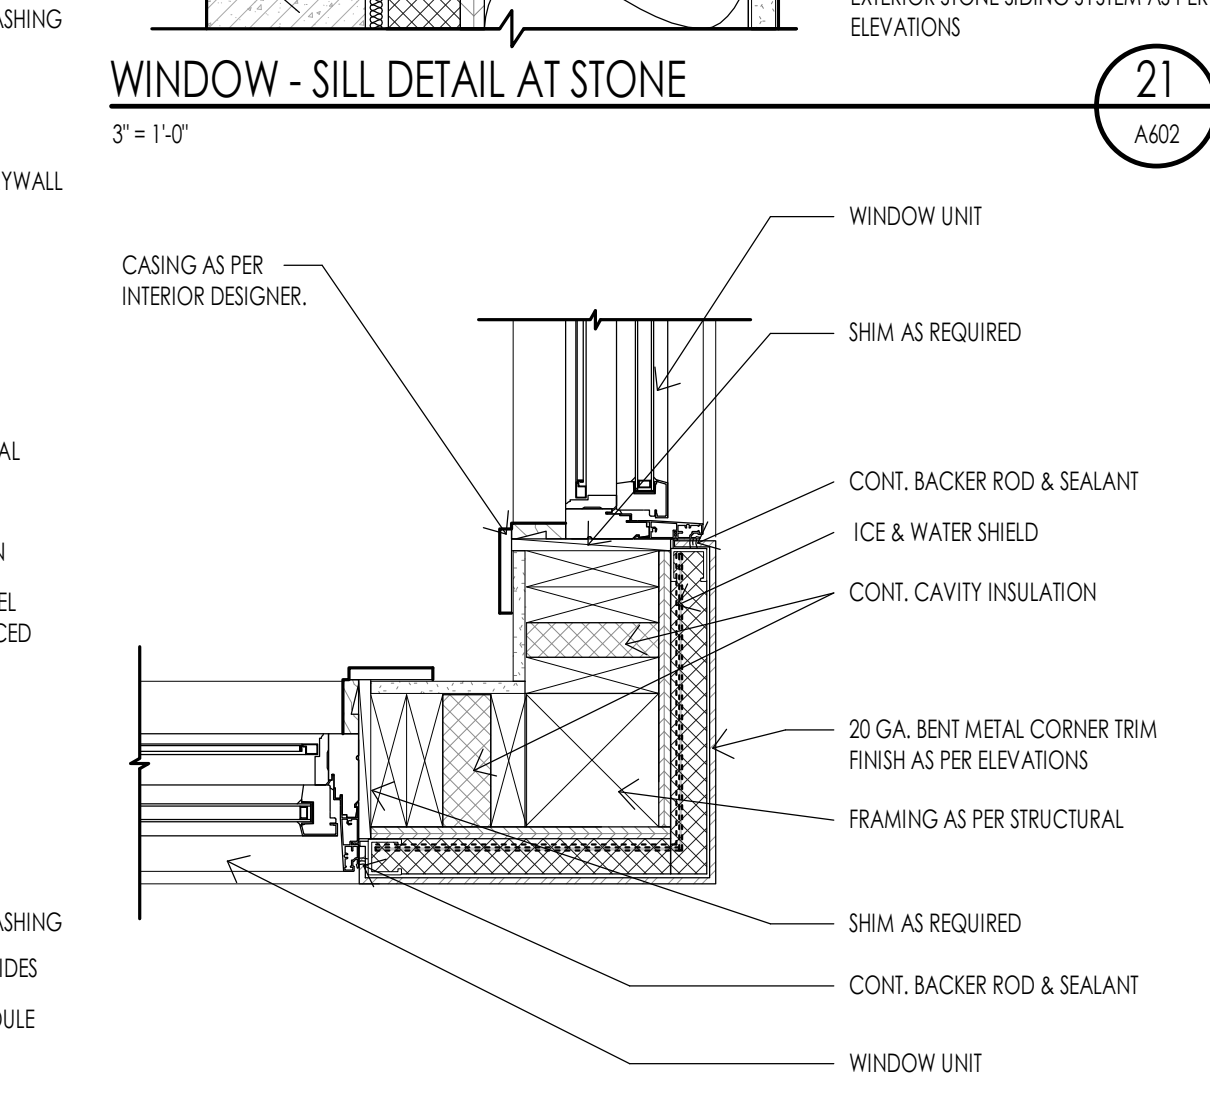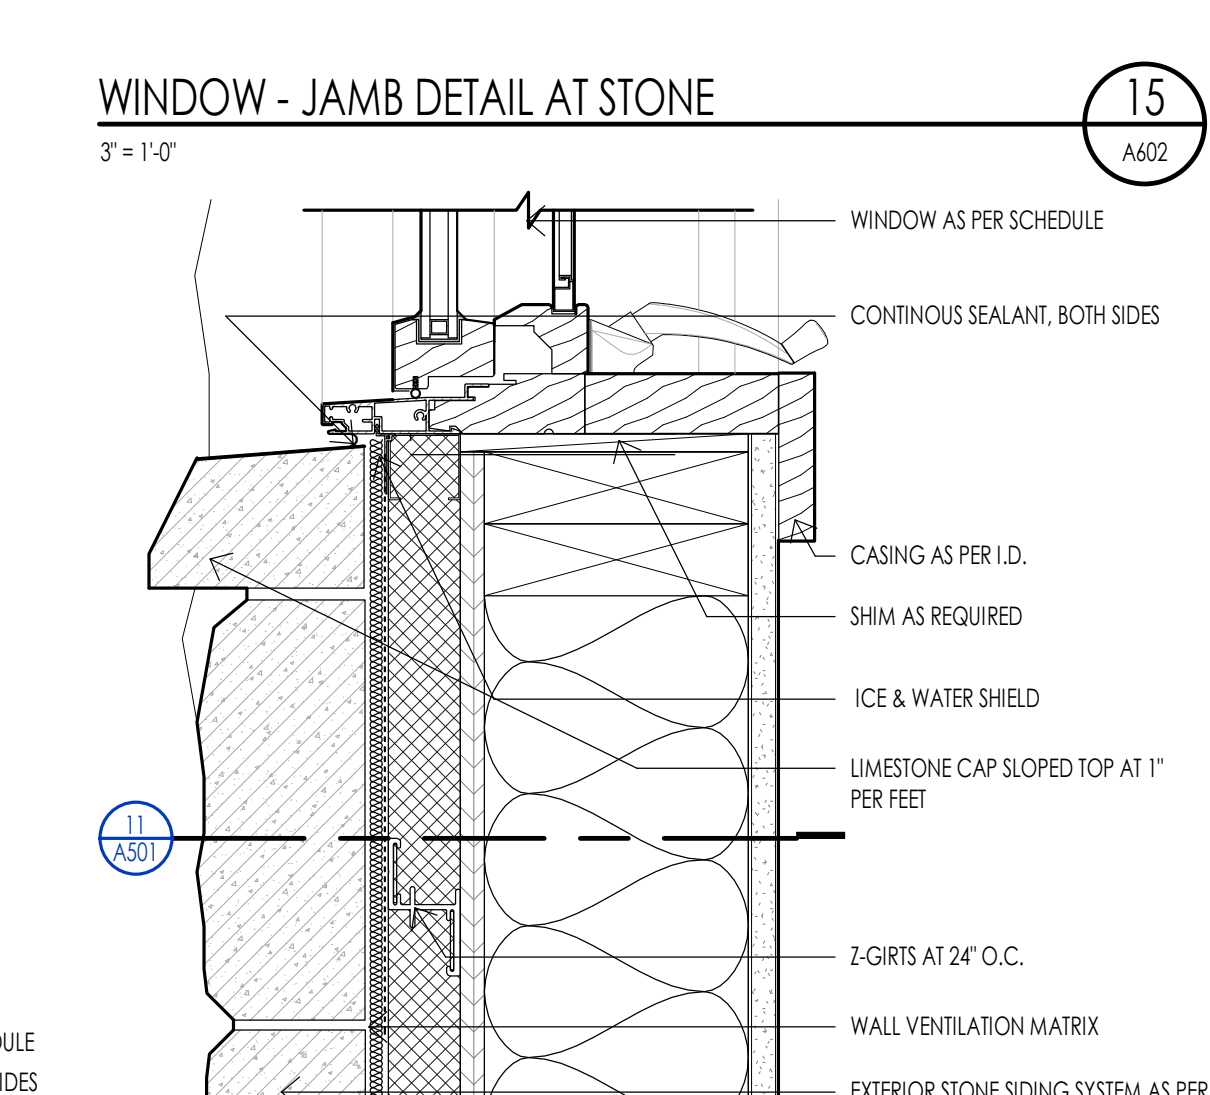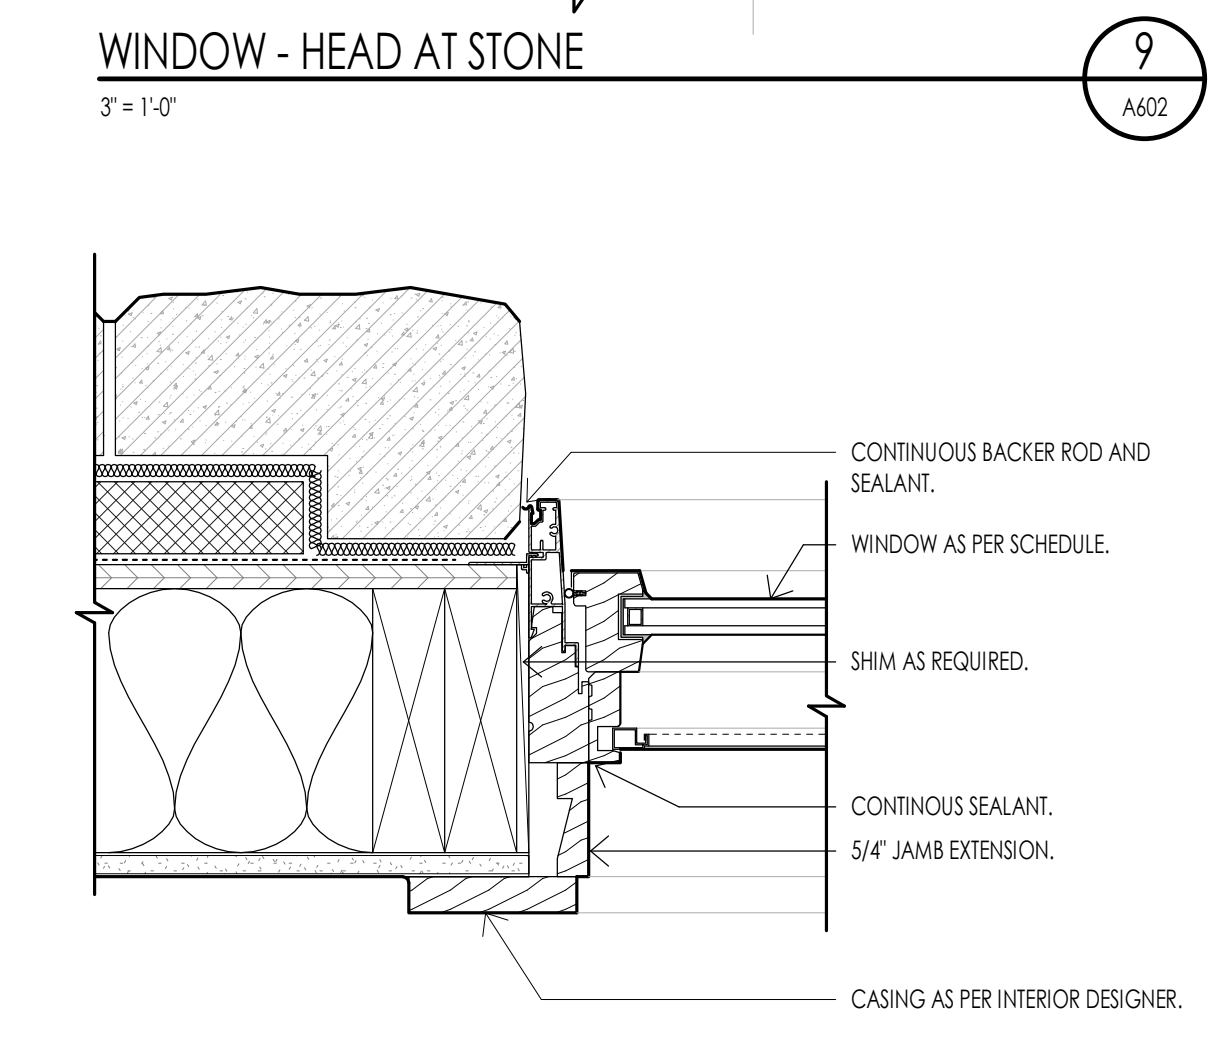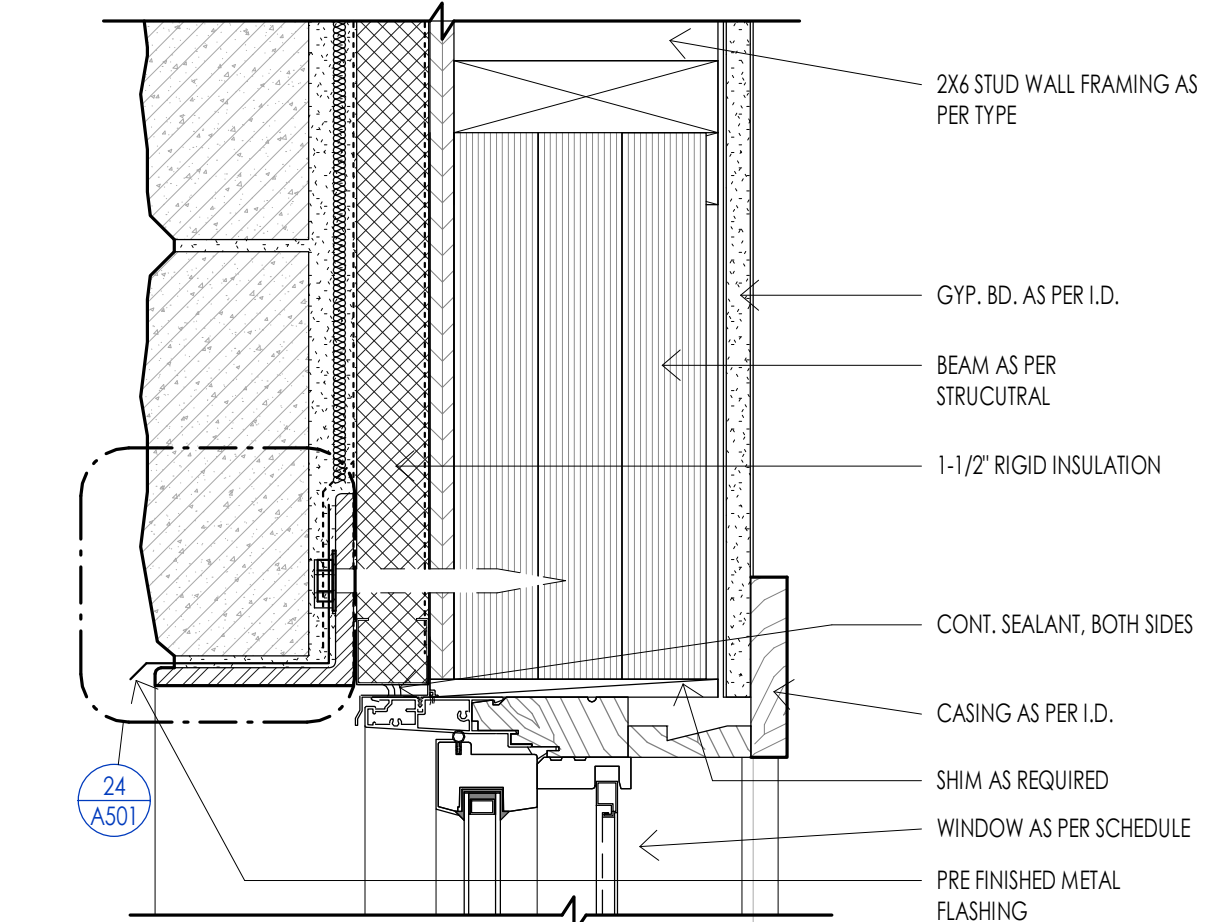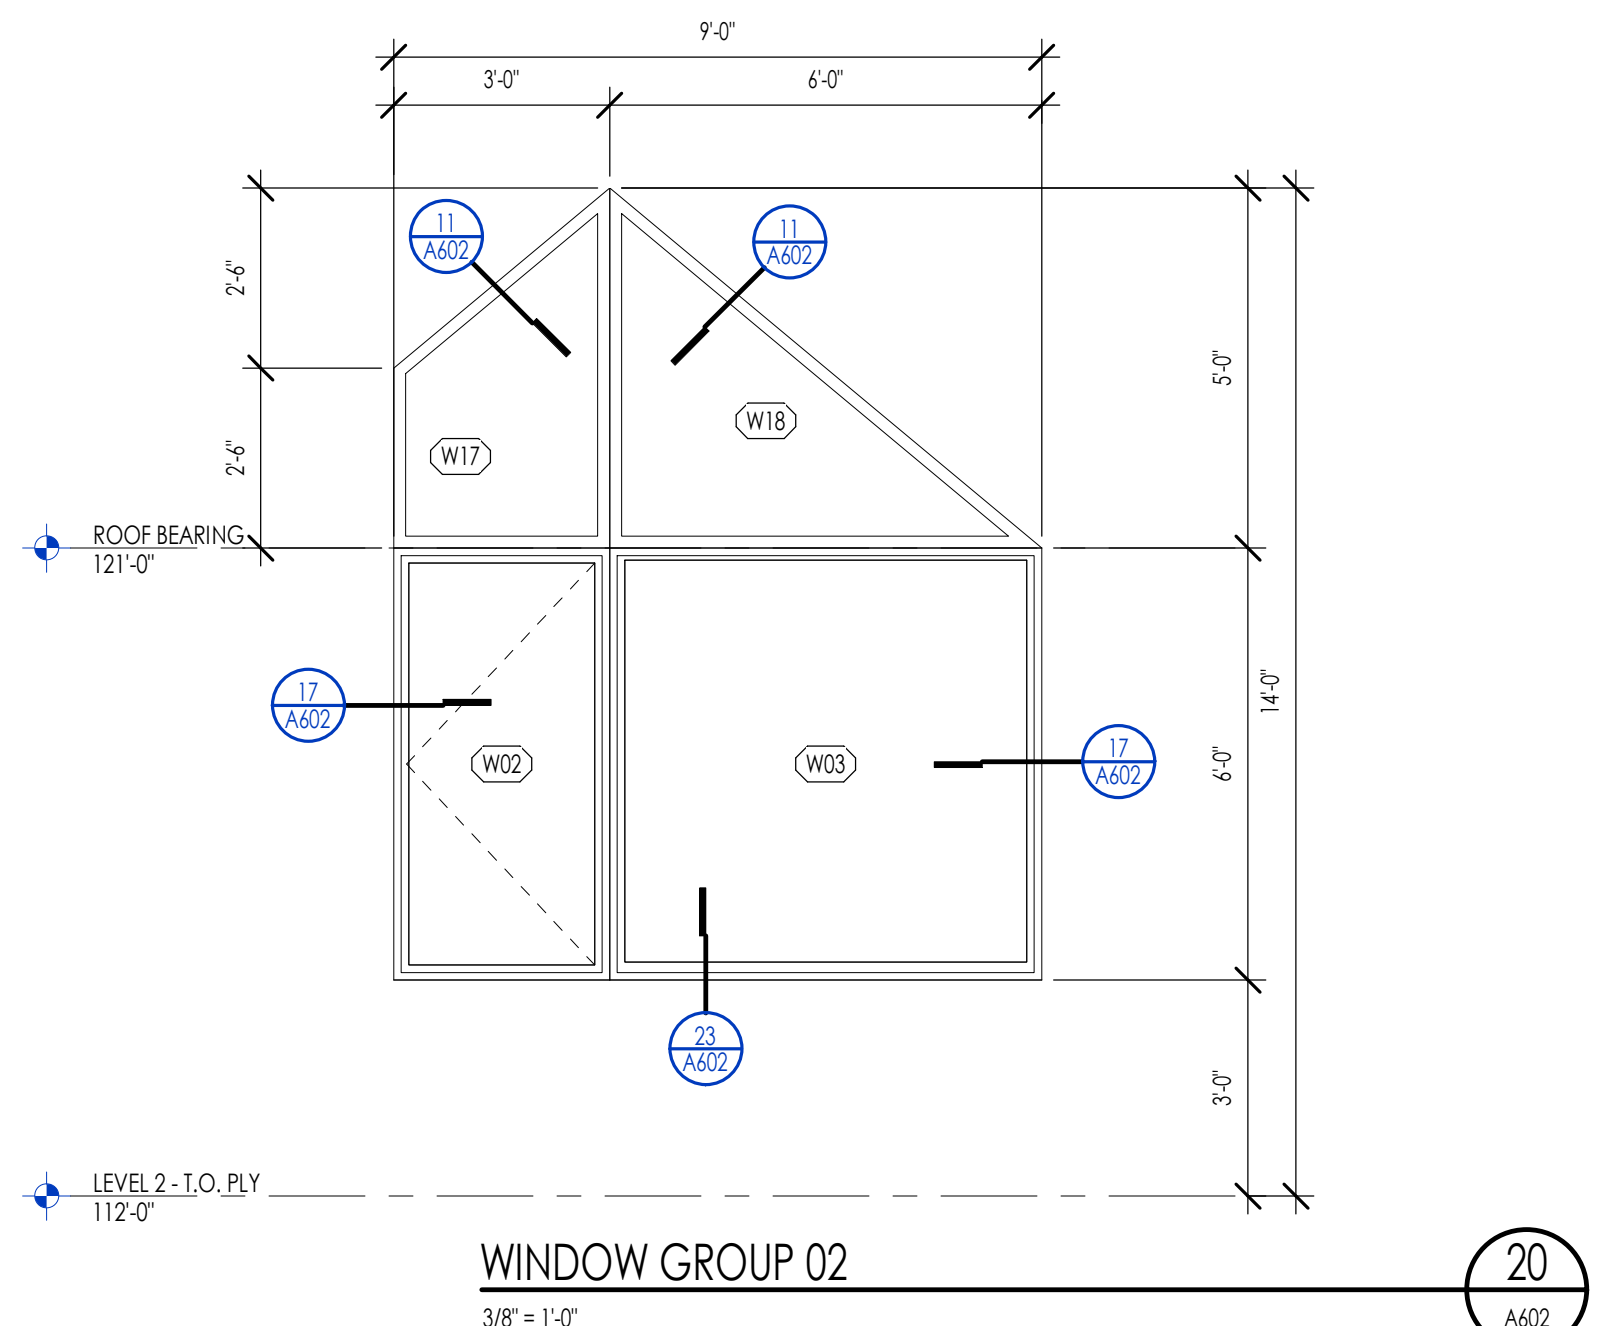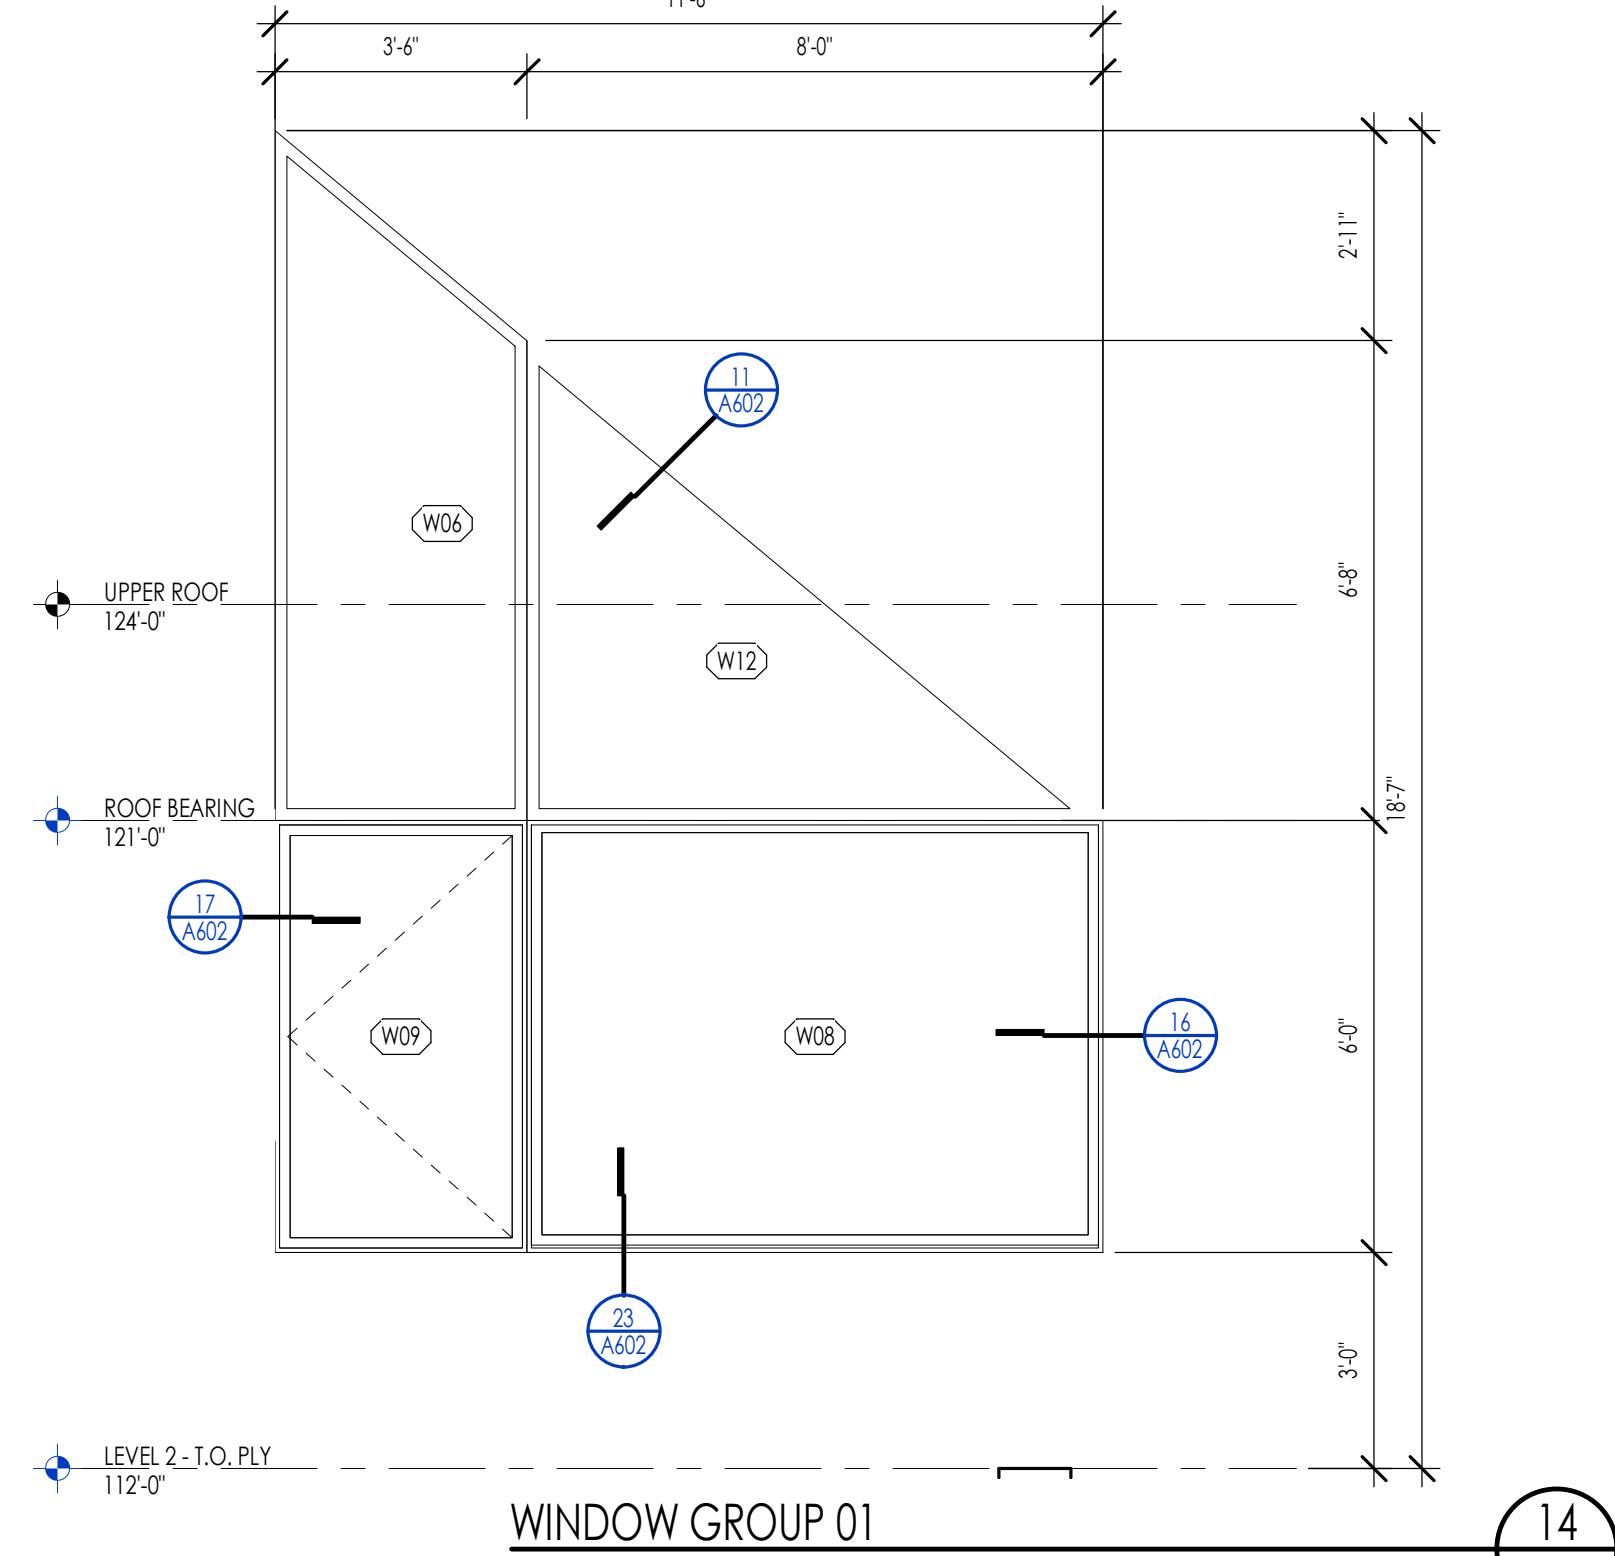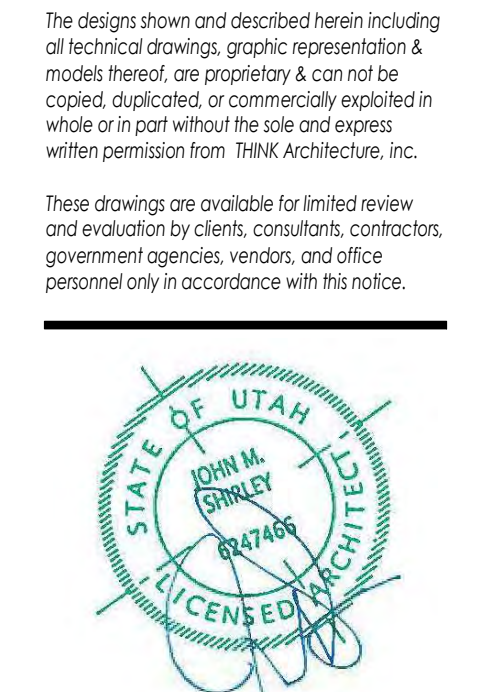

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30

REVISIONS:

SHEET TITLE:
WINDOW SCHEDULE & ELEVATIONS

SHEET NUMBER:
A602


PERMIT SET

© 2023 THINK ARCHITECTURE INC.

MECHANICAL GENERAL NOTES


- PLUMBING GENERAL NOTES**
- THE PLUMBING SYSTEM SHALL BE DESIGNED BY A LICENSED MECHANICAL CONTRACTOR/ DESIGNER AND SHALL MEET ALL THE REQUIREMENTS OF THE 2015 IRC, IPC AND IECC.
 - THE PLUMBING CONTRACTOR IS RESPONSIBLE FOR THE COMPLETE PLUMBING SYSTEM INSTALLATION AND SHALL PROVIDE A (1) ONE YEAR WARRANTY BEGINNING FROM THE TIME OF CERTIFICATE OF OCCUPANCY. THE CONTRACTOR IS RESPONSIBLE TO PROVIDE THE OWNER COMPLETE OPERATION AND MAINTENANCE MANUALS. THE CONTRACTOR SHALL ALSO SET UP A TIME TO PROVIDE COMPLETE TRAINING OF THE SYSTEM TO THE OWNER.
 - THE PLUMBING CONTRACTOR SHALL REVIEW AND SHALL GANG ALL ROOF VENTS INTO SINGLE ROOF VENTS WHERE POSSIBLE AND SHALL RUN THE VENTS OUT OF THE ROOF AT THE HIGHEST POINT POSSIBLE. ALL VENTS SHALL HAVE BLOCKING ON EACH SIDE OF THE VENT IN THE ROOF STRUCTURE TO ENSURE THE VENTS WILL NOT BE MOVED DUE TO SNOW ON THE ROOF. ALL VENTS SHALL BE SIZED PER THE BUILDING CODE BUT SHALL NOT BE LESS THAN 3 INCH PIPES. THE PLUMBING CONTRACTOR SHALL COORDINATE THAT THE PROPER FLASHING HAS BEEN INSTALLED FOR EACH VENT.
 - THE ROOF VENTS SHALL EXTEND ABOVE THE ROOF AS REQUIRED BY THE LOCAL JURISDICTION AND BUILDING CODES. THE PLUMBING CONTRACTOR SHALL COORDINATE THIS INSTALLATION.
 - ALL PLUMBING FIXTURES ARE SPECIFIED ON THE MECHANICAL DRAWINGS, AND ON THE INTERIOR DRAWINGS. THE PLUMBING CONTRACTOR SHALL PROVIDE FULL AND COMPLETE SHOP DRAWING SUBMITTAL ON ALL PLUMBING FIXTURE ITEMS FOR APPROVAL BY OWNER AND DESIGN TEAM.
 - THE PLUMBING FIXTURES SHALL HAVE THE FOLLOWING REQUIREMENTS:
 - SHOWER HEADS SHALL HAVE A FLOW RATE OF 2.5 GPM OR LESS
 - WATER CLOSETS SHALL HAVE ECONO-FLUSH TANK 1.6 GAL. MAX FLUSH
 - ALL NOSE BBS SHALL BE NON-FREEZE TYPE WITH BACK FLOW PREVENTERS
 - THE PLUMBING CONTRACTOR SHALL INSTALL ALL PLUMBING FIXTURES IN STRICT ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. TAKE CARE DURING BUILDING CONSTRUCTION TO SEE THAT PROVISIONS ARE MADE FOR PROPER FUTURE SUPPORT AND THAT PROVISIONS ARE MADE FOR PROPER FUTURE SUPPORT. ROUGH IN PIPING IS ACCURATELY SET AND PROTECTED FROM MOVEMENT OF DAMAGE DURING CONSTRUCTION.
 - THE PLUMBING CONTRACTOR SHALL MAKE SURE THAT NO PLUMBING WILL BE INSTALLED WITHIN THE EXTERIOR WALL.
 - PLUMBING CONTRACTOR SHALL ASSESS WATER PRESSURE AND ENSURE ADEQUATE PRESSURE IS AVAILABLE FOR MULTIPLE FUTURE USE SIMULTANEOUSLY WITH OUT PRESSURE DECREASE OR TEMPERATURE FLUCTUATION.
 - PLUMBING CONTRACTOR SHALL PROVIDE A TURN OFF VALVE AND DRAIN AT THE LOWEST LEVEL OF THE FACILITY. ALL FIXTURES SHALL BE ABLE TO DRAIN TO THIS POINT. PROVIDE A FLOOR DRAIN AT THE LOCATIONS OF PLUMBING SYSTEM DRAIN.
 - ALL SUPPLY WASTE AND GAS LINE MATERIALS, WORKMANSHIP, AND INSTALLATION AS PER INDUSTRY STANDARDS. ALL WATER SUPPLY LINES IN THE BUILDING SHALL BE TYPE "1" COPPER. TO INCLUDE PIPING TO MANFOLDS. EQUIPMENT SHALL BE COPPER WITHIN THE BUILDING. ALL SUPPLY TO FIXTURES MAY BE POLYETHYLENE CROSS LINK PIPING FOR ABOVE GROUND AND BUILDING APPLICATIONS. INSTALL AS PER MANUFACTURER'S SPECIFICATIONS. ALL CONNECTIONS FOR POLYETHYLENE PIPING SHALL BE BRASS. FITTINGS WITH COMPRESSION BAND FITTINGS.
 - ALL WATER LINES UNDERGROUND SHALL BE TYPE "1" COPPER. ALL FITTINGS AND JOINTS SHALL BE SWEAT SOLDER JOINTS TOGETHER.
 - WASTE LINES SHALL BE PROVIDED WITH CLEAN OUT AS REQUIRED. EXTEND CLEAN OUT TO ACCESSIBLE SURFACE. DO NOT PLACE CLEAN OUTS IN FLOORS UNLESS PREVIOUSLY APPROVED BY THE DESIGN TEAM AND OWNER.
 - GAS PIPING SHALL BE INSTALLED AS PER THE LATEST CODE REQUIREMENTS FOR THIS TYPE OF PROJECT. ALL GAS PIPING SHALL BE FULLY TESTED AND INSPECTED FOR ANY LEAKS PRIOR TO FINAL COMPLETION OF THE PROJECT. THE CONTRACTOR SHALL INSTALL SHUT OFF VALVES AT EACH GAS APPLIANCE AND SHALL LOCATE THE VALVE TO HAVE ACCESS TO THE VALVE.
 - PLUMBING CONTRACTOR SHALL TEST ALL PIPING INCLUDING DRAINAGE WASTE LINES, WATER PIPING, NATURAL GAS PIPING AND FITTINGS. ALL TEST SHALL BE PERFORMED TO MEET THE REQUIREMENTS OF THE APPLICABLE BUILDING CODE.
 - ALL WATER LINES SHALL FULLY DISINFECTED UPON THE FINAL COMPLETION OF THE PROJECT, AND BEFORE CERTIFICATE OF OCCUPANCY AND TURN OVER TO THE OWNER.
 - ALL DRAINS SHALL HAVE A TRAP PRIMER OR EQUIV. AS NECESSARY TO KEEP THE INTEGRITY OF THE PLUMBING TRAP.

- MECHANICAL GENERAL NOTES**
- THE MECHANICAL SYSTEM SHALL BE DESIGNED BY A LICENSED MECHANICAL CONTRACTOR/ DESIGNER AND SHALL MEET ALL THE REQUIREMENTS OF THE 2015 IRC, IMC AND IECC. THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR THE COMPLETE MECHANICAL SYSTEM INSTALLATION AND SHALL PROVIDE A (1) ONE YEAR WARRANTY BEGINNING FROM THE TIME OF CERTIFICATE OF OCCUPANCY. THE CONTRACTOR IS RESPONSIBLE TO PROVIDE THE OWNER COMPLETE OPERATION AND MAINTENANCE MANUALS. THE CONTRACTOR SHALL ALSO SET UP A TIME TO PROVIDE COMPLETE TRAINING OF THE SYSTEM TO THE OWNER.
 - THE MECHANICAL CONTRACTOR IS RESPONSIBLE TO VISIT THE JOB SITE AND BECOME FAMILIAR WITH ALL EXISTING CONDITIONS PRIOR TO STARTING THE WORK. THE MECHANICAL CONTRACTOR MUST ALSO PROVIDE NOTIFICATION TO THE ARCHITECT AND CONTRACTOR OF CONDITIONS THAT MAY BE DIFFERENT THAN EXPECTED DURING BIDDING.
 - ALL LINE VOLTAGE AND LOW VOLTAGE CONTROL WIRING SHALL BE RAN, INSTALLED AND CONNECTED BY THE MECHANICAL CONTRACTOR OR THE MECHANICAL CONTRACTOR SHALL CONTRACT THE SCOPE OF WORK.
 - ALL EQUIPMENT SPECIFICATIONS SHALL BE SUBMITTED TO THE ARCHITECT FOR REVIEW. THE CONTRACTOR MUST PROVIDE THE DOCUMENTATION THAT IT MEETS THE REQUIREMENTS OF THE ENERGY LEVELS BEING ACHIEVED WITHIN THIS BUILDING.
 - THE MECHANICAL CONTRACTOR SHALL REVIEW AND COORDINATE WITH THE DRAWINGS FOR LOCATIONS OF ALL MECHANICAL ZONES.
 - EXHAUST FANS WHERE SHOWN ON EITHER THE MECHANICAL OR ELECTRICAL PLANS SHALL BE SIZED FOR A MINIMAL RATE OF 50 CFM. ALL FANS SHALL BE HARD DUCTED WITH RIGID DUCT (NO FLEX DUCT SHALL BE ALLOWED), AND DIRECTED DIRECTLY TO THE EXTERIOR OF THE BUILDING IN A SOFFIT OR SIDE WALL. THE TERMINATION OF ALL EXHAUST FANS SHALL BE A MINIMUM OF 10'-0" AWAY FROM ANY OPERABLE WINDOW. TERMINATIONS SHALL BE INSTALLED AS NOT TO BE BLOCKED BY SNOW AND ICE. FANS SHALL BE A DIRECT DRIVE CENTRIFUGAL UNIT WITH SLOW SPEED MOTOR. PROVIDE AN ACOUSTICAL INSULATION, GRIPS, CAPS, ETC. AS REQUIRED.
 - ALL GRILLS AND REGISTERS MUST BLEND TO THE ADJACENT FINISH, AND SHALL BE PROVIDED TO MEET THE REQUIREMENTS FOR THE FLOW RATE AS PER THE CFM REQUIREMENTS. ALL GRILLS SHALL BE EITHER PAINTED FOR METAL FINISH SELECTED.
 - WATER HEATERS
 - THE REQUIRED NUMBER OF WATER HEATERS ARE SHOWN ON THE MECHANICAL PLANS. ALL WATER HEATERS SHALL BE 90% OR BETTER HIGH EFFICIENCY WATER HEATERS WITH RAPID RECOVERY. ALL WATER HEATERS SHALL BE INSTALLED WITH SEISMIC ANCHORING, AS PER DETAILS.
 - ALL WATER HEATERS SHALL BE VENTED TO THE EXTERIOR.
 - THE CONTRACTOR SHALL PROVIDE A FLOOR DRAIN WHETHER SHOWN OR NOT AT THE BASE OF ALL WATER HEATERS. THE FLOOR DRAIN MUST BE LOCATED, AND THE FLOOR MUST SLOPE TOWARD THE DRAIN IN A POSITIVE FLOW.
 - GAS FIRED FURNACES
 - THE REQUIRED NUMBER OF GAS FIRED FURNACES SHALL BE PER THE MECHANICAL DESIGNER/ ENGINEER. THE LOCATION IS SHOWN ON THE MECHANICAL DRAWINGS WHERE THE LOCATIONS ARE PROVIDED FOR THE GAS FIRED FURNACES.
 - THE GAS FIRED FURNACES SHALL BE A MINIMUM OF 90% OR BETTER HIGH EFFICIENCY FURNACE. THE EXACT SIZE OF EACH OF THESE UNITS SHALL BE PER THE MECHANICAL DESIGNER/ ENGINEER.
 - THE VENTING OF EACH GAS FIRED FURNACE SHALL BE PVE PIPE AND SHALL BE LOCATED AWAY FROM THE MAIN ENTRIES OF THE BUILDING, AND WINDOW LOCATIONS. COORDINATE THE EXACT LOCATION WITH THE OWNER AND ARCHITECT.
 - THE CONTRACTOR SHALL PROVIDE A FLOOR DRAIN BY THE GAS FIRED FURNACES FOR THE UNIT CONDENSATE LINES.
 - GAS FIRED BOILERS
 - THE REQUIRED NUMBER OF GAS FIRED BOILERS SHALL BE PER THE MECHANICAL DESIGNER/ ENGINEER. THE LOCATION IS SHOWN ON THE MECHANICAL DRAWINGS WHERE THE LOCATIONS ARE PROVIDED FOR THE GAS FIRED BOILERS.
 - THE GAS FIRED BOILER SHALL BE A MINIMUM OF 90% OR BETTER HIGH EFFICIENCY FURNACE. THE EXACT SIZE OF EACH OF THESE UNITS SHALL BE PER THE MECHANICAL DESIGNER/ ENGINEER.
 - THE VENTING OF EACH GAS FIRED BOILER SHALL BE PVE PIPE AND SHALL BE LOCATED AWAY FROM THE MAIN ENTRIES OF THE BUILDING, AND WINDOW LOCATIONS. COORDINATE THE EXACT LOCATION WITH THE OWNER AND ARCHITECT.
 - THE CONTRACTOR SHALL PROVIDE A FLOOR DRAIN BY THE GAS FIRED BOILER FOR THE UNIT CONDENSATE LINES.
 - DUCTWORK
 - ALL DUCTWORK SHALL BE 24 GA. MINIMUM RIGID DUCT AND SHALL BE FULL SEALED AT EACH JOINT LOCATION. NO FLEXIBLE DUCT IS ALLOWED WITHIN THE INSTALLATION.
 - ALL DUCTWORK IN CEILINGS OF UNHEATED ROOM OR UNDER SLAB SHALL BE INSULATED DUCT WORK. ALL DUCTWORK WITHIN THE HEATING ENVELOPE OF THE STRUCTURE DOES NOT REQUIRE TO BE INSULATED, UNLESS SPECIFICALLY NOTED.
 - ALL DUCTWORK SHALL BE IN THE SPACE ALLOCATED, AND SHALL NOT BE DROPPED BELOW FLOOR JOISTS, UNLESS NOTED ON DRAWINGS, OR PREVIOUSLY APPROVED BY THE ARCHITECT AND OWNER.

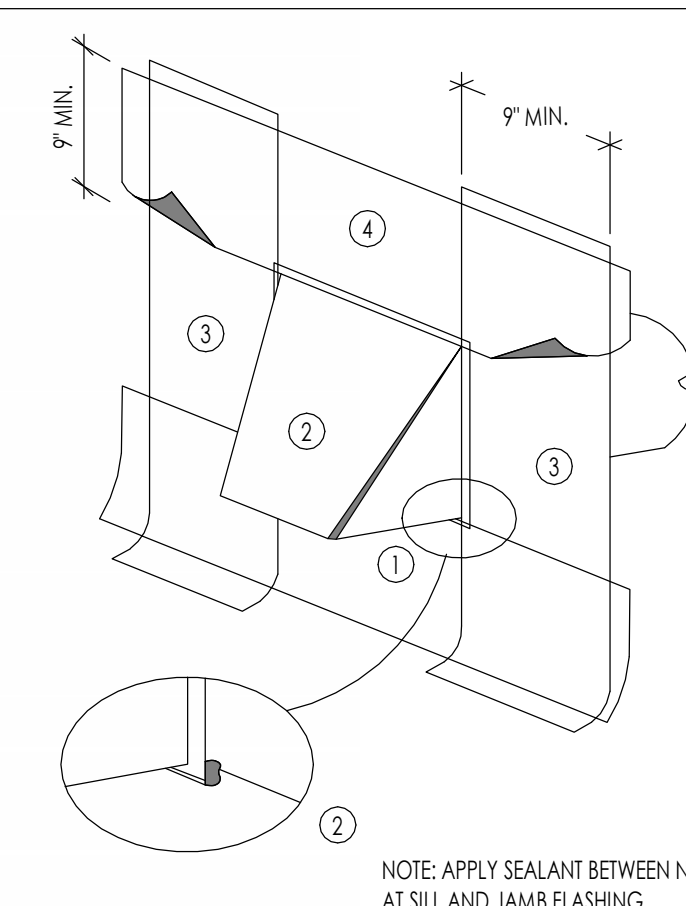


- SILL FLASHING**
9 INCH MIN. WIDE SELF-ADHERED SELF-HEALING RUBBERIZED ELASTOMERIC ASPHALT FLASHING MEMBRANE INSTALLED A MIN. 9 INCHES BEYOND ROUGH OPENING
-DO NOT OVERLAP THE TOP OF SILL FRAMING
-ADHERE ONLY AT TOP EDGE. LEAVE UNATTACHED AT BOTTOM SO THAT THE PAPER CAN BE INSTALLED UNDERNEATH
- METAL EXTERIOR VENT**
24 GA. MIN. GALV. SHEET METAL VENT MUST BE INSTALLED OVER SILL FLASHING. INSTALL JAMB FLASHING OVER OR UNDER NAILING FLANGE. SET VENT IN A CONTINUOUS BED OF SEALANT.
- JAMB FLASHING**
9 INCH MIN. WIDE SELF-ADHERED SELF-HEALING RUBBERIZED ELASTOMERIC ASPHALT FLASHING MEMBRANE FLASHING INSTALLED OVER AND BELOW SILL FLASHING AND ABOVE TOP OF FUTURE HEAD FLASHING. -DO NOT FASTEN THE BOTTOM 9 INCHES OF THE JAMB FLASHING SO THE WEATHER-RESISTANT BARRIER APPLIED LATER MAY BE SUPPLIED UNDERNEATH THE FLASHING IN A WEATHERBOARD FASHION.
- HEAD FLASHING**
APPLY SELF-ADHERED SELF-HEALING RUBBERIZED ELASTOMERIC ASPHALT FLASHING MEMBRANE OVER DRYER VENT FLANGE. EXTEND HEAD FLASHING BEYOND EACH JAMB FLASHING.


EXHAUST VENT DETAIL 1
1 1/2" = 1'-0"

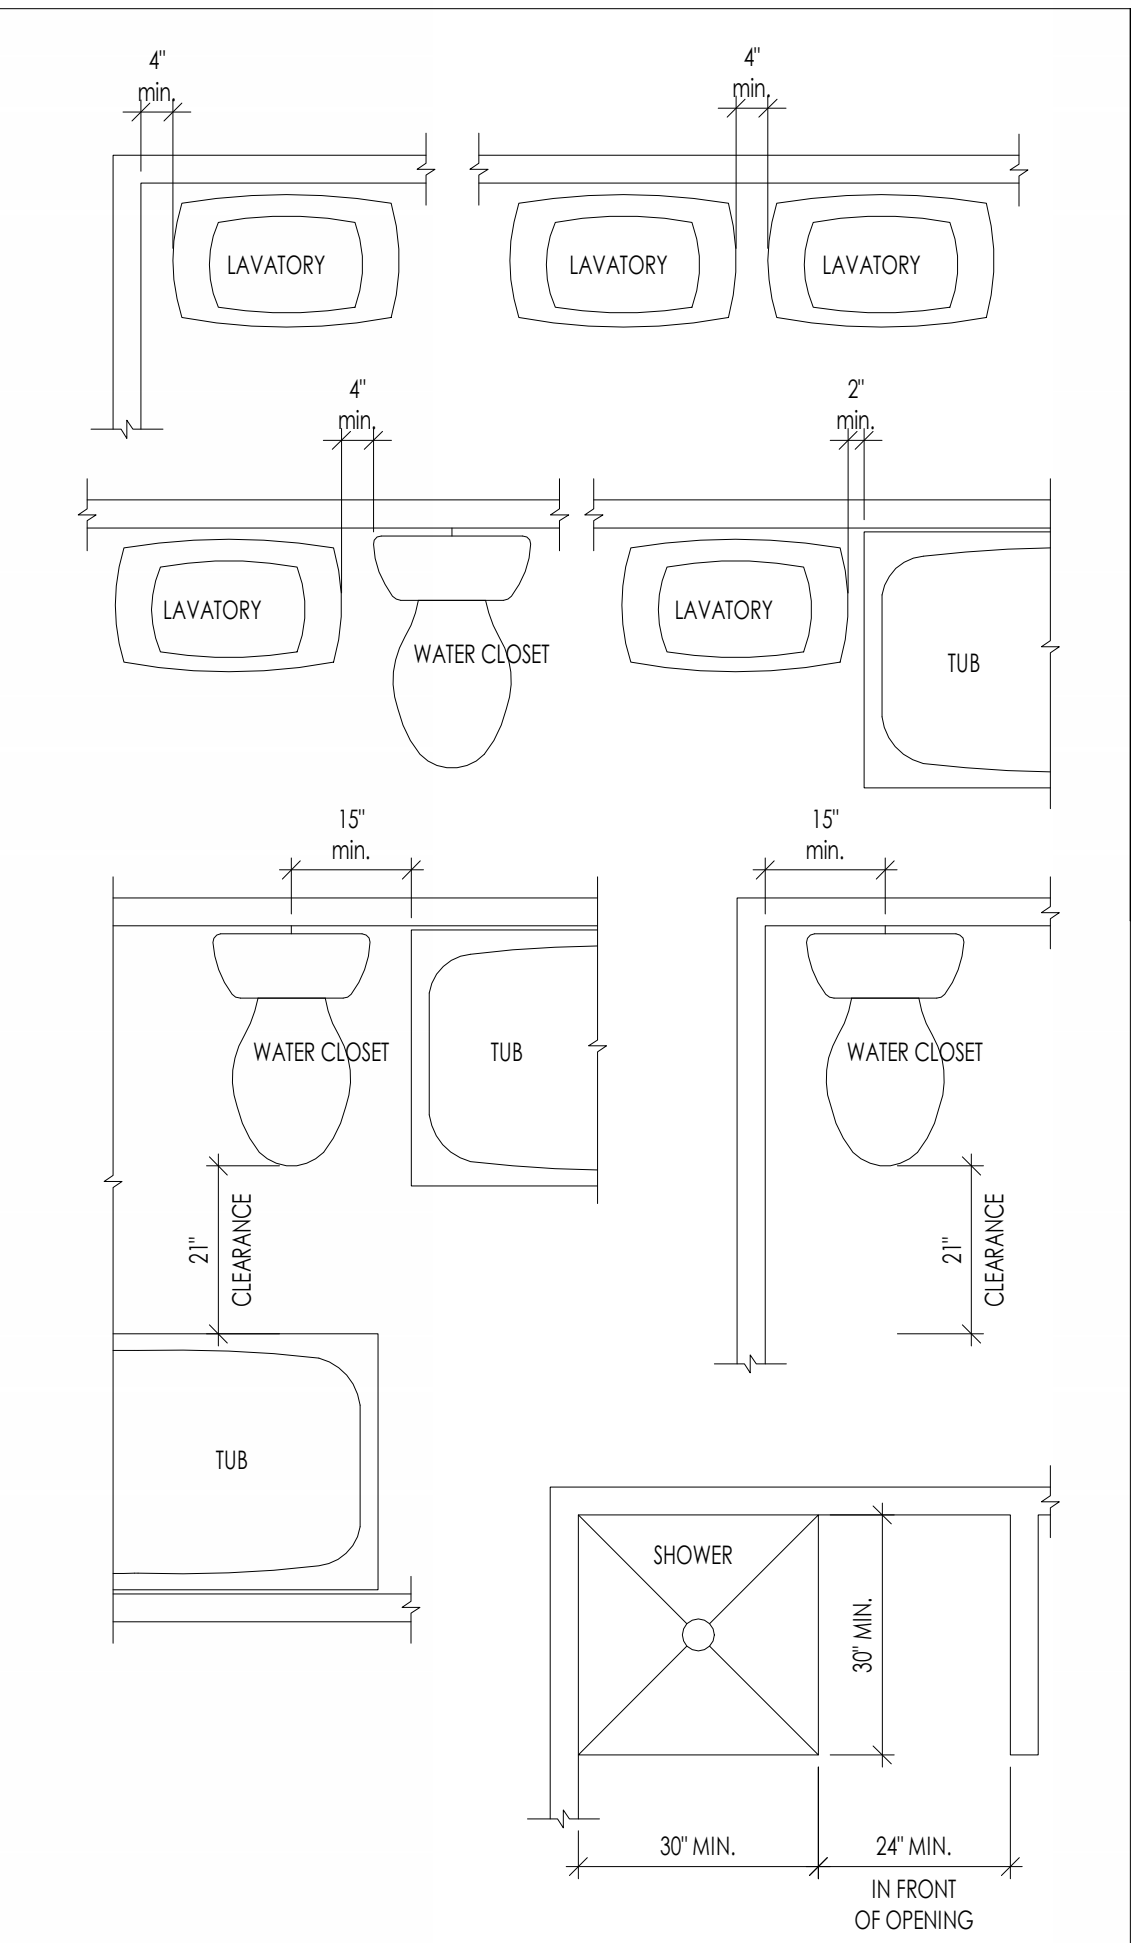


MINIMUM PLUMBING FIXTURE CLEARANCES 2
1/8" = 1'-0"

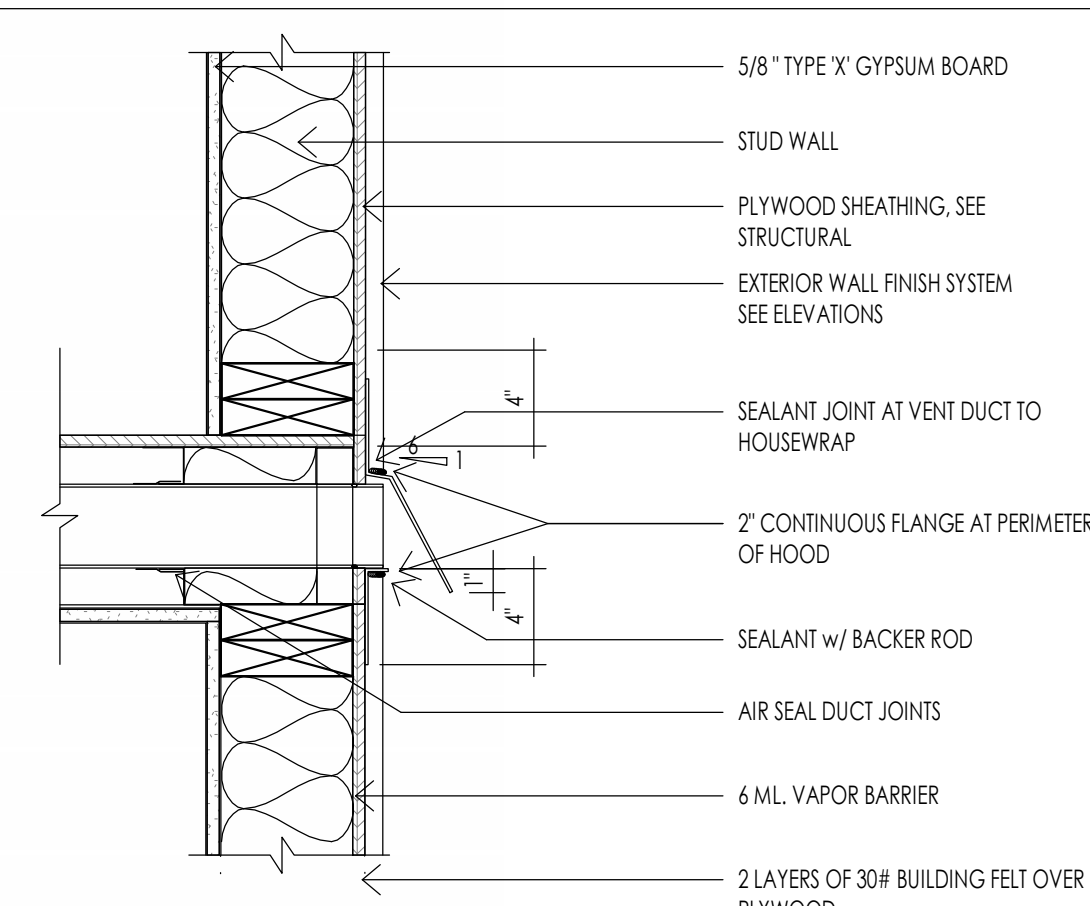

WALL EXHAUST VENT 3
1 1/2" = 1'-0"

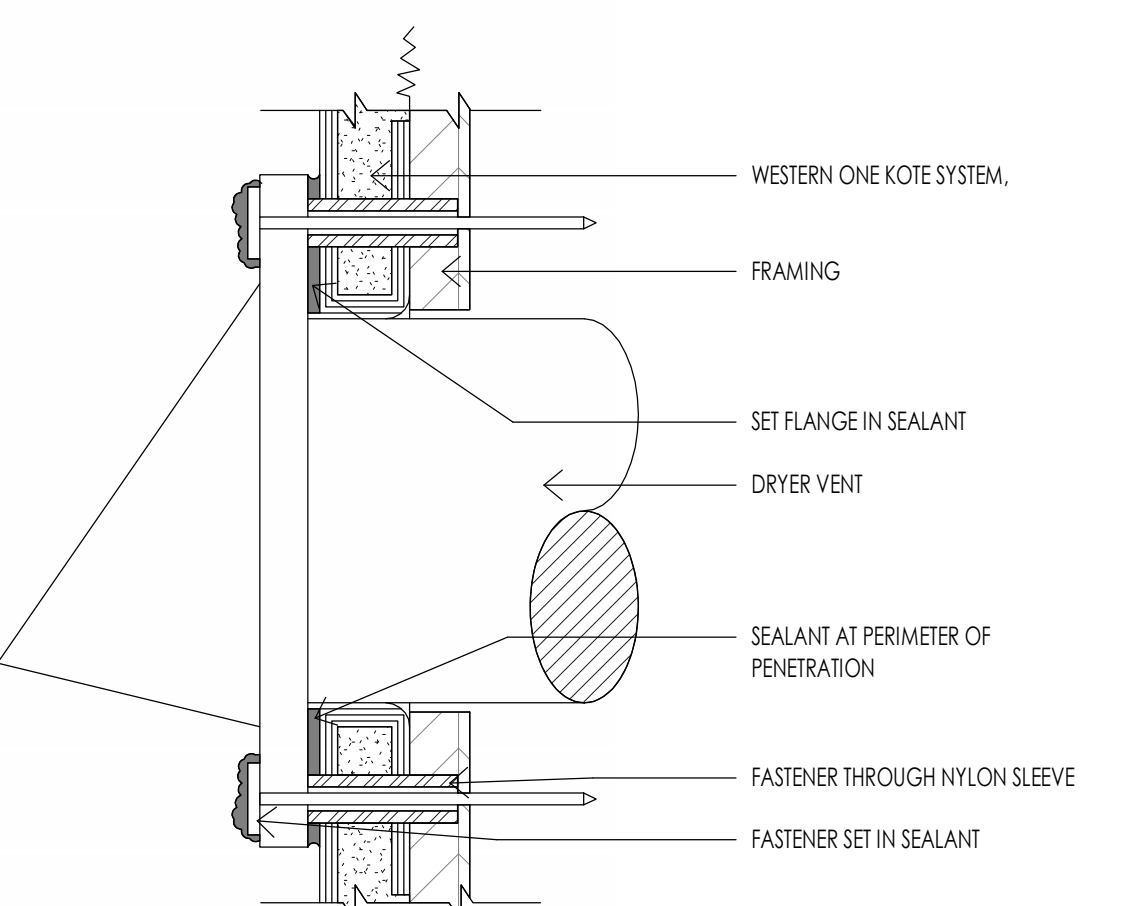

TYPICAL DRYER VENT (SHOWN WITH STUCCO) 4
6" = 1'-0"

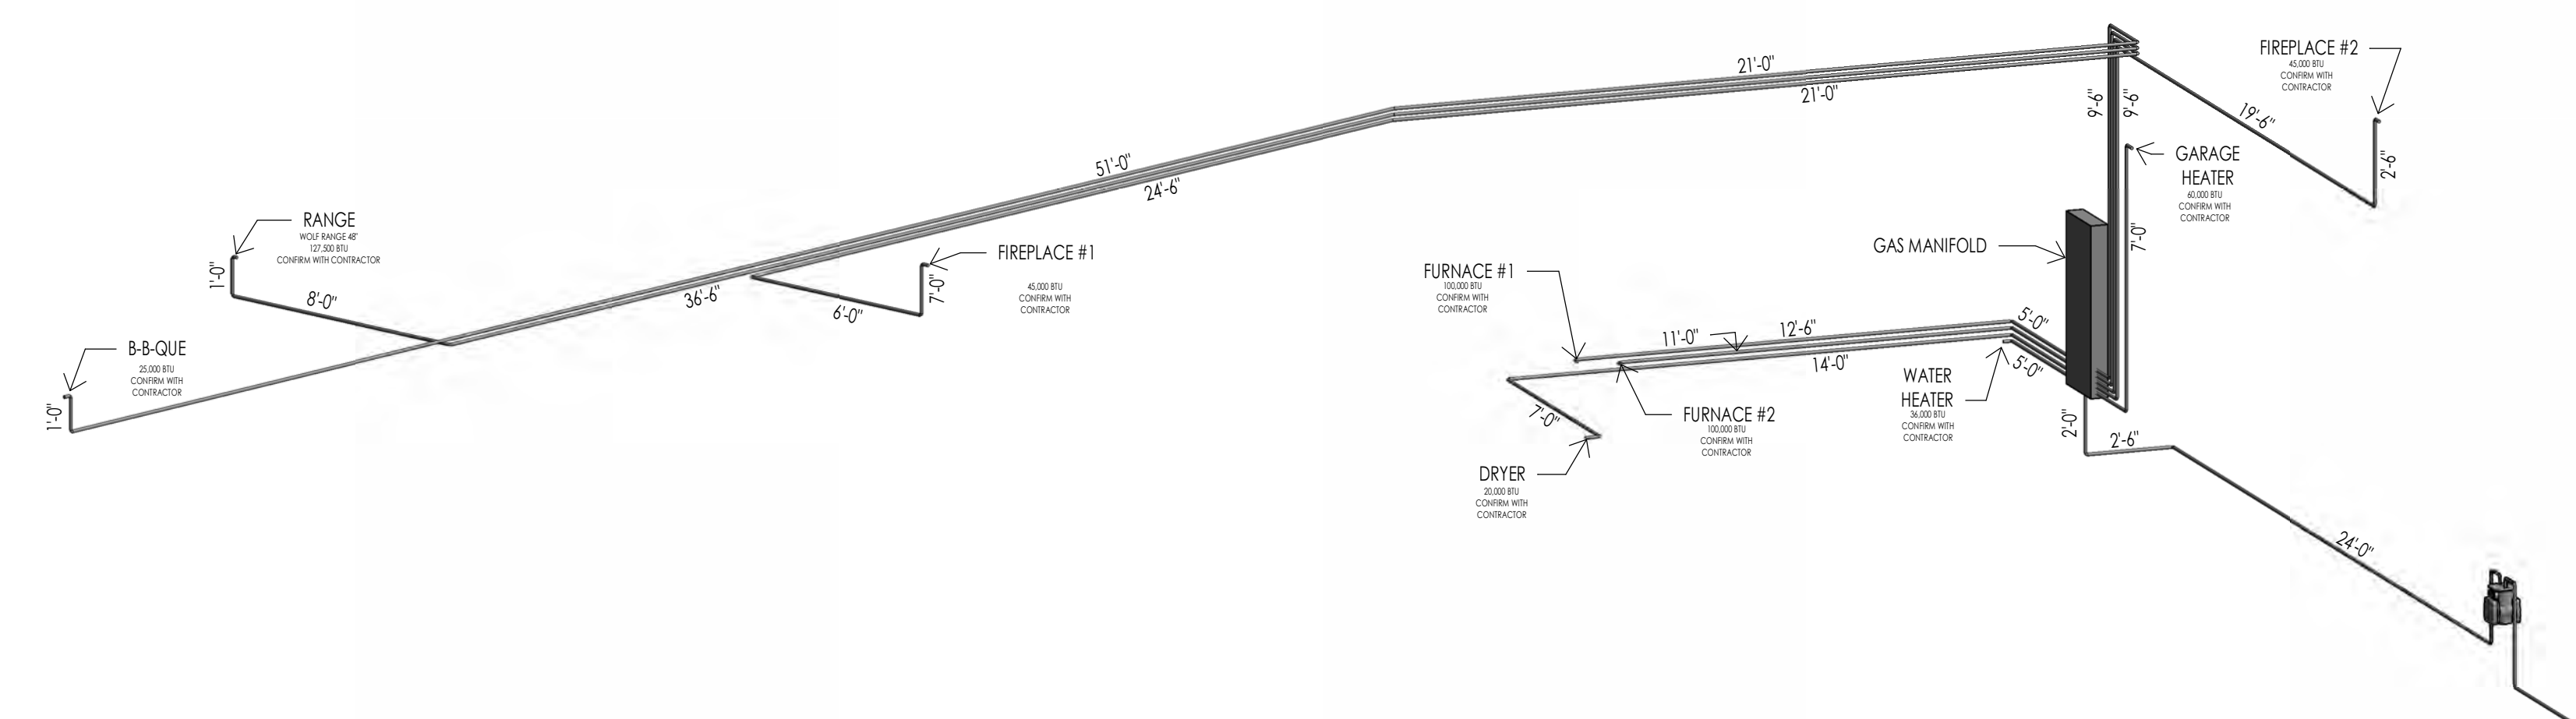

GAS SCHEMATIC 5
M101




Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Sandwich, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkarc.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially reproduced in whole or in part without the sole and express written permission from THINK Architecture, Inc.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

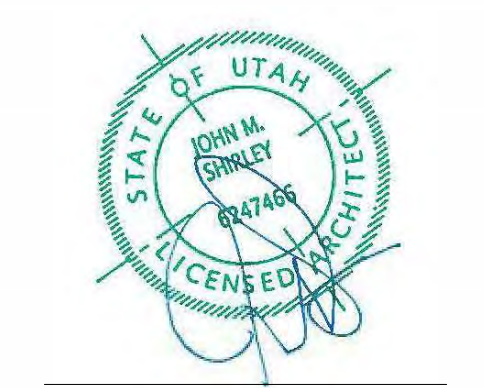

WARM SPRINGS RESIDENCE #35
190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340


PROJECT NO. 22023
DATE: 2023.06.30

REVISIONS:

SHEET TITLE:
MECHANICAL GENERAL NOTES

SHEET NUMBER:
M101

© 2021 THINK ARCHITECTURE INC.

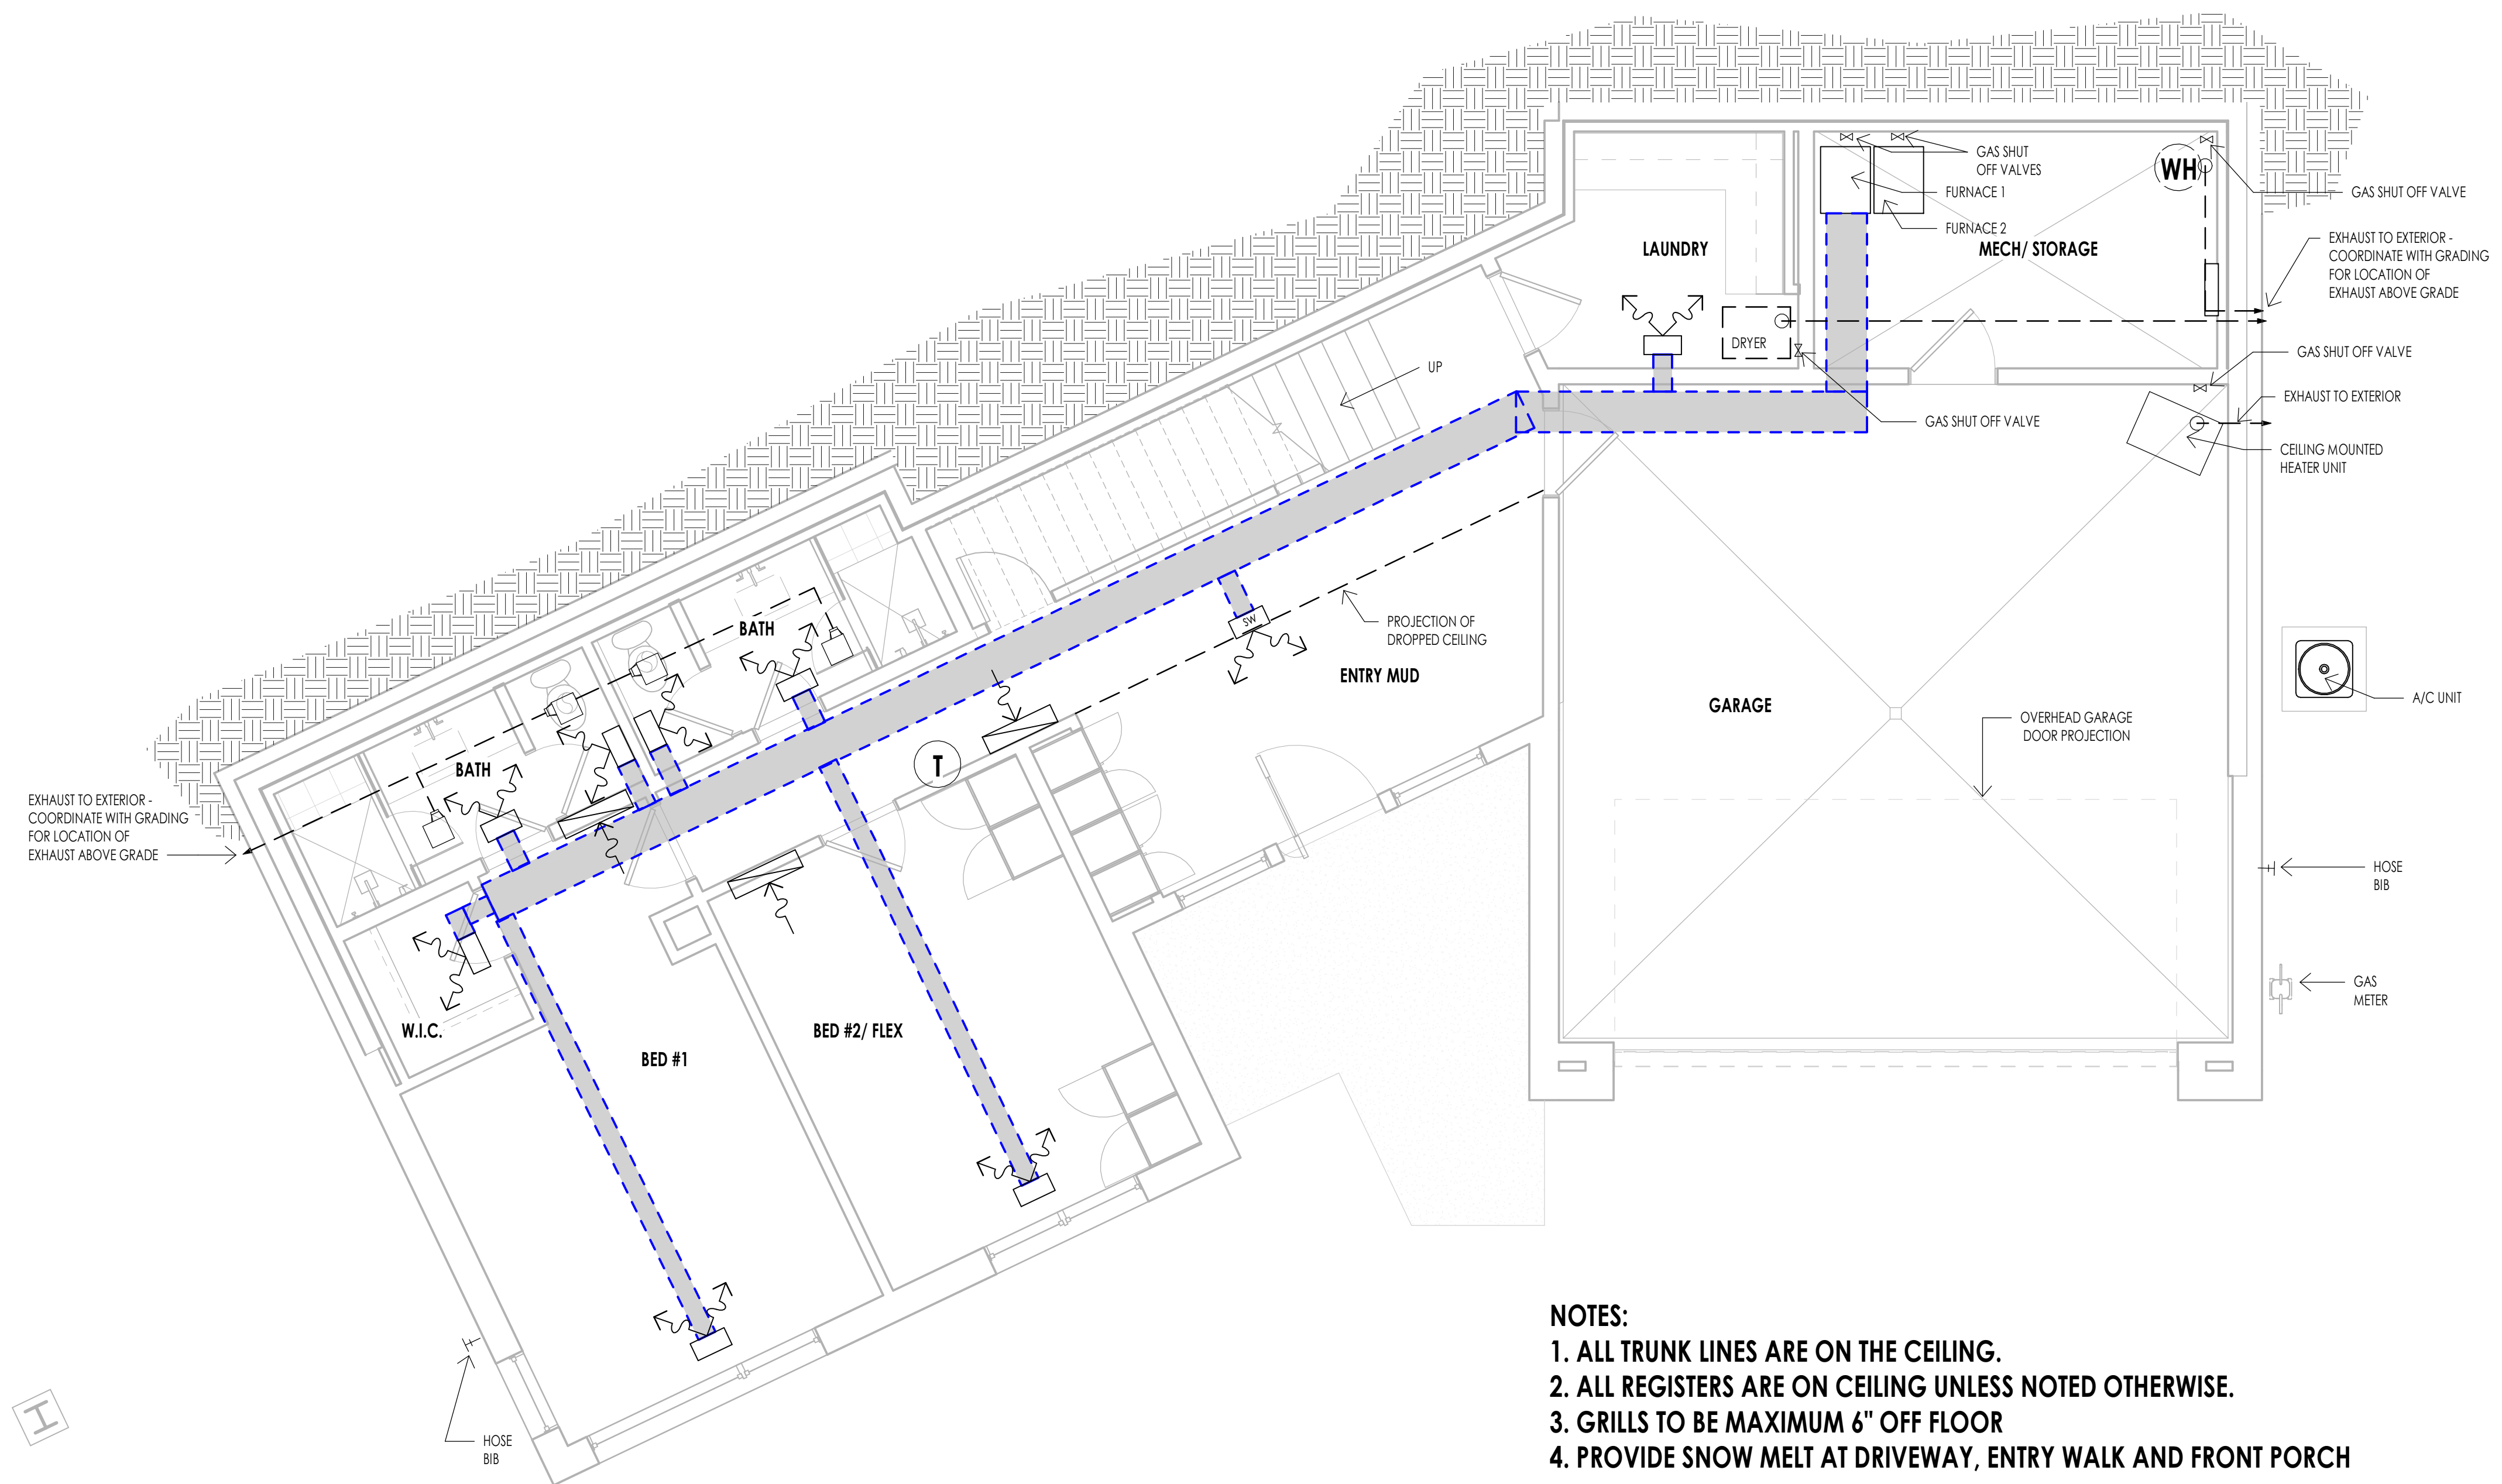

- NOTES:**
1. ALL TRUNK LINES ARE ON THE CEILING.
 2. ALL REGISTERS ARE ON CEILING UNLESS NOTED OTHERWISE.
 3. GRILLS TO BE MAXIMUM 6" OFF FLOOR
 4. PROVIDE SNOW MELT AT DRIVEWAY, ENTRY WALK AND FRONT PORCH

LEVEL 1 - MECHANICAL PLAN
1/4" = 1'-0"

MECHANICAL LEGEND	
SYMBOL	TYPE
	FLOOR OR CEILING MOUNTED HVAC REGISTER
	SW = SIDE WALL T.K. = TOE KICK
	HVAC RETURN AIR REGISTER
	HOSE BIB
	GAS SHUT OFF VALVE
	EXHAUST FAN
	THERMOSTAT
	WATER HEATER


- MECHANICAL GENERAL NOTES**
1. SEE SHEETS A0.3 FOR MECHANICAL AND PLUMBING PROJECT KEY NOTES AND MECHANICAL/PLUMBING INFORMATION.
 2. MECHANICAL AND PLUMBING LAYOUTS ARE SHOWN IN SCHEMATIC. THE PLUMBING AND MECHANICAL CONTRACTORS ARE RESPONSIBLE TO DESIGN AND SIZE EQUIPMENT CAPACITY, PIPE AND DUCT LINES, PLUMBING LINES AND ALL OTHER EQUIPMENT AS PER NATIONAL, STATE AND LOCAL CODES AND AS PER THE GENERAL NOTE REQUIREMENTS.
 3. THE CONTRACTOR IS RESPONSIBLE TO COORDINATE THE LAYOUT AND INSTALLATION OF ALL RELATED ITEMS WITH EXISTING CONDITIONS AND ALL OTHER TRADES.
 4. COORDINATE WITH OWNER, INTERIOR DESIGNER AND/OR PLANS FOR FIXTURE SCHEDULES, STYLES, FINISHES, ETC.
 5. ALL REGISTERS AT LOWER LEVEL TO BE CEILING MOUNT UNLESS OTHERWISE NOTED.
 6. COORDINATE BETWEEN MECH. SUB AND ELECTRICAL SUB AT PRECONSTRUCTION MEETING FOR DUCT LOCATIONS AND RECESSED CAN LOCATIONS.
 7. ALL PLUMBING FIXTURE/MECHANICAL EQUIPMENT SELECTIONS TO BE APPROVED BY OWNER/DEVELOPER.
 8. PROVIDE REQUIRED COMBUSTION AIR VENT DUCTS AT CEILING FOR WATER HEATER AND FURNACE AS REQUIRED BY BLDG. CODES AND MANUFACTURER.
 9. MECHANICAL DESIGN SHOULD BE IN ACCORDANCE WITH 2006 INTERNATIONAL RESIDENTIAL CODE.
 10. DUCT PENETRATIONS IN GARAGES SHALL BE 26 GAUGE SHEET METAL MIN. AND SHALL HAVE NO OPENINGS INTO THE GARAGE.
 11. FLUES SHALL NOT PENETRATE THE ROOF WITHIN 4'-0" OF PARTY WALLS.
 12. RADON: THE MECHANICAL CONTRACTOR IS RESPONSIBLE TO PROVIDE RADON TESTING AND APPLY AN APPROPRIATE MITIGATION SYSTEM.




Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Scary, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkaec.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially exploited in whole or in part without the sole and express written permission from THINK Architecture, Inc.

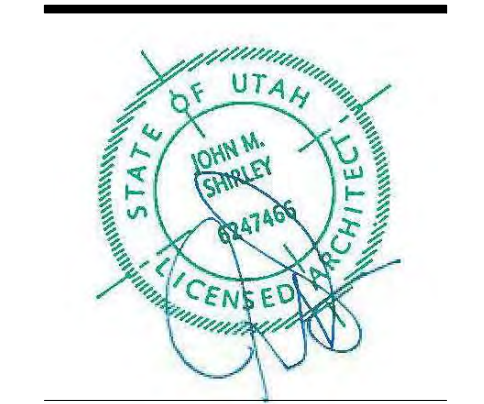

- NOTES:**
1. ALL REGISTERS ARE ON FLOOR UNLESS NOTED OTHERWISE.
 2. GRILLS TO BE MAXIMUM 6" OFF FLOOR

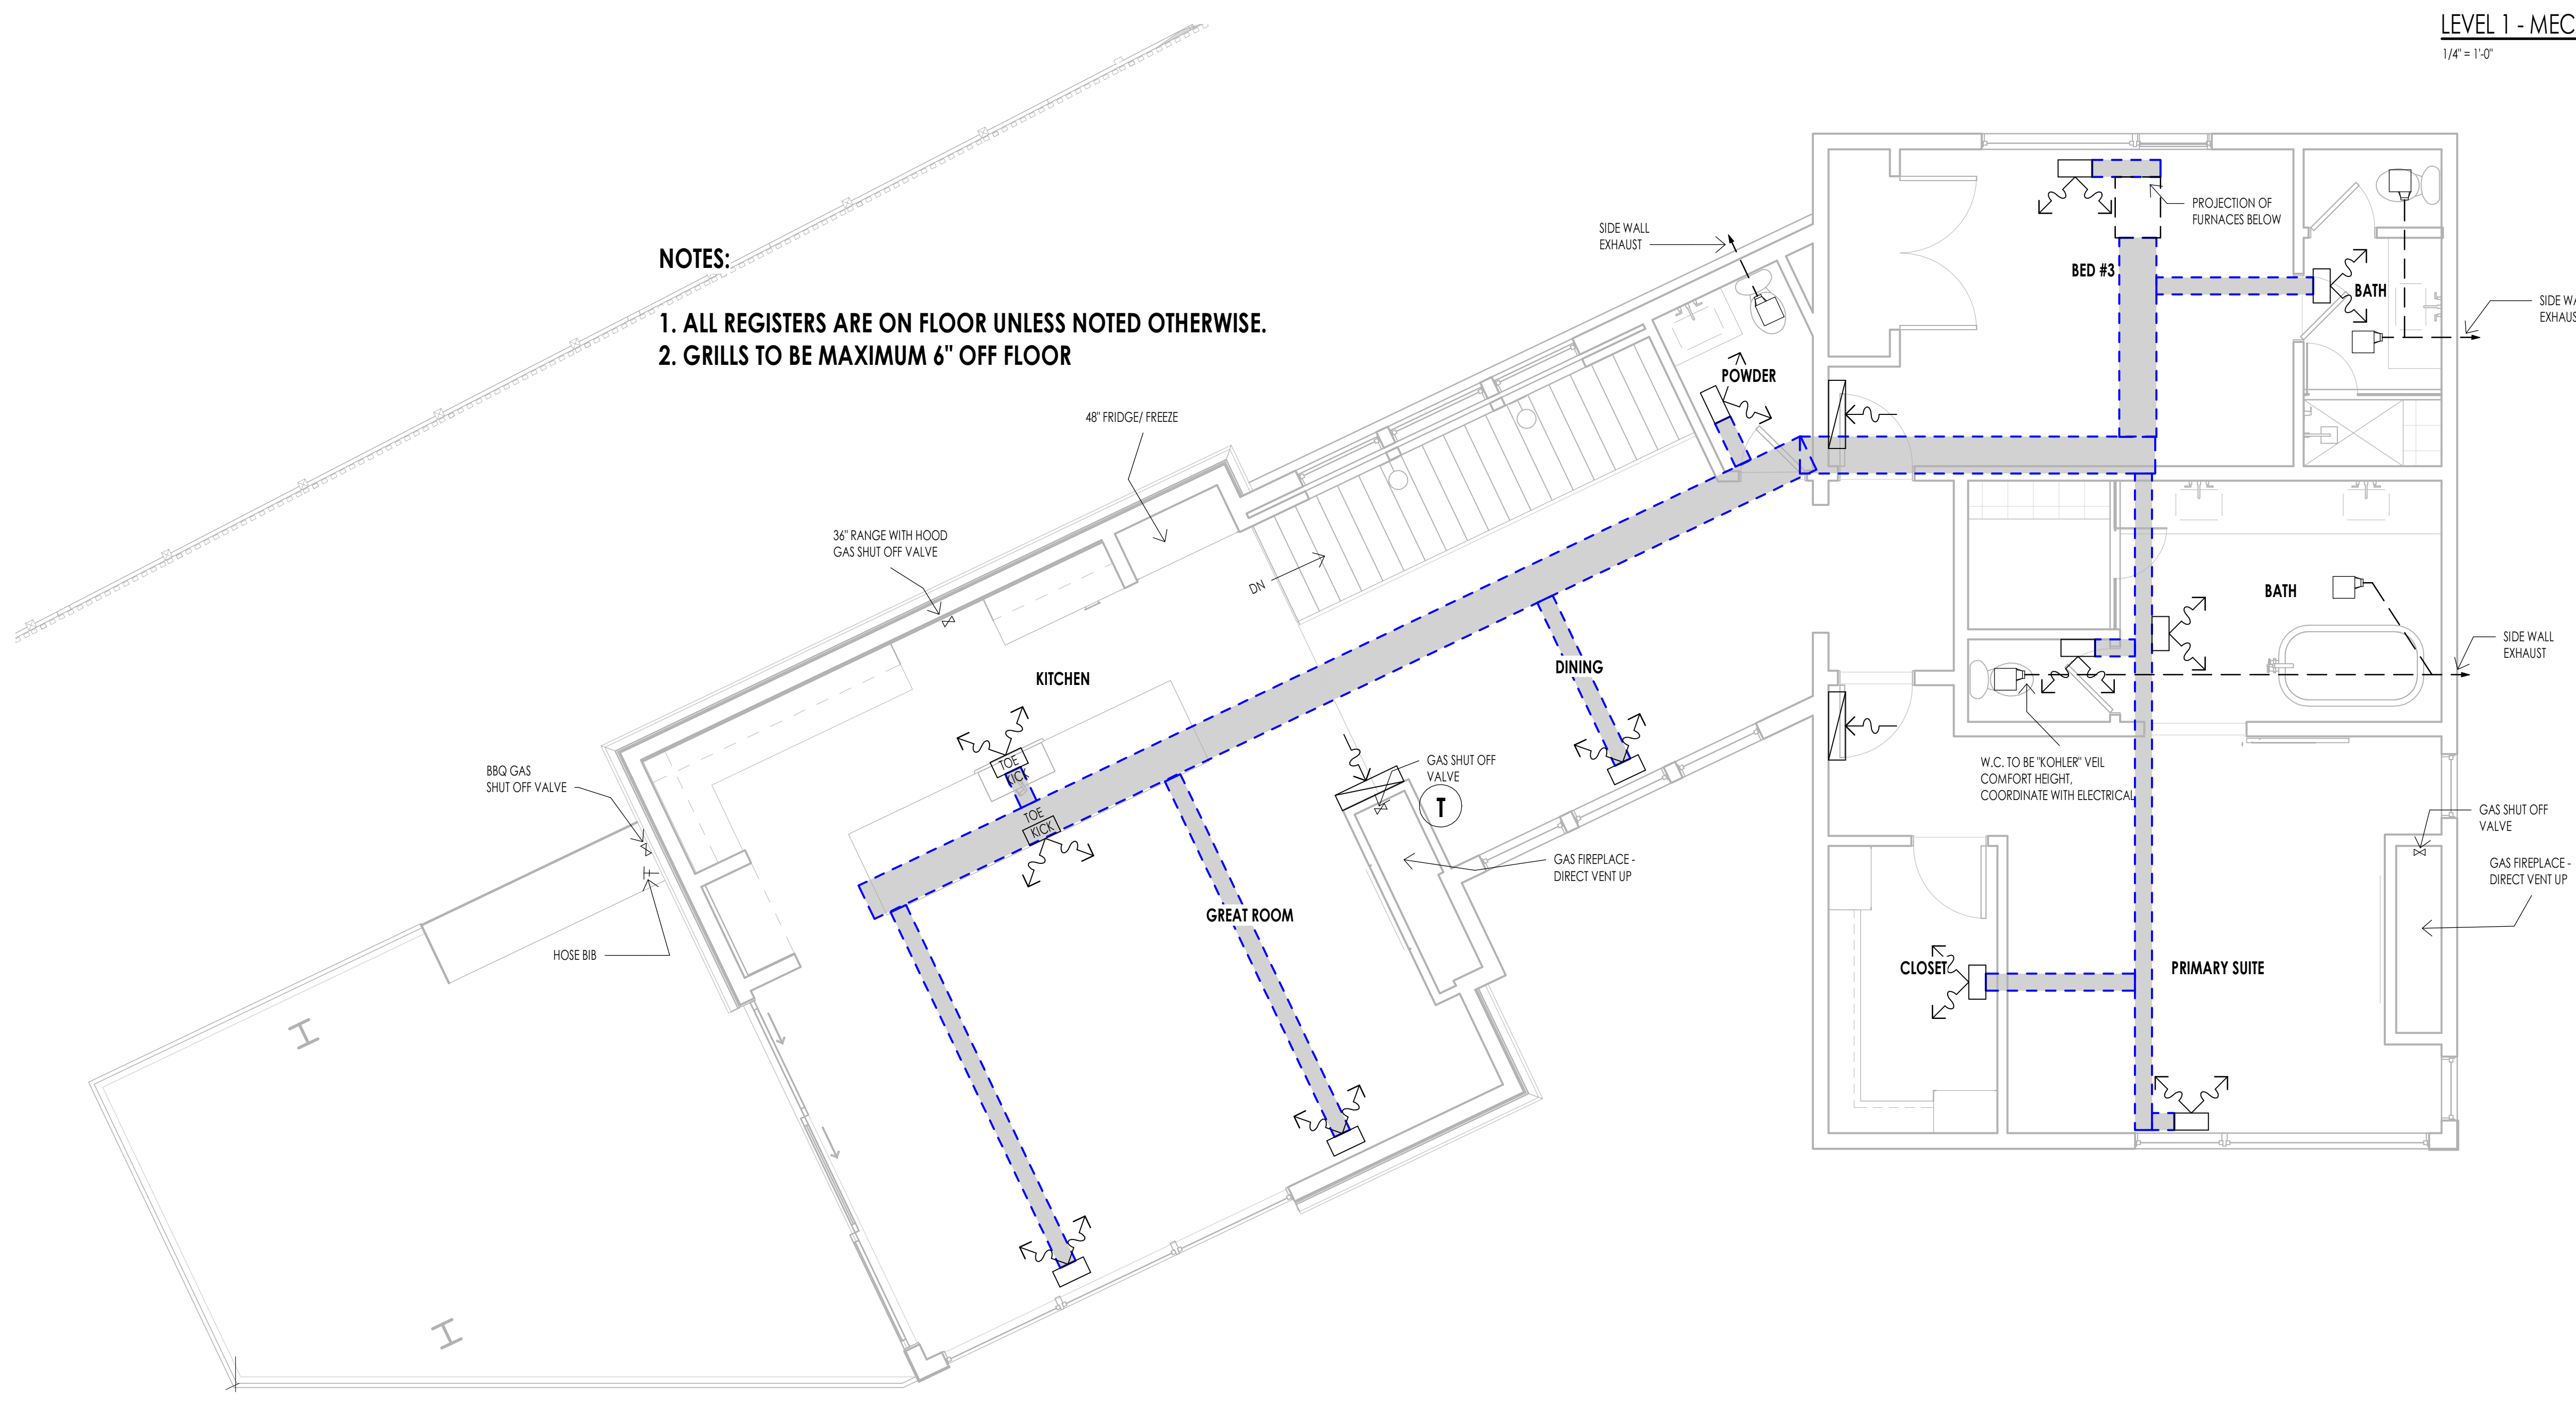

LEVEL 2 - MECHANICAL PLAN
1/4" = 1'-0"

WARM SPRINGS RESIDENCE #35
190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30
REVISIONS:

SHEET TITLE:
MECHANICAL PLAN

SHEET NUMBER:
M102

© 2021 THINK ARCHITECTURE INC.



ELECTRICAL GENERAL NOTES

- ALL WORK DONE BY ELECTRICAL CONTRACTOR SHALL COMPLY WITH THE CURRENT ADOPTED EDITION OF THE NATIONAL ELECTRICAL CODE AND ALL LOCAL CODE REGULATIONS AND AMENDMENTS. THE CONTRACTOR SHALL PERFORM ALL WORK IN CONFORMITY WITH THESE REGULATIONS WHETHER OR NOT SUCH WORK IS SPECIFICALLY SHOWN ON THE DRAWINGS.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO FURNISH AND INSTALL FEEDERS, PANELS, BOARDS, RELAY BRANCH CIRCUIT WIRING, CONDUITS, WIRE, METER BASES, COMPLETE WIRING FOR MOTORS, EXHAUST FANS, LINE VOLTAGE CONNECTIONS FOR HVAC EQUIPMENT, SPECIALTY LIGHTING - FIXTURES, OUTLET BOXES, COVER PLATES, WALL SWITCHES, FIXTURES, RECEPTACLES, ETC.
- ALL DRAWINGS INDICATE LOCATIONS AS DIAGRAMMATIC. LOCATIONS SHALL BE PER APPROPRIATE CODES AND OWNER. CONTRACTOR TO COORDINATE WITH MECHANICAL CONTRACTOR FOR ALL POWER REQUIREMENTS.

THE CONTRACTOR SHALL SET ALL THE BOXES AND NOTIFY THE ARCHITECT AND OWNER OF PLACEMENT OF BOXES. THE ARCHITECT, OWNER AND INTERIOR DESIGNER SHALL WALK THE HOUSE WITH THE ELECTRICAL CONTRACTOR AND SHALL VERIFY ALL THE LOCATIONS. THIS SHALL BE DONE PRIOR TO ANY WIRE BEING PULLED.

IF WIRE IS PULLED, AND BOXES ARE REQUIRED TO BE MOVED, ALL COSTS SHALL BE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR AND NOT THE OWNER/ DESIGN TEAM.

- ELECTRICAL SERVICE CAPACITY AND SIZE SHALL BE COMPUTED BY METHOD INDICATED IN THE NATIONAL ELECTRICAL CODE. PANELS OR CABINETS ENCLOSING FUSES, CIRCUIT BREAKERS, SWITCHES OR OTHER ELECTRICAL SERVICE EQUIPMENT SHALL BE IN AN INCONSPICUOUS, ACCESSIBLE AND PROTECTED LOCATION. ELECTRICAL PANEL CLEARANCE TO BE MINIMUM 30" WIDTH AND 6" HEAD ROOM. ELECTRICAL TO COMPLY WITH N.E.C. 110.1.6. ELECTRICAL METER BASE SHALL BE LOCATED IN AN AREA THAT IS PROTECTED FROM OUTSIDE WEATHER.
- ALL RECEPTACLES LOCATED WITH THE FOLLOWING CONDITIONS TO BE GFCI PROTECTED: ALL KITCHEN COUNTERS, IN BATHROOMS, OUTSIDE AT GRADE LEVEL, UNFINISHED BASEMENTS, AND IN GARAGES. GARAGE RECEPTACLES TO BE 18" ABOVE FINISHED FLOOR.
- ALL SWITCHES, RECEPTACLES, TELEPHONE JACKS AND CATV JACKS TO BE "LEVITON" 5601 ROCKER SERIES IN WHITE. DIMMER SWITCHES TO BE "LUTRON" DIVA ROCKER SERIES IN WHITE. HEIGHT OF LIGHT SWITCHES FROM FINISHED FLOOR TO TOP OF SWITCH TO BE 48" UNLESS NOTED. OTHERWISE, THE MOUNTING FROM THE FINISH FLOOR TO THE CENTER OF OUTLETS INCLUDING TELEPHONE, CATV, ETC. SHALL BE 12" TYPICAL. AT DESKS AND OTHER SURFACES THE OUTLETS SHALL BE 10" TO CENTERLINE ABOVE SURFACE. SWITCHES, OUTLETS, TELEPHONE, CATV, ETC. LOCATIONS SHALL BE APPROVED PRIOR TO COMMENCEMENT OF WIRING.
- UNLESS NOTED OTHERWISE LOCATE AND INSTALL ONE (1) GFCI WEATHER PROTECTED RECEPTACLE AT GRADE LEVEL AND OUTSIDE AT SOFFIT AT EACH EXTERIOR DOOR WHETHER INDICATED ON DRAWINGS OR NOT. PLEASE REFER TO THE ELECTRICAL DRAWINGS FOR ADDITIONAL OUTLETS AT SOFFITS.
- ALL FIXTURES SHALL HAVE A U.L. LABEL LISTING. IF NOT U.L. LISTED FIXTURE SHALL NOT BE USED. ALL RECESS DOWN LIGHTS TO BE THERMAL RATED, AND ALL CAST IN PLACE FIXTURES TO BE INCLUDED IN BASE BID. ALL RECESS DOWN LIGHTS TO BE INCLUDED IN BASE BID WITH TRIM RINGS AS SELECTED BY DESIGNER OR OWNER. ALL LIGHTS IN CLOSETS SHALL MEET N.E.C. 410.8 REQUIREMENTS. ALL LIGHTS LOCATED IN WET OR DAMP LOCATIONS SHALL MEET N.E.C. 410.4 REQUIREMENTS.
- SMOKE DETECTORS TO BE HARD WIRED TO BUILDING CIRCUIT WITH BATTERY BACK UP. PROVIDE SMOKE DETECTORS AT ALL BUILDING LEVELS, IN ALL BEDROOMS, ACCESS TO ALL BEDROOMS, ETC. (UBC 310.9)
- ELECTRICAL PANEL (PANELBOARD/SWITCHBOARD) MAY NOT BE LOCATED BEHIND A DOOR OR IN A ROOM THAT MAY BE LOCKED AND MUST HAVE PROPER WORKING CLEARANCES. PLEASE REFER TO THE ELECTRICAL DRAWINGS FOR THE LOCATIONS FOR ALL ELECTRICAL PANELS. IF THE PANEL BOARD NEEDS TO BE RELOCATED, PLEASE CONSULT THE OWNER AND OR ARCHITECT PRIOR TO MOVING.
- SMALL WALL SECTIONS 2' OR WIDER (INCLUDES BETWEEN DOORS) REQUIRE AN OUTLET.
- GFCI PROTECTION MUST BE PROVIDED FOR ANY RECEPTACLE OUTLET IN THE FOLLOWING: A BATHROOM, ANY COUNTERTOP KITCHEN/LAUNDRY, GARAGE OUTLETS MINIMUM 18" ABOVE FINISHED FLOOR HEIGHT, OUTSIDE FRONT AND REAR OUTLETS MUST HAVE WATERPROOF COVERPLATE.
- A RECEPTACLE OUTLET MUST BE PROVIDED AT EACH SECTION OF KITCHEN COUNTERTOP 12" OR WIDER. THERE MUST ALSO BE A MINIMUM OF TWO (2) DEDICATED COUNTERTOP CIRCUITS.
- A SWITCH CONTROLLED LIGHT MUST BE PROVIDED AT HALLWAYS, STAIRWAYS, EXITS, AND EACH ROOM.
- A HARD-WIRED WITH BATTERY BACKUP SMOKE DETECTOR MUST BE INSTALLED IN ALL BEDROOMS (NEW AND EXISTING) IN THE ACCESS AREA TO ALL BEDROOMS, AND AT LEAST ONE PER FLOOR. TWO (2) FOOT CHANGES IN CEILING HEIGHT ALSO REQUIRE AN ADDITIONAL SMOKE DETECTOR. ALARM SOUND MUST BE AUDIBLE IN ALL AREAS OF HOME.
- WHEN BEDROOMS OCCUR ON 2ND STORES, THE DETECTOR SHOULD BE LOCATED AT THE TOP OF THE STAIRWAY.
- KITCHEN OUTLETS REQUIRED TO BE GFCI PROTECTED, NOT MORE THAN 4'-0" APART.
- CLOSET LIGHT FIXTURES MIN. 12" CLEARANCE TO SHELF (LATERAL MEASURED)

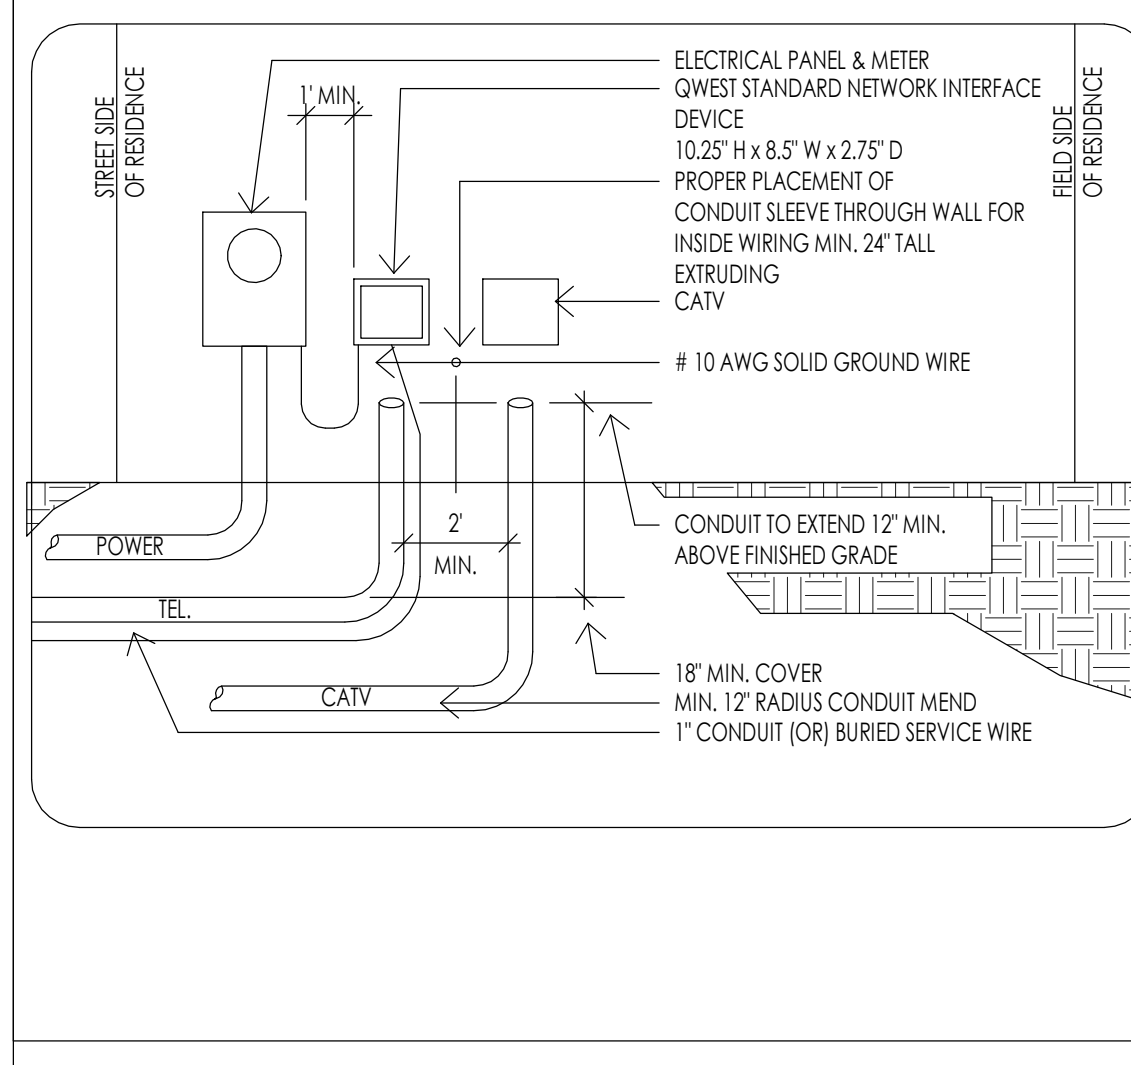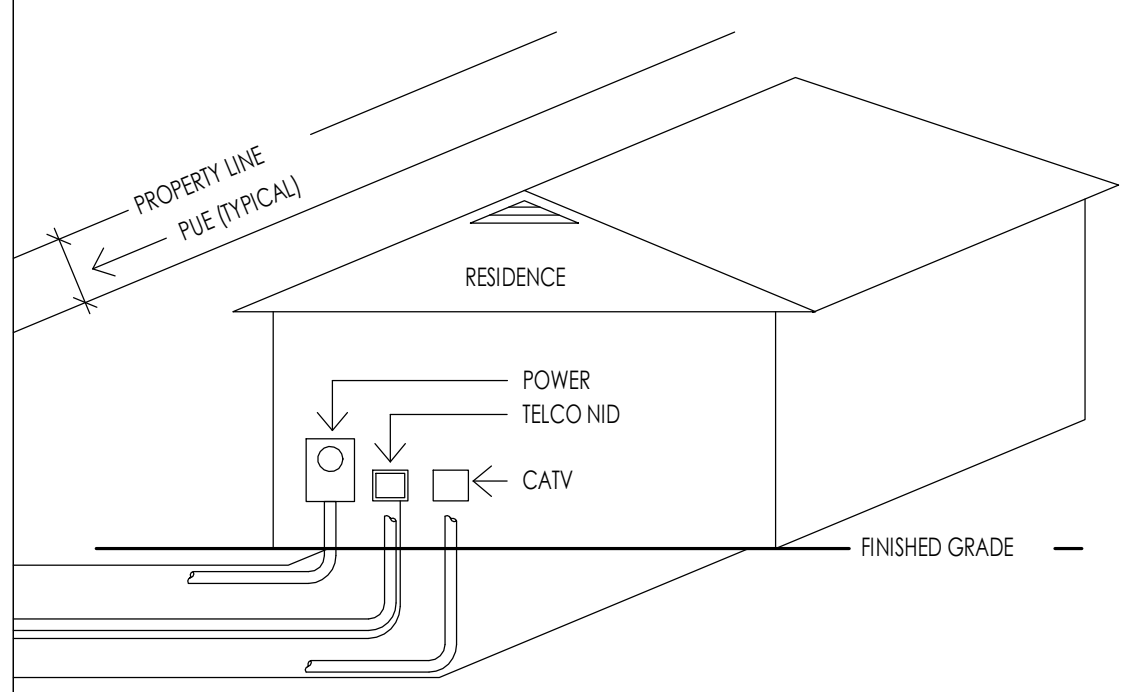

TYPICAL DRY UTILITY LOCATION DETAIL
1/2" = 1'-0"

HL36SA

Ordering Information

SAMPLE ORDER NUMBERS: HL36SA02P27E010CAT, TL36FL40, TL36RMW

Series
HL36SA - 3-inch square shallow new construction directional housing

Height
10 - 10W (nominal)
15 - 15W (nominal)
20 - 20W (nominal)

Options
(black) - Purchase optic separately
SP - 10' beam
NFL - 20' beam
FL - 40' beam
WFL - 50' beam

Light Output
27K - 90 CR, 2700K
30K - 90 CR, 3000K
35K - 90 CR, 3500K
40K - 90 CR, 4000K
50K - 90 CR, 5000K
65K - 90 CR, 6500K CCT, dim to warm**

Input/Output
E070 - 120V-277V, 50/60Hz leading or trailing edge phase cut 1% dimming at 120V only and UNV
120-277V 50/60Hz 0-10V 1% dimming
TL3E - 1-Lamp/6-Lamp Forward Phase Dimming, 1% to 100%, 120V-277V
DE010 - 0-10V Dimming, 0% to 100%, 120V-277V

Housing Type
ICAT+ insulation contact and airtight

Accessories
RAC2 - remote adapter for HL36SA housings and trims
CES3 - collar adapter for HL36SA housings, adjusts from 7/16" to 1-1/4" thick ceilings
Optic & Media
TRIMSP15 - 15" beam
TRIMSP20 - 20" beam
TRIMSP40 - 40" beam
TRIMSP50 - 50" beam
TRIMSP20PC - replacement media holder, package of 12
L100 Series - 2" trim and filters, see spec sheet
Overcast Trim Ring
OTL100W - overcast trim ring for TL3 trims

See page 19 for trim information.
© 2021 Philips Lighting North America

L-1 RECESSED EXTERIOR SOFFIT LIGHT

CHAMPEAUX LINEAR SCONCE

Starting at \$275. Member \$290. Member

Designer Jonathan Browning's Champeaux collection brings refinement and low materials to the classic sconce, a standard of 1970s utility. Crafted in solid brass, Browning's thoughtful reimagining gives beyond function to reveal the cast as a thing of beauty. The design evokes the clean lines inherent in the concept, but sets the form in a new context.

SHOP THE ENTIRE COLLECTION

FINISH OPTIONS

Polished Chrome | Lacquered Burnished Brass | Stone

DETAILS

DIMENSIONS

INSTALLATION & ELECTRICAL

MAXIMUM OF 2.78K COLOR TEMPERATURE
MAXIMUM OF 700 LUMENS
CAP TOP DOWNLIGHT ONLY

CHAT WITH A DESIGNER

L-2 DECORATIVE EXTERIOR WALL SCONCE

LED RECESSED STRIP TAPE LIGHT

SPECIFY YOUR PRODUCT

Use our tool below to create a custom product code and view product compatibility. After making the selections, save the product to a project to keep all your products and specs together in one organized place. Once final, you can order from a nearby distributor.

Your configuration is complete!

Product Code: UNI-TL-O-100-27K-24V-NA

Make a selection in each category to complete your product code.

1. Series	2. Location	3. Output*	4. Temp/Color*	5. Voltage	6. Modifications
UNI-TL - Uniform Thin Line	O - Outdoor	100 - 100 lm/ft 200 - 200 lm/ft 300 - 300 lm/ft	18K - 1800K 22K - 2200K 24K - 2400K 27K - 2700K 30K - 3000K 35K - 3500K 40K - 4000K 50K - 5000K 65K - 6500K	24V - 24V DC	NA - None

* Customizable—Consult Factory

L-6 MOTORCOURT EXTERIOR LIGHTING




Architecture
Interior Design
Landscape Architecture
Land Planning
Construction Management

7927 So. Highpoint Parkway, Suite 300
Scary, Utah 84094
ph. 801.269.0555
fax 801.269.1425
www.thinkarc.com

The designs shown and described herein including all technical drawings, graphic representation & models thereof, are proprietary & can not be copied, duplicated, or commercially exploited in whole or in part without the sole and express written permission from THINK Architecture, Inc.

These drawings are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors, and office personnel only in accordance with this notice.

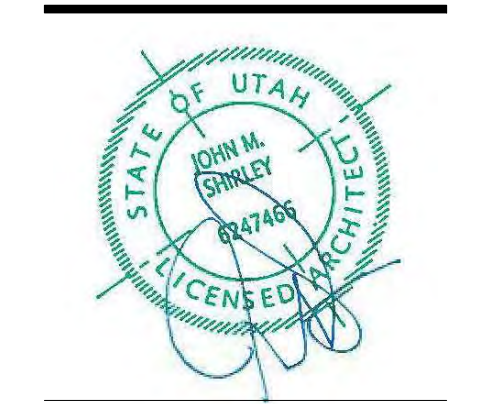


WARM SPRINGS RESIDENCE #35
190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

PROJECT NO. 22023
DATE: 2023.06.30
REVISIONS:
1 04-27-2023 PER CITY COMMENTS

SHEET TITLE:
ELECTRICAL GENERAL NOTES



SHEET NUMBER:
E101

© 2021 THINK ARCHITECTURE INC.

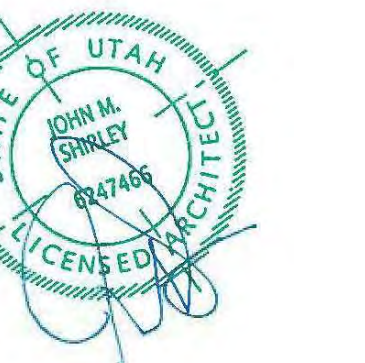

ELECTRICAL LEGEND																																																																					
SYMBOL	DESCRIPTION																																																																				
S	SINGLE POLE TOGGLE SWITCH																																																																				
S ³	THREE WAY TOGGLE SWITCH																																																																				
S ⁴	FOUR WAY TOGGLE SWITCH																																																																				
S ^D	DIMMER TOGGLE SWITCH	Ⓛ	110 V DUPLEX OUTLET ON AN (AFP) ARC FAULT PROTECTED CIRCUIT	GFI	110 V GROUND FAULT INTERRUPTER	WFP	110 V WATERPROOF GFI OUTLET	Ⓛ ²²⁰	220 V OUTLET	Ⓛ ⁴	QUADRUPLUX OUTLET	Ⓛ ^{110V}	110 V FLOOR DUPLEX OUTLET	Ⓛ ^{110V}	110 V SMOKE DETECTOR W/BATTI BACK-UP	Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING
Ⓛ	110 V DUPLEX OUTLET ON AN (AFP) ARC FAULT PROTECTED CIRCUIT	GFI	110 V GROUND FAULT INTERRUPTER	WFP	110 V WATERPROOF GFI OUTLET	Ⓛ ²²⁰	220 V OUTLET	Ⓛ ⁴	QUADRUPLUX OUTLET	Ⓛ ^{110V}	110 V FLOOR DUPLEX OUTLET	Ⓛ ^{110V}	110 V SMOKE DETECTOR W/BATTI BACK-UP	Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING		
GFI	110 V GROUND FAULT INTERRUPTER	WFP	110 V WATERPROOF GFI OUTLET	Ⓛ ²²⁰	220 V OUTLET	Ⓛ ⁴	QUADRUPLUX OUTLET	Ⓛ ^{110V}	110 V FLOOR DUPLEX OUTLET	Ⓛ ^{110V}	110 V SMOKE DETECTOR W/BATTI BACK-UP	Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING				
WFP	110 V WATERPROOF GFI OUTLET	Ⓛ ²²⁰	220 V OUTLET	Ⓛ ⁴	QUADRUPLUX OUTLET	Ⓛ ^{110V}	110 V FLOOR DUPLEX OUTLET	Ⓛ ^{110V}	110 V SMOKE DETECTOR W/BATTI BACK-UP	Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING						
Ⓛ ²²⁰	220 V OUTLET	Ⓛ ⁴	QUADRUPLUX OUTLET	Ⓛ ^{110V}	110 V FLOOR DUPLEX OUTLET	Ⓛ ^{110V}	110 V SMOKE DETECTOR W/BATTI BACK-UP	Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING								
Ⓛ ⁴	QUADRUPLUX OUTLET	Ⓛ ^{110V}	110 V FLOOR DUPLEX OUTLET	Ⓛ ^{110V}	110 V SMOKE DETECTOR W/BATTI BACK-UP	Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING										
Ⓛ ^{110V}	110 V FLOOR DUPLEX OUTLET	Ⓛ ^{110V}	110 V SMOKE DETECTOR W/BATTI BACK-UP	Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING												
Ⓛ ^{110V}	110 V SMOKE DETECTOR W/BATTI BACK-UP	Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING														
Ⓛ ^{CM}	CARBON MONOXIDE DETECTOR	Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																
Ⓛ ^{EF}	EXHAUST FAN	Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																		
Ⓛ ^{EF}	EXHAUST FAN WITH LIGHT FIXTURE	Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																				
Ⓛ ^R	4" LED RECESSED CAN (FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																						
Ⓛ ^C	4" LED RECESSED CAN (CLOSET FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																								
Ⓛ ^W	RECESSED CAN (WET LOCATION-FIXTURE & TRIM PER SCHEDULE)	Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																										
Ⓛ ^{CM}	CEILING MOUNT FIXTURE	Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																												
Ⓛ ^B	BATHROOM WALL SCONCE	Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																														
Ⓛ ^W	WALL MOUNT FIXTURE	Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																
Ⓛ ^{2X2}	2X2 OR 2X4 FLUORESCENT CEILING FIXTURE	Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																		
Ⓛ ^{FL}	FLUORESCENT STRIP LIGHT	Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																				
Ⓛ ^{UL}	LED UNDERCOUNTER LIGHTING	Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																						
Ⓛ ^G	GARAGE DOOR OPENER	Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																								
Ⓛ ^K	KEYLESS ENTRY	Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																										
Ⓛ ^B	DOORBELL	Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																												
Ⓛ ^T	TELEPHONE (CAT 5E WIRING) SINGLE LINE UNLESS NOTED (NUMBER) DESIGNATES PORT OUTLETS REQUIRED	Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																														
Ⓛ ^M	MULTI-MEDIA NETWORK OUTLET (CAT 5E WIRE) W/4 PORT OUTLET	Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																
Ⓛ ^{SW}	STRUCTURED WIRING (FUTURE SMART WIRING) (E) R66 QUAD SHIELD, (S) CAT 6E WIRE - FOR CABLE TV, VIDEO, SATELLITE, ETC. (M) PORT OUTLET	Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																		
Ⓛ [Ⓛ]	GARBAGE DISPOSAL	Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																				
Ⓛ ^{LV}	LOW VOLTAGE RECESSED CAN	Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																						
Ⓛ ^{E1}	RECESSED EXTERIOR SOFFIT LIGHT - SEE SPECS ON SHEET E101	Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																								
Ⓛ ^{E2}	DECORATIVE EXTERIOR WALL SCONCE - SEE SPECS ON SHEET E101	Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																										
Ⓛ ^{E3}	MOTOR COURT EXTERIOR LIGHTING - SEE SPECS ON SHEET E101	Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																												
Ⓛ ^{LDP}	LIGHTING DIGITAL PAD	Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																														
Ⓛ ^{BS}	DOOR BELL SWITCH	Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																																
Ⓛ ^{WBL}	WALL MOUNTED BED LIGHT	Ⓛ ^{LS}	LED STRIP LIGHTING																																																																		
Ⓛ ^{LS}	LED STRIP LIGHTING																																																																				

- ### ELECTRICAL GENERAL NOTES
- SEE SPECS FOR ELECTRICAL INFORMATION.
 - ELECTRICAL LAYOUTS ARE SHOWN IN SCHEMATIC. THE CONTRACTOR IS RESPONSIBLE TO COORDINATE THE LAYOUT AND INSTALLATION OF ALL RELATED ITEMS WITH EXISTING CONDITIONS AND RELATED TRADES.
 - COORDINATE WITH OWNER, INTERIOR DESIGNER AND/OR PLANS FOR FIXTURE SCHEDULES, STYLES, FINISHES, ETC.
 - ALL WORK TO COMPLY WITH 2014 N.E.C. CODES AND 2015 I.R.C. CODES.
 - CENTER OF ALL OUTLETS TO BE 18" ABOVE FINISH FLOOR UNLESS NOTED OTHERWISE. CENTER OF OUTLETS OVER CABINETS, VANITIES, ETC. TO BE 12" ABOVE FINISH COUNTER HEIGHT UNLESS NOTED OTHERWISE.
 - CONTRACTOR TO FIELD VERIFY LOCATION OF ALL ELECTRICAL FIXTURES, SWITCHES, ETC. WITH OWNER AND DESIGNER PRIOR TO WIRING.
 - PROVIDE SLOPED RECESSED CANS FOR SLOPED CEILING APPLICATIONS & THERMAL PROTECTION CANS WHERE IN CONTACT WITH INSULATION AS REQUIRED.
 - CONTRACTOR TO PROVIDE ELECTRICAL SERVICE TO MECHANICAL EQUIPMENT AS REQUIRED.
 - ALL BRANCH CIRCUITS BE PROTECTED BY AN ARCH-FAULT CIRCUIT INTERRUPTER LISTED TO PROVIDE PROTECTION OF THE ENTIRE BRANCH CIRCUIT.
 - PROVIDE A U-FER GROUND. AN ELECTRODE ENCASED BY AT LEAST 2" OF CONCRETE SHALL BE LOCATED NEAR THE BOTTOM OF THE CONCRETE FOUNDATION SYSTEM. AND SHALL BE IN DIRECT CONTACT WITH THE EARTH. CONSISTING OF AT LEAST 20 FEET OF BARE ELECTRICALLY CONDUCTIVE ROD AT LEAST 1/2 INCH IN DIAMETER OR BARE COPPER CONDUCTOR NOT SMALLER THAN 4 AWG. (I.R.C. E555B.1.2 AND N.E.C. 250.30)
 - THE CONTRACTOR SHALL VERIFY OUTLET LOCATIONS AND VOLTAGE REQUIREMENTS AS PER APPLIANCE SPECIFICATIONS.
 - STRUCTURED WIRE MEDIA PANEL TO BE "TELETON" (O.A.E.) AND INCLUDE: A/C POWER MODULE, CAT 5 VOICE AND DATA MODULES, 10/100 Mbps SATA HUB, CATV BOOSTER AND AUDIO / VIDEO CONTROL MODULES.
 - SMOKE AND/OR CARBON MONOXIDE DETECTORS ARE TO BE HARD WIRED TOGETHER IN SERIES WITH BATTERY BACKUP AS PER CODE REQUIREMENTS. COMBINATION UNITS ARE PERMITTED AS APPROVED.
 - ALL EXTERIOR ELECTRICAL OUTLETS TO HAVE WEATHERPROOF COVERS.
 - ALL 125V 15 AND 20 AMP RECEPTACLES WITHIN DWELLING UNITS MUST BE TAMPER PROOF.

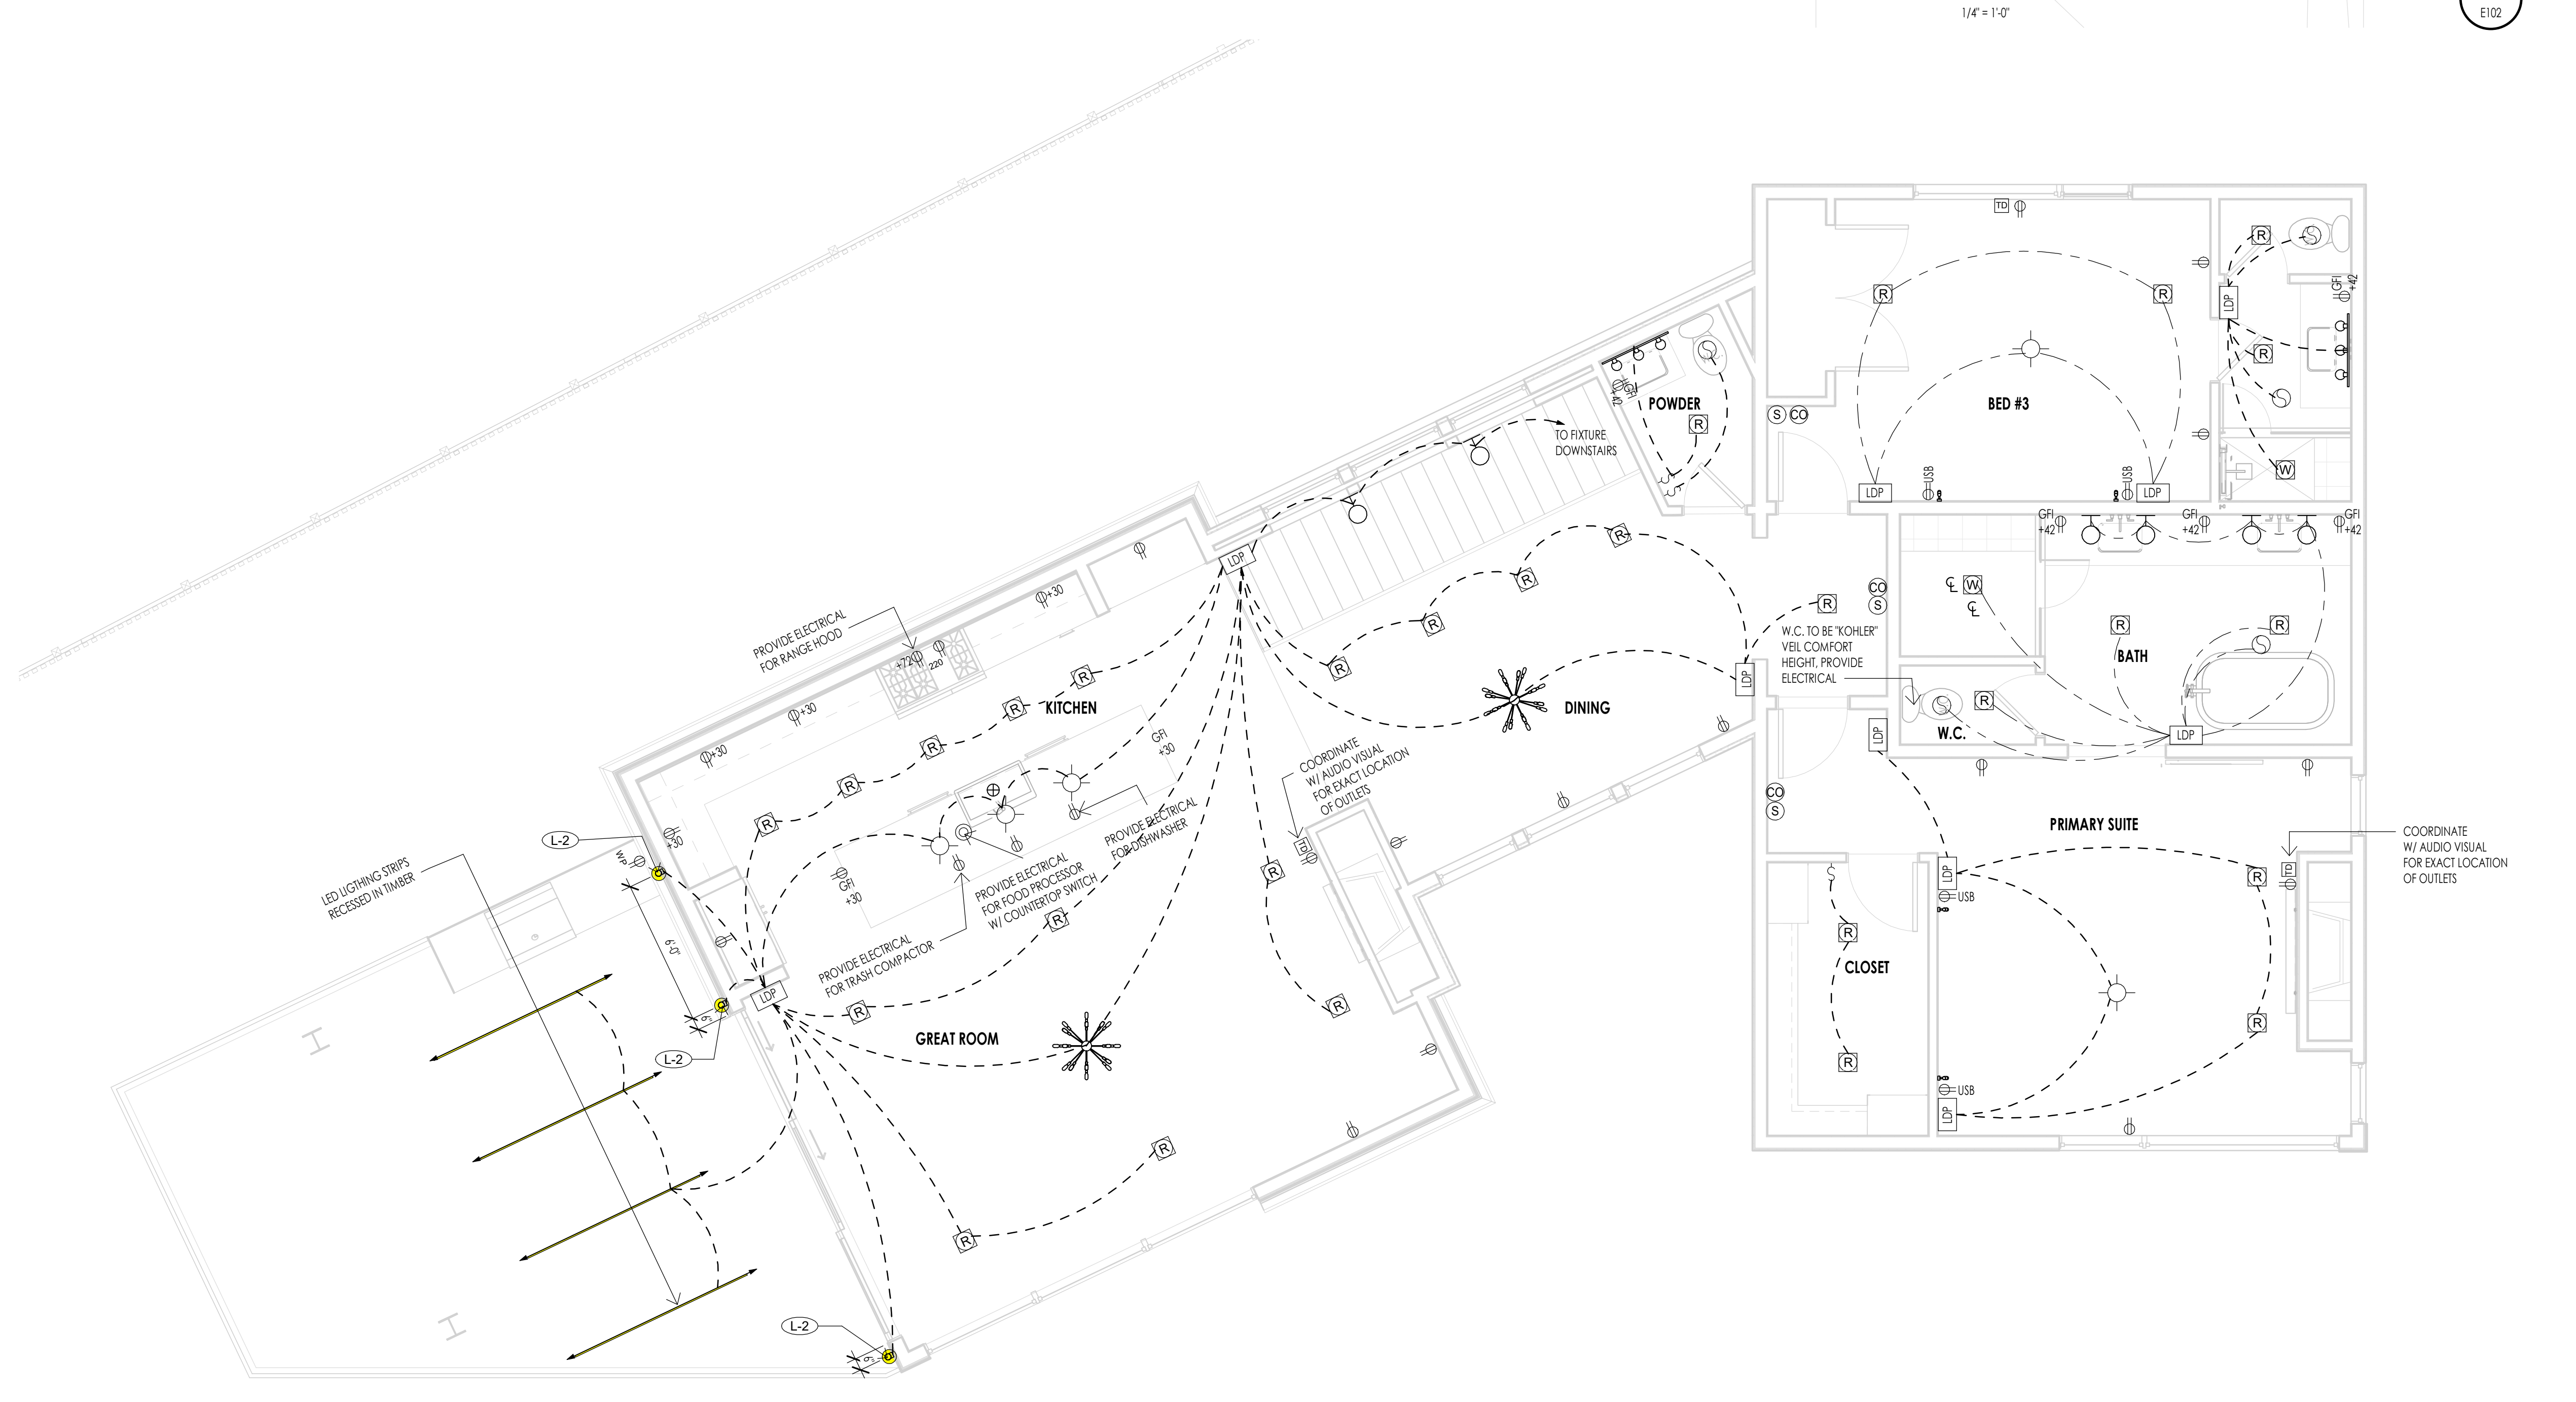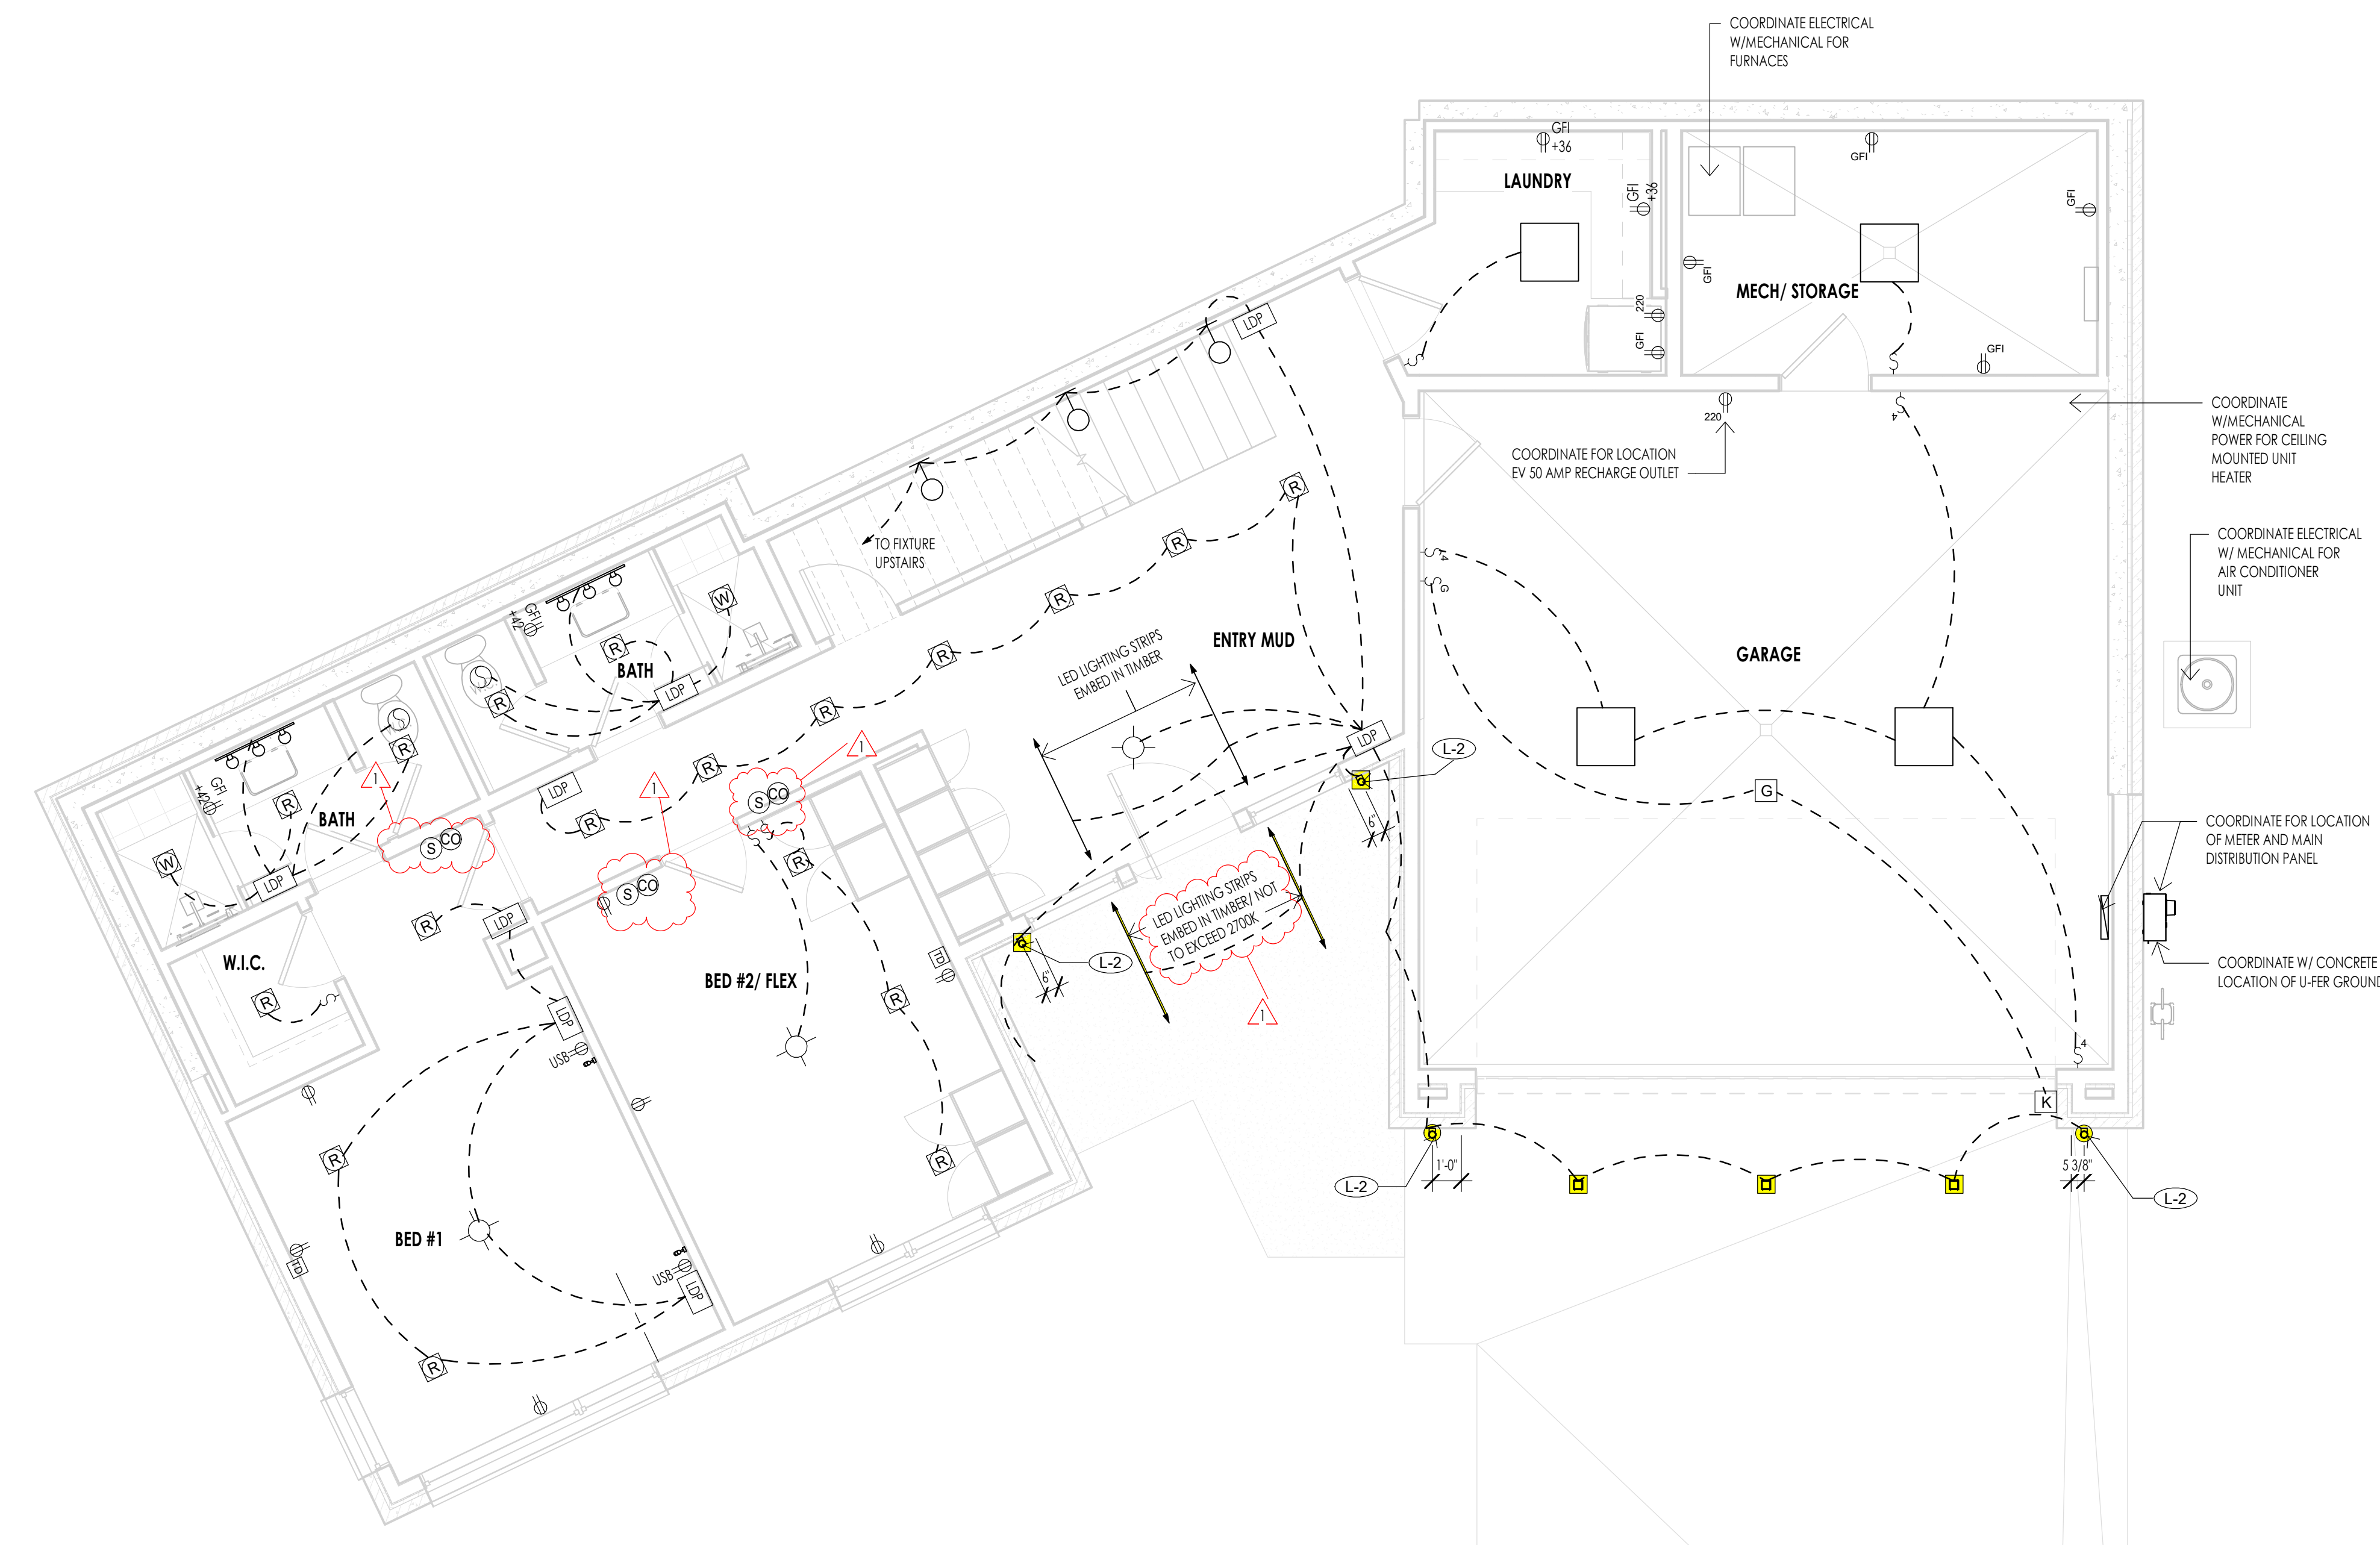

WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340


PROJECT NO. 22023
DATE: 2023.06.30

REVISIONS:
1 04-27-2023 PER CITY COMMENTS


SHEET TITLE:
ELECTRICAL PLANS

SHEET NUMBER:
E102

© 2021 THINK ARCHITECTURE, INC.

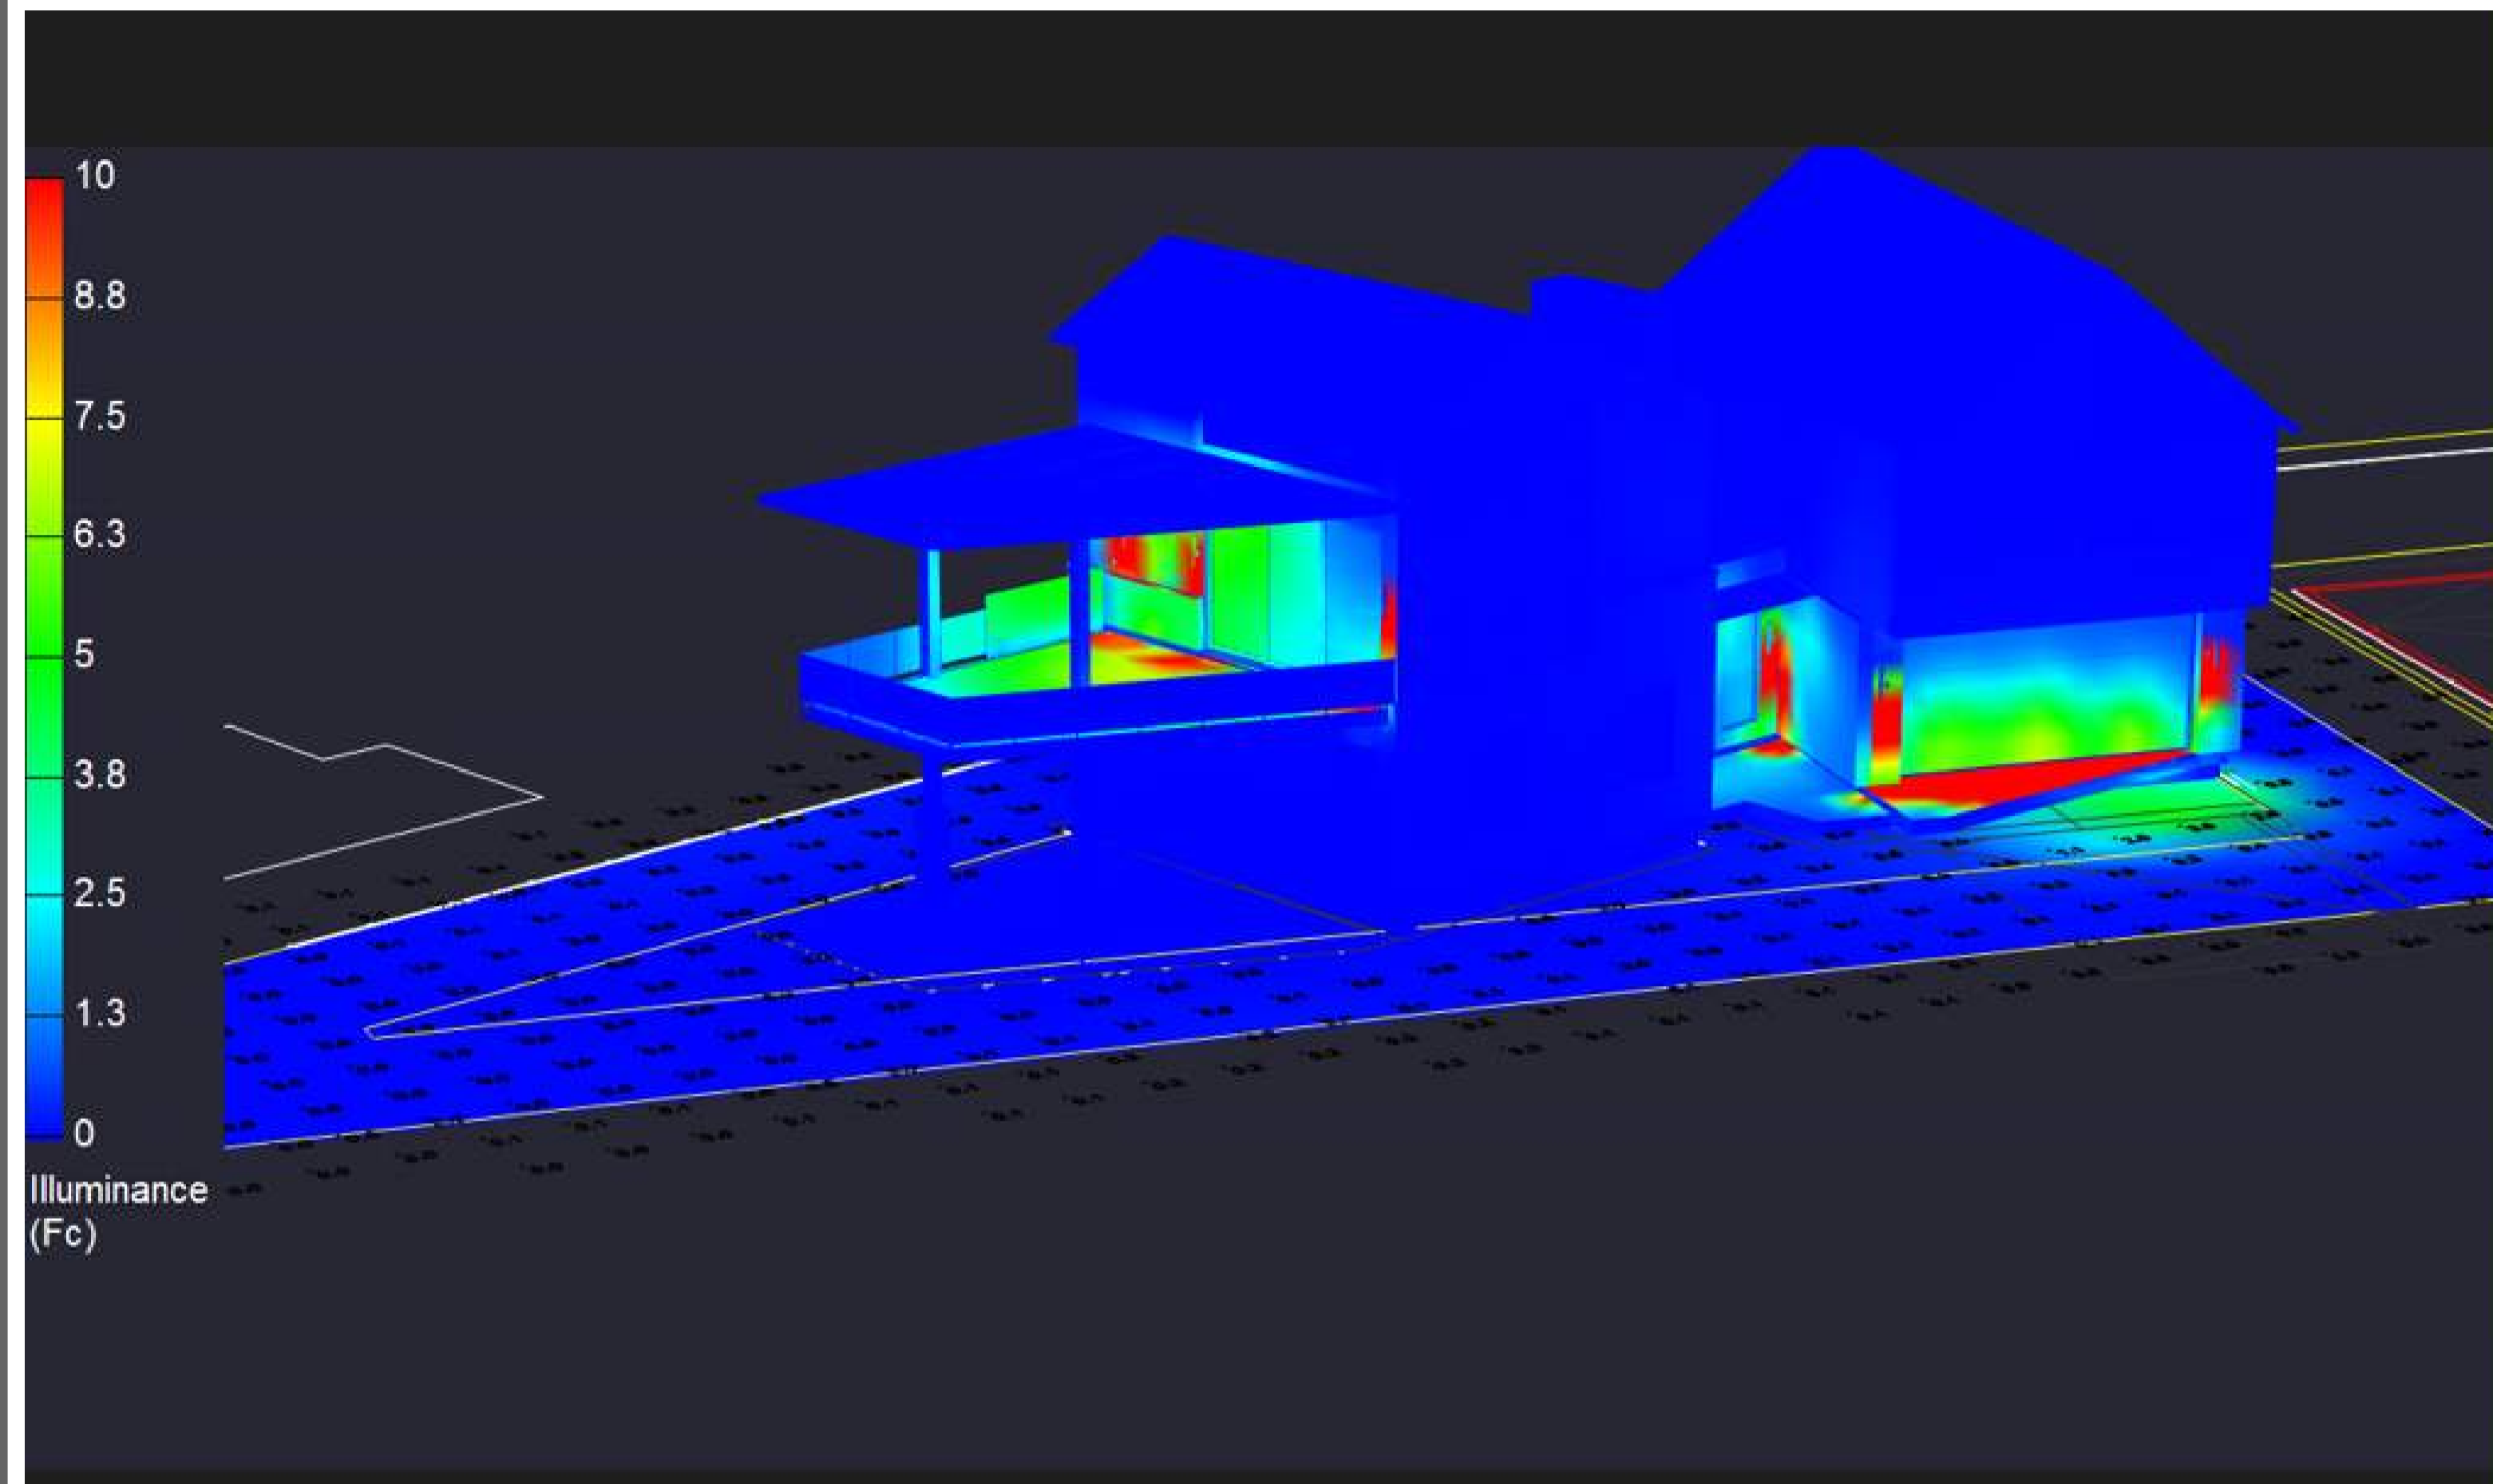


PSEUDO RENDERING WITH ILLUMINANCE SCALE

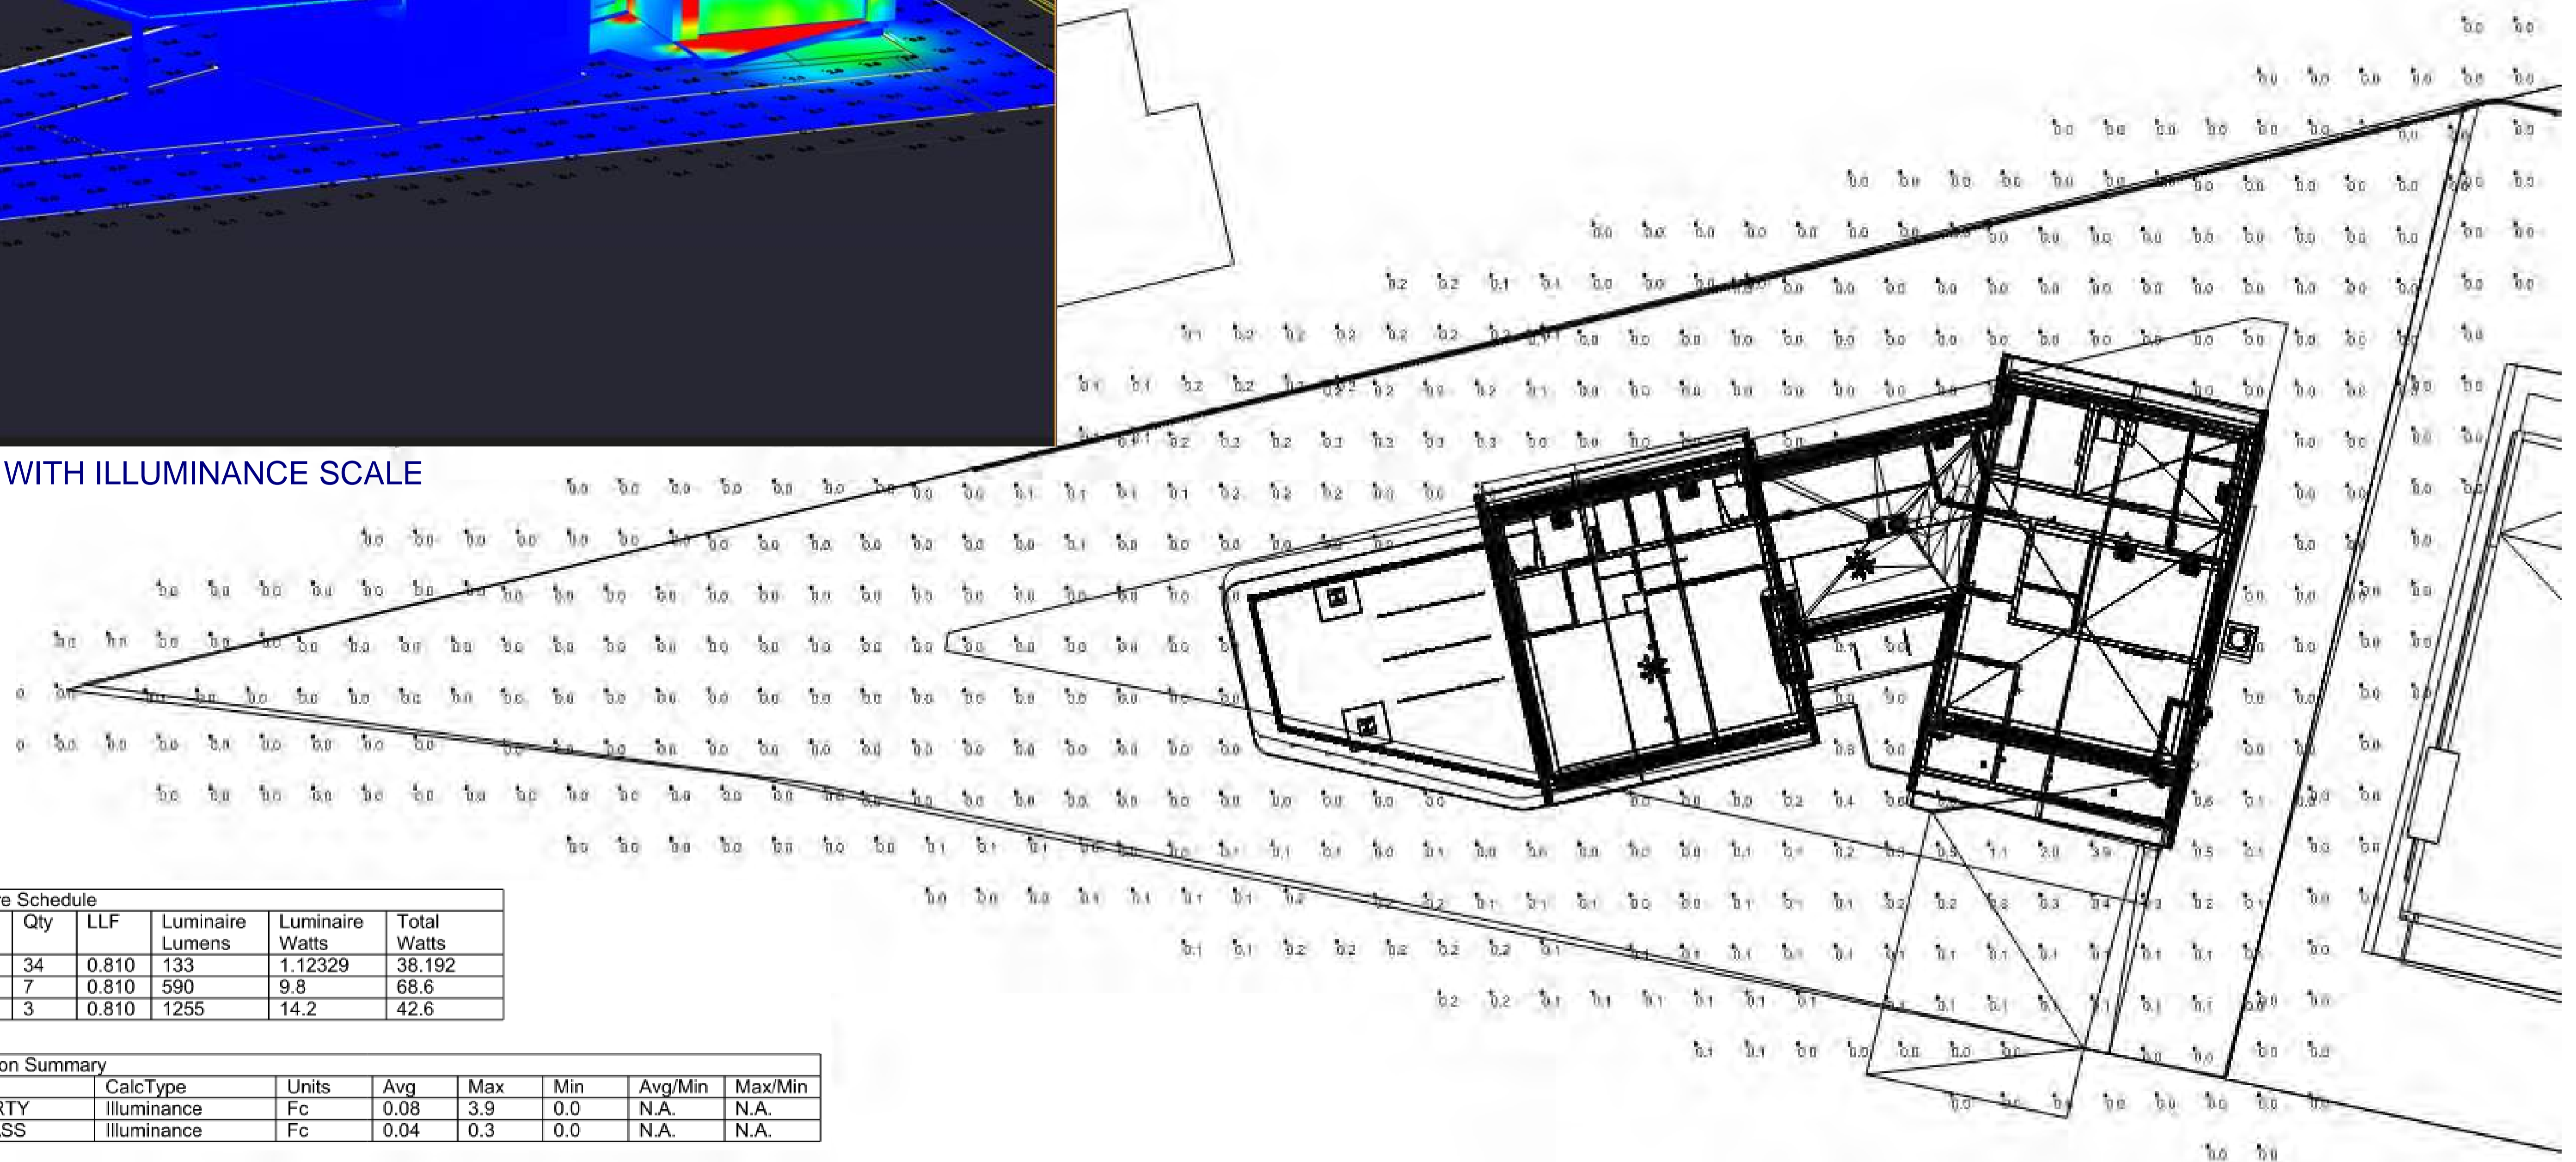


Luminaire Schedule					
Tag	Qty	LLF	Luminaire Lumens	Luminaire Watts	Total Watts
LED	34	0.810	133	1.12329	38.192
L2	7	0.810	590	9.8	68.6
L1	3	0.810	1255	14.2	42.6

Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	
PROPERTY	Illuminance	Fc	0.08	3.9	0.0	N.A.	N.A.	
TRESPASS	Illuminance	Fc	0.04	0.3	0.0	N.A.	N.A.	

POINT-BY-POINT CALCULATION AND SUMMARIES
(5 FOOT GRID)

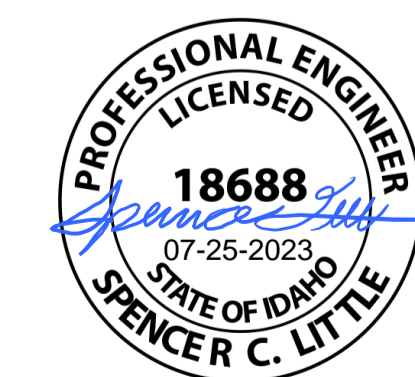


WARM SPRING RESIDENCES
 KETCHUM, ID

 LOT 35 CALCULATIONS AND
 RENDERINGS
SPECTRUM
 ENGINEERS



EXPOSED TIMBER AND STEEL
FRAMED DECKING

METAL SIDING

WOOD
SIDING

ALUMINUM
GARAGE
DOOR

STONE
VENEER




THINSET MASONRY:

ELDORADO STONE:
TIGHT DRY STACKED STONE
BLACK RIVER



VERTICAL SHIP LAP CEDAR SIDING:

PRESTAINED CEDAR SIDING

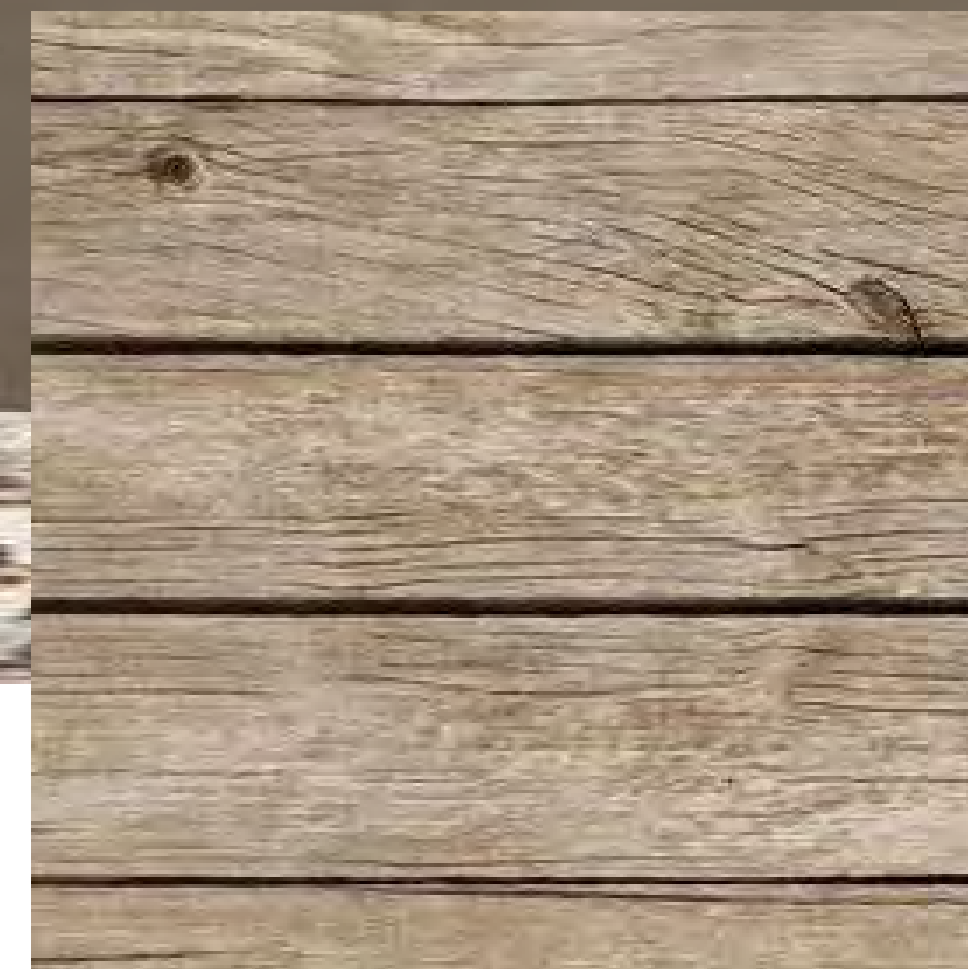

TIMBER COLUMNS, RAFTERS, TRIM:

RECLAIMED DOUGLAS FIR




METAL SIDING AND TRIM:

STEEL TRIM
COLOR: AGED STEEL, LIGHT RUST FINISH




WINDOWS:

ALUMINUM CLAD WOOD WINDOWS
COLOR: DARK BRONZE

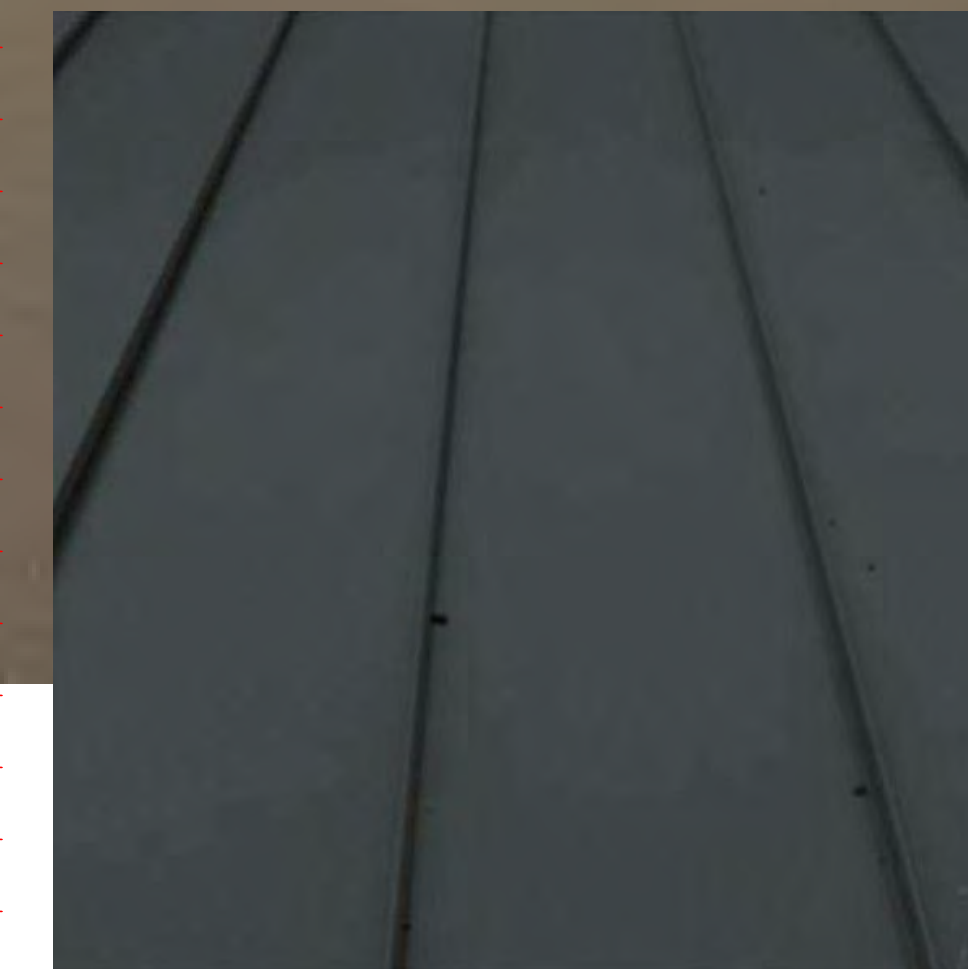

METAL ROOFING:

STANDING SEAM METAL ROOF
BONDENURED ZINC NATURAL PATINA

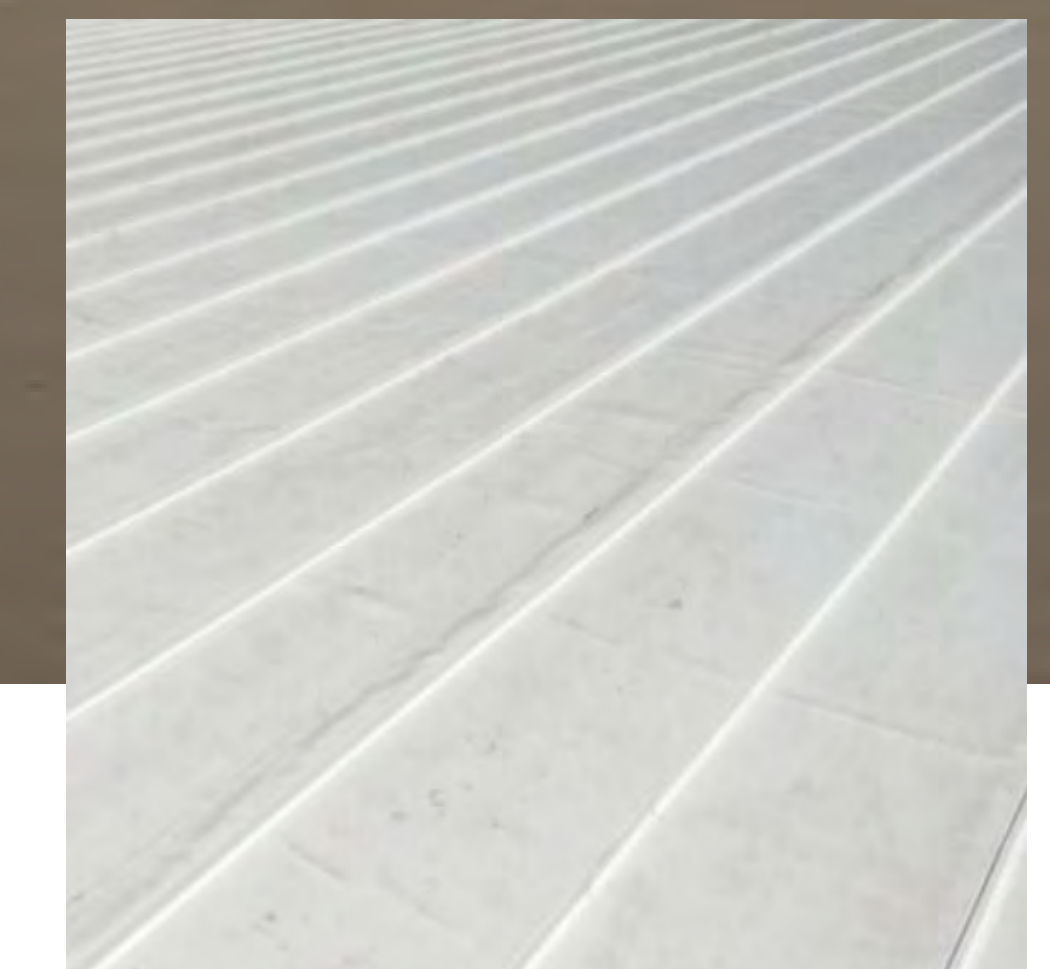

ROOF:

SINGLE PLY ROOFING MEMBRANE



WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340



WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340



WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340



WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340



WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340



WARM SPRINGS RESIDENCE #35

190 BALD MOUNTAIN ROAD
KETCHUM, IDAHO 83340

